

**FLOOD INUNDATION &
RISK ASSESSMENT REPORT
PROPOSED NEW RESIDENCE
12B JOHN ST
AVALON**

**Job No 181005
Nov 2023
Prepared by
Lucas Molloy
BE CPEng NER**

INTRODUCTION

This report has been prepared in support of the proposed Development Application for a new residence at No 12B John St Avalon in respect to potential flood inundation / impacts and Northern Beaches Councils Water Management for Development Policy Section 10.0 Flood Risk Management and the Pittwater 21 DCP Section B3.11 Flood Prone Land.

It is proposed to construct a new residence as detailed in the architectural plans by *THW Architects* refer Appendix A.


Barrenjoey Consulting Engineers p/l inspected the site on 30th Sept 2019 / 22nd Nov 2023.

The extent of flooding is as summarized in the "Flood Information Request" data as supplied by Northern Beaches Council, refer Appendix D.

The Flood Planning Level varies across the site and at worst case is 3.05m AHD.

For the 1% AEP event the site is classified -

Flood Hazard	varies across site H1 – H5
Flood Hydraulic Category	Fringe + storage
Flood Risk Precinct	varies across site Low / Medium / High
Land Use Group	Residential – Dwelling House

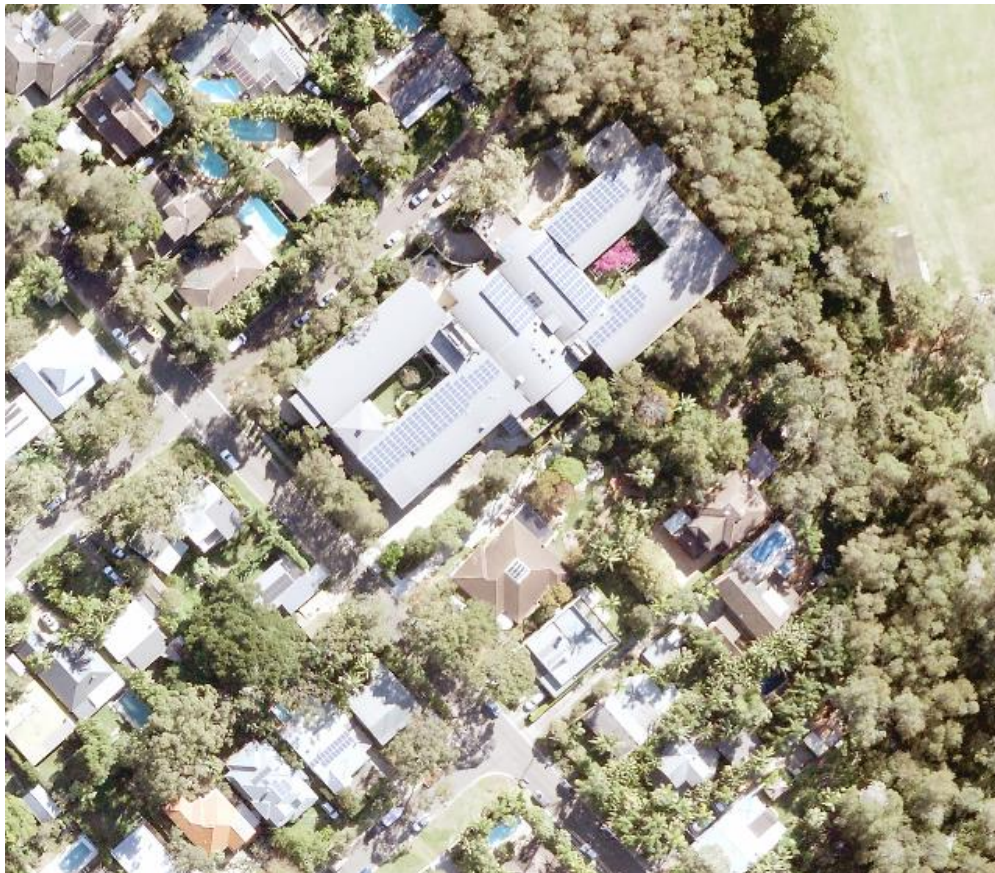

Aerial Image of No 12A / 12B John St Avalon
(Northern Beaches Council web site)

Pittwater 21 Development Control Plan - 2014

B3.11 Flood Prone Land

1.2 Prescriptive Controls

A. FLOOD EFFECTS CAUSED BY DEVELOPMENT

A1	Jetty na to this development
A2	na
A3	The applicant shall include in their submission, calculations to illustrate that any fill or other structures that reduce the total flood storage are replaced by Compensatory Works. No fill / structures proposed within flood storage areas
A4	na

B. DRAINAGE INFRASTRUCTURE AND CREEK WORKS

B1	Flood mitigation works or stormwater devices that modify a major drainage system, stormwater system, natural water course, floodway or flood behaviour within or outside the development site may be permitted subject to demonstration through a Flood Management Report that they comply with the Flood Prone Land Design Standard found on Council's webpage. No flood mitigation works are proposed.
B2	A Section 88B notation under the Conveyancing Act 1919 may be required to be placed on the title describing the location and type of flood mitigation works with a requirement for their retention and maintenance. No flood mitigation works are proposed.

C. BUILDING COMPONENTS AND STRUCTURAL SOUNDNESS

C1	All buildings shall be designed and constructed as flood compatible buildings in accordance with Reducing Vulnerability of Buildings to Flood Damage: Guidance on Building in Flood Prone Areas, Hawkesbury-Nepean Floodplain Management Steering Committee (2006). Achievable using conventional building practices.
C2	All structures must be designed and constructed to ensure structural integrity up to the Flood Planning Level, taking into account the forces of floodwater, wave action, flowing water with debris, buoyancy and immersion. Structural certification shall be provided confirming the above. Where shelter-in-place refuge is to be provided the structural integrity is to be to the Probable Maximum Flood level. Achievable using conventional building and engineering practices.
C3	All new electrical equipment, power points, wiring, fuel lines, sewerage systems or any other service pipes and connections must be waterproofed and/or located above the Flood Planning Level. All existing electrical equipment and power points located below the Flood Planning Level must have residual current devices installed that turn off all electricity supply to the property when flood waters are detected. Achievable using conventional building practices.

D. STORAGE OF GOODS

D1	Hazardous or potentially polluting materials shall not be stored below the Flood Planning Level unless adequately protected from floodwaters in accordance with industry standards. Achievable using conventional building practices
D2	Goods, materials or other products which may be highly susceptible to water damage are to be located/stored above the Flood Planning Level. Achievable using conventional building practices

E. FLOOD EMERGENCY RESPONSE

E1	Development shall comply with Council's Flood Emergency Response Planning for Development in Pittwater Policy and the outcomes of any Flood Risk Emergency Assessment Report where it applies to the land. Achievable by adhering to this report.
E2	New development must provide an appropriately sized area to safely shelter in place above the Probable Maximum Flood level and appropriate access to this area should be available from all areas within the development. Evacuation of the site is readily available via flood free access driveway
E3	na
E4	na

F. FLOOR LEVELS

F1	New floor levels within the development shall be at or above, the Flood Planning Level. A reduced Flood Planning Level may be considered only where it is permitted in this Development Control Plan. The structure must be flood proofed (wet or dry) to the Flood Planning Level. This control cannot be applied to critical or vulnerable uses. The ground floor FFL 3.05m AHD is at the FPL level 3.05m AHD
F2	All development structures must be designed and constructed so as not to impede the floodway or flood conveyance on the site, as well as ensuring no loss of flood storage in a 1% AEP Event. The building is sited/elevated as not to effect the floodway or flood conveyance on the site Where the dwelling is located over a flow path it must be elevated on suspended pier/pile footings such that the level of the underside of all floors including balconies and decks within the flood affected area are at or above, or raised to the Flood Planning Level to allow clear passage of the floodwaters under the building. The development must comply with the Flood Prone Land Design Standard. The dwelling is not located over a flowpath
F3	Where the lowest floor has been elevated to allow the passage of flood waters, a restriction shall be imposed on the title of the land, pursuant to S88B of the Conveyancing Act confirming that the undercroft area is not to be enclosed. To be conditioned within DA approval
F4	A one- off addition or alteration below the Flood Planning Level of less than 30 square metres or an increase of less than 10% of the ground floor area (whichever is the lesser) for residential development may be considered only where: (a) it is an extension to an existing room (b) the Flood Planning Level is incompatible with the floor levels of the existing room This control will not be permitted if this provision has previously been utilised since the

	making of this Plan. The structure must be flood proofed to the Flood Planning Level. na to this development
F5	na
F6	Any existing floor level may be retained below the Flood Planning Level when undertaking a first floor addition provided that: (a) it is not located within a floodway; (b) there is no increase to the building footprint below the Flood Planning Level; (c) it is flood proofed to the Flood Planning Level; na to this development
F7	na
F8	The minimum floor level of any first floor additions shall be at or above the Probable Maximum Flood Level na to this development
F9	Foyers – consideration may be given to a minimum floor level of a foyer being set at the 5% AEP flood level, provided it can be demonstrated that it complies with the Flood Prone Land Design Standard. na to this development
F10	na
F11	na

G. CAR PARKING

G1	Open carpark areas and carports shall not be located within a floodway. No open carpark areas and carports are located within a floodway
G2	The lowest floor level of open carparks and carports (unroofed or with open sides) shall be constructed no lower than the natural ground levels. na to this development
G3	All enclosed car parks must be protected from inundation up to the relevant flood planning level. For example, basement carparks must be provided with a crest at the entrance, the crest of which is at the relevant Flood Planning Level. All access, ventilation and any other potential water entry points to any enclosed car parking shall be above the relevant Flood Planning Level. Council will not accept any options that rely on electrical, mechanical or manual exclusion of the floodwaters from entering the enclosed carpark na to this development
G4	na
G5	Enclosed Garages must be located at or above the 1% AEP level The Proposed garage is located at the 1% AEP level 2.55m AHD
G6	Carports must comply with the Flood Prone Land Design Standard na to this development
G7	Where a driveway is required to be raised it must be demonstrated that there is no loss to flood storage in the 1% AEP flood event and no impact on flood conveyance through the site na to this development
G8	Multi Dwelling Housing and Shop Top Housing residential carparking – consideration may be given to a minimum floor level for open or covered carparking being set at the 5% AEP flood level, provided it can be demonstrated that it complies with the Flood Prone Land Design Standard na to this development

G9	na
G10	na

H. FENCING

H1	Fencing, including pool fencing, shall be designed so as not to impede the flow of flood waters and not to increase flood affectation on surrounding land. Appropriate fencing must comply with the Flood Prone Land Design Standard in addition to other regulatory requirements of pool fencing. Achievable using conventional building practices
----	---

I. POOLS

I1	Pools located within the 1% AEP flood extent are to be in-ground, with coping flush with natural ground level. Where it is not possible to have pool coping flush with natural ground level, it must be demonstrated that the development will result in no net loss of flood storage and no impact on flood conveyance on or from the site. All electrical equipment associated with the pool (including pool pumps) is to be All chemicals associated with the pool are to be stored at or above the flood planning level. na to this development
----	--

FLOOD RISK ASSESSMENT

A flood risk assessment was carried out for the 1% AEP and PMF event adopting the following

- Likelihood of the hazard occurring
 - Almost Certain 1:10
 - Likely 1:100
 - Possible 1:1000
 - Unlikely 1:10000
 - Rare 1:100000
- Consequence of the hazard to persons and property
 - Insignificant no injury / \$ 0 - low
 - Minor first aid injury / \$ low - medium
 - Moderate medical treatment required / \$ medium – high
 - Major serious injuries / \$ major
 - Catastrophic death / \$ major ++

	Insignificant	Minor	Moderate	Major	Catastrophic
Almost Certain					
Likely (1%)					
Possible					
Unlikely (PMF)					
Rare					

Legend

Low - acceptable
Moderate – tolerable
Sever – unacceptable

1 Risk to persons 'shelter in place' provisions as per the *Flood Risk Management Report* specified / ensured, therefore risk assessment -

1% event – minor injuries possible therefore moderate / tolerable risk assessment

PMF event – minor injuries possible therefore low / acceptable risk assessment

2 Risk to structures adequate structural capacity to resist the flood forces (water and debris) as per the *Flood Risk Management Report* specified / ensured, therefore risk assessment -

1% event – insignificant therefore low / acceptable risk assessment

PMF event – minor damage to structures therefore low / risk assessment

2 Risk to vehicles vehicles protected from flood exposure, therefore risk assessment -

1% event – insignificant therefore low / acceptable risk assessment

PMF event – moderate damage therefore low / acceptable risk assessment

3 Risk to services protection of services from flood exposure as per the *Flood Risk Management Report* specified / ensured, therefore risk assessment -

1% event – insignificant therefore low / acceptable risk assessment

PMF event – minor damage therefore low / acceptable risk assessment

SUMMARY

Assessment of Impacts Compliance Table

	Not Applicable	Compliance	
		Yes	No
A Flood effects caused by Development	X	-	-
B Drainage Infrastructure & Creek Works	X	-	-
C Building Components & Structural	-	X	-
D Storage of Goods	-	X	-
E Flood Emergency Response	-	X	-
F Floor Levels	-	X	-
G Car Parking	-	X	-
H Fencing	-	X	-
I Pools	X	-	-

The proposed works if carried out in accordance with recommendations within this *Flood Inundation & Risk Assessment Report* by Barrenjoey Consulting dated Nov 2023 will satisfy the intent of Northern Beaches Councils Water Management for Development Policy Section 10.0 Flood Risk Management and the Pittwater 21 DCP Section B3.11 Flood Prone Land. Noting the following measures are to be implemented into the works –

- **All occupants are to be informed of the sites flooding potential / impact and available warning services (ie : Councils *Floodwatch*, SES services etc).**
- **All occupants are to be informed of the sites flooding potential / impact and the residences 'shelter in place' capacity.**
- **All structures must be designed and constructed to ensure structural integrity up to the Flood Planning Level**
- **All occupants are to be informed of the sites flooding potential and requirements for goods / valuables storage etc.**

It is to be noted that, due to the many complex factors that can affect a site, the subjective nature of a risk analysis, and the imprecise nature of the science of flood analysis, the risk of persons being injured, to life and property cannot be completely removed. The recommendations within this Report do not remove the risk associated with the predicted flooding event, though lower those risks to an acceptable level reasonably anticipated by the community in everyday life.

Regards
BARRENJOEY CONSULTING ENGINEERS Pty Ltd



Per
Lucas Molloy (Director)
BE CPEng NER

Appendix A
Architectural plans
THW Architects

12B JOHN STREET
AVALON, NSW, 2107

SHEET LIST:

- | | |
|------------------------|-------------------------|
| 00 - COVER PAGE | 20 - SECTIONS |
| 01 - SITE PLAN | 21 - SECTIONS |
| 02 - GROUND FLOOR PLAN | 100 - SITE ANALYSIS |
| 03 - FIRST FLOOR PLAN | 101 - ANALYSIS SECTIONS |
| 10 - ELEVATIONS | 102 - CUT & FILL |
| 11 - ELEVATIONS | 103 - SHADOW PLANS |
| 12 - ELEVATIONS | 104 - SHADOW 3D'S |
| 13 - ELEVATIONS | 105 - COLOUR & FINISHES |
| 14 - ELEVATIONS | 106 - 3D'S |



NAME	SEX	HEIGHT	WEIGHT
W001	0	1200	2400
W002	0	1200	1800
W003	0	1200	2400
W004	0	1400	600
W005	0	1800	3500
W006	0	2400	600
W007	0	3100	6400
W008	0	3100	2050
W009	0	2400	600
W010	0	600	600
W011	0	2400	600
W012	0	2800	5200
W013	0	2800	3000
W014	0	2400	500
W015	430	2000	500
W016	430	2000	500
W017	1300	600	1500
W018	300	2100	900
W019	1300	600	1800
W020	0	2500	900
W021	0	2500	5000
W022	900	7100	2550
W023	0	2600	900

ARCHITECTS' WORK IS COPYRIGHTED AND COVERED BY COPYRIGHT ACT THAT
 PROHIBITS NOT TO BE SCANNED ITS SOURCE INFORMATION (TEXT, IMAGE, AND)



reg# NSW 7417 - TIM WEST
ph. 02 9918 5085
e. tim@tthw.net.au
m. Suite 101 - Level 1, 60 Old Barmenjoey rd, Avalon NSW, 2107

SURVEY
BEE & (ETHERIDGE PT) LTD
SUITE 2, 14 STARVY ST, FORESTVILLE, NSW, 2087
P. 9975 3535
E. SURVEY@BEEETH.COM.AU
W. BEEETH.COM.AU

STORMWATER / FLOOD
BARRELIORY CONSULTING ENGINEERS
34 GEORGE ST, AVALON, NSW, 2107
LUCAS@CBFOND.COM
0418 x30 330

PLANNER	VAUGHAN MELJON DEVELOPMENT CONSULTING VAUGHAN MELJON 8/1 KALINJA ST, NEWPORT, NSW, 2106 9999 4922
BASIX / NATHERS	SUSTAINABLE THERMAL SOLUTIONS 138 COWLES RD, WILMAMAN, NSW, 2098 ENQUIRY@SUSTAINABLETHERMAL SOLUTIONS.COM.AU 0420 312 721


LANDSCAPE
A TOTAL CONCEPT
45 WEST ST, NORTH SYDNEY, NSW, 2060
DESIGN@ATOTALCONCEPT.COM.AU
9957 8122

BIODIVERSITY / COASTAL
ECOLOGICAL CONSULTANTS AUSTRALIA
ECOLOGICALCA@OUTLOOK.COM
9718 4486

PROJECT PROPOSED DWELLING 128 JOHN ST., AVALON, NEW, 2107	
CLIENT TIM DONOVAN TDONOVAN@CITYFREEHOLDS.COM.AU	

K	7/06/2023	DA REVISED
C	16/10/2019	DA
B	30/09/2019	PRELIMINARY DA
A	13/09/2019	CONSULTANTS SET
IF	DATE	COMMENTS

JOB NUMBER 142B	DRAWN BY MV	CHK. BY TW	PAGE SIZE A3
PROJECT NAME 12B JOHN ST			SCALE 1 : 100
DRAWING NAME COVER PAGE			DRAWING NUMBER A 00 -K

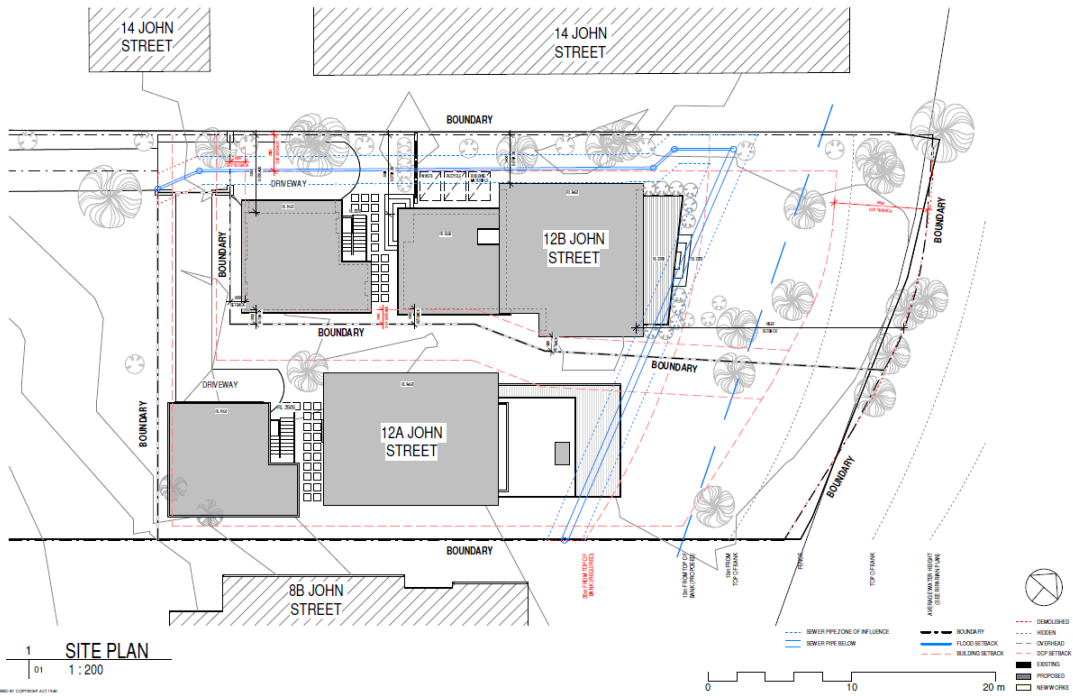

ARCHITECTS WORK IS COPYRIGHT AND COVERED BY COPYRIGHT ACT 1948



reg# NSW 7417 - TIM WEST
ph. 02 9918 5085
e. tim@thw.net.au
m. Suite 101 - Level 1, 60 Old Barrerjoey rd, Avalon NSW, 2107

SURVEY
BEE & LETHERIDGE PTY LTD
SUITE 2, 14 STARKEY ST, FORESTVILLE, NSW, 2087
P. 9175 3530
E. SURVEY@BEELETH.COM.AU
W. BEELETH.COM.AU

STORMWATER / FLOOD
BARRENJOBY CONSULTING ENGINEERS
34 GEORGE ST, AVALON, NSW, 2107
LUCASCEB@BOPOND.COM
0418 430 330

PLANNER	VAUGHAN MELLIGAN DEVELOPMENT CONSULTING VAUGHAN MELLIGAN 8/1 KALNYIA ST. NEWPORT, NSW, 2106 9999 4922
BASIX / NATHERS	SUSTAINABLE THERMAL SOLUTIONS 136 COWLEY RD. MOSMAN, NSW, 2088 ENQUIRE@SUSTAINABLETHERMALSOLUTIONS.COM.AU 0430 312 721



LANDSCAPE
A TOTAL CONCEPT
45 WEST ST, NORTH SYDNEY, NSW, 2060
DESIGN@ATOTALCONCEPT.COM.AU
9957 5122



BIODIVERSITY / COASTAL
ECOLOGICAL CONSULTANTS AUSTRALIA
ECOLOGICALCA@OUTLOOK.COM
9918 4485



PROJECT PROPOSED DWELLING 128 JOHN ST, AVALON, NSW, 2107	CLIENT TIM DONOVAN TDONOVAN@CITYFREEHOLD. COM.AU
---	---



K	17/05/2023	DA REVIEWED
J	28/03/2023	DA
I	22/03/2023	DA
H	23/10/2022	DA
C	16/10/2019	DA
B	30/09/2019	PRELIMINARY DA
A	13/09/2019	CONSULTANTS SET


JOB NUMB 142B	DRAWN BY MV	CHK. BY TW	PAGE SIZE A3
PROJECT NAME 12B JOHN ST			SCALE As indicated
DRAWING NAME SITE PLAN			DRAWING NUMBER A 01 -K

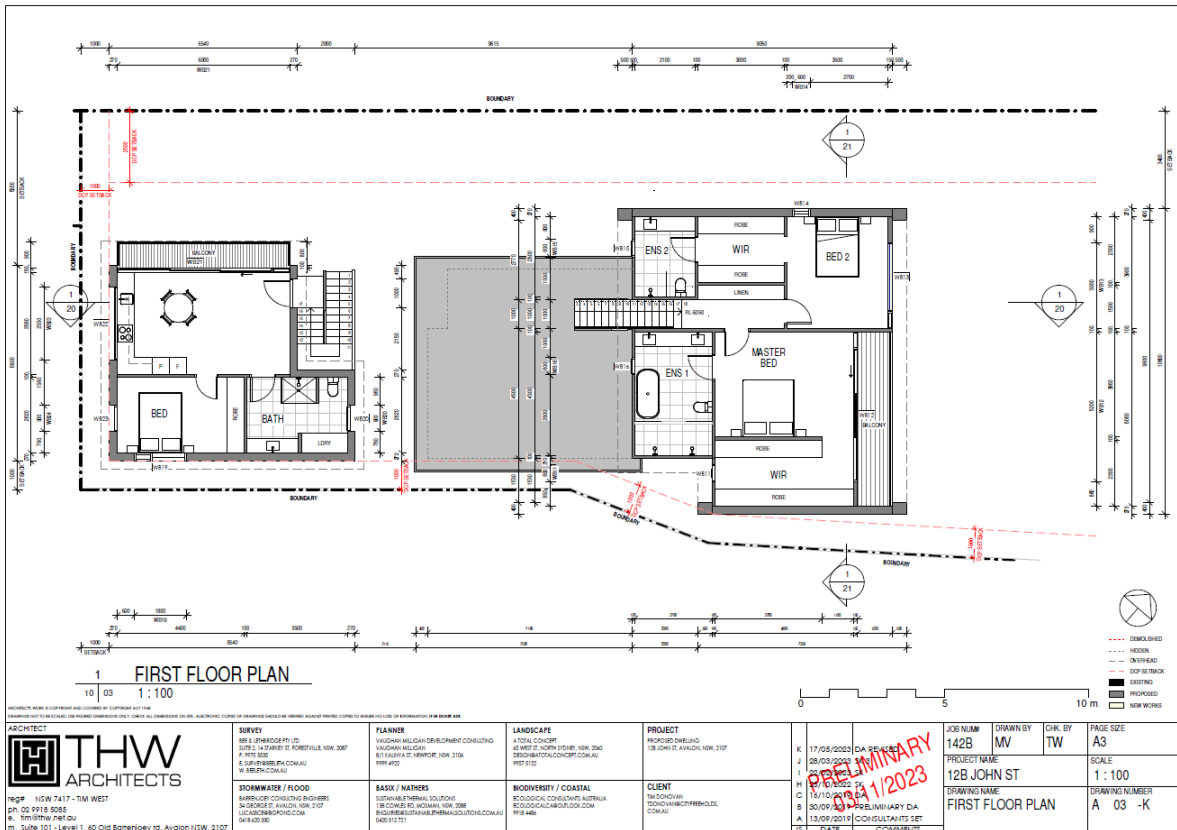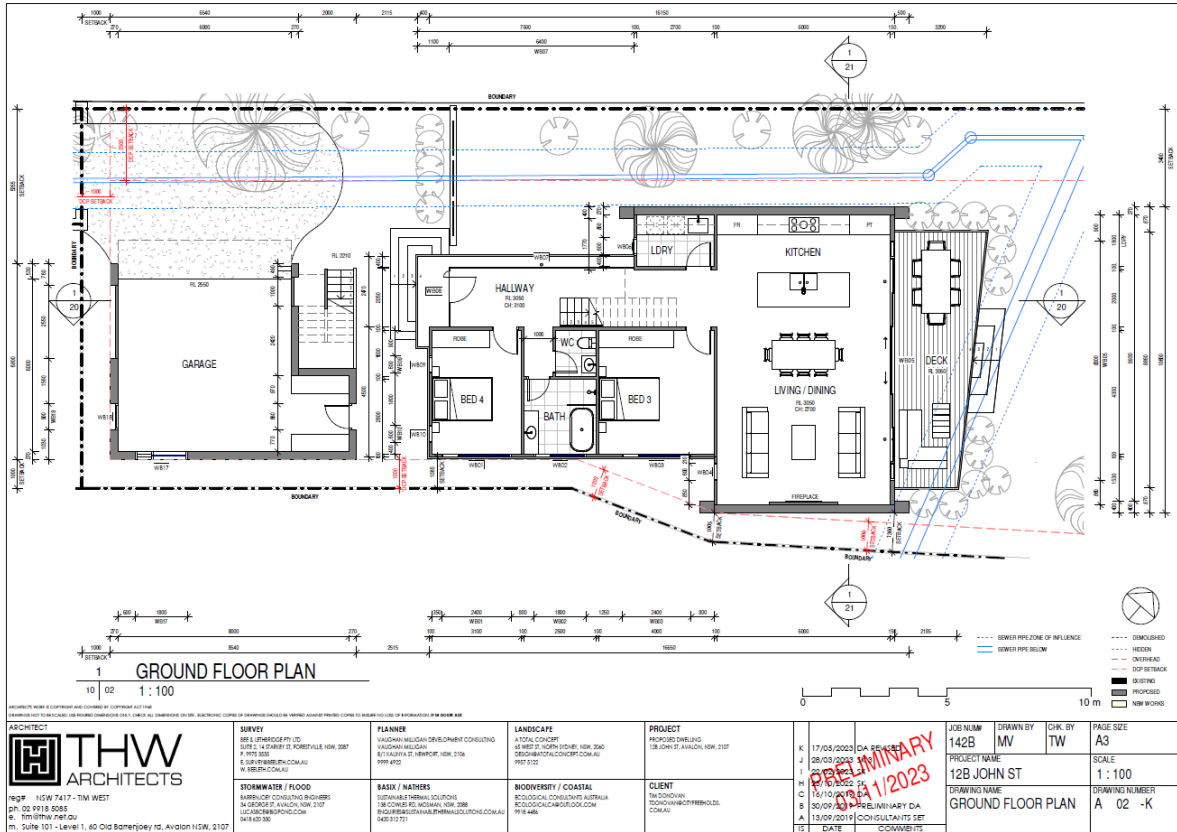

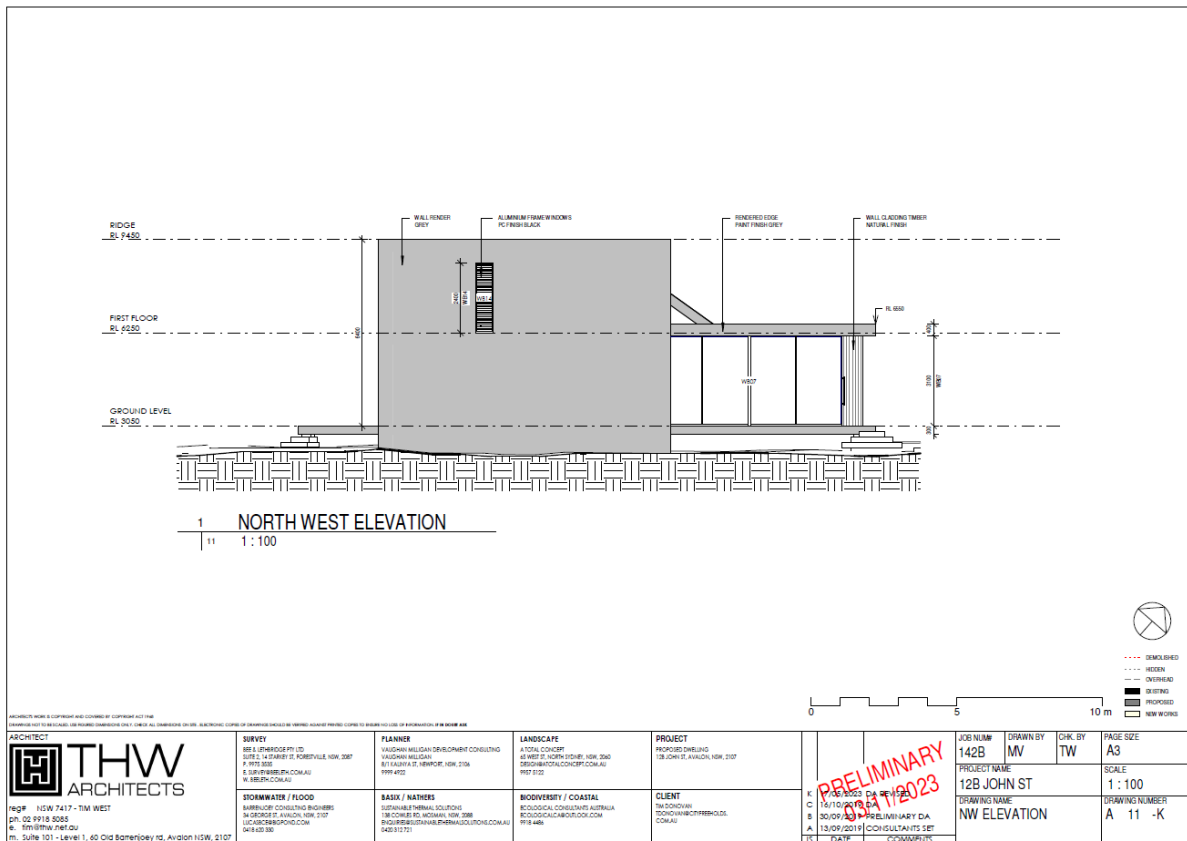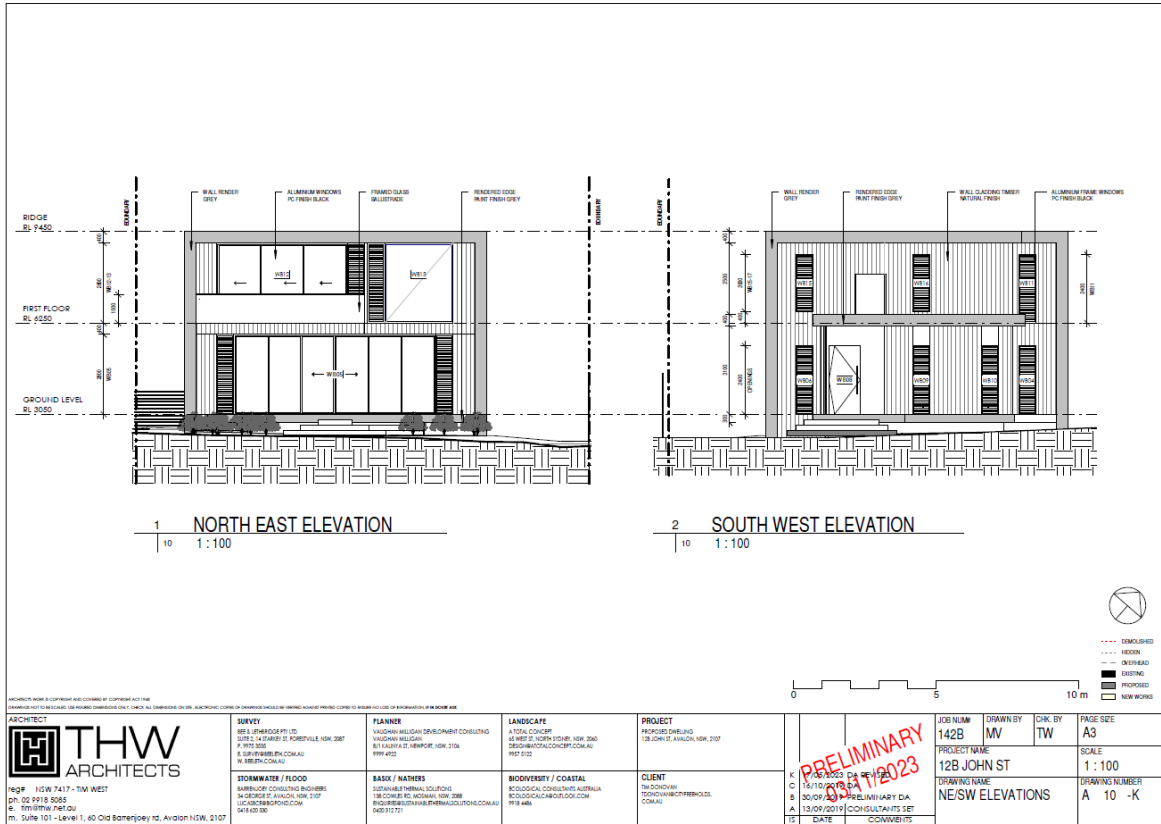


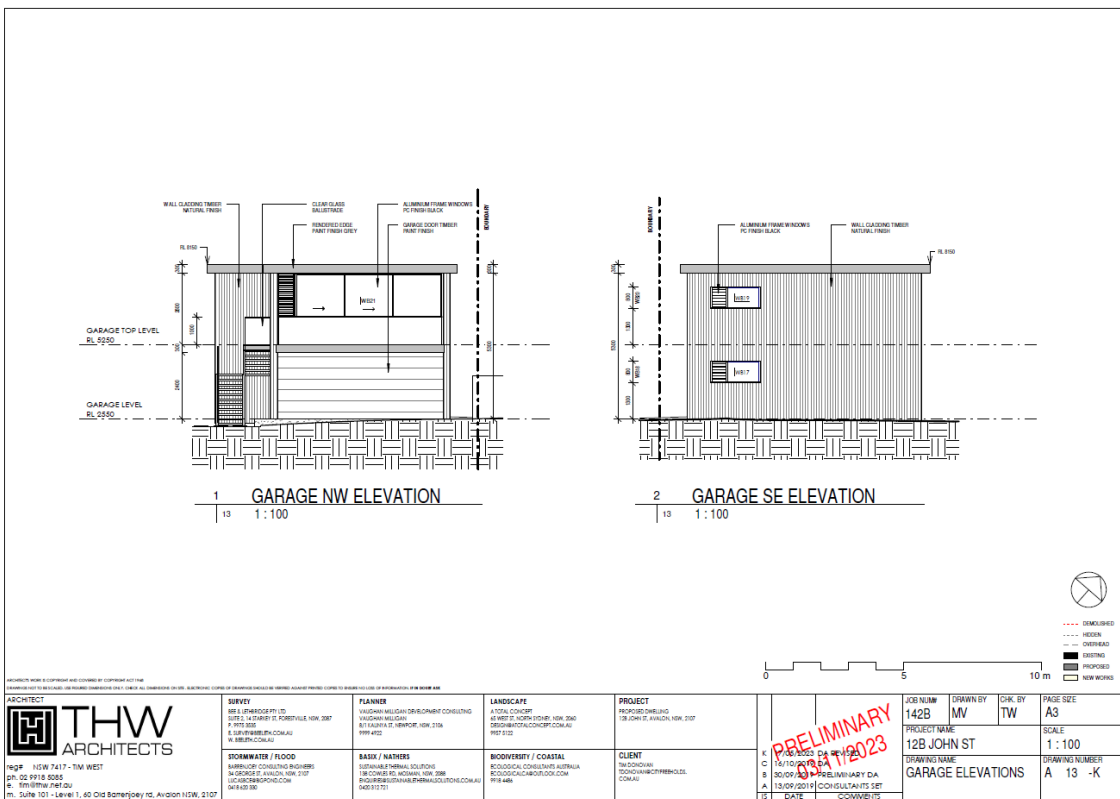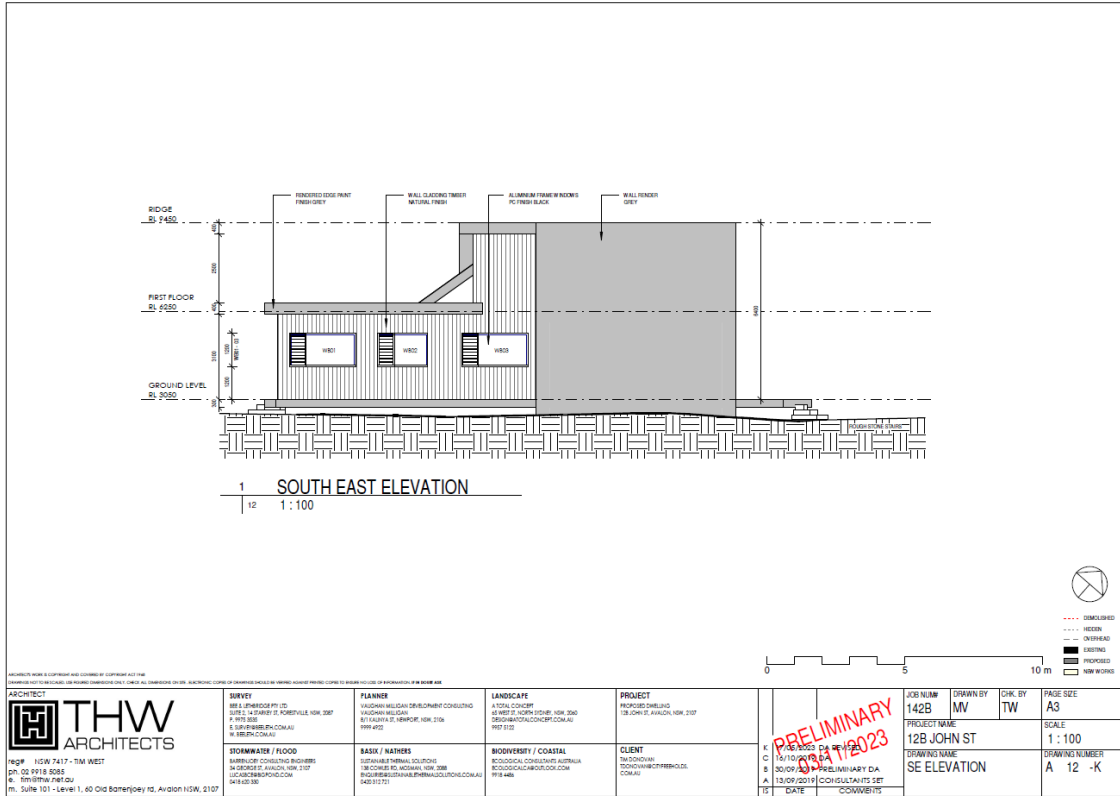

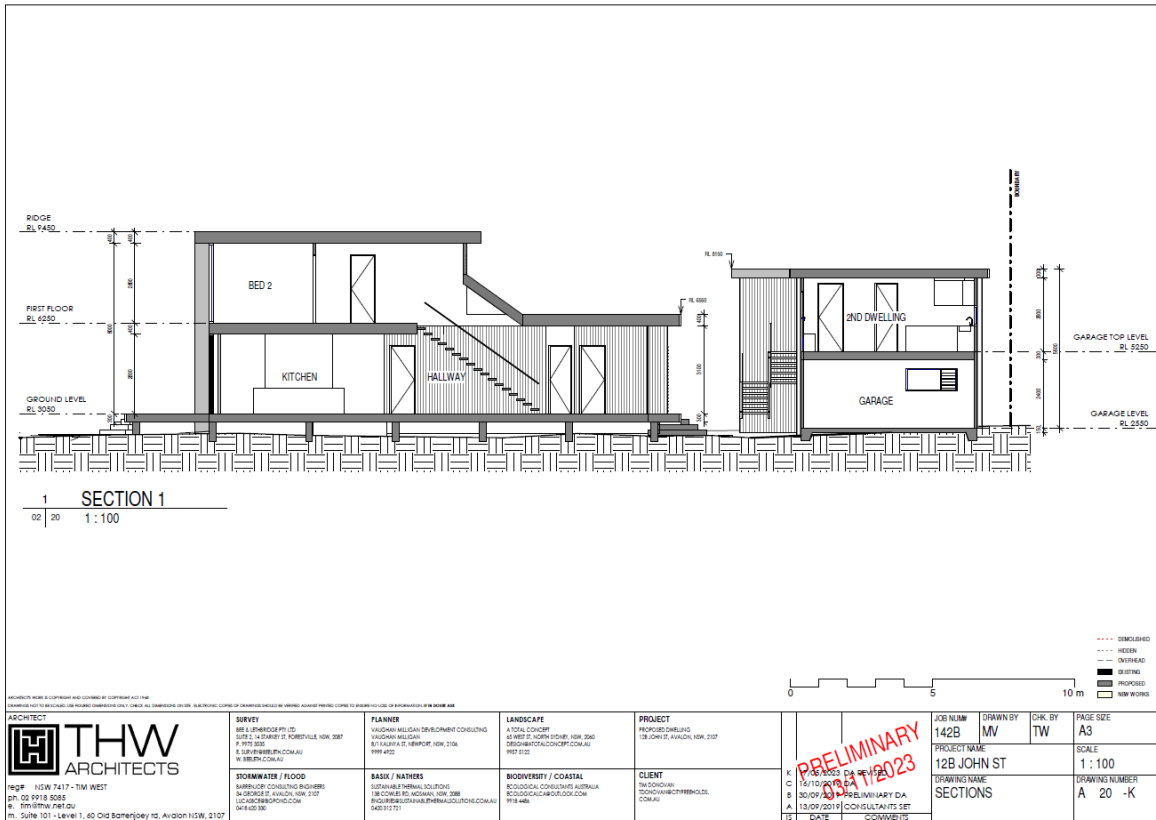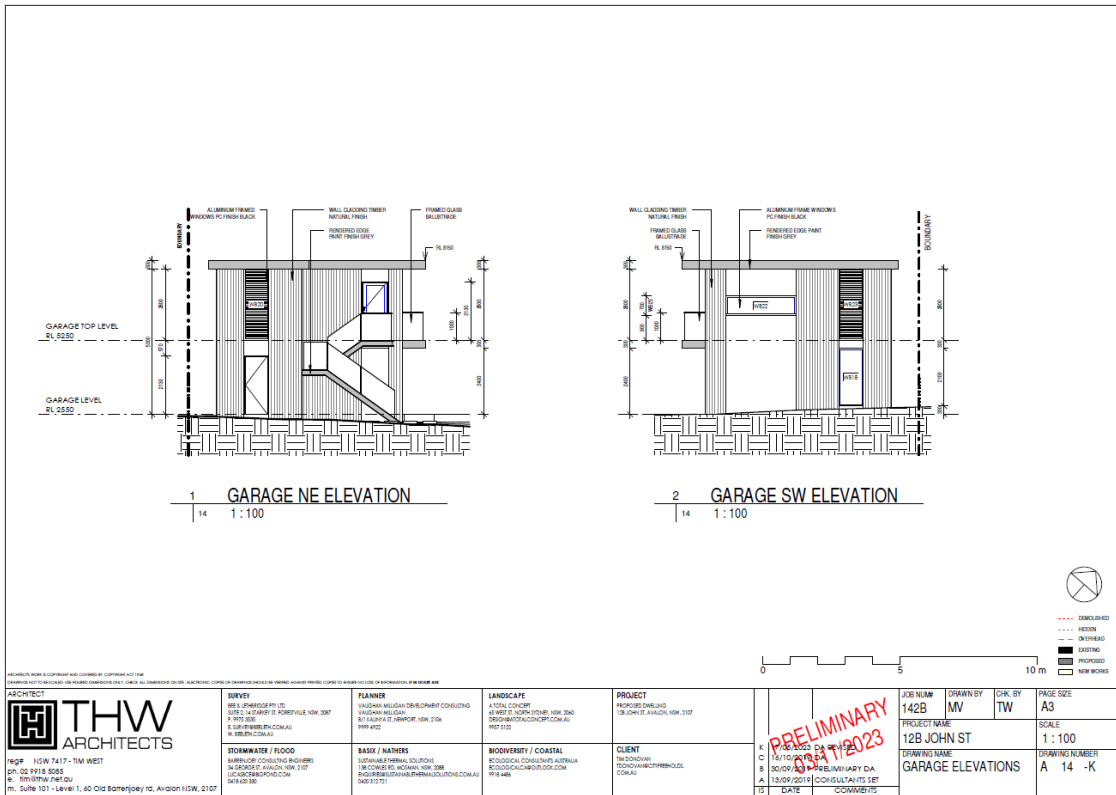

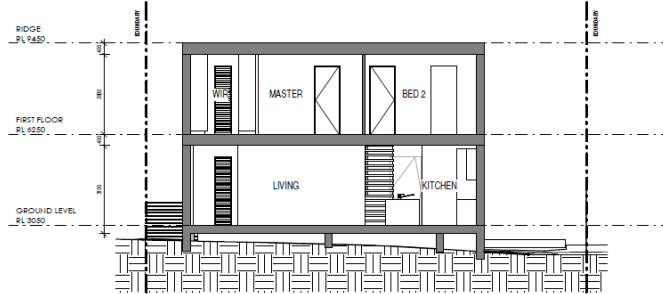

1 SECTION 2
21 1:100




ARCHITECT NAME & COPYRIGHT ARE COVERED BY COPYRIGHT ACT 1968

UNLESS NOTED OTHERWISE, THE DRAWING IS FOR INFORMATION ONLY. NO LIABILITY IS ACCEPTED FOR ANY LOSS OR DAMAGE TO ANYTHING SHOWN OR NOT SHOWN IN THE DRAWING.

ARCHITECT THW ARCHITECTS reg'd NSW 7417 - TIM WEST ph. 02 9918 8088 e. tim@thw.net.au m. Suite 101 - Level 1, 60 Old Boneyoey Rd, Avalon NSW, 2107	SURVEY REG'D SURVEYOR PT LTD 1001 E. STREETS PT FOREVALE NSW 2887 P. 1971 000 E. 1001@thw.net.au M. 1001@thw.net.au	PLANNER VAUGHAN MULLIGAN DEVELOPMENT CONSULTING VAUGHAN MULLIGAN 81 TAYLOR ST. BENTLEY NSW 2155 9999 4102	LANDSCAPE A TOTAL CONCEPT 45 WEST ST. NORTH SYDNEY NSW 2060 9555 5500 E. 45@totalconcept.com.au M. 9555 5500	PROJECT PROPOSED DWELLING 12B JOHN ST. AVALON NSW 2107	JOB NUM 142B DRAWN BY MV CHK. BY TW PAGE SIZE A3	PROJECT NAME 12B JOHN ST SCALE 1:100
	STORMWATER / FLOOD BARBARA JUNG CONSULTING ENGINEERS 14 GEORGE ST. AVALON NSW 2107 LUCAS@BARBARAJUNG.COM.AU 9418 8150	BASIC / MATHEMS RAEHLER MATHEMATICAL SOLUTIONS RAEHLER, KATHARINA, NSW 2286 R@RAEHLERMATHEMATICALSOLUTIONS.COM.AU 9418 1171	BIOGEOLOGY / COASTAL ECOLOGICAL CONSULTANTS AUSTRALIA 1001@thw.net.au, H@THW.NSW 2107 R@H@THW.NSW 2107	CLIENT TM SONDHORN 1001@thw.net.au 1001@thw.net.au	DATE 13/09/2018 COMMENTS PRELIMINARY DA	DRAWING NAME SECTIONS DRAWING NUMBER A 21 -K


JOHN STREET

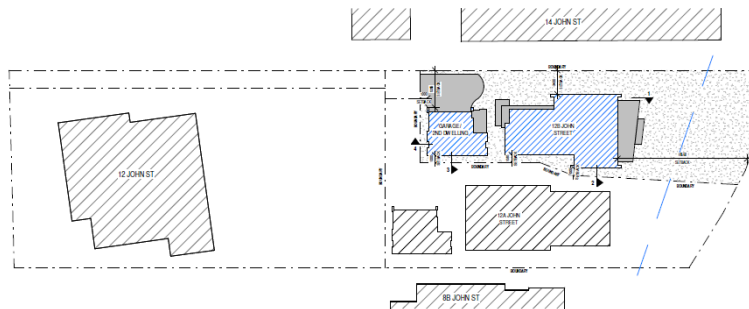

1 SITE ANALYSIS NEW
100 1:400


SITE ANALYSIS

SITE AREA	700m²
ZONE	EA
MAX COVERAGE	40% = 280m²
BUILDING FOOTPRINT	180.2m²
HARD PAVING / DECK / STAIRS	87.3m²
PRO COVERAGE	271.1m² = 38.7%
REQ LANDSCAPE	90% = 630m²
PRO LANDSCAPE	428.9m² = 61.3%
MAX HEIGHT	8.5m
PRO HEIGHT	7.34m
REQ FRONT SETBACK	6.50m
PRO FRONT SETBACK HOUSE	12.1m
PRO FRONT SETBACK GARAGE	1.30m
REQ REAR SETBACK	6.50m
PRO REAR SETBACK HOUSE	18.55m
PRO REAR SETBACK GARAGE	37.7m
REQ SIDE SETBACK	1.50m / 2.50m
PRO SIDE SETBACK HOUSE	1.08m / 3.40m
PRO SIDE SETBACK GARAGE	1.00m / 5.30m



ARCHITECT NAME & COPYRIGHT ARE COVERED BY COPYRIGHT ACT 1968

UNLESS NOTED OTHERWISE, THE DRAWING IS FOR INFORMATION ONLY. NO LIABILITY IS ACCEPTED FOR ANY LOSS OR DAMAGE TO ANYTHING SHOWN OR NOT SHOWN IN THE DRAWING.

	REG'D LANDSCAPE ARCHITECT 1001 E. STREETS PT FOREVALE NSW 2887 P. 1971 000 E. 1001@thw.net.au M. 1001@thw.net.au	VAUGHAN MULLIGAN DEVELOPMENT CONSULTING VAUGHAN MULLIGAN 81 TAYLOR ST. BENTLEY NSW 2155 9999 4102	A TOTAL CONCEPT 45 WEST ST. NORTH SYDNEY NSW 2060 9555 5500 E. 45@totalconcept.com.au M. 9555 5500	PROPOSED DWELLING 12B JOHN ST. AVALON NSW 2107	142B	MV	TW	A3
	SURVEYOR / FLOODING MARKHAM / CONSULTING ENGINEERS 1001 E. STREETS PT FOREVALE NSW 2887 E. 1001@thw.net.au M. 1001@thw.net.au	BASIC / NATHERS ESTABLISHMENT SOLUTIONS 1001 E. STREETS PT FOREVALE NSW 2887 E. 1001@thw.net.au M. 1001@thw.net.au	BIOVEGETRY / COASTAL BIOLOGICAL CONSULTING AUSTRALIA 1001 E. STREETS PT FOREVALE NSW 2887 E. 1001@thw.net.au M. 1001@thw.net.au	CLIENT TM SONDHORN 1001@thw.net.au 1001@thw.net.au	PROJECT NAME 12B JOHN ST SCALE As indicated			
REG'D NSW 7417 - TIM WEST Ph: 02 9918 8088 E: tim@thw.net.au M: Suite 101 - Level 1, 60 Old Boneyoey Rd, Avalon NSW, 2107				DATE 13/09/2018 COMMENTS PRELIMINARY DA				

Barrenjoey Consulting Engineers Pty Ltd
Stormwater Structural Civil
abn 13124694917 acn 124694917



1 3D VIEW 1
105



2 3D VIEW 2
105




3 3D VIEW 3
105



4 3D VIEW 4
105

ALL INFORMATION ON THIS DOCUMENT AND CONTAINED BY COPYRIGHT ACT 1968 DRAWINGS NOT TO BE LOANED, REPRODUCED OR COPIED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT											
ARCHITECT  REG# NSW 7417 - TIM WEST PH: 02 9918 5085 E: tim@thw.net.au M: Suite 101 - Level 1, 60 Old Barrenjoey Rd, Avalon NSW, 2107		SURVEY SEE & LEVISOPT PT LTD SUITE 1, 4 DARWIN ST, KOREVALE, NSW, 2087 P: 9973 3555 E: SURVEY@SEELE.COM.AU M: 9973 3555		PLANNER VAUGHAN MULLIGAN DEVELOPMENT CONSULTING VAUGHAN MULLIGAN 8/1 KALBARA ST, NEWPORT, NSW, 2106 9999 4922		LANDSCAPE A TOTAL CONCEPT 40 WEST ST, NORTH DUNBIE, NSW, 2340 DESIGNS@TOTALCONCEPT.COM.AU 9957 5122		PROJECT PROPOSED DWELLING 12B JOHN ST, AVALON, NSW, 2107		PRELIMINARY 1/2023 J 17/05/2023 DA PRELIMINARY K 28/05/2023 DA PRELIMINARY I 28/05/2023 DA PRELIMINARY H 16/10/2023 DA PRELIMINARY C 30/09/2019 PRELIMINARY DA B 13/09/2019 CONSULTANTS SET A 13/09/2019 DATE CONSULTANTS	
STORMWATER / FLOOD BARRENJOEY CONSULTING ENGINEERS 34 GEORGE ST, AVALON, NSW, 2107 LUCAS@BCE.COM.AU 0418 620 330		BASIC / NATHERS SUSTAINABLE THERMAL SOLUTIONS 136 COMES RD, MOSMAY, NSW, 2386 INFO@SUSTAINABLETHERMAL.COM.AU 0400 313 721		BIODIVERSITY / COASTAL ECOLOGICAL CONSULTANTS AUSTRALIA ECOLOGICAL@CAECOUT.COM.AU 9918 4488		CLIENT 12B JOHN ST 12B JOHN ST, AVALON, NSW, 2107 12B JOHN ST, AVALON, NSW, 2107		JOB NUM# 142B DRAWN BY MV CHK BY TW PROJECT NAME 12B JOHN ST DRAWING NAME 3D VIEWS DRAWING NUMBER A 105 -K		PAGE SIZE A3 SCALE	

Appendix B
Site Survey
Bee & Lethbridge

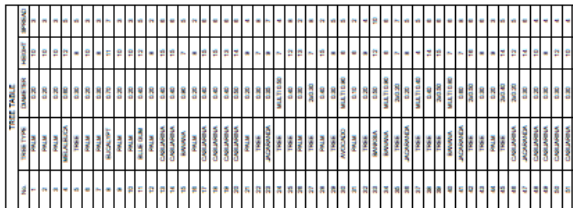

Appendix C
Flood Information Request – Basic
Northern Beaches Council



FLOOD INFORMATION REPORT (COMPREHENSIVE)

Property: 12A John Street AVALON BEACH NSW 2107

Lot DP: Lot 2 DP 1237357

Issue Date: 29/11/2023

Flood Study Reference: Avalon to Palm Beach Floodplain Risk Management Study and Plan 2017, Manly Hydraulics Laboratory

Flood Information¹:

Map A - Flood Risk Precincts

Maximum Flood Planning Level (FPL) ^{2,3,4}: 3.05 m AHD

Map B - 1% AEP Flood & Key points

1% AEP Maximum Water Level ^{2,3}: 2.55 m AHD

1% AEP Maximum Depth from natural ground level³: 1.84 m

1% AEP Maximum Velocity: 1.48 m/s

Map C - 1% AEP Hydraulic Categorisation

1% AEP Hydraulic Categorisation: Floodway at rear

Map D - Probable Maximum Flood

PMF Maximum Water Level (PMF) ⁴: 3.57 m AHD

PMF Maximum Depth from natural ground level: 2.85 m

PMF Maximum Velocity: 3.60 m/s

Map E - Flooding with Climate Change

1% AEP Maximum Water Level with Climate change ³: 2.91 m AHD

1% AEP Maximum Depth with Climate Change³: 2.17 m

Map F - Flood Life Hazard Category in PMF

Map G - Indicative Ground Surface Spot Heights


- (1) The provided flood information does not account for any local overland flow issues nor private stormwater drainage systems.
- (2) Overland flow/mainstream water levels may vary across a sloping site, resulting in variable minimum floor/ flood planning levels across the site. The maximum Flood Planning Level may be in a different location to the maximum 1% AEP flood level.
- (3) Intensification of development in the former Pittwater LGA requires the consideration of climate change impacts which may result in higher minimum floor levels.
- (4) Vulnerable/critical developments require higher minimum floor levels using the higher of the PMF or FPL

Notes

General

- All levels are based on Australian Height Datum (AHD) unless otherwise noted.
- This is currently the best available information on flooding; it may be subject to change in the future.
- Council recommends that you obtain a detailed survey of the above property and surrounds to AHD by a registered surveyor to determine any features that may influence the predicted extent or frequency of flooding. It is recommended you compare the flood level to the ground and floor levels to determine the level of risk the property may experience should flooding occur.
- Development approval is dependent on a range of issues, including compliance with all relevant provisions of Northern Beaches Council's Local Environmental Plans and Development Control Plans.
- Please note that the information contained within this letter is general advice only as a detail survey of the property as well as other information is not available. Council recommends that you engage a suitably experienced consultant to provide site specific flooding advice prior to making any decisions relating to the purchase or development of this property.
- The Flood Studies on which Council's flood information is based are available on Council's online [Flood Study Reports](#) webpage.
- If the FPL is higher than the PMF level, then the FPL should still be used as the FPL, as it includes freeboard which the PMF does not.
- If the property is affected by an Estuarine Planning Level (EPL) which is higher than the FPL, then the EPL should be used as the FPL.
- Areas affected by an EPL in the former Pittwater LGA are mapped on Council's online [Estuarine Hazard Map](#). Note that areas in the former Manly LGA affected by an EPL have been identified and will be soon added to this map.
- Council's drainage infrastructure is mapped on Council's [Stormwater Map](#). Note that locations are indicative only and may not be exactly as shown.

MAP A: FLOOD RISK PRECINCTS

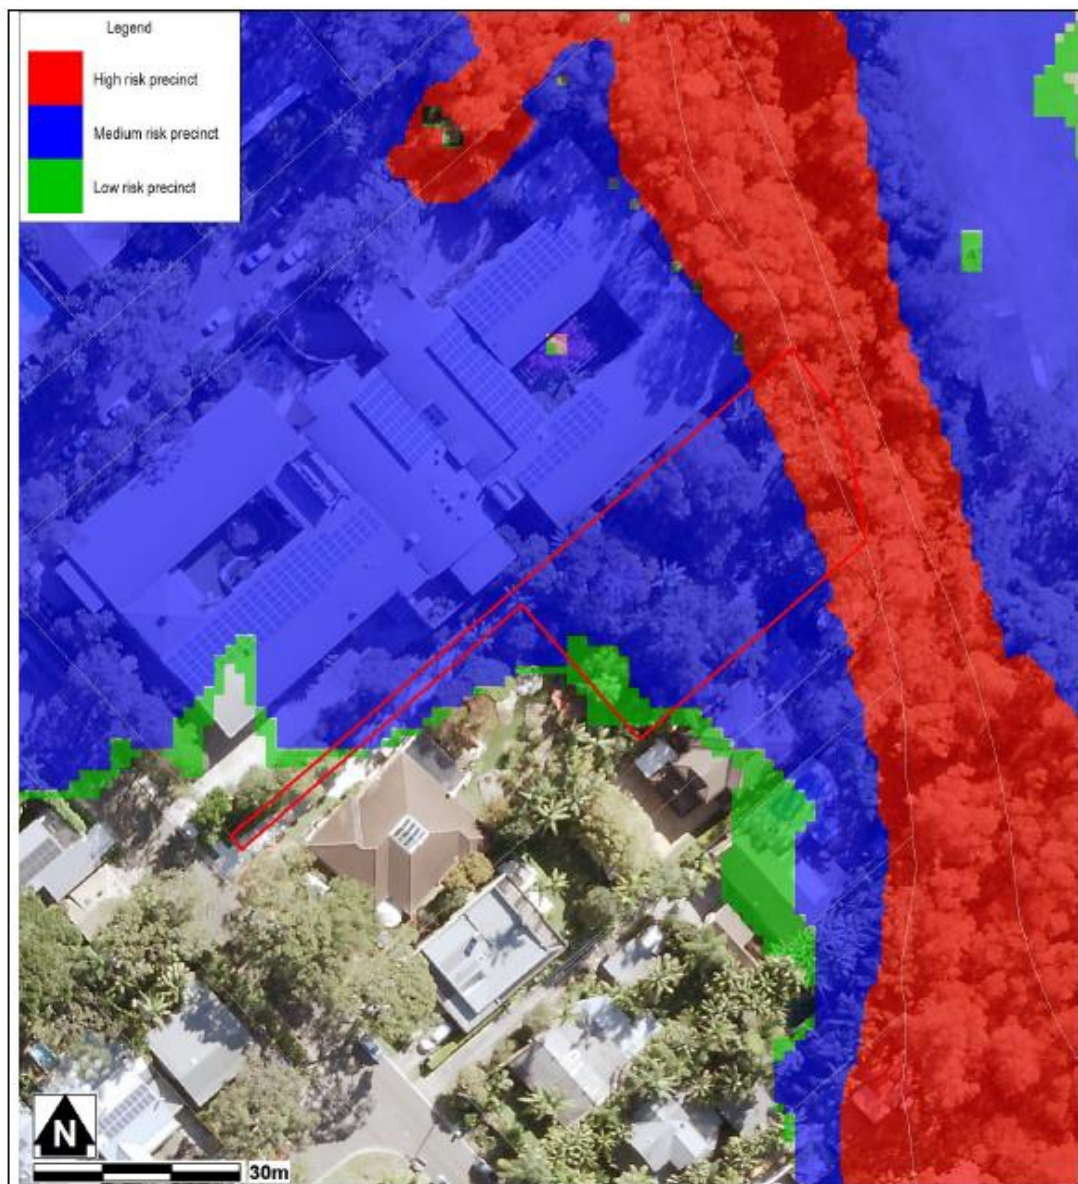


Notes:

- **Low Flood Risk precinct** means all flood prone land not identified within the High or Medium flood risk precincts.
- **Medium Flood Risk precinct** means all flood prone land that is (a) within the 1% AEP Flood Planning Area; and (b) is not within the high flood risk precinct.
- **High Flood Risk precinct** means all flood prone land (a) within the 1% AEP Flood Planning Area; and (b) is either subject to a high hydraulic hazard, within the floodway or subject to significant evacuation difficulties (H5 or H6 Life Hazard Classification).
- **The Flood Planning Area** extent is equivalent to the Medium Flood Risk Precinct extent and includes the High Flood Risk Precinct within it. The mapped extent represents the 1% annual Exceedance Probability (AEP) flood event + freeboard.
- None of these mapped extents include climate change.
- Cadastre Lines (Source: NSW Government Land and Property Information), flood levels/extents (Source: Avalon to Palm Beach Floodplain Risk Management Study and Plan 2017, Manly Hydraulics Laboratory) and aerial photography (Source: NearMap 2014) are indicative only.

Issue Date: 29/11/2023

Page 3 of 13

MAP B: FLOODING - 1% AEP EXTENT & KEY POINTS

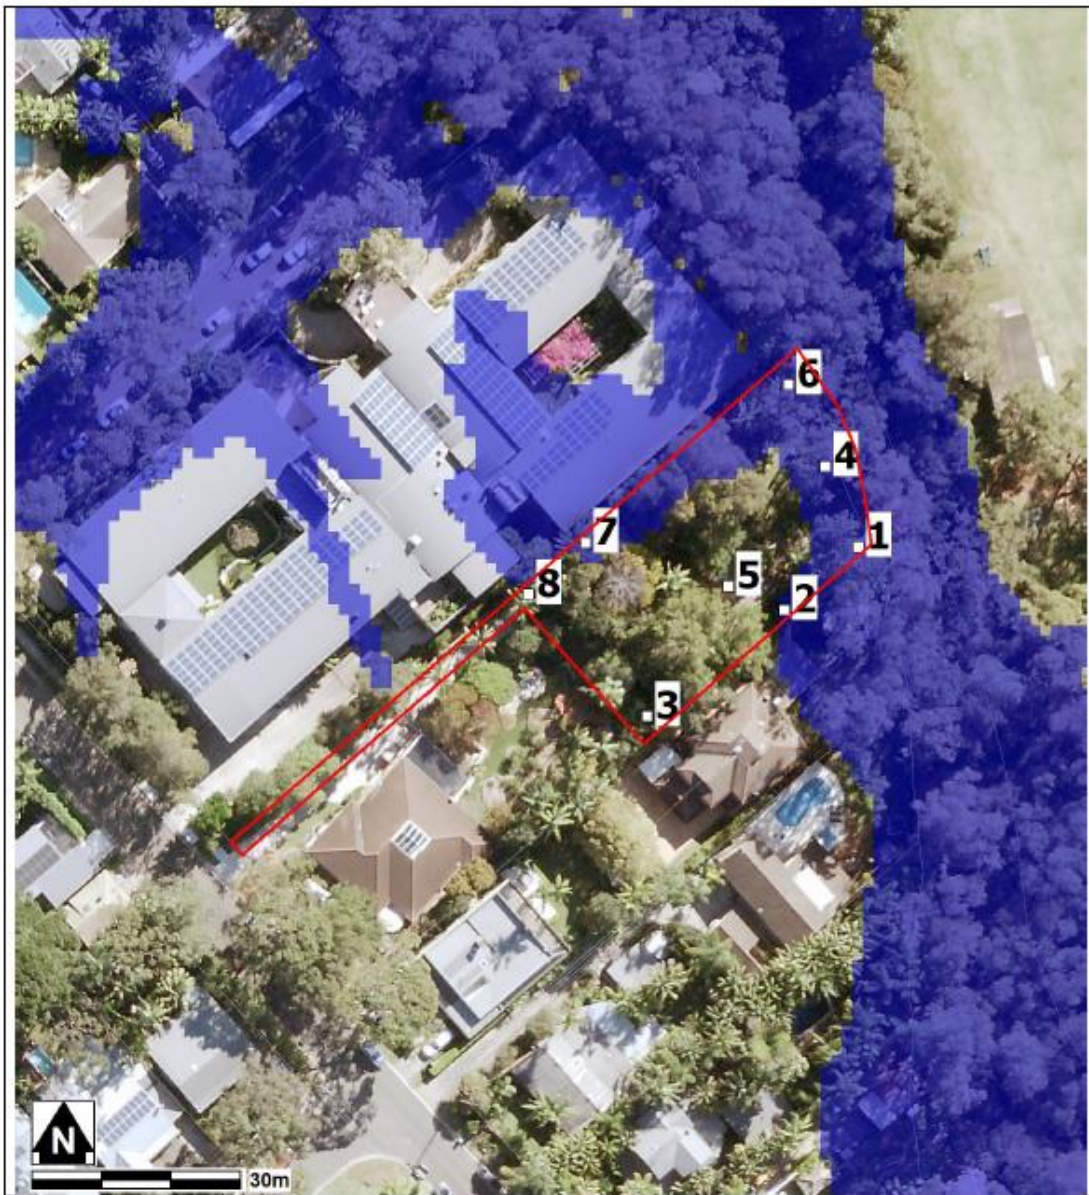

Notes:

- Extent represents the 1% annual Exceedance Probability (AEP) flood event.
- Flood events exceeding the 1% AEP can occur on this site.
- Extent does not include climate change.
- Cadastre Lines (Source: NSW Government Land and Property Information), flood levels/extents (Source: Avalon to Palm Beach Floodplain Risk Management Study and Plan 2017, Manly Hydraulics Laboratory) and aerial photography (Source Near Map 2014) are indicative only.

Flood Levels

ID	5% AEP Max WL (m AHD)	5% AEP Max Depth (m)	1% AEP Max WL (m AHD)	1% AEP Max Depth (m)	1% AEP Max Velocity (m/s)	Flood Planning Level (m)	PMF Max WL (m AHD)	PMF Max Depth (m)	PMF Max Velocity (m/s)
1	2.28	1.00	2.51	1.23	1.06	3.01	3.55	2.27	2.94
2	N/A	N/A	2.54	0.18	0.09	3.04	3.56	1.18	1.10
3	N/A	N/A	N/A	N/A	N/A	N/A	3.50	0.24	0.23
4	2.23	0.83	2.45	1.00	0.87	2.95	3.47	2.01	2.72
5	N/A	N/A	N/A	N/A	N/A	3.03	3.47	0.83	1.27
6	2.19	0.85	2.40	1.06	0.96	2.90	3.38	2.05	2.67
7	N/A	N/A	2.39	0.20	0.03	2.89	3.37	1.18	0.73
8	N/A	N/A	N/A	N/A	N/A	2.89	3.33	0.96	0.48

Climate Change Flood Levels (30% Rainfall intensity and 0.9m Sea Level Rise)

ID	CC 1% AEP Max WL (m AHD)	CC 1% AEP Max Depth (m)
1	2.84	1.55
2	2.86	0.48
3	N/A	N/A
4	2.78	1.32
5	2.81	0.17
6	2.73	1.39
7	2.72	0.53
8	2.71	0.34

WL – Water Level


PMF – Probable Maximum Flood

N/A - No Peak Water Level/Depth/Velocity Available.

Notes:

- The flood planning levels above are calculated by adding a 0.5m freeboard to the 1% AEP water level. However, if the depth of flow is less than 0.3m and a Velocity X Depth product is less than 0.3m²/s, a freeboard of 0.3m may be able to be justified for development.


MAP C: 1% AEP FLOOD HYDRAULIC CATEGORY EXTENT MAP

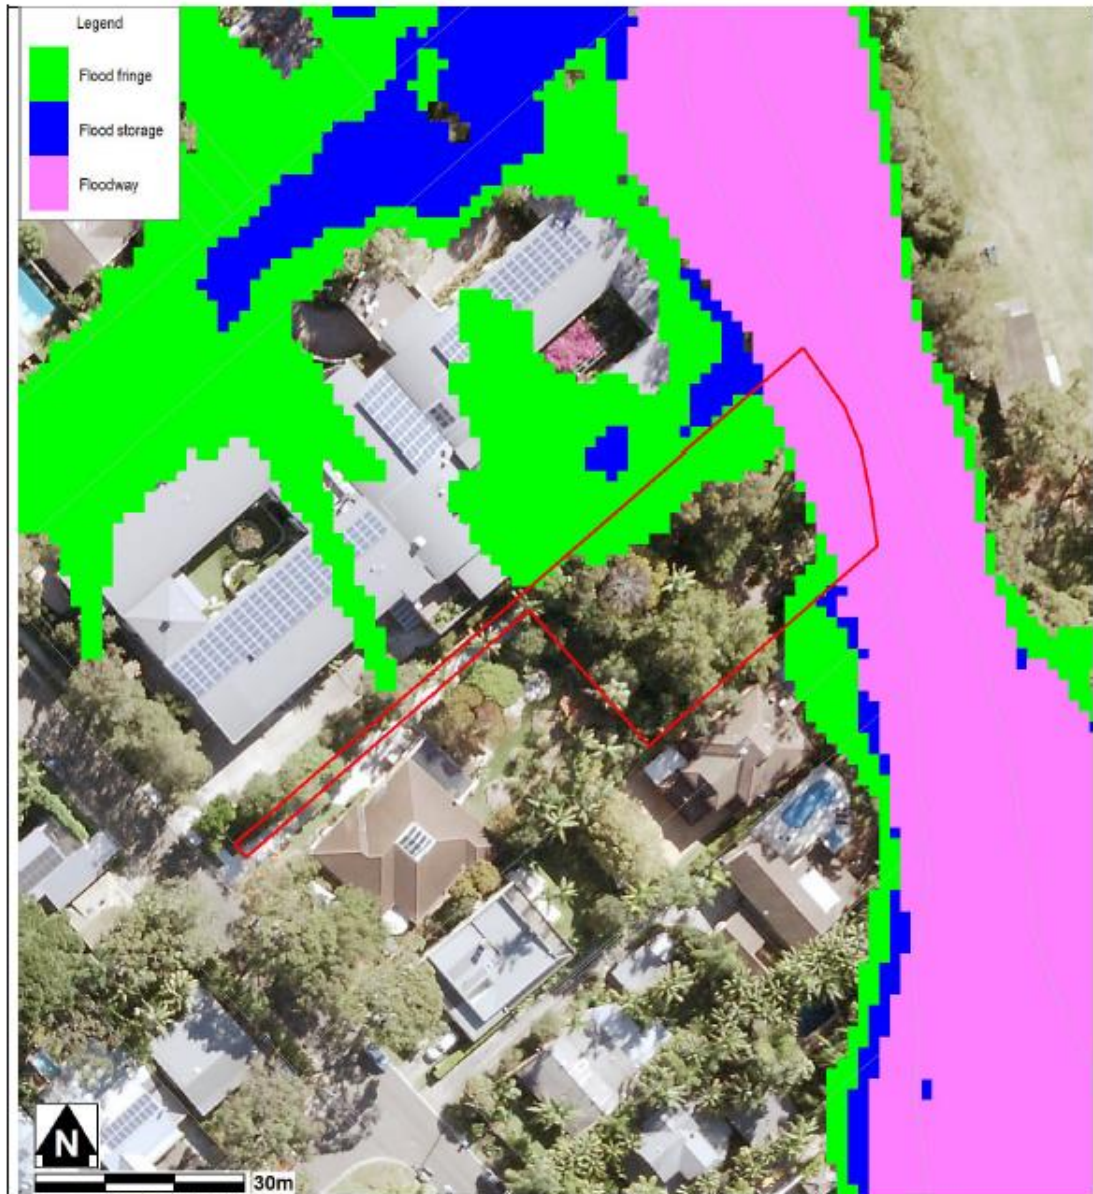

Notes:

- Extent represents the 1% annual Exceedance Probability (AEP) flood event
- Extent does not include climate change
- Cadastre Lines (Source: NSW Government Land and Property Information), flood levels/extents (Source: Avalon to Palm Beach Floodplain Risk Management Study and Plan 2017, Manly Hydraulics Laboratory) and aerial photography (Source: NearMap 2014) are indicative only

MAP D: PMF EXTENT MAP

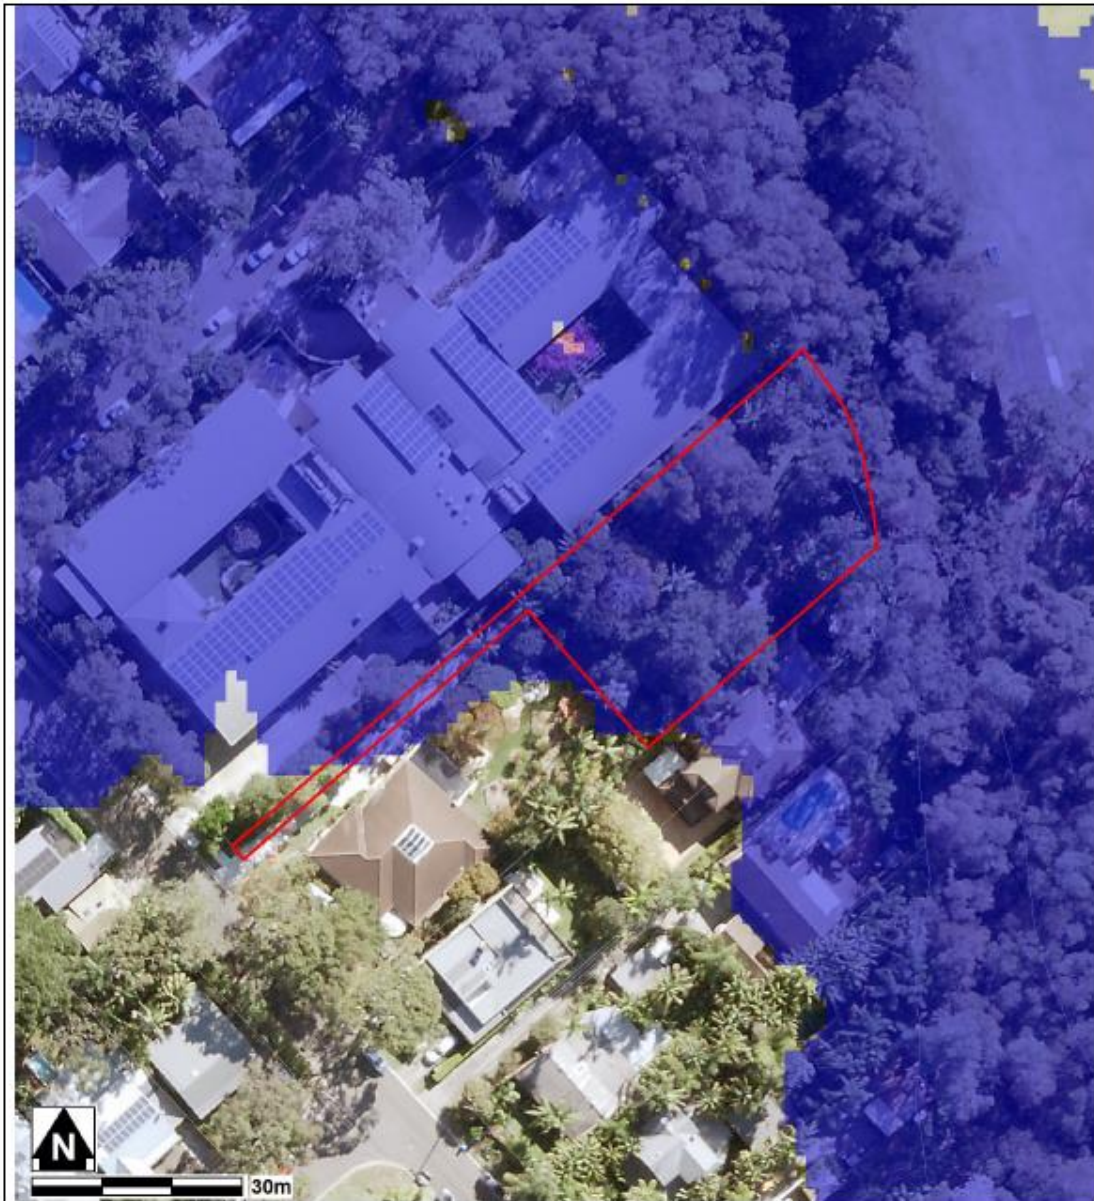

Notes:

- Extent represents the Probable Maximum Flood (PMF) flood event
- Extent does not include climate change
- Cadastre Lines (Source: NSW Government Land and Property Information), flood levels/extents (Source: Avalon to Palm Beach Floodplain Risk Management Study and Plan 2017, Manly Hydraulics Laboratory) and aerial photography (Source: NearMap 2014) are indicative only


MAP E: FLOODING – 1% AEP EXTENT PLUS CLIMATE CHANGE



Notes:

- Extent represents the 1% annual Exceedance Probability (AEP) flood event including 30% rainfall intensity and 0.9m Sea Level Rise climate change scenario
- Flood events exceeding the 1% AEP can occur on this site.
- Cadastre Lines (Source: NSW Government Land and Property Information), flood levels/extents (Source: Avalon to Palm Beach Floodplain Risk Management Study and Plan 2017, Manly Hydraulics Laboratory) and aerial photography (Source: NearMap 2014) are indicative only

MAP F: FLOOD LIFE HAZARD CATEGORY IN PMF

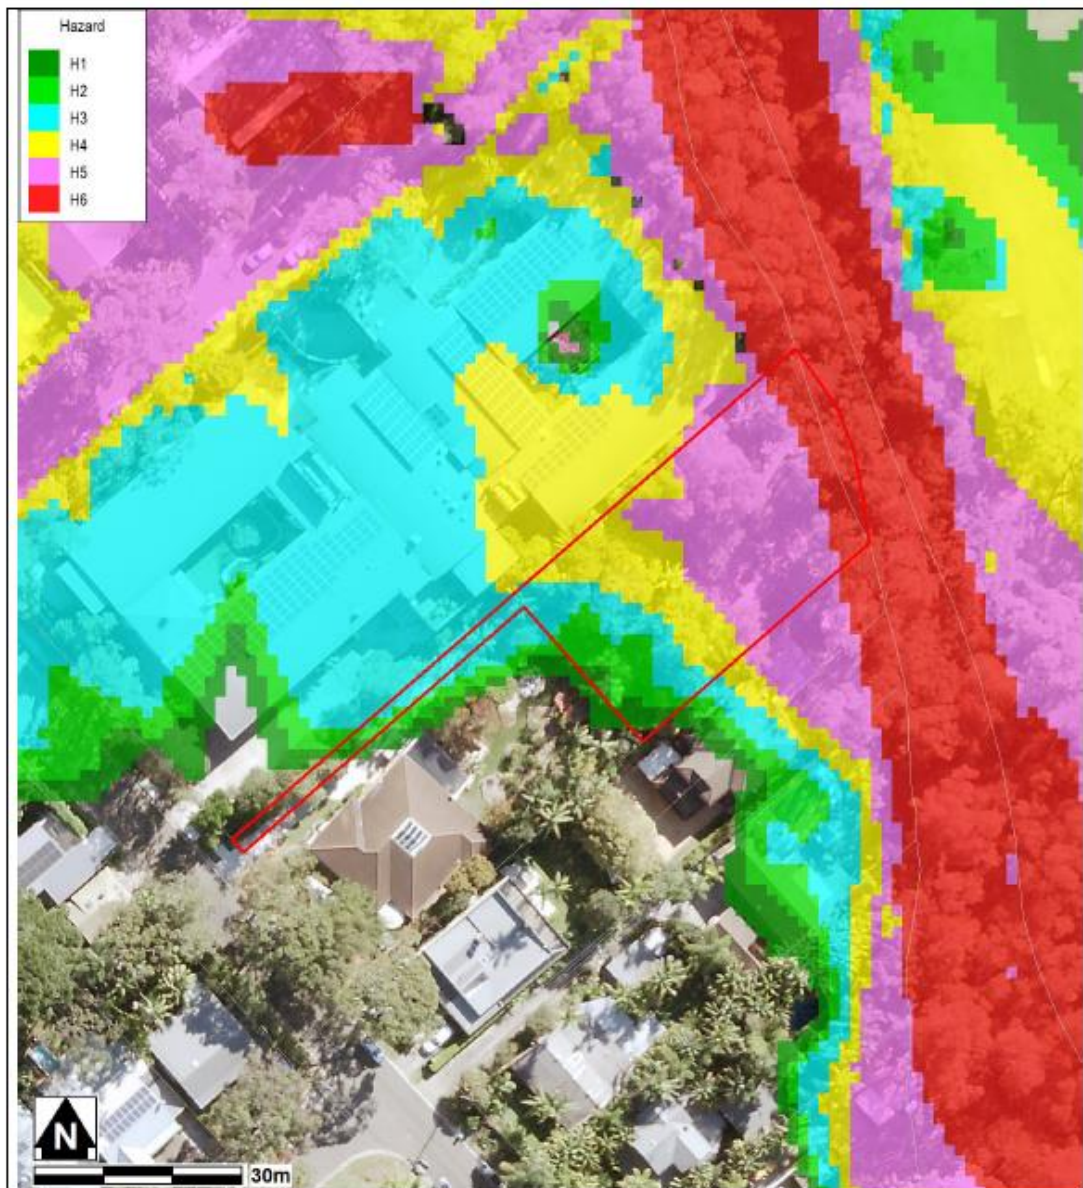

Notes:

- Cadastre Lines (Source: NSW Government Land and Property Information), flood levels/extents (Source: Avalon to Palm Beach Floodplain Risk Management Study and Plan 2017, Manly Hydraulics Laboratory) and aerial photography (Source Near Map 2014) are indicative only.

MAP G: INDICATIVE GROUND SURFACE SPOT HEIGHTS



Notes:

- The surface spot heights shown on this map were derived from Airborne Laser Survey and are indicative only.
- Accuracy is generally within $\pm 0.2\text{m}$ vertically and $\pm 0.15\text{m}$ horizontally, and Northern Beaches Council does not warrant that the data does not contain errors.
- If accuracy is required, then survey should be undertaken by a registered surveyor.

Issue Date: 29/11/2023

Page 10 of 13

Preparation of a Flood Management Report

Introduction

These guidelines are intended to provide advice to applicants on how to determine what rules apply on flood prone land, and how to prepare a Flood Management Report. The purpose of a Flood Management Report is to demonstrate how a proposed development will comply with flood related planning requirements.

Planning Requirements for Flood Prone Land

Development must comply with the requirements for developing flood prone land set out in the relevant Local Environment Plan (LEP) and Development Control Plan (DCP). There are separate LEPs and DCPs for each of the former Local Government Areas (LGAs), although preparation of a LGA-wide LEP and DCP is currently under way.

The clauses specific to flooding in the LEPs and DCPs are as follows:

LEP Clauses	DCP Clauses
Manly LEP (2013) – 5.21 Flood Planning	Manly DCP (2013) – 5.4.3 Flood Prone Land
Warringah LEP (2011) – 5.21 Flood Planning Warringah LEP (2000) – 47 Flood Affected Land *	Warringah DCP (2011) – E11 Flood Prone Land
Pittwater LEP (2014) – 5.21 Flood Planning Pittwater LEP (2014) – 7.4 Flood Risk Management	Pittwater 21 DCP (2014) – B3.11 Flood Prone Land Pittwater 21 DCP (2014) – B3.12 Climate Change

* The Warringah LEP (2000) is relevant only for the "deferred lands" which affects only a very small number of properties, mostly in the Oxford Falls area.

Development on flood prone land must also comply with Council's Water Management for Development Policy, and if it is in the Warriewood Release Area, with the Warriewood Valley Water Management Specification. Guidelines for Flood Emergency Response Planning are available for addressing emergency response requirements in the DCP. These documents can be found on Council's website on the [Flooding page](#).

Note that if the property is affected by estuarine flooding or other coastal issues, these need to be addressed separately under the relevant DCP clauses.

When is a Flood Management Report required?

A Flood Management Report must be submitted with any Development Application on flood prone land (with exceptions noted below), for Council to consider the potential flood impacts and applicable controls. For Residential or Commercial development, it is required for development on land identified within the Medium or High Flood Risk Precinct. For Vulnerable or Critical development, it is required if it is within any Flood Risk Precinct.

There are some circumstances where a formal Flood Management Report undertaken by a professional engineer may not be required. However the relevant parts of the DCP and LEP would still need to be addressed, so as to demonstrate compliance. Examples where this may apply include:

- If all proposed works are located outside the relevant Flood Risk Precinct extent
- First floor addition only, where the existing ground floor level is above the FPL
- Internal works only, where habitable floor areas below the FPL are not being increased

Note that development on flood prone land will still be assessed for compliance with the relevant DCP and LEP, and may still be subject to flood related development controls.

What is the purpose of a Flood Management Report?

The purpose of a Flood Management Report is to demonstrate how a proposed development will comply with flood planning requirements, particularly the development controls outlined in the relevant LEP and DCP clauses. The report must detail the design, measures and controls needed to achieve compliance, following the steps outlined below.

A Flood Management Report should reflect the size, type and location of the development, proportionate to the scope of the works proposed, and considering its relationship to surrounding development. The report should also assess the flood risk to life and property.

Preparation of a Flood Management Report

The technical requirements for a Flood Management Report include (where relevant):

1. Description of development
 - Outline of the proposed development, with plans if necessary for clarity
 - Use of the building, hours of operation, proposed traffic usage or movement
 - Type of use, eg vulnerable, critical, residential, business, industrial, subdivision, etc
2. Flood analysis
 - 1% AEP flood level
 - Flood Planning Level (FPL)
 - Probable Maximum Flood (PMF) level
 - Flood Risk Precinct, ie High, Medium or Low
 - Flood Life Hazard Category
 - Mapping of relevant extents
 - Flood characteristics for the site, eg depth, velocity, hazard and hydraulic category, and the relevance to the proposed development

If the property is affected by an Estuarine Planning Level (EPL) which is higher than the FPL, then the EPL should be used as the FPL. If the FPL is higher than the PMF level, then the FPL should still be used as the FPL, as it includes freeboard which the PMF does not.

3. Assessment of impacts
 - Summary of compliance for each category of the DCP, as per the table below.

	Compliance		
	N/A	Yes	No
A) Flood effects caused by Development			
B) Building Components & Structural Soundness			
C) Floor Levels			
D) Car parking			
E) Emergency Response			
F) Fencing			
G) Storage of Goods			
H) Pools			

- Demonstration of how the development complies with any relevant flood planning requirements from the DCP, LEP, Water Management for Development Policy, and if it is in the Warriewood Valley Urban Land Release Area, with the Warriewood Valley Water Management Specification (2001)
- For any non-compliance, a justification for why the development should still be considered.

- Calculations of available flood storage if compensatory flood storage is proposed
- Plan of the proposed development site showing the predicted 1% AEP and PMF flood extents, as well as any high hazard or floodway affectation
- Development recommendations and construction methodologies
- Qualifications of author - Council requires that the Flood Management Report be prepared by a suitably qualified Engineer with experience in flood design / management who has, or is eligible for, membership to the Institution of Engineers Australia
- Any flood advice provided by Council
- Any other details which may be relevant

Further information and guidelines for development are available on Council's website at:

<https://www.northernbeaches.nsw.gov.au/planning-and-development/building-and-renovations/development-applications/guidelines-development-flood-prone-land>

Council's Flood Team may be contacted on 1300 434 434 or at floodplain@northernbeaches.nsw.gov.au.

Appendix E
Northern Beaches Council
Standard Hydraulic Certification Form

**NORTHERN BEACHES COUNCIL
STANDARD HYDRAULIC CERTIFICATION FORM**

FORM A/A1 – To be submitted with Development Application

Development Application for

Address of site: **12B John St Avalon**

Declaration made by hydraulic engineer or professional consultant specialising in flooding/flood risk management as part of undertaking the Flood Management Report:

I, **Lucas Molloy** on behalf of **Barrenjoey Consulting Engineers p/l** on this the **30th Nov 2023** certify that I am engineer or a professional consultant specialising in flooding and I am authorised by the above organisation/ company to issue this document and to certify that the organisation/ company has a current professional indemnity policy of at least \$2 million.

Flood Management Report Details:

Report Title:

**FLOOD INUNDATION &
RISK ASSESSMENT REPORT
PROPOSED NEW RESIDENCE
12B JOHN ST AVALON**

Report Date:

Nov 2023

Author:

Lucas Molloy

Author's Company/Organisation:

Barrenjoey Consulting Engineers p/l

I: **Lucas Molloy**

Please tick all that are applicable (more than one box can be ticked)

X have obtained and included flood information from Council (must be less than 12 months old)

X have followed Council's Guidelines for Preparing a Flood Management Report

na have requested a variation to one or more of the flood related development controls. Details are provided in the *Flood Management Report*.

Signature



Name

**Lucas Molloy
BE CPEng NER 788184
Director
Barrenjoey Consulting Engineers p/l**

End