


ALL PITS TO BE CAST IN-SITU TO COUNCIL'S DETAILS AND SPECIFICATIONS

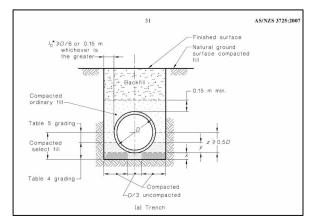

Sieve size	Weight passing
19.0	100
2.36	100-50
0.60	90-20
0.30	60-10
0.15	25-0
0.075	10-0

Sieve size	Weight passing
75.0	100
9.5	100-50
2.36	100-30
0.60	50-15
0.075	25-0
0.075 E: Acceptable mater ts would result in ma draining. Granular	

ROAD RECTIFICATION NOTES (TYPICAL)


REINSTATE INTEGRAL KERB AND GUTTER ON 50mm SAND TO COUNCIL'S SPECIFICATIONS AND DETAILS CUT ROAD PAVEMENT 500mm WIDE AND REINSTATE TO GEORGES RIVER COUNCIL'S SPECIFICATIONS;

PIPE BEDDING AND HAUNCH MATERIAL TO BE CEMENT MODIFIED CRUSHED ROCK CONFORMING TO

PIPE BACKFILL TO CONFORM TO AS3725, COMPACTED TO 95% DRY COMPACTION IN LAYERS OF 150mm THICKNESS

ROAD PAVEMENT MINIMUM 200mm THICKNESS 20mm CRUSHED ROCK COMPACTED TO 98% DRY COMPACTION IN LAYERS OF 100mm THICKNESS

WEARING COURSE TO BE 50mm AC10 HOTMIX

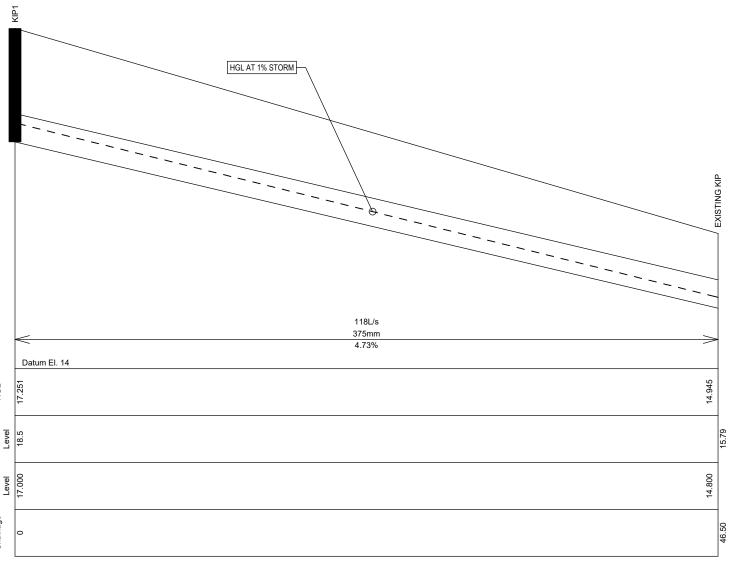

LONGSECTION H - 1:250 V - 1:25

NOTE: BED LAYER (x) TO BE 100mm THICK 1-2% CEMENT BOUND WELL GRADED BACKFILL COMPACTED TO 80% COMPACTION. PIPE HAUNCH ZONE (y) TO BE 150mm THICK 1-2% CEMENT MODIFIED WELL GRADED BACKFILL COMPACTED TO 80% COMPACTION. MATERIAL OVER PIPE TO BE COMPACTED TO 80% COMPACTION



APPROVED BY	REVISION	DRAWN	DESCRIPTION	DATE
ADER ZAKI	P1	NZ	ISSUED FOR CO-ORDINATION	28.04.2023
IEAust CPEng NER	P2	NZ	ISSUED FOR CO-ORDINATION	08.06.2023
11-	Р3	NZ	ISSUED FOR CO-ORDINATION	26.06.2023
J aki	А	NZ	ISSUED FOR DA	27.06.2023
0413 942 613				
admin@nycivilengineering.com.au				

EXTERNAL PIPE SECTION	
-----------------------	--

DRAWING TITLE

PROPOSED SENIORS LIVING DEVELOPMENT No.37-43 HAY STREET COLLAROY

SHEET SIZEA3	JOB REFERENC	
DESIGNED NZ	E230197	
	DRAWING No.	
CHECKED NZ	D11	

ISSUE	Α	No. IN SE
SCALE	1:250	11