

|  | NOTES:           • All structures including stormwater & drainage to engineer's details.           • Do not obtain dimensions by scaling drawings.           • All dimensions are to be checked on site prior to starting work.           • These drawings are to be read in conjunction with all other consultant's drawings and specifications.  | JJ Drafting<br>174 Garden St, North Narrabeen, NSW, 2101                        | DATE: | DESCRIPTION: | PROJECT DETAILS:<br>PROPOSED ALTERATIONS AND ADDITIONS<br>9 EUNGAI PLACE NORTH NARRABEEN |
|--|--|---|-------|--------------|--|
|  | <ul> <li>All workmanship &amp; materials shall be in accordance with the requirements of current editions including amendments of the relevant SAA Codes of Practice, the Building Code of Australia and local council requirements.</li> <li>New materials are to be used throughout unless otherwise noted.</li> <li>Concrete footings, slab, structural beams or any other structural members are to be designed by a practicing engineer.</li> </ul> | PO Box 687, Dee Why, NSW, 2099<br>Mob. 0414 717 541<br>Email iidraff@toa com au |       |              | DRAWING TITLE:<br>ROOF PLAN & STORMWATER CONCEPT   |

| DATE:   | DRAWN BY:   | SCALE:      |  |
|---------|-------------|-------------|--|
| AUG/19  | AHB         | 1:200 @ A3  |  |
| JOB No: | CHECKED BY: | DRAWING No: |  |
| 721/19  | JJ          | DA.05       |  |

# **Designated Site Manager/Builder**

PRIOR TO COMMENCEMENT OF WORK A SITE MANAGER OR BUILDER MUST BE NOMINATED. THE SITE MANAGER OR BUILDER WILL BE RESPONSIBLE AND LIABLE FOR ALL WORKS CARRIED OUT ON THE SITE. THIS ASSUMES THE RESONSIBILITY FOR THE ACTIONS OF ALL SUBCONTRACTED PARTIES AS WELL AS ADVISING THEM OF COUNCIL'S REQUIREMENTS WHEN CARRYING OUT WORKS.

## **Topsoil Management**

PRIOR TO THE STRIPPING OF TOPSOIL, THE VEGETATIVE COVER MUST BE REDUECED BY EITHER SLASHING OR MOWING ALL TOPSOIL IS TO BE RETAINED AND PROTECTED FOR REUSE ON SITE. SOIL STOCKPILES MUST NOT BE LOCATED ON NATURE STRIPS, FOOTPATHS, ROADWAYS, KERBS, ACCESSWAYS, WITHIN DRAINAGE LINES/FLOWS/PATHS OR AROUND OR AGAINST TREE SHRUBS.

SEDIMENT CONTROL MEASURES MUST BE INCORPORATED WITH ANY RESULTING STOCKPILE. THE STOCKPILE CAN BE PROTECTED FROM EROSION BY COVERING IT WITH AN IMPERVIOUS MATERIAL. IN CONJUNCTION WITH THE INSTALLATION OF A SEDIMENT FENCE AROUND IT.

IF STOCKPILES ARE TO REMAIN FOR MORE THAN ONE MONTH THEY ARE TO BE GRASSED IMMEDIATELY AND STABILISED WITHIN FOURTEEN DAYS. SURPLUS TOPSOIL MUST BE REASONABLY REMOVED FROM SITE.

## **Builidng Material Stockpiling**

SUFFICIENT AREA MUST BE ALLOCATED WITHIN THE SITE FOR SUCH STORAGE OF BUILDING MATERIALS, DEMOLITION WASTE, WASTE CONTAINERS, ETC. AS WILL BE REQUIRED

## Sediment Fences

A SEDIMENT FENCE SHOULD BE LOCATED ALONG THE DOWNSLOPE BOUNDARY(S) OF THE SITE. ON THE CONSTRUCTION SIDE OF THE TURF FILTER STRIP OR NATIVE VEGETATION . AND AROUND ALL STOCKPILES OF MATERIAL ON THE SITE

## Dust Control

ALL TRUCKS/UTES MUST COVER THEIR LOADS AT ALL TIMES. APPROPRIATE METHODS ARE TO BE EMPLOYED TO PREVENT BLOWING DUST CREATING AN UNACCEPTABLE HAZARD OR NUISANCE ON THE SITE OR DOWN WIND. PRODUCTION OF DUST CAN BE MINIMISED BY LIMITING AREA OF EARTHWORKS, WATERING AND PROGRESSIVE VEGETATION. WHERE DUST IS CREATED AS A RESULT WORKS AND/OR SOIL EXPOSURE, THE BARE SOIL AREAS MUST BE WATERED. DURING AND/OR AT THE END OF FACH DAY TO LAY THE DUST

EARTH MOVONG ACTIVITIES SHOULD BE AVOIDED WHERE WINDS ARE SUFFICIENTLY STRONG ENOUGH TO RAISE VISIBLE DUST.

## **Erosion & Sediment Controls**

APPROPRIATE EROSION AND SEDIMENT CONTROLS MUST BE IMPLEMENTED ON ALL SITES THAT INVOLVE SOIL DISTURBANCE. THE MEASURES MUST BE IN PLACE PRIOR TO THE COMMENCEMENT OF WORK

THOSE CONTROLS ARE TO BE MONITORED AND MAINTAINED IN ORDER TO SERVE THEIR INTENDED FUNCTION FOR THE DURATION OF THW WORKS OR UNTIL SUCH TIME AS THE SITE IS FULLY STABILISED, JE ANY CONTROLS ARE DAMAGED OR BECOME INFEFECTIVE DURING THE COURSE OF THE WORKS THEY ARE TO BE REINSTATED OR REPLACED IMMEDIATELY. SUFFICIENT ACCESS TO THESE CONTROLS MUST BE PROVIDED IN CASE OF THE NEED TO REPAIR.

## Sediment Traps

WHERE A SEDIMENT FENCE IS NOT USED APPROPRIATE SEDIMENT TRAPS SHOULD BE LOCATED AT ALL POINTS WHERE STORMWATER LEAVES THE CONSTRUCTION SITE OR LEAVES THE GUTTER AND ENTERS THE DRAINAGE SYSTEM. A COMMON TECHNIQUE IS THE GRAVEL SAUSAGE.

### Diversion Channels

TRUE NORTH:

A DIVERSION CHANNEL IS AN EXCAVATED EARTH DITCH OR PATH. THESE STRUCTURES AREE USED TO INTERCEPT AND DIRECT RUN-OFF TO A DESIRED LOCATION WHERE POSSIBLE.

ALL STORMWATER RUN-OFF FLOWING ONTO DISTURBED AREAS, INCLUDING STOCKPILES, MUST BE INTERCEPTED, DIVERTED AND/OR SAFELY DISPOSED OF. THIS CAN BE ACHIVED BY CONSTRUCTING A TEMPORARY EARTH BANK AROUND THE UPSLOPE EXTENT OF THE CONSTRUCTION SITE WHERE THE DIVERSION DOES NOT AFFECT THE NEIGHBOURING PROPERTIES.


All structures including stormwater & drainage to engineer's details

NOTES

specifications.

Do not obtain dime

local council requirements

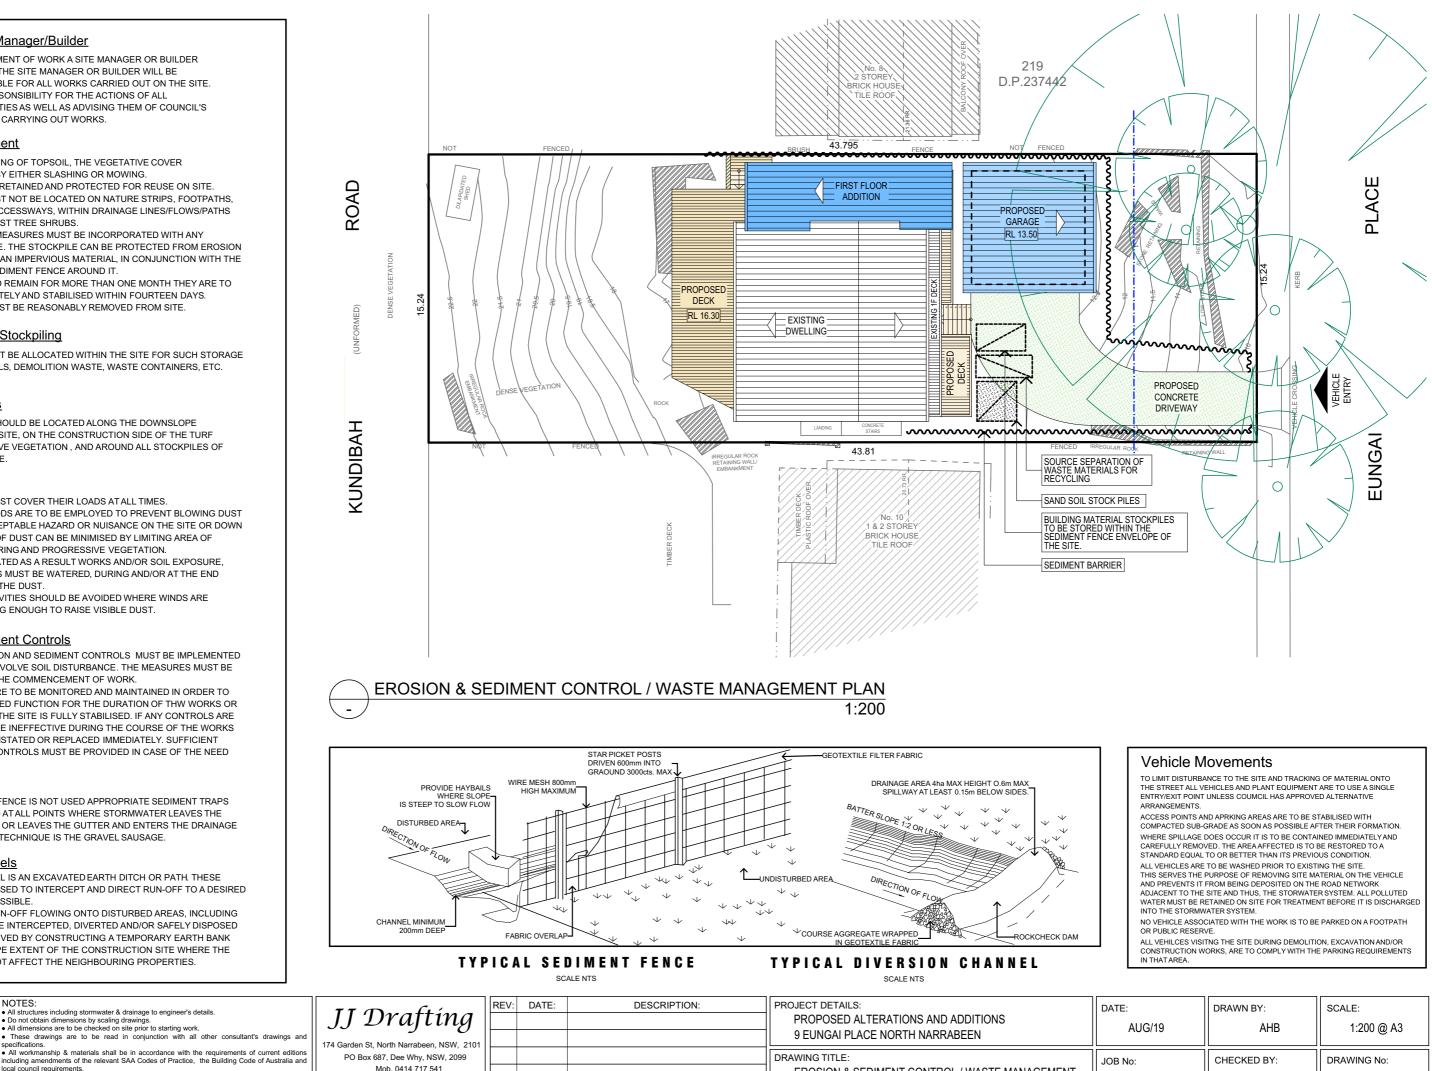

materials are to be used throughout unless otherwise noted. rete footings, slab, structural beams or any other structural members are to be designed by a practicing engineer

Email. jjdraft@tpg.com.au www.ijdrafting.com.au

| 7) ( |  |  | 1  |
|------|--|--|----|
| ~    |  |  | 1  |
| 2101 |  |  |    |
|      |  |  |    |
| 99   |  |  | DR |
|      |  |  | 1  |
|      |  |  | 1  |
|      |  |  | 1  |
|      |  |  | 1  |

| PROJECT DETAILS:<br>PROPOSED ALTERATIONS AND ADDITIONS<br>9 EUNGAI PLACE NORTH NARRABEEN | date:<br>AUG/19   | DRAWN BY:<br>AHB  | SCALE:<br>1:200 @ A3 |
|--|-------------------|-------------------|----------------------|
| <br>DRAWING TITLE:<br>EROSION & SEDIMENT CONTROL / WASTE MANAGEMENT<br>PLAN              | JOB No:<br>721/19 | CHECKED BY:<br>JJ | DRAWING No:<br>DA.12 |