


NOTE:
1. REFER TO PIPE LAYING SPECIFICATIONS FOR DETAILS


PIPE DIA Ø	W	X	Y
100-150	300	75	75
225-300	600	75	75

UPVC DRAINAGE PIPE

TYPICAL PIPE LAYING DETAILS 1:20

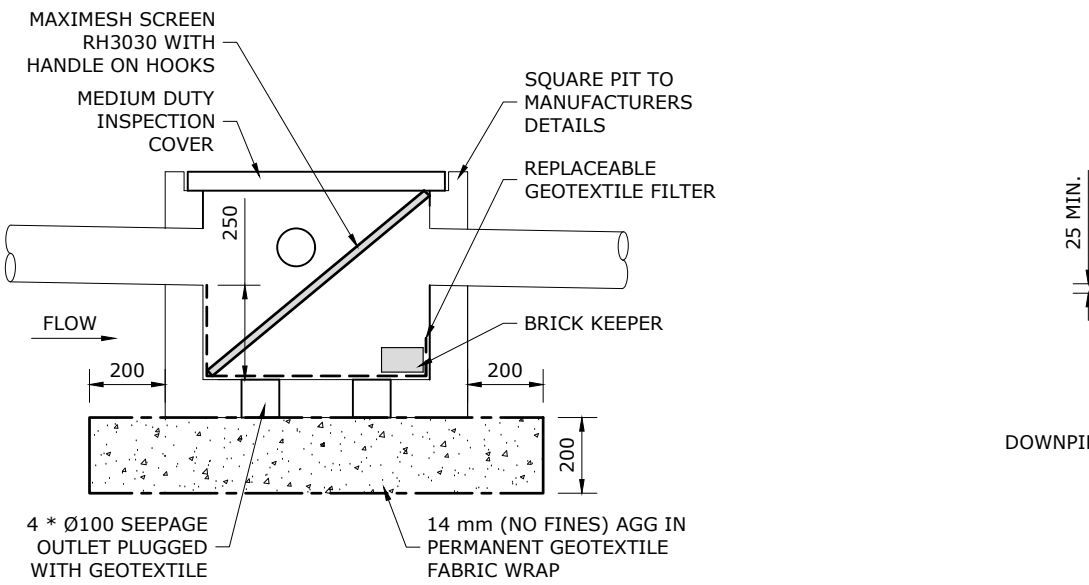


TYPICAL SILT ARRESTOR PIT DETAIL 1:20

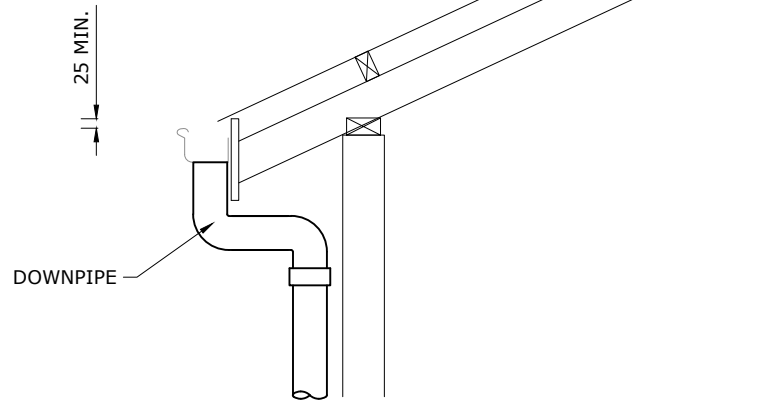

TYPICAL EAVES GUTTER DETAIL 1:20

SITE LOCATION PLAN 1:50

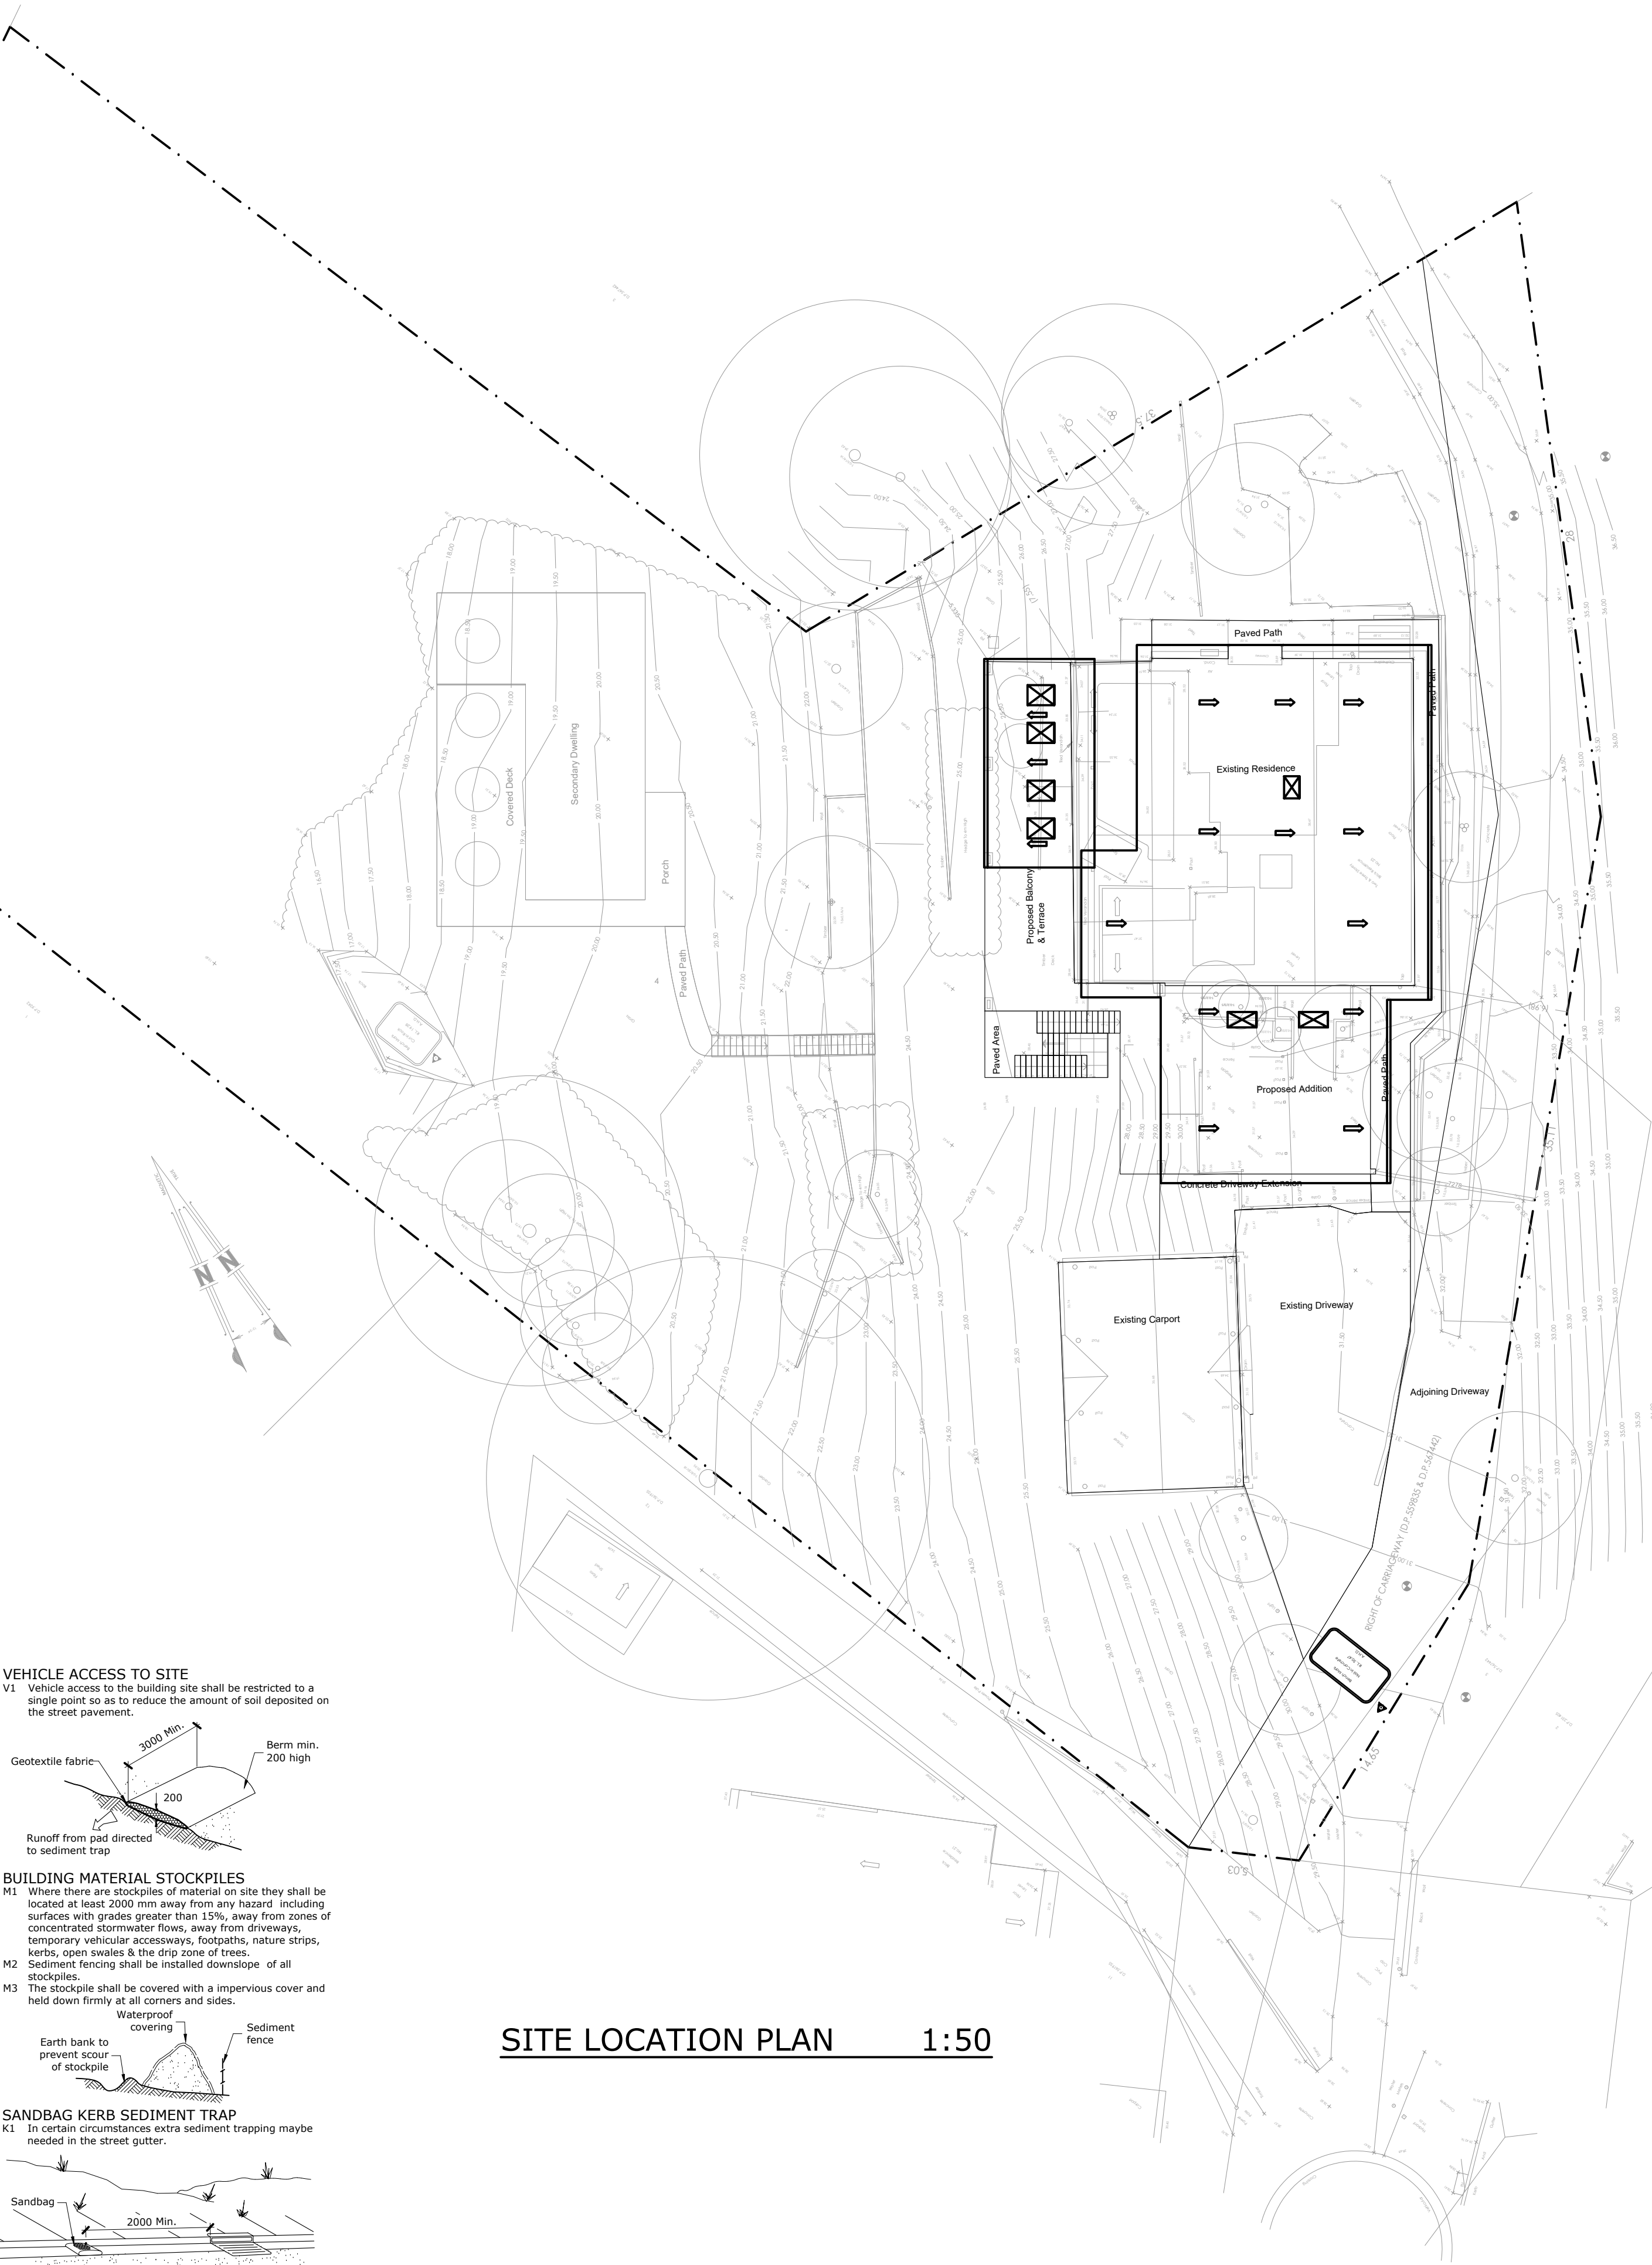

DRAINAGE DESIGN CALCULATIONS:

Council: Northern Beaches Region 1: (Northern)
Site area = 3709.31 m² (0.37093 ha)
Pre-developed impervious area = 1081 m²
Post-developed impervious area = 1089 m²
Increase in impervious area = 8 m² < 40 m²
Site affected by 100 year flood event.
Single residential dwelling with a one off alteration with a net increase of < 40 m² of impervious area.
Therefore OSD is not required.

DRAINAGE LINE NOTE:

All underground pipes and pits shall not disturb tree roots.
All sub-soil drainage shall be installed to BCA requirements and connected to the drainage system.
Drainage line location is indicative and shown for clarity. Exact location subject to change to engineer's approval.
Existing drainage infrastructure shall be clean & in proper working order.
All levels shall be verified by builder on-site prior to commencing.
All charged drainage lines shall be solvent jointed UPVC pipes.

RAINWATER RE-USE:

1. All inlets to rainwater tank to be fitted with first flush device.
2. Gutter guard to be installed on all eaves gutters.
3. Pressure pump/tap to be provided for re-use of captured tank water.
4. A permanent sign to be located in the vicinity of the tank stating the tank is not potable for use.
5. All rainwater services shall be clearly labelled 'Non Potable Water' with appropriate hazard identification.
6. Pipework used for rainwater services shall be coloured purple in accordance with AS1344.
7. All valves and apertures shall be clearly and permanently labelled with safety signs to comply with AS1319.
8. An air gap or a RPZD to be installed to ensure backflow prevention.
9. Rainwater tank, reticulation system and mains top arrangement to be installed in accordance with AS/NZS3500.1.2-2003 and the NSW Code of Practice: Plumbing and Draining.
10. Rainwater tanks shall be plumbed to all garden irrigation systems.

THRESHOLD NOTE:

All new slabs shall have compliant set downs at all thresholds.
Threshold design is the responsibility of the architect and builder to comply with the requirements of the NCC (previously BCA) section 3.1.3.
E2 Design takes no responsibility for structures built without a compliant threshold set down.

GENERAL

- G1 These drawings shall be read in conjunction with the architectural and other consultants' drawings / specifications and with other such written instructions as may be issued during the construction. Any discrepancy shall be referred to the Engineer before commencing the work.
- G2 All dimensions are in millimeters, UNO (unless noted otherwise).
- G3 These drawings shall not be scaled, refer to dimensions given only or refer to the Architectural drawings.
- G4 All levels and setting out dimensions shown on the drawings shall be checked on site prior to the commencement of the work.
- G5 During construction the structure shall be maintained in a stable condition with no part being overstressed.
- G6 Existing services, where shown, have been drawn based on supplied information and as such their accuracy can not be guaranteed. It is the responsibility of the contractor to determine their exact location prior to the commencement of work.
- G7 All service trenches under vehicular pavements shall be back filled in accordance with the respective authorities requirements.
- G8 All trench backfill material shall be compacted to the same density as the surround material.
- G9 All site disturbed areas shall be reinstated to the original condition, including kerbs, footpaths, concrete areas, gravel and grassed areas, etc.
- G10 It is the contractor responsibility to obtain all authority approvals.

STORMWATER DRAINAGE

- S1 The stormwater drainage design has been carried out in accordance with AS / NZS 3500.3 "Stormwater Drainage" & AS / NZS 3500.2.3 "Stormwater Drainage - Acceptable Solutions".
- S2 Any variations to the design levels shall be referred to the engineer immediately for approval.
- S3 Any variations to specified products or details shall be referred to the engineer for approval prior to the commencement of work.
- S4 Subsoil drainage shall be provided to all retaining walls & embankments. They shall be a minimum of Ø100 slotted pipe in filter sock surrounded by crushed rock. They shall drain to the stormwater drainage system.

SEDIMENT & EROSION CONTROL NOTES

- E1 The sediment & erosion controls shall be maintained effectively for the duration of the project. They shall not be removed until the site has been stabilized or landscaped to the principal certifying authorities satisfaction.

- E2 A single all weather access way shall be provided at the front of the property consisting of 50-80 mm aggregate or similar material with a minimum thickness of 150 mm laid over needle-punched geotextile fabric (Bdim A14 or similar) and installed prior to any works being commenced on site.

- E3 Where the building works are greater than a single dwelling development, a shaker pad must be installed as part of the vehicular accessway. The shaker pad shall be:
- Established on suitable prepared & compacted material.
- Constructed such that it is flush with the adjoining surfaces.
- A minimum of 5000 mm in length and breadth.
- Designed with rungs spaced 200-250 mm apart & with a maximum width of 75 mm each.

- E4 The contractor shall ensure that no spoil or fill encroaches upon adjacent areas during the project.
- E5 The contractor shall ensure that all kerb inlets and drains affected by stormwater flow from the site are protected at all times during the project. Kerb inlet sediment traps shall be installed along the immediate vicinity along the street frontage. These shall be regularly maintained during the project.
- E6 The street / road shall be kept clean from dirt and debris from vehicles departing the site.
- E7 Sediment fencing shall be secured to posts (please note that if star pickets or similar are used then plastic safety caps shall be installed on top of the posts) at 2000 mm intervals with the geotextile fabric embedded a minimum of 200 mm in to the soil.
- E8 All the topsoil stripped from the site shall be stockpiled such that it does not interfere with drainage lines and stormwater inlet pits. The stockpile shall be suitably covered with an impervious membrane and screened by sediment fencing.

SOIL CONSERVATION NOTE:


- C1 Sediment trap shall be provided to capture water borne sediments:
- Sediment fencing
- Sediment trap
- Washout area
- C2 These shall be maintained regularly during the course of the construction with the sediment trap cleaned after each storm event.

SEDIMENT TRAP

- T1 A 1000 x 1000 mm square by 500 mm deep pit located at the lowest point of the site.


WASHOUT AREA

- W1 The washout area shall be 1800 x 1800 mm allocated for the washing of tools & equipment in accordance with the detail below:

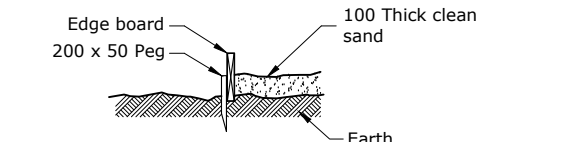


SEDIMENT FENCE

- F1 Provide sediment fence on down slope boundary as shown on plan.
- F2 Geotextile fabric to be buried 200 mm below ground at the lower edge.

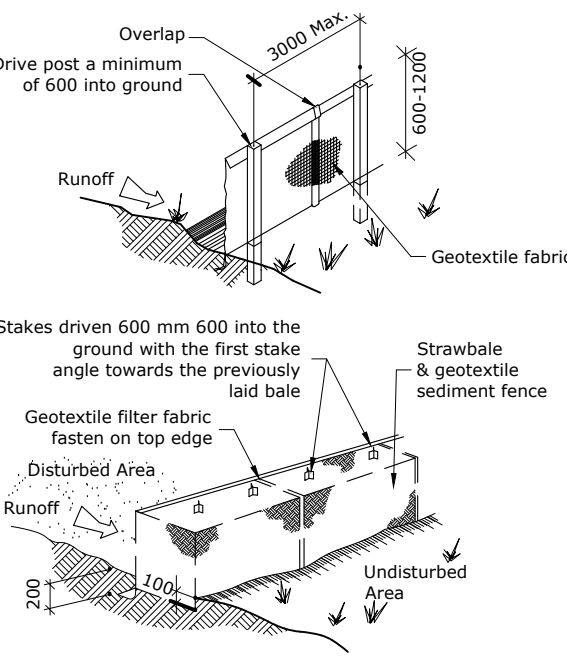

VEHICLE ACCESS TO SITE

- V1 Vehicle access to the building site shall be restricted to a single point so as to reduce the amount of soil deposited on the street pavement.

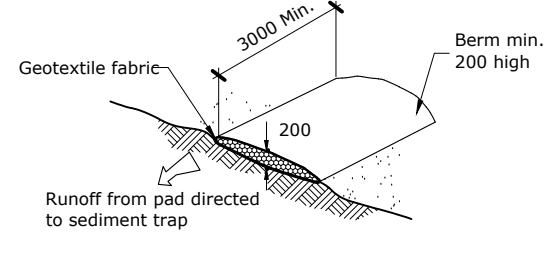


BUILDING MATERIAL STOCKPILES



- M1 Where there are stockpiles of material on site they shall be located at least 2000 mm away from any hazard including surfaces with grades greater than 15%, away from zones of concentrated stormwater flows, away from driveways, temporary vehicular accessways, footpaths, nature strips, kerbs, open swales & the drip zone of trees.
- M2 Sediment fencing shall be installed downslope of all stockpiles.
- M3 The stockpile shall be covered with a impervious cover and held down firmly at all corners and sides.



SANDBAG KERB SEDIMENT TRAP

- K1 In certain circumstances extra sediment trapping may be needed in the street gutter.

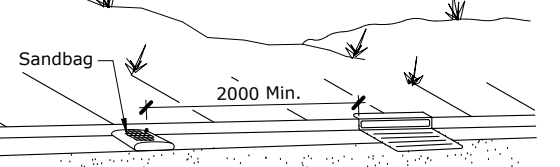

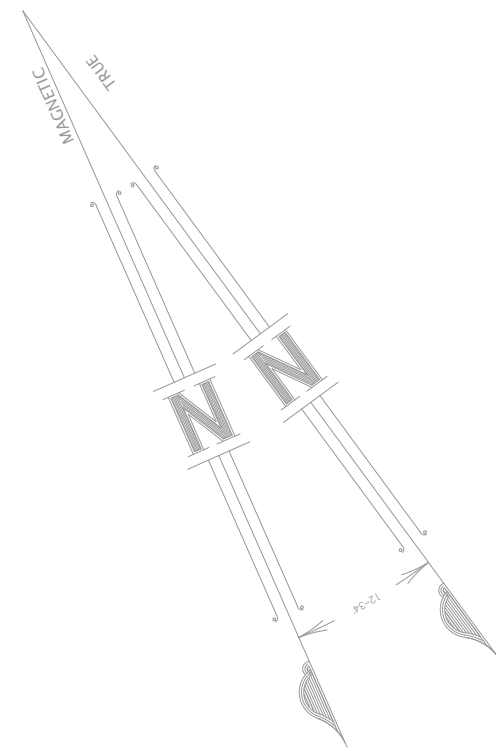



CONCEPT ROOF DRAINAGE PLAN 1:100

- All drainage lines shall be UPVC (Class SH) Stormwater Drainage Pipe, UNO.
- All drainage lines shall be laid @ 1% min fall, UNO.
- DP = Down Pipe


DOWNPIPE & GUTTER SCHEDULE		
MARK	GUTTER SIZE	DP
GS1	150 Half Round Eaves Gutter	Ø100 or 100x75

NOTE: All Gutter Systems shall be GS1, UNO.


REV	APP.	AMENDMENT DESCRIPTION	DATE
COPYRIGHT E2 Civil And Structural Design Pty Ltd is the owner of the copyright subsisting in these drawings, plans, designs and specifications. They must not be used, reproduced or copied in whole or in part without prior written consent of E2 Civil And Structural Design Pty Ltd. Design is not certified unless signed.			
P.O. Box 608 WAVERLEY NSW 2024 p 02 8594 6111 f 02 8089 1051 info@E2design.com.au www.E2design.com.au ACN 145 358 265			
E2 CIVIL AND STRUCTURAL DESIGN PTY LTD			
PROPOSED ALTERATIONS 23 BAROONA ROAD CHURCH POINT NSW 2105			
KONAREVA			
Concept Roof Drainage Plan			
SCALE: 1:100	DATE: 21 Sep 2021	DESIGN: DB	REV: 0
JOB: 21.405	DRW: SW2	SIGNED:	

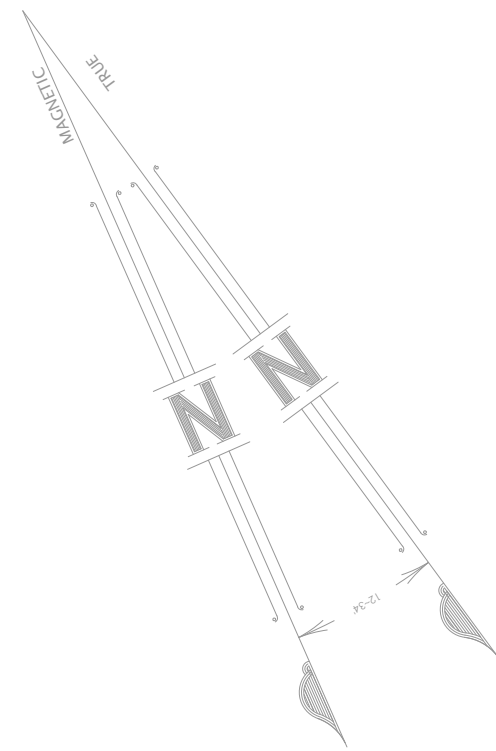**CONCEPT FIRST FLOOR DRAINAGE PLAN 1:100**

- All drainage lines shall be UPVC (Class SH) Stormwater Drainage Pipe, UNO.
- All drainage lines shall be laid @ 1% min fall, UNO.
- DP = Down Pipe
- EDP = Existing Down Pipe

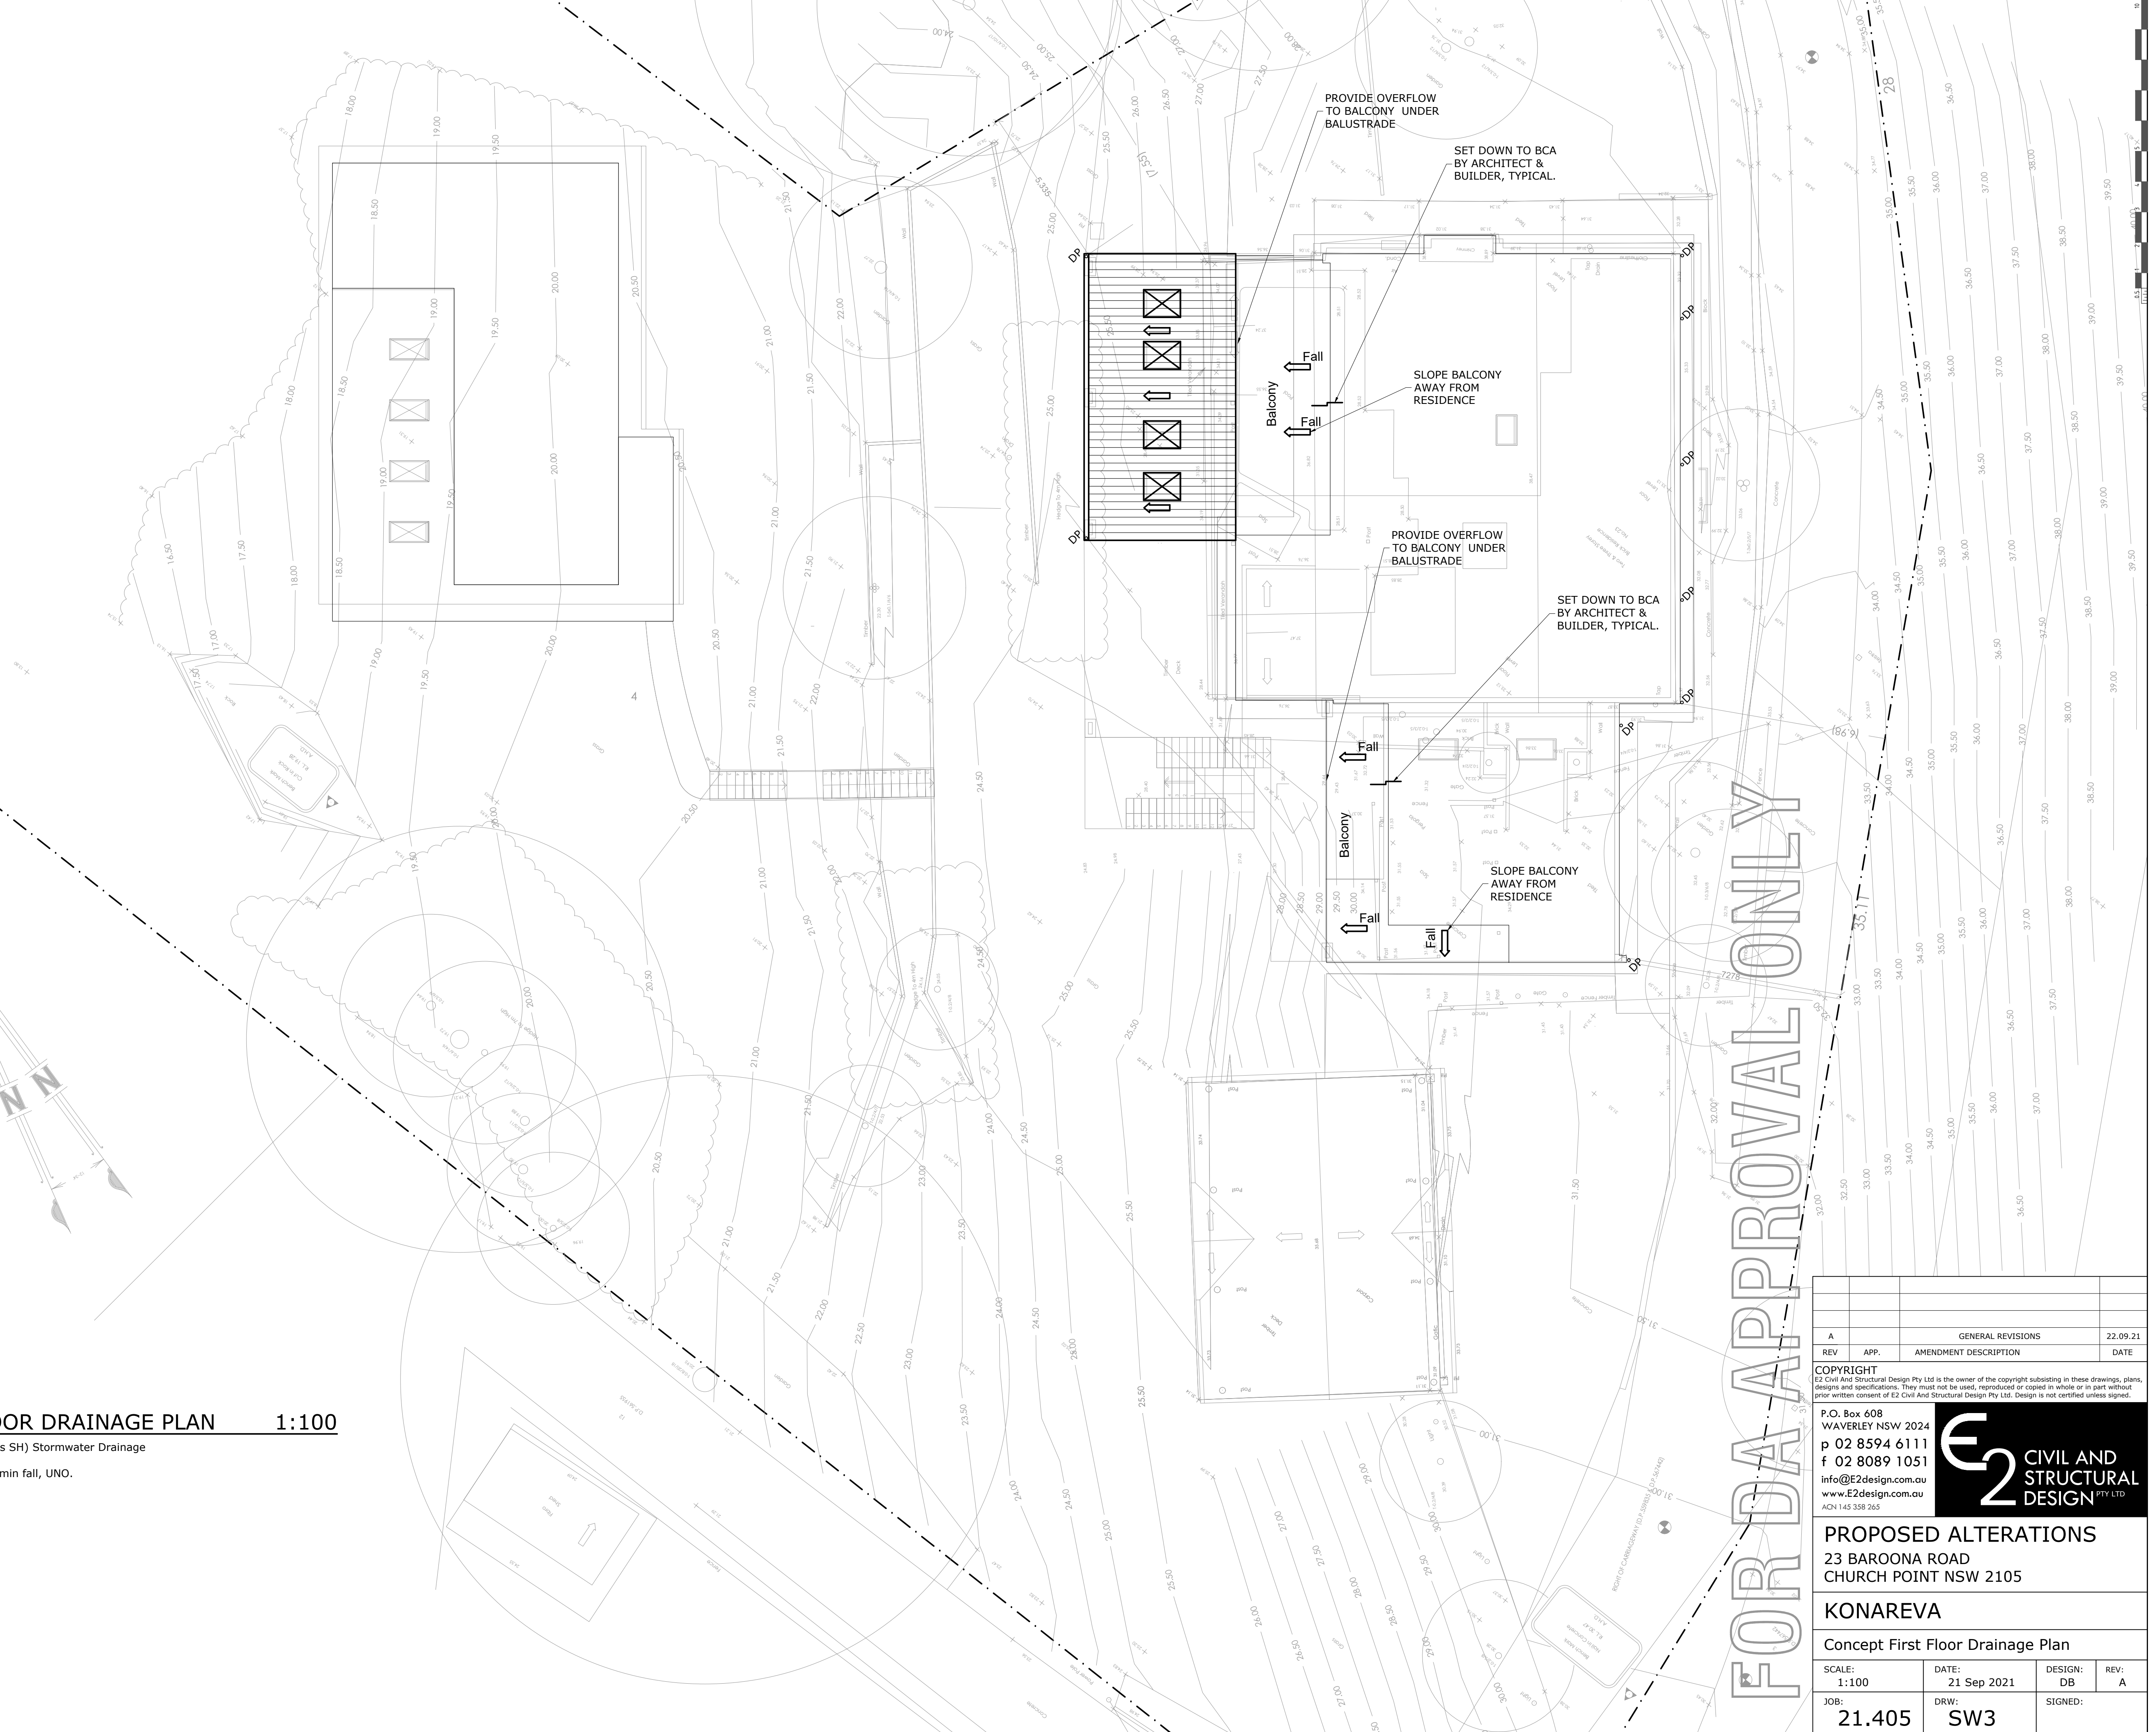

A	GENERAL REVISIONS		22.09.21
REV	APP.	AMENDMENT DESCRIPTION	DATE
COPYRIGHT			
E2 Civil And Structural Design Pty Ltd is the owner of the copyright subsisting in these drawings, plans, designs and specifications. They must not be used, reproduced or copied in whole or in part without prior written consent of E2 Civil And Structural Design Pty Ltd. Design is not certified unless signed.			
P.O. Box 608 WAVERLEY NSW 2024 p 02 8594 6111 f 02 8089 1051 info@E2design.com.au www.E2design.com.au ACN 145 358 265			
E2 CIVIL AND STRUCTURAL DESIGN PTY LTD			
PROPOSED ALTERATIONS			
23 BAROONA ROAD CHURCH POINT NSW 2105			
KONAREVA			
Concept First Floor Drainage Plan			
SCALE: 1:100	DATE: 21 Sep 2021	DESIGN: DB	REV: A
JOB: 21.405	DRW: SW3	SIGNED:	



EXISTING DISCHARGE LINE ASSUMED TO DISCHARGE TO BUSHLAND AND CREEK. PRESENT IN GOOD WORKING CONDITION.

PLUMBER TO CONFIRM ADEQUACY AND CONDITION OF EXISTING LINE WITH HYDRAULIC ENGINEER. NEED FOR UPGRADE TO ENGINEER'S DISCRETION.

2x 2500L RAINWATER TANKS TO BE CONNECTED IN SERIES BY PLUMBER.

PLUMBER TO CONFIRM SIZE OF EXISTING INLET PIT. IF PIT IS UNDERSIZED, UPGRADE TO A 450 SQ. SILT ARRESTOR PIT.

PLUMBER TO CONNECT RAINWATER TANK OVERFLOW TO EXISTING INLET PIT.

SLOPE BALCONY & TERRACE AWAY FROM RESIDENCE.

SET DOWN TO BCA BY ARCHITECT & BUILDER, TYPICAL.

ADDITIONAL GROUND DRAINAGE TO FUTURE DETAIL IF REQUIRED BY HYDRAULIC ENGINEER.

ENSURE ALL EXTERNAL AREAS ARE MINIMUM 150MM BELOW ADJACENT INTERNAL FFL, TYPICAL.

PLUMBER TO CONFIRM EXISTING DRAINAGE LINE IS IN CLEAN & WORKING ORDER. ELSE REPLACE WITH NEW Ø100 UPVC GRAVITY DRAINAGE LINE.

PLUMBER TO CONFIRM EXISTING STRIP DRAIN IS IN CLEAN & WORKING ORDER. ELSE REPLACE WITH NEW 150 WIDE GRATED STRIP DRAIN.

CONCEPT GROUND FLOOR DRAINAGE PLAN 1:100

- All drainage lines shall be UPVC (Class SH) Stormwater Drainage Pipe, UNO.
- All drainage lines shall be laid @ 1% min fall, UNO.
- DP = Down Pipe
- EDP = Existing Down Pipe

DRAWING KEY:

- Existing Ø100 UPVC Gravity Drainage Line
- Ø100 UPVC Gravity Drainage Line
- Ø150 UPVC Gravity Drainage Line
- Existing Stormwater Drainage Line TBC

GENERAL REVISIONS			
REV	APP.	AMENDMENT DESCRIPTION	DATE
A			22.09.21
COPYRIGHT			
E2 Civil And Structural Design Pty Ltd is the owner of the copyright subsisting in these drawings, plans, designs and specifications. They must not be used, reproduced or copied in whole or in part without prior written consent of E2 Civil And Structural Design Pty Ltd. Design is not certified unless signed.			
P.O. Box 608 WAVERLEY NSW 2024 p 02 8594 6111 f 02 8089 1051 info@E2design.com.au www.E2design.com.au ACN 145 358 265			
E2 CIVIL AND STRUCTURAL DESIGN PTY LTD			
PROPOSED ALTERATIONS			
23 BAROONA ROAD CHURCH POINT NSW 2105			
KONAREVA			
Concept Ground Floor Drainage Plan			
SCALE: 1:100	DATE: 21 Sep 2021	DESIGN: DB	REV: 0
JOB: 21.405	DRW: SW4	SIGNED:	