

27 July 2023

Our ref: JOE/S1589

Charlie McKill

Via email: charlie@avenueonedesign.com.au

Proposed Knockdown Rebuild – 272 Whale Beach Road, Whale Beach, NSW

Site Classification & Slope Stability Risk Assessment Report

1 Introduction

1.1 PROJECT DESCRIPTION

At the request of Charlie McKill, Fortify Geotech Pty Ltd carried out a site classification in accordance with AS2870 “Residential Slabs & Footings”, and a qualitative slope instability risk assessment for the proposed knockdown rebuild at 272 Whale Beach Road, in Whale Beach.

Due to steep slopes in the vicinity of the proposed site, a geotechnical site classification and slope instability risk assessment is required.

To establish the site subsurface conditions, a handheld hydraulic push-tube was used to excavate two boreholes on the property. Borehole 1A was drilled at the front of the property, and borehole 2A was drilled at the rear of the property. The subsurface profile was logged in accordance with the Unified Soil Classification System (USCS) and the logs are attached to the end of this report. Dynamic Cone Penetrometer (DCP) testing was conducted near the location of borehole 1A. Figure 2 is an aerial photograph showing the approximate borehole locations.

1.2 SITE DESCRIPTION AND GEOLOGY

The site is located on 272 Whale Beach Road, Whale Beach, NSW. The ~700m² site is presently occupied by an existing residence towards the southern end of the block. The northern side of the block is covered by thick vegetation with visible sandstone bedrock. The site dips to the south at ~36°. There is no evidence of deep existing site cuts or large-scale placement of fill. Figure 1 shows the site locality, whilst Figure 2 is a recent aerial photograph which also shows the approximate borehole locations.

Local Geology maps (Reference 1) indicate the area to be underlain by Triassic age, Hawkesbury Sandstone, which consists medium to coarse grained quartz sandstone, very minor shale, and laminitic lenses.

1.3 SCOPE OF INVESTIGATION

The aim of the investigation was to:

- Identify subsurface conditions including extent and nature of any fill materials, soil strata, bedrock type and depth, and groundwater presence.
- Provide a site classification to AS2870 “Residential Slabs & Footings”.
- Recommend suitable footing systems for the buildings including types, founding depths and allowable bearing pressures.
- Conduct a slope instability risk assessment
- Advise on excavation conditions and suitability of excavated materials for use as structural fill.
- Advise on site drainage

The assessment required the development of a qualitative matrix risk assessment to people and property, in accordance with the guidelines of “Landslide Risk Management Concepts and Guidelines”, Australian Geomechanics Journal, 2007. In this instance, the residents of the house are considered as “people” and the proposed alterations and additions, as well as the surrounding houses and highway were considered as “property”.

The slope stability assessment is qualitative, based on the guidelines on landslide risk management published by the Australian Geomechanics Society. Risk assessment involves the following components: (i) Hazard identification, (ii) Likelihood of Hazards Occurring, (iii) Consequences of Hazards, and (iv) Significance of Risks. This uses a matrix approach to determine the risk level of each hazard based on the likelihood and consequences of each hazard occurrence.

2 Investigation Results

2.1 SUBSURFACE CONDITIONS

The subsurface conditions of the proposed development were investigated by two boreholes designated 1A and 2A. Borehole 2A was conducted just behind a 0.6m high retaining wall. The borehole logs in Appendix A can be referred to for more detail.

Investigation boreholes 1A and 2A found the subsurface profile to comprise:

TABLE 1 – Subsurface Conditions

| Geological Profile | Depth Interval | Description |
|--------------------|----------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| TOPSOIL | 0m to 0.05m/0.2m | SILTY SAND, SANDY SILT; fine to medium grained sand, fine to coarse grained sand, dark brown, brown, trace fine sized gravel, moist to wet, moist, loose, |
| COLLUVIUM | 0.05m to 0.4/0.65m | SANDY CLAY, SILTY SAND; fine to medium grained sand, medium to high plasticity clay, pale yellow, grey mottled orange, brown, trace medium plasticity clay, moist to wet, moist, firm to stiff, stiff, soft to firm, loose. |
| RESIDUAL | 0.4m/0.65m to >1.15m | SANDY CLAY, CLAYEY SAND, CLAY, GRAVELLY CLAY; fine to medium grained sand, low to medium plasticity clay, medium plasticity clay, medium to high plasticity clay, orange and grey, orange, pale grey mottled orange, dry to moist, dry, stiff, medium dense firm. |

2.2 DYNAMIC CONE PENETROMETER (DCP) TESTING

To determine the density/relative consistency of the subsurface profile, a Dynamic Cone Penetrometer (DCP) test was conducted on 19th July 2022 in accordance with AS1289.6.3.2 "Determination of the penetration resistance of a soil – 9kg dynamic cone penetrometer test". The DCP result is shown in Table 2 below. The DCP test was taken from the base of borehole 1A, starting at 1.5m depth. The approximate location of the DCP test is shown in Figure 2.

TABLE 2 - DCP Testing Results

| Depth below existing groundsurface (m) | Blows per 100mm penetration DCP 1 |
|-------------------------------------------|-----------------------------------------|
| 1.5 | 16 |
| 1.6 | 28 |
| 1.7 | 25 |

2.3 GROUNDWATER

Permanent groundwater was not encountered in the investigation boreholes. However, temporary perched seepages could be encountered at shallower depths following rainfall within the more previous soils.

3 SLOPE INSTABILITY RISK ASSESSMENT

3.1 METHOD OF RISK ASSESSMENT

The following sections of the report outline the slope instability risk assessment carried out for the site. The assessment is qualitative, based on the guidelines provided in the Australian Geomechanics Journal Vol 42 March 2007, and has been adopted by the NSW Department of Infrastructure, Planning and Natural Resources. This uses a matrix approach to determine the risk level of each hazard based on the likelihood and consequences of each hazard occurring.

Risk assessment involves the following components:

- (i) Identification on the potential site slope hazards that may damage property and/or cause loss of life (Hazard Identification).
- (ii) Estimation of the likelihood of each hazard occurring (Likelihood of Hazards Occurring).
- (iii) Assessment of the potential consequences to property and people of these hazards occurring (Consequences of Hazards).
- (iv) Evaluation of the significance of the assessed risks against criteria of acceptability (Significance of Risks).

Following the risk assessment, options for the treatment of the risk are provided as a guide to the owner, administrator and regulatory authorities who will need to decide whether to avoid or accept the risk, or to treat the site to reduce the likelihood and/or consequences of the hazards.

A flowchart, included in the Australian Geomechanics Journal, Vol 42, March 2007, paper on "Landslide Risk Management Concept & Guidelines" 2007 (Reference 2), which shows the processes of risk assessment/risk management is copied here in Appendix D. Appendix E provides guidelines for hillside construction.

3.2 HAZARD IDENTIFICATION

The potential hazards to slope stability at this site were considered, and includes:

- Large Scale Translational Slide
- Small Scale Slumps in the Soil Profile
- Surface Erosion
- Failure of Retaining Wall
- Large Rockfall from Upslope

3.3 LIKELIHOOD OF HAZARDS OCCURRING

3.3.1 Large Scale Translational Slide

There have been a few landslips have been recorded in the vicinity of 272 Whale Beach Road. Moreover, the Whale Beach area has been reported to have more landslides per property than the average for the Pittwater LGA, suggesting an increased slope stability risk for the region compared to other suburbs in the Pittwater LGA (Reference 3). The existing trees on the slope are mostly vertical, with little to no slanted growth. There is no evidence of cracking in the exterior structure of the existing residence, and other residential structures have been constructed on the surrounding blocks on steeper slopes. For a large-scale slide to happen there would need to be a combination of unfavourable triggering conditions such as earthquakes, extreme rainfall, saturated soils, mass clearance of vegetation, unsupported excavations etc. Given the steep slope and history of slope instability in this geological formation, such an event is considered to be "Possible".

3.3.2 Small-Scale Slumps in the Soil Profile

Under adverse site conditions, such as when site soils are saturated, small slumping failures of the soils could conceivably occur. However, as there does not appear to have any slippages or slumps in the past, such an event is "Possible".

3.3.3 Failure of Retaining Wall

The cuts to be constructed on the block will be supported by well-drained, properly designed and constructed engineered retaining walls. As no failures or cracking was observed on current structures on the property, the likelihood or a properly drained and constructed retaining wall failure is judged to be "Unlikely".

3.3.4 Surface Erosion

There are presently no signs of surface scouring on the block, probably in part due to the surface vegetation and good surface drainage. Nevertheless, the upper soils are quite silty, so if the vegetation was removed and surface water flow-paths were allowed to develop, surface erosion is "Unlikely".

3.3.5 Rock Fall from Upslope

Large rockfalls from upslope may have occurred in the past indicated by the presence of some large boulders around the existing residence and in the surrounding properties. However, given the large amount of development upslope of the site, the risk is reduced. Therefore, this event is "Unlikely".

3.4 CONSEQUENCES OF HAZARDS OCCURRING

3.4.1 Large-Scale Translational Slide

Theoretically, a large-scale slide could occur with little or no warning, and the consequences to property and people would depend on the volume of the slide material, its velocity, and whether or not people are present, or in the downslope dwelling at the time. Using the AGS table of qualitative measures of vulnerability and consequences in Appendix C, we consider the consequences of such a rare event to be “Medium”, i.e. Theoretically, there is the possibility of a fatality in the dwelling and/or the imposition of moderate damage to some of the structure in the rare event of this occurring.

3.4.2 Small-Scale Slumps in the Soil Profile

The consequence to the proposed development of a small-scale slump occurring in the soil is believed to be “Minor” considering the relatively low loads expected from the structure. However, the slope uphill or downhill might be affected, and some material may slough onto the downslope structure. The chance or temporal probability of persons being in the area during an earth slump is low, and therefore the risk of loss of life is low. The consequences for persons is therefore rated as “Minor”.

3.4.3 Failure of a Retaining Wall

If a retaining wall failed, damage may well result to the structure, depending on many factors. In general, the consequences can be rated as “Minor to Medium”. The chance of persons being injured or of loss of life is low and the consequences to persons are therefore also rated as “Minor to Medium”.

3.4.4 Surface Erosion

If such an event develops and occurs, small cobbles/boulders may wash out of erosion gully slides and rolled downhill. The consequential damage to a structure would be “Minor”.

3.4.5 Rockfall from upslope

The top of the hill is >300m to the north-west of the site with multiple other properties and residential roads in between. Therefore, any rockfalls that do occur will have slowed in velocity by the time it reaches the property or be protected by developments uphill. Therefore, the consequences are assessed as “Minor”.

3.5 RISK ESTIMATION

A summary of estimated risk to property and life for each of the potential hazards identified in the previous sections is provided in Table 2. The resulting risk level was derived using the AGS risk analysis matrix presented in Appendix C.

TABLE 2: Risk Analysis Summary

| Potential Hazard | Assessed Likelihood | Assessed Consequences | Risk Level |
|---------------------------------|---------------------|--------------------------------------------|------------|
| Large-Scale Translational Slide | Possible | To Dwelling - Medium | Moderate |
| | | To People in/adjacent to dwelling – Medium | Moderate |
| Small-Scale Slumps in Soil | Possible | To Dwelling - Minor | Moderate |
| | | To People in/adjacent to dwelling - Minor | Moderate |
| Failure of Retaining Wall | Unlikely | To Dwelling – Minor to Medium | Low |
| | | To People in/adjacent to dwelling – Minor | Low |
| Surface Erosion | Unlikely | To Dwelling - Minor | Low |
| | | To People in/adjacent to dwelling - Minor | Low |
| Rock Fall | Unlikely | To Dwelling –Minor | Low |
| | | To People in/adjacent to dwelling –Minor | Low |

3.6 SIGNIFICANCE OF RISKS (RISK EVALUATION)

Risk evaluation is the process by which owners, administrators and relevant regulatory authorities can decide whether the potential risks (See Table 2) are acceptable, and/or whether these can be feasibly eliminated or reduced by remedial treatment. Implications of each level of risk are described in Appendix C.

In this case, the overall risk to property and people is assessed to be “Low” to “Moderate”. Provided design and construction of the structure is undertaken in accordance with accepted procedures for hillside construction, and treatments are carried out to reduce the potential hazards, the risk is no higher than normally acceptable for residential development.

3.7 RISK TREATMENT

To maintain and/or reduce the risk level of slope stability during the construction of the residence and subsequent occupation, the following measures are recommended to be implemented:

- Ensure footings are founded on competent material, preferably weathered bedrock.
- Limit cut-to-fill earthworks.
- All retaining walls should be properly designed and constructed, and positively drained.
- Maintain adequate drainage of the site and ensure drains are free-flowing.
- Where possible, maintain the existing vegetation cover.
- Periodic inspection of the slope uphill for signs of erosion developing, and remediate as necessary.

Some useful guidelines on hillside construction, prepared by the Australian Geomechanics Society, are presented in Appendix E.

4 Site Classification

Since the site is located within a landslip zone, the site is designated as Class “P” (problem) site in accordance with AS2870 “Residential Slabs & Footings”. Footings should be founded in bedrock or ‘massive’ sandstone boulders using piers. However, sandstone bedrock was not encountered in the investigation, thus would be expected at depths of >1.6m. The characteristic ground surface movement “ Y_s ”, as defined by AS2870 for the range of extreme dry to extreme wet moisture conditions is estimated to be between 20mm and 40mm. The site can therefore be treated as Class “M” (moderately reactive).

Deemed-to-comply footing designs provided by AS2870 are applicable specifically to residential-style one and two-storey structures, or buildings with similar loads and superstructure stiffness.

5 Structure Footings

AS2870 (Reference 4) provides “deemed-to-comply” footing/slab designs, which for a class “M” site includes stiffened rafts, stiffened footing slabs, waffle rafts, and strip and/or pad footings with above ground floors. Footings and slabs should be in accordance with the principles of AS2870.

Footings including thickened sections of slabs forming footings should be taken below the fill material and founded in stiff to very stiff residual soils or weathered bedrock, which can be expected below 1.6m depth. It is strongly recommended that footings founded in the underlying bedrock should be used, however this was not encountered in the investigation.

Recommended allowable end-bearing pressures and shaft adhesion values for various footing systems and likely foundation materials are provided in Table 3.

Table 3 – Recommended Allowable End-Bearing Pressures for Footings

| Foundation Material Type | Depth Below Existing Surface Level | Allowable End-Bearing Pressure | | | Allowable Shaft Adhesion on Bored Piers and Anchors | |
|------------------------------------------------|------------------------------------|--------------------------------|--------|-------------|-----------------------------------------------------|--------|
| | | Strips | Pads | Bored Piers | Downward Loading | Uplift |
| Newly Placed Controlled Fill | - | 100kPa | 125kPa | N.A | N.A | N.A |
| Stiff Residual Soils | ~0.6m/0.65m | 100kPa | 125kPa | 150kPa | 15kPa | 7kPa |
| Highly Weathered (HW) Sandstone Bedrock | >1.6m | 500kPa | 600kPa | 750kPa | 75kPa | 32kPa |

It is recommended that footings are inspected by a geotechnical engineer prior to the pouring of concrete to ensure that footings are founded in adequate material.

6 Excavation Conditions & Use of Excavated Material

It is understood that only shallow excavations will be required. The excavations will be through topsoil, residual clays and possibly into weathered sandstone bedrock and boulders. The fill material is readily diggable by backhoe and medium sized excavator to at least 1.15m/>1.6m depth. Moderately weathered and less weathered bedrock could be encountered below 1.15m/1.6m depth and would require heavy excavator, bulldozer ripping and rock hammering, as well as any large sandstone boulders

Any low/medium plasticity colluvial and residual soils can be used in controlled fill construction of building platforms. Topsoil and existing uncontrolled fill material should not be used in controlled fill construction, however, it can be used for landscaping.

If imported fill is required, a suitable select fill material would include a low or medium plasticity soil such as clayey sand or gravelly clayey sand, containing between 25% and 50% fines less than 0.075mm size (silt and clay), and no particles greater than 75mm size.

7 Site Drainage

Permanent groundwater was not encountered during the investigation. The permanent groundwater table is expected to be below the proposed excavations. Temporary perched seepages may be present following rain, but should be readily controllable using pumps during construction.

Suitable surface drainage should be provided to ensure rainfall run-off or other surface water cannot pond against buildings or pavements. Drainage should be provided behind all retaining walls, and subsoil drains should be installed along the upslope sides of access roads and carparks.

Should you require any further information, please contact our office.

Yours faithfully,

Fortify Geotech Pty Ltd

Written by;




Jerome Sami
Geotechnical Engineer

Reviewed by;




Jeremy Murray
Director - Senior Geotechnical Engineer
FIEAust CPEng EngExec RPEQ NER APEC Engineer
IntPE(Aust)

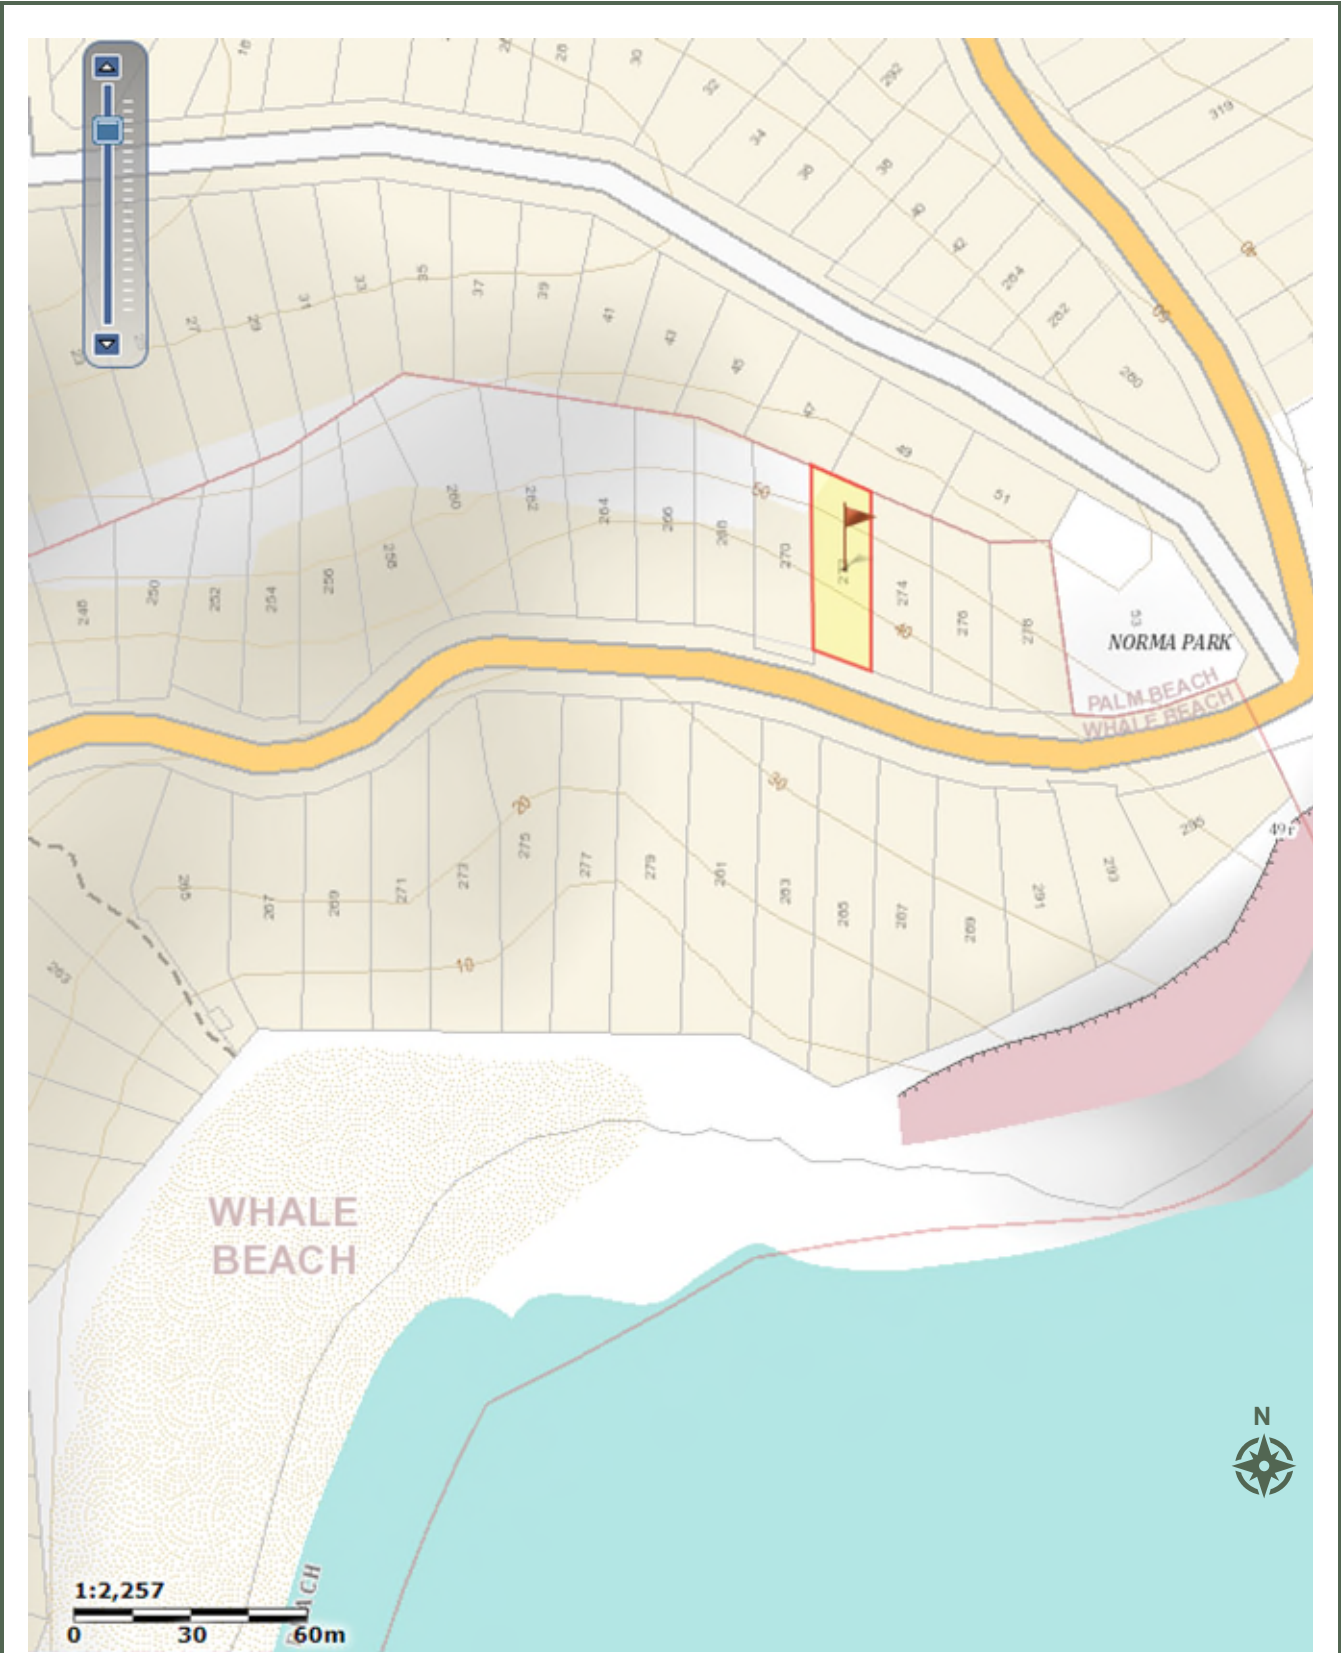

SITE LOCALITY

S1589

FIGURE 1

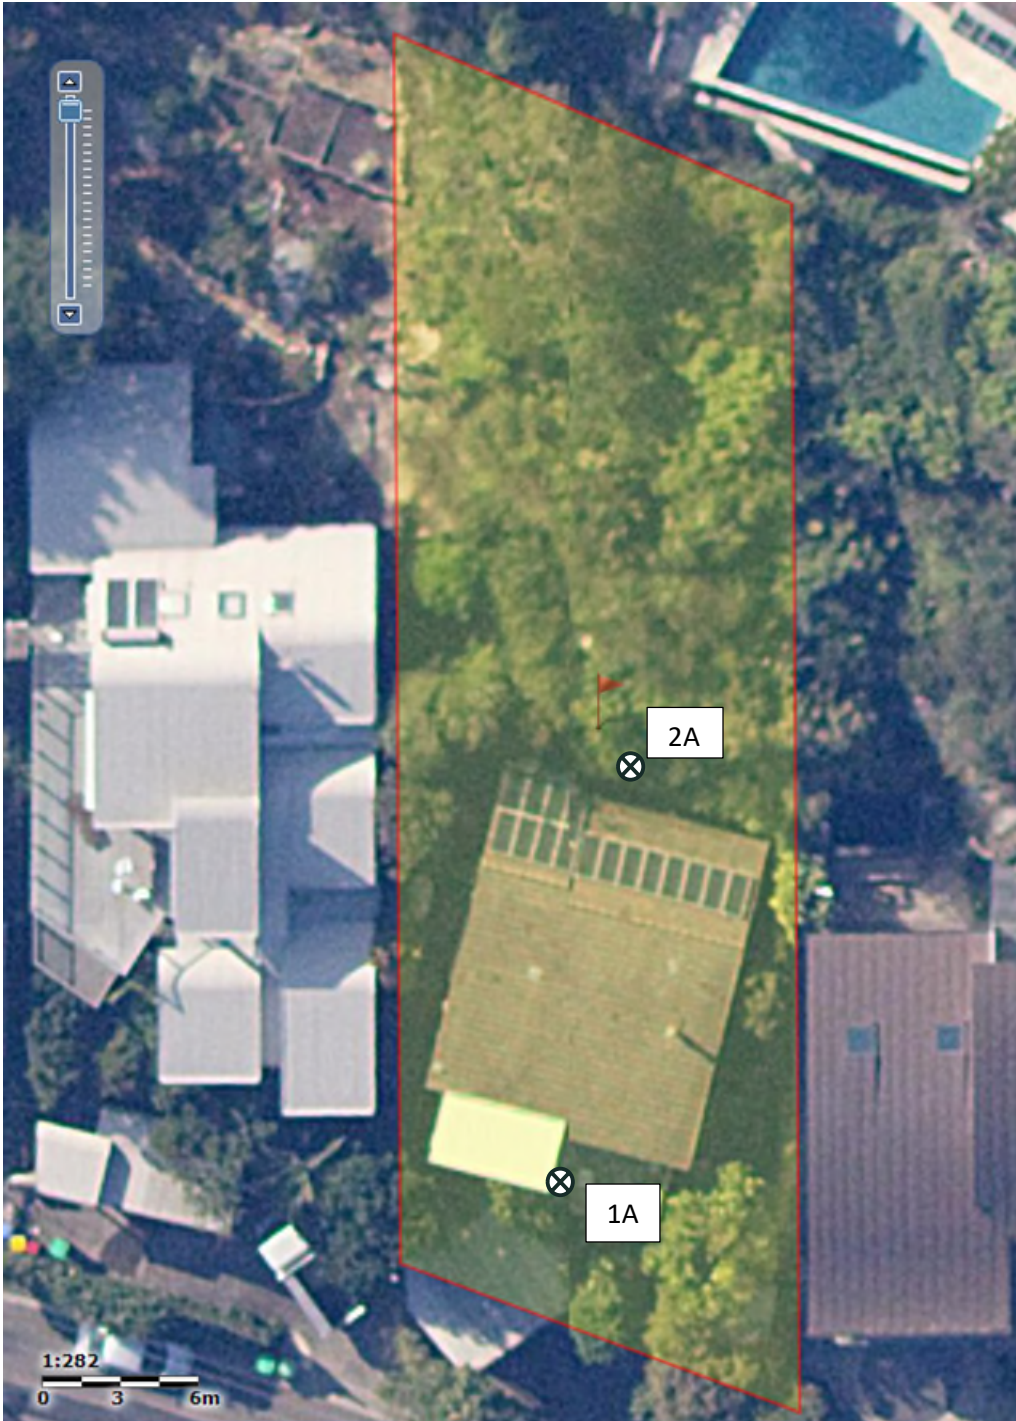

LEGEND:

Borehole Location - X



AERIAL PHOTOGRAPH AND BOREHOLE LOCATIONS

S1589

FIGURE 2

Figure 3: Site Photographs









REFERENCES









- Reference 1. MinView – geological map - <https://minview.geoscience.nsw.gov.au> - Accessed 20/07/2022
- Reference 2. Landslide Risk Management Concepts and Guidelines 2007 - https://landsliderisk.org/wp-content/uploads/2017/04/ags_2007c2.pdf - Accessed 20/07/2022
- Reference 3. Assessment of Landslide Likelihood in the Pittwater Local Government Area, 2007, - https://www.researchgate.net/profile/Andrew-Leventhal/publication/266181202_Assessment_of_landslide_likelihood_in_the_Pittwater_Local_Government_Area/links/550241800cf2d60c0e62d8ef/Assessment-of-landslide-likelihood-in-the-Pittwater-Local-Government-Area.pdf - Accessed 20/07/2022
- Reference 4. Standards Australia, “AS2870 – Residential Slabs & Footings”, 2011.
- Reference 5. AS3798, “Guidelines on earthworks for commercial and residential developments”.
- Reference 6. Geoscience Australia, Earthquake Hazards - <http://maps.ga.gov.au/interactive-maps/#/theme/hazards/map/earthquakehazards>- Accessed 20/07/2022
- Reference 7. Standards Australia, “AS1170.4 – 2007 – Minimum Design Loads on Structures – Part 4 Earthquake Loads”.








Appendix A

Borehole Logs 1A & 2A

| | | | | | |
|-------------|-------------|------------------|---------------------|------------|-----------------------------------------|
| UTM | : 56H | Driller Rig | : Handheld Pushtube | Job Number | : S1589 |
| Easting | : 345101.2 | Driller Supplier | : Fortify Geotech | Client | : Avenue One Design |
| Northing | : 6279997.0 | Logged By | : Mitchell Mack | Project | : S1589 - Proposed Knockdown Rebuild |
| RL | : N/A | Reviewed By | : | Location | : 272 Whale Beach Road, Whale Beach NSW |
| Total Depth | : 1.6m | Date | : 19/07/2022 | | |

| Water | Depth (m) | Soil Origin | Graphic Log | Classification Code | Material Description | Moisture | Consistency | Testing | Samples |
|-------|-----------|-------------|-------------------------------------------------------------------------------------|---------------------|----------------------------------------------------------------------------------------------------------------------------------------------|----------|-------------|---------|---------|
| | | | | | | | | | |
| | 0.05 | Topsoil |  | SM | Silty SAND (SM) : Loose, fine to medium grained, brown, trace fine sized gravel, trace low plasticity clay, Wet to Moist. | W-M | L | | |
| | | Colluvium |  | CI-CH | Sandy CLAY (CI-CH) : Firm to stiff, medium to high plasticity, pale yellow, fine to medium grained sand, w ≈ PL. | w ≈ PL | F-St | | |
| | 0.23 | Colluvium |  | CI-CH | AS ABOVE:Stiff, | w ≈ PL | St | | |
| | 0.45 | Colluvium |  | CI-CH | AS ABOVE:Soft to firm, grey mottled orange, w > PL. | w > PL | S-F | | |
| | 0.65 | Residual |  | CI | Sandy CLAY (CI) : Stiff, medium plasticity, orange, fine to medium grained sand, w ≈ PL. | w ≈ PL | St | | |
| | 0.8 | Residual |  | SC | AS ABOVE:Clayey SAND (SC) : Medium dense, , fine to medium grained, low to medium plasticity clay, trace fine to medium sized gravel, Dry. | D | MD-St | | |
| | 1 | Residual |  | CL | Sandy CLAY (CL) : Stiff, low plasticity, pale grey mottled orange, fine to medium grained sand, with fine to coarse sized gravel, w < PL. | w < PL | St | | |
| | 1.5 | |  | | | | | | |
| | | | | | 1A Terminated at 1.6m (at Target) | | | | |

| | | |
|----------------------|------------------------------------|--------------------------------------------------|
| UTM : 56H | Driller Rig : Handheld Pushtube | Job Number : S1589 |
| Easting : 345426.7 | Driller Supplier : Fortify Geotech | Client : Avenue One Design |
| Northing : 6280231.1 | Logged By : Mitchell Mack | Project : S1589 - Proposed Knockdown Rebuild |
| RL : N/A | Reviewed By : | Location : 272 Whale Beach Road, Whale Beach NSW |
| Total Depth : 1.15m | Date : 19/07/2022 | |

| Water | Depth (m) | Soil Origin | Graphic Log | Classification Code | Material Description | Moisture | Consistency | Testing | Samples |
|-------|-----------|-------------|-------------------------------------------------------------------------------------|---------------------|-------------------------------------------------------------------------------------------------------------------|----------|-------------|---------|---------|
| | | | | | | | | | |
| | 0.2 | Topsoil |  | OL | Sandy SILT (OL) : Soft, low plasticity, dark brown, fine to coarse grained sand, organic, w ≈ PL. | w ≈ PL | S | | |
| | 0.4 | Colluvium |  | SM | Silty SAND (SM) : Loose, fine to medium grained, brown, trace medium plasticity clay, Wet to Moist. | W-M | L | | |
| | 0.5 | Residual |  | CI | CLAY (CI) : Firm, medium plasticity, orange, trace fine to medium grained sand, w ≈ PL. | w ≈ PL | F | | |
| | 0.6 | Residual |  | CI | AS ABOVE:Stiff, | w ≈ PL | St | | |
| | 1.1 | Residual |  | CI-CH | Gravelly CLAY (CI-CH) : Stiff, medium to high plasticity, orange and grey, fine to coarse sized gravel, w ≈ PL. | w ≈ PL | St | | |
| | 1.5 | | | | 2A Terminated at 1.15m (tested on soil behind 0.6m retaining wall) | | | | |
| | 2.0 | | | | | | | | |



Appendix B

Engineering Terms and Definitions

DESCRIPTION AND CLASSIFICATION OF SOILS

The methods of description and classification of soils used in this report are based on the Australian Standard 1726 – 1993, Geotechnical site investigations. In general, descriptions cover the following properties – soil type, colour, secondary grain size, structure, inclusions, strength or density and geological description.

Soil types are described according to the predominating particle size, qualified by the grading of other particles present (e.g. sandy clay) on the following basis:

| Classification | Particle Size |
|----------------|----------------------|
| Clay | Less than 0.002mm |
| Silt | 0.002mm to 0.06mm |
| Sand | 0.06mm to 2.00mm |
| Gravel | 2.00mm to 60.00mm |
| Cobbles | 60mm (63mm) to 200mm |
| Boulders | >200mm |

Soils are also classified according to the Unified Soil Classifications System which is included in this Appendix. Rock types are classified by their geological names.

Cohesive soils are classified on the basis of strength either by laboratory testing or engineering examination. The terms are defined as follows:

| Consistency | Shear Strength s_u (kPa) (Representative Undrained Shear) | |
|-------------|----------------------------------------------------------------|---------------|
| Very soft | < 12 | <2 (~SPT "N") |
| Soft | 12 - 25 | 2-4 |
| Firm | 25 - 50 | 4-8 |
| Stiff | 50 – 100 | 8-15 |
| Very Stiff | 100 – 200 | 15-30 |
| Hard | > 200 | >30 |

Non-cohesive soils are classified on the basis of relative density, generally from the results of in-situ standard penetration tests as below:

| Term | Relative Density (%) | SPT Blows/300mm 'N' |
|--------------|----------------------|---------------------|
| Very loose | < 15 | <4 |
| Loose | 15-35 | 4-10 |
| Medium dense | 35-65 | 10-30 |
| Dense | 65-85 | 30-50 |
| Very Dense | >85 | >50 |

SAMPLING

Sampling is carried out during drilling to allow engineering examination (and laboratory testing where required) of soil or rock.

Disturbed samples taken during drilling provide information on colour, type, inclusions and depending upon the degree of disturbance, some information on strength and structure.

Undisturbed samples are generally taken by one of two methods:

1. Driving or pushing a thin walled sample tube into the soil and withdrawing with a sample of soil in a relatively undisturbed state.
2. Core drilling using a retractable inner tube (R.I.T.) core barrel.

Such samples yield information on structure and strength in additions to that obtained from disturbed samples and are necessary for laboratory determination of shear strength and compressibility. Undisturbed sampling is generally effective only in cohesive soils.

Details of the type and method of sampling are given in the report.

PENETRATION TESTING

The relative density of non-cohesive soils is generally assessed by in-situ penetration tests, the most common of which is the standard penetration test. The test procedure is described in Australian Standard 1289 “Testing Soils for Engineering Purposes” Testing Soils for Engineering Purposes” – Test No. F3.1.

The standard penetration test is carried out by driving a 50mm diameter split tube penetrometer of standard dimensions under the impact of a 63 kg hammer having a free fall of 750mm.

The “N” value is determined as the number of blows to achieve 300mm of penetration (generally after disregarding the first 150mm penetration through possibly disturbed material). The results of these tests can be related empirically to the engineering properties of the soil.

The test is also used to provide useful information in cohesive soils under certain conditions, a good quality disturbed sample being recovered with each test. Other forms of in situ testing are used under certain conditions and where this occurs, details are given in the report.

DEFINITIONS OF ROCK, SOIL, AND DEGREES OF CHEMICAL WEATHERING

GENERAL DEFINITIONS – ROCK AND SOIL

ROCK In engineering usage, rock is a natural aggregate of minerals connected by strong and permanent cohesive forces.

Note: Since “strong” and “permanent” are subject to different interpretations, the boundary between rock and soil is necessarily an arbitrary one.

SOIL In engineering usage, soil is a natural aggregate of mineral grains which can be separated by such gentle mechanical means as agitation in water, can be remoulded and can be classified according to the Unified Soil Classification System. Three principal classes of soil recognized are:

Residual soils: soils which have been formed in-situ by the chemical weathering of parent rock. Residual soil may retain evidence of the original rock texture or fabric or, when mature, the original rock texture may be destroyed.

Transported soils: soils which have been moved from their places of origin and deposited elsewhere. The principal agents of erosion, transport and deposition are water, wind and gravity. Two important types of transported soil in engineering geology and materials investigations are:

Colluvium – a soil, often including angular rock fragments and boulders, which has been transported downslope predominantly under the action of gravity assisted by water. The principle forming process is that of soil creep in which the soil moves after it has been weakened by saturation. It may be water borne for short distances.

Alluvium – a soil which has been transported and deposited by running water. The larger particles (sand and gravel size) are water worn.

Lateritic soils: soils which have formed in situ under the effects of tropical weathering include all reddish residual and non residual soils which genetically form a chain of material ranging from decomposed rock through clay to sesqui-oxide rich crusts. The term does not necessarily imply any compositional, textural or morphological definition; all distinctions useful for engineering purposes are based on the differences in geotechnical characteristics.

ROCK WEATHERING DEFINITIONS

| | |
|---------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Extremely Weathered (EW) | Rock substance affected by weathering to the extent that the rock exhibits soil properties, i.e. it can be remoulded and can be classified according to the Unified Classification System, but the texture of the original rock is still evident. |
| Highly Weathered (HW) | Rock substance affected by weathering to the extent that limonite staining or bleaching affects the whole of the rock substance and other signs of the chemical or physical decomposition are evident. Porosity and strength may be increased or decreased compared to the fresh rock usually as a result of iron leaching or deposition. The colour and strength of the original fresh rock substance is no longer recognisable. |
| Moderately Weathered (MW) | Rock substance affected by weathering to the extent that staining extends throughout the whole of the rock substance and the original colour of the fresh rock is no longer recognisable. |
| Slightly Weathered (SW) | Rock substance affected by weathering to the extent that partial staining or discolouration of the rock substance, usually by limonite, has taken place. The colour and texture of the fresh rock is recognisable. |
| Fresh (Fr) | Rock substance unaffected by weathering. |

The degrees of rock weathering may be gradational. Intermediate stages are described by dual symbols with the prominent degree of weathering first (e.g. EW-HW).

The various degrees of weathering do not necessarily define strength parameters as some rocks are weak, even when fresh, to the extent that they can be broken by hand across the fabric, and some rocks may increase in strength during the weathering process.

Fresh drill cores of some rock types, such as basalt and shale may disintegrate after exposure to the atmosphere due to slaking, desiccation, expansion or contraction, stress relief or a combination of any of these factors.

AN ENGINEERING CLASSIFICATION OF SEDIMENTARY ROCKS

This classification system provides a standardised terminology for the engineering description of the sandstone and shales in the Sydney area, but the terms and definitions may be used elsewhere when applicable. Where other rock types are encountered, such as in dykes, standard geological descriptions are used for rock types and the same descriptions as below are used for strength, fracturing and weathering.

Under this system rocks are classified by Rock Type, Strength, Stratification Spacing, Degree of Fracturing and Degree of Weathering. These terms do not cover the full range of engineering properties. Descriptions of rock may also need to refer to other properties (e.g. durability, abrasiveness, etc) where these are relevant.

ROCK TYPE DEFINITIONS

| ROCK TYPE | DEFINITION |
|---------------|-----------------------------------------------------------------------------------------------------------------------|
| Conglomerate: | More than 50% of the rock consists of gravel sized (greater than 2mm) fragments. |
| Sandstone: | More than 50% of the rock consists of sand sized (0.06 to 2mm) grains. |
| Siltstone: | More than 50% of the rock consists of silt-sized (less than 0.06mm) granular particles and the rock is not laminated. |
| Claystone: | More than 50% of the rock consists of silt or clay sized particles and the rock is not laminated. |
| Shale: | More than 50% of the rock consists of silt or clay sized particles and the rock is laminated. |

Rocks possessing characteristics of two groups are described by their predominant particle size with reference also to the minor constituents, e.g. clayey sandstone, sandy shale.

STRATIFICATION SPACING

| Term | Separation of Stratification Planes |
|---------------------|-------------------------------------|
| Thinly Laminated | < 6mm |
| Laminated | 6mm to 20mm |
| Very thinly bedded | 20mm to 60mm |
| Thinly bedded | 60mm to 0.2m |
| Medium bedded | 0.2m to 0.6m |
| Thickly bedded | 0.6m to 2m |
| Very thickly bedded | > 2m |

DEGREE OF FRACTURING

This classification applies to diamond drill cores and refers to the spacing of all types of natural fractures along which the core is discontinuous. These include bedding plane partings, joints and other rock defects, but exclude known artificial fractures such as drilling breaks.

| Term | Description |
|---------------------|------------------------------------------------------------------------------------------------------------------------|
| Fragmented: | The core is comprised primarily of fragments of length less than 20mm, and mostly of width less than the core diameter |
| Highly Fractured: | Core lengths are generally less than 20mm – 40mm with occasional fragments. |
| Fractured: | Core lengths are mainly 30mm – 100mm with occasional shorter and longer section. |
| Slightly Fractured: | Core lengths are generally 300mm – 1000mm with occasional longer sections and occasional sections of 100mm – 300mm. |
| Unbroken: | The core does not contain any fracture. |

ROCK STRENGTH

Rock strength is defined by the Point Load Strength Index (Is 50) and refers to the strength of the rock substance in the direction normal to the bedding. The test procedure is described by the International Society of Rock Mechanics.

| Term | Point Load Index Is(50) MPa | Field Guide | Approx qu MPa* |
|-----------------------|-----------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------|
| Extremely Weak: | 0.03 | Easily remoulded by hand to a material with soil properties. | 0.7 |
| Very Weak: | 0.1 | May be crumbled in the hand. Sandstone is “sugary” and friable. | 2.4 |
| Weak: | 0.3 | A piece of core 150mm long x 50mm dia. May be broken by hand and easily scored with a knife. Sharp edges of core may be friable and break during handling. | 7 |
| Medium Strong: | 1 | A piece of core 150mm long x 50mm dia. can be broken by hand with considerable difficulty. Readily scored with knife. | 24 |
| Strong: (SW) | 3 | A piece of core 150mm long x 50mm dia. core cannot be broken by unaided hands, can be slightly scratched or scored with knife. | 70 |
| Very Strong (SW) | 10 | A piece of core 150mm long x 50mm dia. may be broken readily with hand held hammer. Cannot be scratched with pen knife. | 240 |
| Extremely Strong (Fr) | >10 | A piece of core 150mm long x 50mm dia. is difficult to break with hand held hammer. Rings when struck with a hammer. | >240 |

The approximate unconfined compressive strength (qu) shown in the table is based on an assumed ratio to the point load index of 24:1. This ratio may vary widely.

Unified Soil Classification System (Metricated) Data for Description Identification and Classification of Soils

| MAJOR DIVISIONS | | DESCRIPTION | | | | FIELD IDENTIFICATION | | | | | | LABORATORY CLASSIFICATION | | | | | | | | | | |
|----------------------------|------------------------------------------------------------------|-----------------------------------------------------------------------------------|--------------------------------------------|--------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------|---------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------|--------------------------------------------------------|--------------------------------------------------------|---------------------------|--------------------------------------------------------------------------------------------------------------------------------------|------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------|----------------------------|--|--|--|
| | | Group Symbol | Graphic Symbol | TYPICAL NAME | DESCRIPTIVE DATA | GRAVELS AND SANDS | | | | Group Symbol | % [Z] < 0.06mm | PLASTICITY OF FINE FRACTION | | | NOTES | | | | | | | |
| | | | | | | GRADATIONS | | NATURE OF FINES | DRY STRENGTH | | | | | | | | | | | | | |
| COARSE GRAINED SOILS | GRAVELS More than 50% of coarse grains are greater than 2.0mm | GW | | Well graded gravels and gravel-sand mixtures, little or no fines | Give typical name, indicate approximate percentages of sand and gravel, maximum size, angularity, surface condition and hardness of the coarse grains, local or geological name and other pertinent descriptive information, symbols in parenthesis. For undisturbed soils add information on stratification, degree of compactness, cementation, moisture conditions and drainage characteristics. EXAMPLE: Silty Sand, gravelly, about 20% hard, angular gravel particles, 10mm maximum size, rounded and sub angular sand grains coarse to fine, about 15% non-plastic fines with low dry strength, well compacted and moist in place, light brown alluvial sand, (SM) | Determine approximate percentages of material over 60mm size, maximum size, shape, surface texture, hardness of material, geological description, identify on estimated percentage mass of the various fractions. COARSE GRAINED SOILS More than half of the material less than 60mm is larger than 0.06mm | 0.06mm is about the smallest particle visible to the naked eye | GOOD | Wide range in grain size | "Clean" materials (not enough fines to band coarse grains) | None | GW | 0-5 | - | >4 | Between 1 and 3 | 1. Identify Fines by the method given for fine grained soils. 2. Borderline classifications occur when the percentage of fines (fraction smaller than 0.06mm size) is greater than 5% and less than 12%. Borderline classifications require the use of dual symbols eg SP-SM GW-GC | | | | | |
| | | GP | | Poorly graded gravels and gravel-sand mixtures, little or no fines | | | | POOR | Predominantly one size or range of sizes | | | | Fines are non-plastic (I) Fines are plastic (I) | None to medium | GP | 0-5 | | - | Fails to comply with above | | | |
| | | GM | | Silty gravels, gravel-sand-silt mixtures | | | | GOOD TO FAIR | "Dirty" materials (Excess of fines) | Fines are non-plastic (I) Fines are plastic (I) | None to medium | GM | | | 12-50 | Below 'A' line and Ip > 7 | | - | - | | | |
| | | GC | | Clayey gravels gravel-sand-clay mixtures | | | | | | | | GC | 12-50 | Above 'A' line and Ip > 7 | - | - | | | | | | |
| | SANDS More than 50% of coarse grains are greater than 2.0mm | SW | | Well graded sands and gravelly sands, little or no fines | | | | GOOD | Wide range in grain size | "Clean" materials (not enough fines to band coarse grains) | None | SW | 0-5 | - | >6 | between 1 and 3 | | | | | | |
| | | SP | | Poorly graded sands and gravelly sands, little or no fines | | | | POOR | Predominantly one size or range of sizes | | | Fines are non-plastic (I) Fines are plastic (I) | None to medium | SP | 0-5 | - | | Fails to comply with above | | | | |
| | | SM | | Silty sand, sand-silt mixtures | | | | GOOD TO FAIR | "Dirty" materials (Excess of fines) | Fines are non-plastic (I) Fines are plastic (I) | None to medium | | | SM | 12-50 | Below 'A' line or Ip < 4 | | - | - | | | |
| | | SC | | Clayey sands, sand-clay mixtures | | | | | | | | SC | 12-50 | Above 'A' line and Ip > 7 | - | - | | | | | | |
| | FINE GRAINED SOILS | Liquid Limit less than 50% | ML | | | | | Inorganic silts, very fine sands, rock flour, silty or clayey fine sands. | Give typical name, indicate degree and character of plasticity, amount and maximum size of coarse grains, colour in wet condition, odour if any, local or geological name and r pertinent descriptive information, symbols in parenthesis. For undisturbed soil add information on structure, stratification, consistency in undisturbed and remoulded states, moisture and drainage conditions. EXAMPLE Clayey Silt, brown, low plasticity, small percentage of fine sand, numerous vertical root-holes, firm and dry in place, fill, (ML). | Determine approximate percentages of material over 60mm size, maximum size, shape, surface texture, hardness of material, geological description, identify on estimated percentage mass of the various fractions. FINE GRAINED SOILS More than half of the material less than 60mm is less than 0.06mm | 0.06mm is about the smallest particle visible to the naked eye | SILT AND CLAY FRACTION | | | Use the gradation curve of material passing 60mm for classification of fractions according to criteria given under "Major Division". | More than 50% passing 0.06mm | | | | | | |
| | | | Fraction smaller than 0.20mm AS sieve size | | | | | | | | | | | | | | | | | | | |
| | | | DRY STRENGTH | DILATANCY | | | | TOUGHNESS | | | | | | | | | | | | | | |
| | | | None to low | Quick to slow | | | | None | | | | | | | | | | | | | | |
| Medium to high | | | None to very slow | Medium | | | | | | | | | | | | | | | | | | |
| Low to medium | | | Slow | Low | | | | | | | | | | | | | | | | | | |
| Liquid Limit more than 50% | | MH | | Inorganic silts, micaceous or diatomaceous fine sands or silts, elastic silts. | Low to medium | Slow to none | Low to medium | MH | | | | Below 'A' line | | | | | | | | | | |
| | | CH | | Inorganic clays of high plasticity, fat clays. | High to very high | None | High | CH | | | | Above 'A' line | | | | | | | | | | |
| | | OH | | Organic clays of medium to high plasticity. | Medium to high | None to very slow | Low to medium | OH | | | | Below 'A' line | | | | | | | | | | |
| | | PI* | Peat muck and other highly organic soils. | | | | | | | | | | | | | | | | | | | |
| | | Readily identified by colour, odour, spongy feel and generally by fibrous texture | | | | | | | | | | | | | | | | | | | | |
| | | PI* | *Effervescence with H2O2 | | | | | | | | | | | | | | | | | | | |



Appendix C

Qualitative Terminology of Risk Management

PRACTICE NOTE GUIDELINES FOR LANDSLIDE RISK MANAGEMENT 2007

APPENDIX C: - QUALITATIVE TERMINOLOGY FOR USE IN ASSESSING RISK TO PROPERTY (CONTINUED)

QUALITATIVE RISK ANALYSIS MATRIX - LEVEL OF RISK TO PROPERTY

| LIKELIHOOD | | CONSEQUENCES TO PROPERTY (With Indicative Approximate Cost of Damage) | | | | |
|---------------------|----------------------------------------------------|-----------------------------------------------------------------------|------------------|-------------------|-----------------|------------------------------|
| | Indicative Value of Approximate Annual Probability | 1: CATASTROPHIC 200 % | 2: MAJOR 60 % | 3: MEDIUM 20 % | 4: MINOR 5 % | 5: INSIGNIFICANT 0.5 % |
| A - ALMOST CERTAIN | 10 ⁻¹ | VH | VH | VH | H | M or L (5) |
| B - LIKELY | 10 ⁻² | VH | VH | H | M | L |
| C - POSSIBLE | 10 ⁻³ | VH | H | M | M | VL |
| D - UNLIKELY | 10 ⁻⁴ | H | M | L | L | VL |
| E - RARE | 10 ⁻⁵ | M | L | L | VL | VL |
| F - BARELY CREDIBLE | 10 ⁻⁶ | L | VL | VL | VL | VL |

Notes: (5) For Cell A5, may be subdivided such that a consequence of less than 0.1% is Low Risk.
(6) When considering a risk assessment it must be clearly stated whether it is for existing conditions or with risk control measures which may not be implemented at the current time.

RISK LEVEL IMPLICATIONS

| Risk Level | | Example Implications (7) |
|------------|----------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| VH | VERY HIGH RISK | Unacceptable without treatment. Extensive detailed investigation and research, planning and implementation of treatment options essential to reduce risk to Low; may be too expensive and not practical. Work likely to cost more than value of the property. |
| H | HIGH RISK | Unacceptable without treatment. Detailed investigation, planning and implementation of treatment options required to reduce risk to Low. Work would cost a substantial sum in relation to the value of the property. |
| M | MODERATE RISK | May be tolerated in certain circumstances (subject to regulator's approval) but requires investigation, planning and implementation of treatment options to reduce the risk to Low. Treatment options to reduce to Low risk should be implemented as soon as practicable. |
| L | LOW RISK | Usually acceptable to regulators. Where treatment has been required to reduce the risk to this level, ongoing maintenance is required. |
| VL | VERY LOW RISK | Acceptable. Manage by normal slope maintenance procedures. |

Note: (7) The implications for a particular situation are to be determined by all parties to the risk assessment and may depend on the nature of the property at risk; these are only given as a general guide.

Attachment 1 – Risk Assessment Matrix

E – Extreme risk – detailed action plan required
H – High risk – needs senior management attention
M – Medium risk – specify management responsibility
L – Low risk – manage by routine procedures

High or Extreme risks must be reported to Senior Management and require detailed treatment plans to reduce the risk to **Low or Medium**.

| | People | Reputation | Business Process & Systems | Financial | Consequence | | | | |
|--|----------------|-----------------|----------------------------------------------------------------------------------------------------------------------|-----------------------|----------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|----------------------------------------------------------------------|
| | | | | | Injuries or ailments not requiring medical treatment. | Minor injury or First Aid Treatment Case. | Serious injury causing hospitalisation or multiple medical treatment cases. | Life threatening injury or multiple serious injuries causing hospitalisation. | Death or multiple life threatening injuries. |
| | | Internal Review | Minor errors in systems or processes requiring corrective action, or minor delay without impact on overall schedule. | 1% of Budget or <\$5K | Minor errors in systems or processes requiring corrective action, or minor delay without impact on overall schedule. | Scrutiny required by internal committees or internal audit to prevent escalation. | Scrutiny required by external committees or ACT Auditor General's Office, or Inquest, etc. | Intense public, political and media scrutiny. Eg: front page headlines, TV, etc. | Assembly inquiry or Commission of inquiry or adverse national media. |
| | | | | | Policy procedural rule occasionally not met or services do not fully meet needs. | One or more key accountability requirements not met. Inconvenient but not client welfare threatening. | Strategies not consistent with Government's agenda. Trends show service is degraded. | Critical system failure, bad policy advice or ongoing non-compliance. Business severely affected. | |
| | | | | | 2.5% of Budget or <\$50K | > 5% of Budget or <\$500K | > 10% of Budget or <\$5M | > 25% of Budget or >\$5M | |
| | | | | | Insignificant | Minor | Moderate | Major | Catastrophic |
| | | | | | 1 | 2 | 3 | 4 | 5 |
| | Almost Certain | 5 | Is expected to occur in most circumstances | M | H | H | H | E | E |
| | Likely | 4 | Will probably occur | M | M | H | H | H | E |
| | Possible | 3 | Might occur at some time in the future | L | M | M | M | H | E |
| | Unlikely | 2 | Could occur but doubtful | L | M | M | M | H | H |
| | Rare | 1 | May occur but only in exceptional circumstances | L | L | M | M | M | H |

Adapted from Standards Australia Risk Management AS/NZS 4360: 2004

Appendix D

Flowchart for landslide Risk Management

FRAMEWORK FOR LANDSLIDE RISK MANAGEMENT

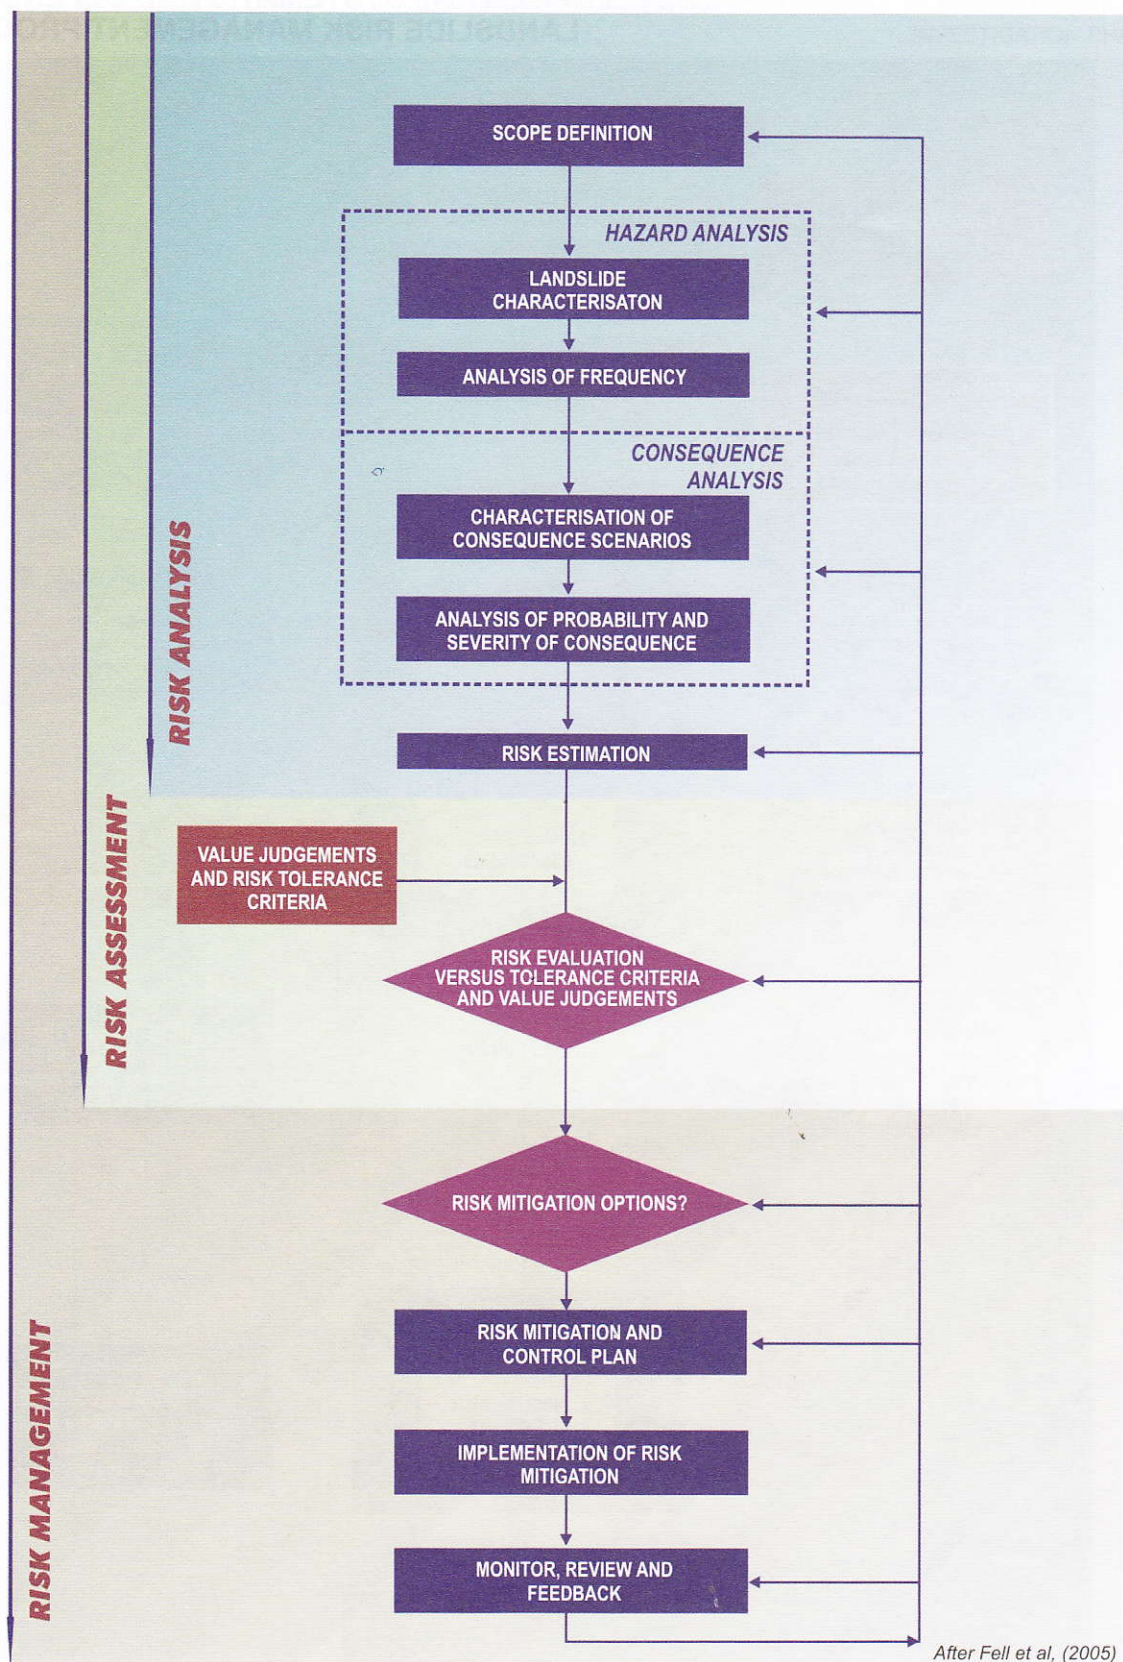


Figure 2: Abbreviated flowchart for Landslide Risk Management.
Ref: AGS (2007a, 2007c)



Appendix E


Guideline for Hillside Construction

PRACTICE NOTE GUIDELINES FOR LANDSLIDE RISK MANAGEMENT 2007


APPENDIX G - SOME GUIDELINES FOR HILLSIDE CONSTRUCTION

| ADVICE | | GOOD ENGINEERING PRACTICE | POOR ENGINEERING PRACTICE |
|----------------------------------------------|--|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| GEOTECHNICAL ASSESSMENT | | Obtain advice from a qualified, experienced geotechnical practitioner at early stage of planning and before site works. | Prepare detailed plan and start site works before geotechnical advice. |
| PLANNING | | | |
| SITE PLANNING | | Having obtained geotechnical advice, plan the development with the risk arising from the identified hazards and consequences in mind. | Plan development without regard for the Risk. |
| DESIGN AND CONSTRUCTION | | | |
| HOUSE DESIGN | | Use flexible structures which incorporate properly designed brickwork, timber or steel frames, timber or panel cladding. Consider use of split levels. Use decks for recreational areas where appropriate. | Floor plans which require extensive cutting and filling. Movement intolerant structures. |
| SITE CLEARING | | Retain natural vegetation wherever practicable. | Indiscriminately clear the site. |
| ACCESS & DRIVEWAYS | | Satisfy requirements below for cuts, fills, retaining walls and drainage. Council specifications for grades may need to be modified. Driveways and parking areas may need to be fully supported on piers. | Excavate and fill for site access before geotechnical advice. |
| EARTHWORKS | | Retain natural contours wherever possible. | Indiscriminatory bulk earthworks. |
| CUTS | | Minimise depth. Support with engineered retaining walls or batter to appropriate slope. Provide drainage measures and erosion control. | Large scale cuts and benching. Unsupported cuts. Ignore drainage requirements |
| FILLS | | Minimise height. Strip vegetation and topsoil and key into natural slopes prior to filling. Use clean fill materials and compact to engineering standards. Batter to appropriate slope or support with engineered retaining wall. Provide surface drainage and appropriate subsurface drainage. | Loose or poorly compacted fill, which if it fails, may flow a considerable distance including onto property below. Block natural drainage lines. Fill over existing vegetation and topsoil. Include stumps, trees, vegetation, topsoil, boulders, building rubble etc in fill. |
| ROCK OUTCROPS & BOULDERS | | Remove or stabilise boulders which may have unacceptable risk. Support rock faces where necessary. | Disturb or undercut detached blocks or boulders. |
| RETAINING WALLS | | Engineer design to resist applied soil and water forces. Found on rock where practicable. Provide subsurface drainage within wall backfill and surface drainage on slope above. Construct wall as soon as possible after cut/fill operation. | Construct a structurally inadequate wall such as sandstone flagging, brick or unreinforced blockwork. Lack of subsurface drains and weepholes. |
| FOOTINGS | | Found within rock where practicable. Use rows of piers or strip footings oriented up and down slope. Design for lateral creep pressures if necessary. Backfill footing excavations to exclude ingress of surface water. | Found on topsoil, loose fill, detached boulders or undercut cliffs. |
| SWIMMING POOLS | | Engineer designed. Support on piers to rock where practicable. Provide with under-drainage and gravity drain outlet where practicable. Design for high soil pressures which may develop on uphill side whilst there may be little or no lateral support on downhill side. | |
| DRAINAGE | | | |
| SURFACE | | Provide at tops of cut and fill slopes. Discharge to street drainage or natural water courses. Provide general falls to prevent blockage by siltation and incorporate silt traps. Line to minimise infiltration and make flexible where possible. Special structures to dissipate energy at changes of slope and/or direction. | Discharge at top of fills and cuts. Allow water to pond on bench areas. |
| SUBSURFACE | | Provide filter around subsurface drain. Provide drain behind retaining walls. Use flexible pipelines with access for maintenance. Prevent inflow of surface water. | Discharge roof runoff into absorption trenches. |
| SEPTIC & SULLAGE | | Usually requires pump-out or mains sewer systems; absorption trenches may be possible in some areas if risk is acceptable. Storage tanks should be water-tight and adequately founded. | Discharge sullage directly onto and into slopes. Use absorption trenches without consideration of landslide risk. |
| EROSION CONTROL & LANDSCAPING | | Control erosion as this may lead to instability. Revegetate cleared area. | Failure to observe earthworks and drainage recommendations when landscaping. |
| DRAWINGS AND SITE VISITS DURING CONSTRUCTION | | | |
| DRAWINGS | | Building Application drawings should be viewed by geotechnical consultant | |
| SITE VISITS | | Site Visits by consultant may be appropriate during construction/ | |
| INSPECTION AND MAINTENANCE BY OWNER | | | |
| OWNER'S RESPONSIBILITY | | Clean drainage systems; repair broken joints in drains and leaks in supply pipes. Where structural distress is evident see advice. If seepage observed, determine causes or seek advice on consequences. | |

EXAMPLES OF **GOOD** HILLSIDE PRACTICE

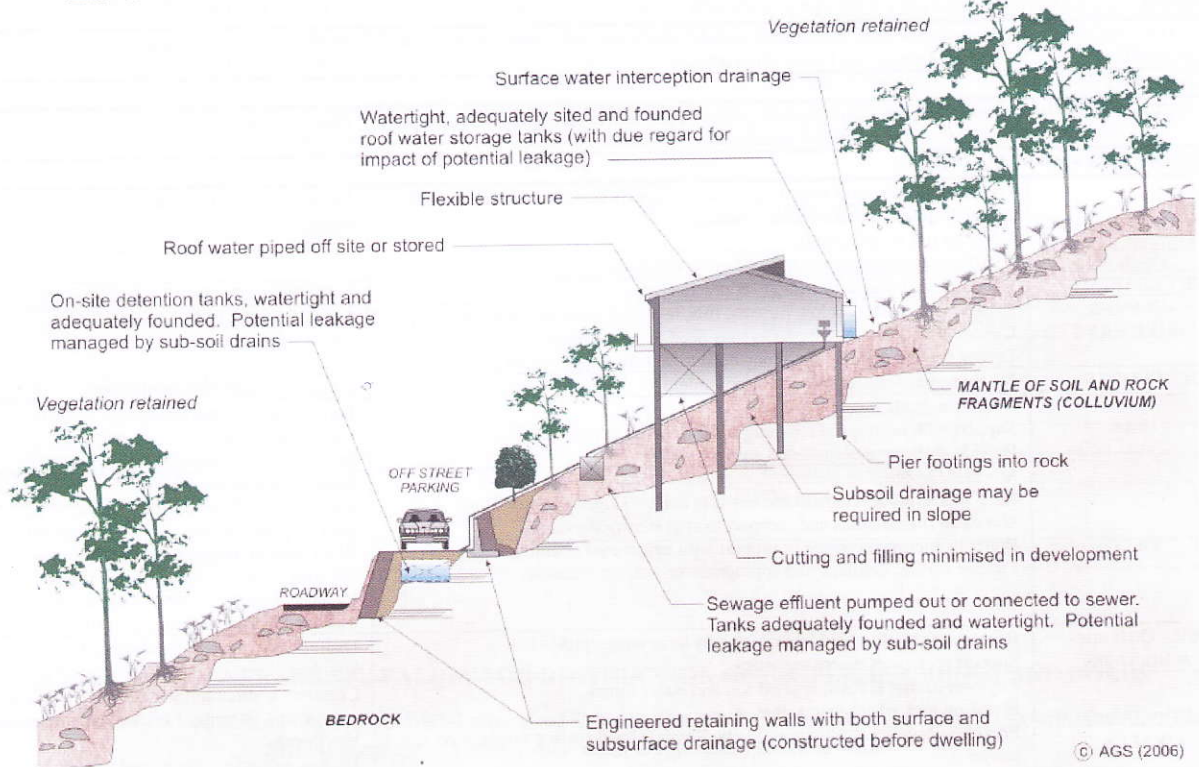

EXAMPLES OF **POOR** HILLSIDE PRACTICE

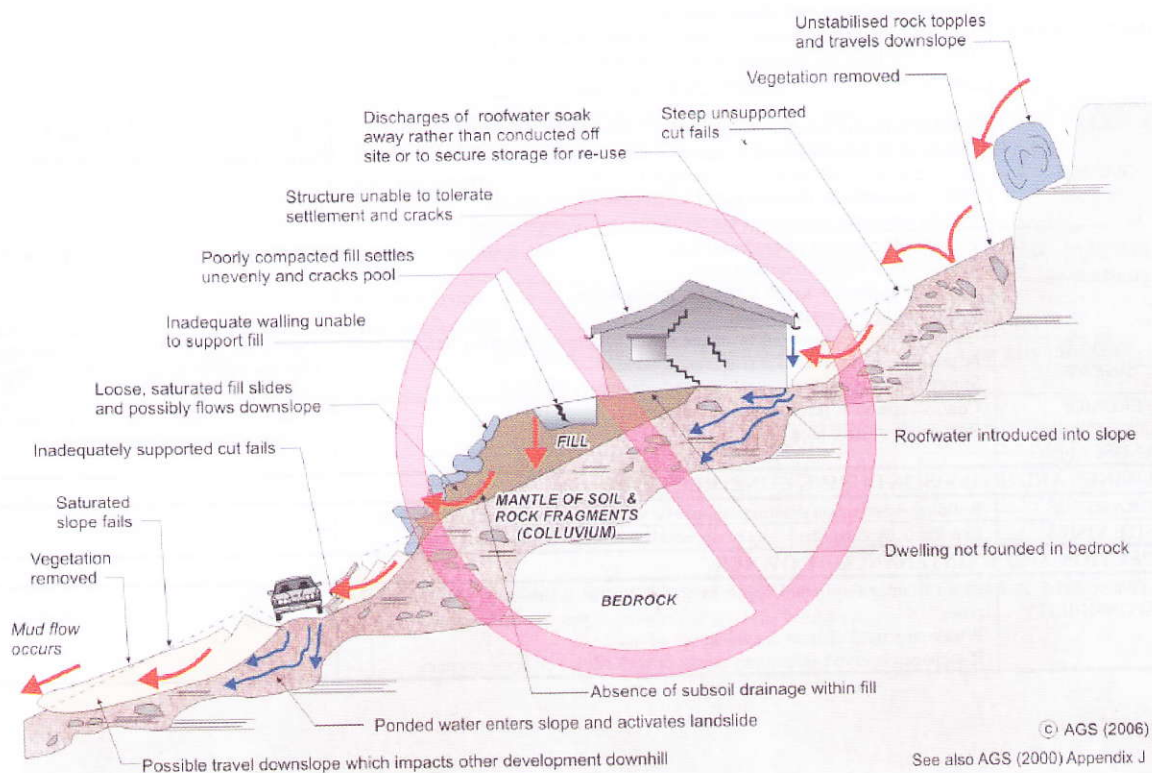

Limitations in the Use and Interpretation of this Geotechnical Report

Our Professional services were performed, our findings obtained, and our recommendations prepared in accordance with generally accepted engineering principles and practices. This warranty is in lieu of all other warranties, either expressed or implied.

The geotechnical report was prepared for the use of the Owner in the design of the subject facility and should be made available to potential contractors and/or the Contractor for information on factual data only. This report should not be used for contractual purposes as a warranty of interpreted subsurface conditions such as those indicated by the interpretive boring and test pit logs, cross- sections, or discussion of subsurface conditions contained herein.

The analyses, conclusions and recommendations contained in the report are based on site conditions as they presently exist and assume that the exploratory borings, test pits, and/or probes are representative of the subsurface conditions of the site. If, during construction, subsurface conditions are found which are significantly different from those observed in the exploratory borings and test pits, or assumed to exist in the excavations, we should be advised at once so that we can review these conditions and reconsider our recommendations where necessary. If there is a substantial lapse of time between the submission of this report and the start of work at the site, or if conditions have changed due to natural causes or construction operations at or adjacent to the site, this report should be reviewed to determine the applicability of the conclusions and the recommendations considering the changed conditions and time lapse.

The Summary Boring Logs are our opinion of the subsurface conditions revealed by periodic sampling of the ground as the borings progressed. The soil descriptions and interfaces between strata are interpretive and actual changes may be gradual.

The boring logs and related information depict subsurface conditions only at the specific locations and at the particular time designated on the logs. Soil conditions at the other locations may differ from conditions occurring at these boring locations. Also, the passage of time may result in a change in the soil conditions at these boring locations.

Groundwater levels often vary seasonally. Groundwater levels reported on the boring logs or in the body of the report are factual data only for the dates shown.

Unanticipated soil conditions are commonly encountered on construction sites and cannot be fully anticipated by merely taking soil samples, borings or test pits. Such unexpected conditions frequently require that additional expenditures be made to attain a properly constructed project. It is recommended that the Owner consider providing a contingency fund to accommodate such potential extra costs.

This firm cannot be responsible for any deviation from the intent of this report including, but not restricted to, any changes to the scheduled time of construction, the nature of the project or the specific construction methods or means indicated in this report: nor can our firm be responsible for any construction activity on sites other than the specific site referred to in this report.