

Planning For Bushfire Protection




Ronald Coffey
0408 220 443
31 Collins Street North Narrabeen
Sydney NSW 2101
Email: ron.coffey@bigpond.com
Web: www.bushfireconsultants.com.au

Reference: 714-10A
21/06/2016

Bushfire Risk Assessment

In relation to proposed development at:

No 949 Barrenjoey Road, Palm Beach

<i>This Assessment has been prepared and Certified by: Ronald Coffey BPAD – A Certified Practitioner FPAA Cert. No: BPD-PA 09328</i>	
Can this proposal comply with AS3959, 2009 + addendum to Appendix 3 of PBP?	<u>YES</u>
What is the recommended level of compliance AS3959, 2009?	<u>BAL 12.5</u>
Does this development comply with the requirements of PBP?	<u>YES</u>
Does this development comply with the Aims and objectives of PBP?	<u>YES</u>
Is referral to the NSW RFS required?	<u>NO</u>

Contents

Introduction

- 1) Location
- 2) Development Proposal and Building Classifications
- 3) Description of the Subject Property
- 4) Classification of the Vegetation on and surrounding the Site
- 5) Assessment of Effective Slope
- 6) Access and Egress
- 7) Water Supplies
- 8) Environment considerations
- 9) Bushfire Threat Assessment
- 10) Assessment of the extent to which the development proposal Conforms or Deviates with Chapter 4 of Planning for Bushfire Protection
- 11) Recommendations
- 12) Summary
- 13) References
- 14) Fences and Gates

Introduction

The purpose of this report is to determine the category of bushfire attack and subsequent construction standard for the proposed development of a new Class 10a garage and entrance driveway at No 949 Barrenjoey Road, Palm Beach.

The site is identified as 'bush fire prone land' for the purposes of Section 146 of the *Environmental Planning and Assessment Act 1979* and the legislative requirements for building on bushfire prone lands are applicable.

The proposed development is an infill development as defined within Chapter 4.3.5 of *Planning for Bushfire Protection 2006* and this report has been prepared in accordance with the requirements of section 79BA of the *Environment Planning and Assessment Act*.

PBP 4.3.5 (Part f) Where a Class 10a buildings is constructed in proximity to another class of building the Class 10a should meet the requirements of the main building or be located >10m away from the main building.

AS3959, 2009 Part 3.2.3 Adjacent Structures: Where any garage, carport or similar roofed structure is not attached to a building required to comply with this standard, the entire garage, carport, or similar roofed structure on the subject allotment shall comply with the construction requirements of this standard.

Alternatively, the adjacent structure shall be separated from the building by one of the following: A distance of not less than 6m from the building required to comply with this standard; or a wall with a complying FRL.


In this instance the proposed garage is within 10m of the existing dwelling and shall comply with the construction requirements of the standard.

This assessment includes an analysis of the hazard, threat and subsequent risk to the development proposal and provides recommendations that satisfy the Objectives and Performance requirements of the *Building Code of Australia, Planning for Bushfire Protection 2006 [PBP]* and *Australian Standard AS3959, 2009*.

The site was inspected: 21/05/2016

1) Location

No 949 Barrenjoey Road, Palm Beach
Lot 6, DP 541797
LGA - Pittwater

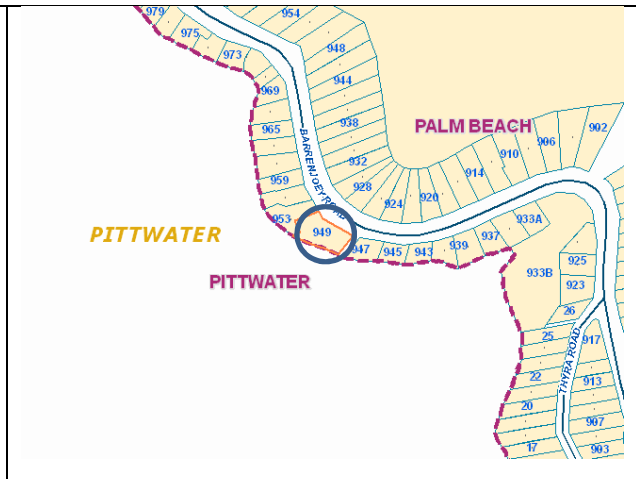

2) Development Proposal and Building Classifications

The proposal is for a new Class 10a garage and entrance driveway.

The proposal does not include alterations, additions or renovations of the existing dwelling and in accordance with the NSW Rural Fire Service advice this report does not include recommendations for the upgrading of the existing dwelling.


3) Description of the Subject

Property

The development site is a residential lot facing north-east onto Barrenjoey Road.

The following sections 4-8 describe in detail the vegetation, slope, access and egress, availability of water supplies and environmental considerations for the site.

The adjacent image is the bushfire prone land map for the area.

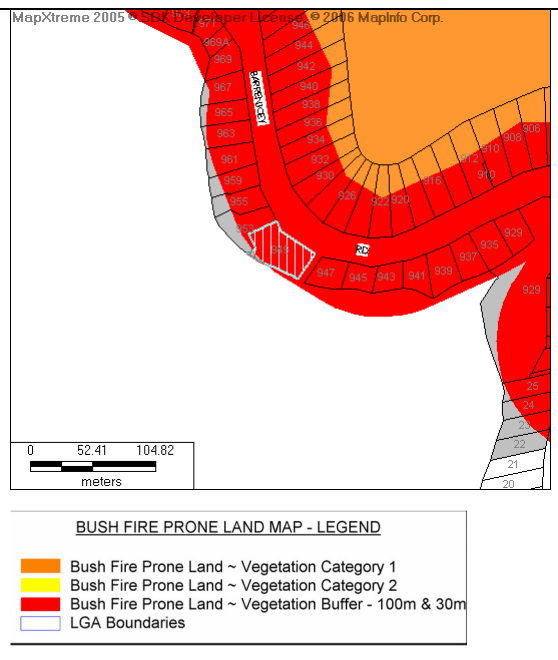

4) Classification of the Vegetation on and surrounding the Site

The site is developed and maintained and there is no threat from bushfire attack on the site.



North-east: >70m north-east of the subject site is an area of bushland that is considered a threat from bushfire attack to the site. With reference to PBP and the bushfire prone land map for the area the classification of vegetation for this hazard is forest.

South & west: waterfront

5) Assessment of Effective Slope

Effective slope away from the development site:

North & east: The slope of significance in terms of bushfire attack is of the hazard to the north-east – 19.6° upslope

South & west: Waterfront

6) Access and Egress

The site has direct access to Barrenjoey Road, which is a public road, and access and egress for emergency vehicles and evacuation is in opposite directions and appears adequate.

7) Adequacy of water supply

The area has reticulated water supply and hydrants are spaced at regular distances along Barrenjoey Road.

8) Environmental Considerations

The scope of this assessment has not been to provide an environmental assessment; however, the subject site is a small residential lot that has been developed for many years and it appears that the proposed development will have no adverse environmental effect.

9) Bushfire Risk Assessment

Table 1; Reference AS3959, 2009 Table 2.4.2

Determination of category of bushfire attack for the site and subsequent required building standards

Direction	Distance of APZ	Vegetation Classification	Assessment of Effective Slope	Anticipated Radiant heat	Bushfire Attack Level (BAL)
North-east	70m	Forest	19.6 degrees upslope	<12.5kw/m ²	BAL 12.5
South & west	>140m	Waterfront	n/a	-	-

Summary: Based upon the relevant provisions of PBP the anticipated radiant heat attack for the site is <12.5kw/m² and the subsequent minimum construction standard is BAL 12.5 AS3959, 2009.

10) Assessment of the extent to which the construction conforms or deviates from Chapter 4 of 'Planning for Bushfire Protection 2006'

The proposed development conforms to the requirements of PBP for bushfire protection measures for infill development in relation to:

Performance Criteria	Acceptable Solutions	Meets Performance Criteria
The intent may be achieved where:		
<u>In relation to APZ's:</u> - Defendable space is provided - An APZ is provided and maintained for the life of the building	Defendable space is provided on all sides of the building. Asset protection zones are provided partially on site and by adjoining development and public roads.	Yes
<u>In relation to siting and design:</u> Buildings are sited and designed to minimise the risk of bushfire attack	The siting of the development has been determined in accordance with local council requirements and no advantage could be gained by recommending a re-siting of the garage.	Yes
<u>In relation to construction standards:</u> It is demonstrated that the proposed building can withstand bushfire attack in the form of wind, smoke, embers, radiant heat and flame contact	Construction standards have been recommended in accordance with the requirements of PBP	Yes
<u>In relation to access requirements:</u> Safe operational access is provided [and maintained] for emergency services personnel in suppressing a bushfire while residents are seeking to relocate, in advance of a bushfire.	The access and egress requirements have been designed to provide safe and effective evacuation from the subject site and appear to be adequate for fire brigade personnel and firefighting equipment.	Yes
<u>In relation to water and utility services:</u> - Adequate water and electricity services are provided for fire-fighting operations - gas and electricity services are located so as to not contribute to the risk to a building	The area has reticulated water supply and the nearest street hydrant is within the minimum required distance from the most distant point of the subject site in accordance with the requirements of PBP and AS2419.1 2005 This report shall recommend compliance with PBP 4.1.3 for services including electricity and gas.	Yes
<u>In relation to landscaping:</u> It is designed and managed to minimise flame contact and radiant heat to buildings, and the potential for wind driven embers to cause ignitions	The site is landscaped and managed and no part of the site is shown on the bushfire prone land map as a hazard. The landscaping on the site complies with the principles of Appendix 5 of PBP.	Yes
<u>In relation to Emergency and Evacuation Planning:</u>	An emergency evacuation plan is not recommended as a condition of consent.	Yes

11) Recommendations

The following recommendations are made for the bushfire protection measures for the proposed development of a new Class 10a garage and entrance driveway at No 949 Barrenjoey Road, Palm Beach and are based upon the relevant provisions of the NSW Rural Fire Service guideline entitled *Planning for Bushfire Protection 2006*.

- 1) Construction Standard: The proposed development shall be constructed to a minimum standard of Section 3 [construction general] and Section 5 [BAL 12.5] of AS3959, 2009 '*Construction of Buildings in Bushfire Prone Areas*' and Section A3.7 of the NSW Rural Fire Service Addendum to Appendix 3 of '*Planning for Bushfire Protection 2006*'.
- 2) Construction Standard Class 10b: At the planning stage, class 10b buildings in bushfire prone areas should be non-combustible. [Class 10b buildings include a retaining or free standing wall, swimming pool or the like.]
- 3) Fences and Gates: All new fencing and gates shall be constructed in accordance with the NSW Rural Fire Service guideline: Fast Fact – *Fences or Gates in Bushfire Prone Areas*. [Refer Section 14 of this report]
- 4) Electricity and Gas Supplies: As far as practical, new electricity and gas supplies shall be installed in accordance with the requirements of 4.1.3 of PBP. Note: 4.1.3 of PBP requires that '*where practical, electrical transmission lines should be underground*' and '*the location of gas services will not lead to ignition of surrounding bushland or the fabric of the building*'.
- 5) Existing Dwelling: The proposal does not include alterations, additions or renovations of the existing dwelling and in accordance with the NSW Rural Fire Service advice this report does not include recommendations for the upgrading of the existing dwelling.
- 6) Asset Protection Zones: At the commencement of building works and in perpetuity, the entire property shall be managed as an inner protection area as outlined within PBP and the NSW RFS document '*Standards for asset protection zones*'.

The following points are a guide to Inner Protection area requirements.

The Inner Protection Area should comprise of the following:

- Minimal fine fuel on the ground;
- Vegetation that does not provide a continuous path to the building for the transfer of fire;

- Shrubs and trees that do not form a continuous canopy and vegetation is planted in clumps rather than continuous rows;
 - Species that retain dead material or deposit excessive quantities of ground fuel are avoided;
 - Shrubs and trees are pruned so that they do not touch or overhang the building; and
 - Vegetation is located far enough away from the building so that plants will not ignite the building by direct flame contact or radiant heat emission.
- 7) Emergency and Evacuation Planning: The need to formulate an emergency evacuation plan has been discussed; however, an emergency evacuation plan is not recommended as a condition of consent.
- 8) Water Supplies: Reticulated water supply is located on the adjoining road at regular intervals and is easily accessible. No additional water supplies have been recommended.

12) Summary

This report consists of a bushfire risk assessment for the proposed residential development of a new Class 10a garage and entrance driveway at No 949 Barrenjoey Road, Palm Beach.

The report concludes that the proposed development is on designated bushfire prone land and the legislative requirements for development in bushfire prone areas are applicable.

The proposed development will be constructed to the minimum standards required in accordance with the guidelines of *Planning for Bushfire Protection 2006*.

This report has considered all of the elements of bushfire attack and provided the proposed development is constructed in accordance with the recommendations included in section 11 of this report, it is my considered opinion that the development satisfies the Objectives and Performance requirements of the *Building Code of Australia, Planning for Bushfire Protection 2006 and Australian Standard AS3959, 2009*.

Notwithstanding the precautions adopted, it should always be remembered that bushfires burn under a wide range of conditions and an element of risk, no matter how small always remains, and although the standard is designed to improve the performance of such

buildings, there can be no guarantee, because of the variable nature of bushfires, that any one building will withstand bushfire attack on every occasion.

This Report is a Bush Fire Hazard Assessment that provides the required information to assist Local Council and the Rural Fire Service in determining compliance in accordance with Planning for Bushfire Protection and AS 3959, 2009. The Local Council is the Final Consenting Authority and the construction of the building must comply with the recommendations included in the Council's conditions of consent.



Ron Coffey – Bushfire Safety Engineer
Grad I Fire E [Institute of Fire Engineers - 1973]
Grad Cert Fire Safety Eng [UWS - 2003]
Grad Dip Building in Bushfire Prone Areas [UWS – 2005]
Ass Prof Cert in Expert Evidence in the Land & Environment Court [UTS – 2005]
Corporate Member - Institute of Fire Engineers
Member - Fire Protection Association Australia



*Planning for Bushfire Protection Pty Ltd
Fire Protection Association of Australia
BPAD-A Certified Practitioner/Certified Business
Certification No BPD-PA09328
02 9997 5797 - 0408220443*

13) References

Australian Building Codes Board

Building Code of Australia
Volumes 1&2
Canprint

Australian Building Codes Board [2001]

Fire Safety Engineering Guidelines
Edition 2001
ABCB Canberra

D. Drysdale D. [1998]

Introduction to Fire Dynamics 2nd Edition
John Wiley & Sons Ltd

NSW Government Environmental Planning and Assessment Act [1979]

Part 79BA – Consultation and development Consent – Certain Bushfire Prone Land
NSW Government Printer

Planning NSW [2006]

Planning for Bushfire Protection 2006

A Guide for Councils, Planners, Fire Authorities, Developers and Home Owners

This document provides the necessary planning considerations when developing areas for residential use in residential, rural residential, rural and urban areas when development sites are in close proximity to areas likely to be affected by bushfire events and replaces Planning for Bushfire Protection 2001.

[This document is essential reading: Download a copy from the RFS website or purchase a copy through the NSW Government Online Shop or phone 9228 6333](#)

Ramsay C & Rudolph L [2003]

Landscape and Building Design for Bushfire Prone Areas
CSIRO Publishing

Standards Australia [2009]

Australian Standards 3959
Australian Building Code Board

14) Fences and Gates

BAL 12.5 & BAL 19

1. Where a timber fence does not connect to a dwelling and has a minimum of 1 metre separation from the dwelling then a fence may be constructed from hardwood, or non-combustible material.
2. Where a fence connects directly to or has less than 1 metre separation from a dwelling it should be constructed from non-combustible materials only.
3. In all cases where timber fences are proposed, care should be taken in the selection, location and maintenance of landscaping adjoining the fence. Unmanaged landscaping could promote fire activity due to ember, radiant heat and direct flame contact and then further impact timber fencing.

The above is based on the premise that construction for level 1 & 2 dwellings is sufficiently removed from the main fire front and won't be subjected to direct flame contact or extreme levels of radiant heat that may cause ignition of combustible materials. However, dwellings could still be exposed to significant levels of ember attack and relatively high levels of radiated heat that may cause fences to ignite.

BAL 29, BAL 40 &/or Flame Zone

Dwellings assessed as requiring these construction levels shall have fencing constructed from non-combustible materials e.g. Sheet metal or masonry. This is due to the increased likelihood of direct flame contact causing ignition of combustible materials which may provide a fire path to the dwelling.