

HYDRAULIC DETAILS FOR PROPOSED RESIDENTIAL ALTERATION & ADDITION AT 147 FRENCHS FOREST RD WEST, FRENCHS FOREST, NSW 2086

DRAWING LIST - CIVIL / HYDRAULICS

S01	DRAWING TITLE, INDEX & NOTES
S02	ROOF DRAINAGE DETAILS
S03	GROUND FLOOR DRAINAGE PLAN
S04	DETAILS
S05	SEDIMENT CONTROL PLAN

NO OSD IS REQUIRED.



10.	17.7	240	52.2	810	154	2380
5.	12.5	190	36.9	570	109	1680
4.	11.2	175	33.0	510	97.2	1500
3.	9.7	150	28.6	440	84.2	1300
2.	7.9	120	23.3	360	68.7	1060
1.	5.6	85	16.5	260	48.6	750
FRICTION SLOPE (%)	Q (l/s)	EIA (m2)	Q (l/s)	EIA (m2)	Q (l/s)	EIA (m2)
	Ø100 mm uPVC		Ø150mm uPVC		Ø225 mm uPVC	

EIA = EQUIVALENT IMPERVIOUS AREA

HYDRAULIC NOTES



- H.1. ALL SERVICES ARE TO BE LOCATED IN THE FIELD IN CONJUNCTION WITH A RESPONSIBLE OFFICER OF EACH RELEVANT AUTHORITY PRIOR TO COMMENCEMENT OF CONSTRUCTION.
- H.2. DRAINAGE PITS ARE TO BE 450 mm SQUARE OR LARGER AND FITTED WITH A GALVANISED GRATE.
- H.3. DRAINAGE PIPE SIZES ARE Ø100 mm UNLESS NOTED.
- H.4. DRAINAGE PIPES SHALL BE SEWER GRADE PVC UNLESS NOTED.
- H.5. ALL BARE SOIL AREAS ARE TO BE PROTECTED FROM EROSION BY TEMPORARY MEASURES RE-VEGETATED AT CESSATION OF CONSTRUCTION.
- H.6. A SEDIMENT CATCHMENT POND IS TO BE PROVIDED AT THE RATE OF 120 m3 CAPACITY PER HECTARE DRAINED. THE DETENTION TANKS MAY BE USED FOR THIS PURPOSE, PROVIDED SUFFICIENT WATER IS RETAINED AS A POOL DURING CONSTRUCTION & ADEQUATE SAFETY FENCING IS PROVIDED.
- H.7. THE DOWNHILL BOUNDARY OF THE SITE IS TO BE PROTECTED BY HAY BALE OR FILTER FABRIC FENCE DURING CONSTRUCTION AS SHOWN IN ATTACHED DETAIL.
- H.8. THE STREET DRAINAGE PIT LOCATED DOWNHILL OF THE SITE SHALL BE PROTECTED FROM SEDIMENT WITH HAY BALES.
- H.9. A SINGLE CONSTRUCTION ENTRANCE SHALL BE ESTABLISHED IN THE MANNER SHOWN IN ATTACHED H.9 DETAIL.
- H.10. ALL EROSION PROTECTION MEASURES TO MEET THE REQUIREMENTS OF THE DEPT. OF CONSERVATION AND LAND MANAGEMENT AS OUTLINED IN 'URBAN EROSION & SEDIMENT CONTROL', SCS TECH. HANDBOOK No.2 1978 UNLESS SPECIFIED BY COUNCIL.


SPECIAL NOTES

1. ALL PIPES TO BE LAID ON 75 mm SAND BED WITH THE BARRELS FULLY SUPPORTED ("B" CLASS BEDDING)
2. PROVIDE "CLEANING EYES" TO ALL DOWN PIPES NOT DIRECTLY CONNECTED TO PITS.
3. "HEAVY DUTY" GRATES AND COVERS ARE TO BE PROVIDED IN TRAFFICABLE AREAS.
4. THE SUMP IN THE DETENTION TANK SHALL BE DELETED.
5. ORIFICE PLATES USED TO RESTRICT THE OUTFLOW MUST BE MACHINED TO THE EXACT DIMENSION AS CALCULATED, FROM MINIMUM 3 mm THICK STAINLESS STEEL OR 3 mm THICK GALVANISED STEEL AFTER MACHINING. THEY MUST BE CAST IN THE PIT WALLS OR PERMANENTLY FIXED IN THE PIT BY SOME APPROVED METHOD SO THEY CANNOT BE EASILY REMOVED.
6. A PLAQUE MEASURING NO LESS THAN 400 mm X 200 mm SHALL BE IN SOME WAY PERMANENTLY ATTACHED AND PROMINENTLY DISPLAYED WITHIN THE IMMEDIATE VICINITY OF THE OSD DEVISE. THIS PLAQUE SHALL ADVISE OCCUPIERS OF THE PROPERTY OF THE EXISTENCE OF THE OSD DEVISE AND ALSO THAT THE DEVISE IS NOT IN ANY WAY TO BE TAMPERED WITH OR CHANGED WITHOUT PRIOR WRITTEN CONSENT OF COUNCIL.
7. THE CONSTRUCTED OSD INSTALLATION MUST BE APPROPRIATELY CERTIFIED BY A SUITABLY QUALIFIED AND EXPERIENCED CONSULTING ENGINEER (GENERALLY CP ENG. QUALIFICATION) WHO MUST STATE THAT IT COMPLIES WITH COUNCIL'S OSD POLICY, ALL RELEVANT CODES AND STANDARDS AND ALSO THAT IT IS GENERALLY IN ACCORDANCE WITH APPROVED PLANS.
8. UPON COMPLETION OF THE OSD WORKS, WORK-AS-EXECUTED (WAE) PLANS SHALL BE SUBMITTED TO THE COUNCIL BY THE CONSULTING ENGINEER/REGISTERED SURVEYOR TO VERIFY THAT THE VOLUME OF STORAGE HAS BEEN ATTAINED AND THAT CRITICAL WATER AND FLOOR LEVELS ARE IN ACCORDANCE WITH DESIGN REQUIREMENTS. ANY CHANGES OR VARIATIONS TO THE APPROVED PLANS SHALL BE HIGHLIGHTED IN RED.
9. CERTIFICATION ON THE STANDARD FORM FOR ON-SITE DETENTION RECORD OF INSTALLATION ISSUED BY COUNCIL AND WAE PLANS SHALL BE SUBMITTED TOGETHER WITH THE COMPLIANCE CERTIFICATE.

CONSTRUCTION NOTES:

1. CONSTRUCT SEDIMENT FENCES AS CLOSE AS POSSIBLE TO BEING PARALLEL TO THE CONTOURS OF THE SITE, BUT WITH SMALL RETURNS AS SHOWN IN THE DRAWING TO LIMIT THE CATCHMENT AREA OF ANY ONE SECTION. THE CATCHMENT AREA SHOULD BE SMALL ENOUGH TO LIMIT WATER FLOW IF CONCENTRATED AT ONE POINT TO 50 LITRES PER SECOND IN THE DESIGN STORM EVENT, USUALLY THE 10-YEAR EVENT.
2. CUT A 150mm DEEP TRENCH ALONG THE UPSLOPE LINE OF THE FENCE FOR THE BOTTOM OF THE FABRIC TO BE ENTRENCHED.
3. DRIVE 1.5m LONG STAR PICKETS INTO GROUND @ 2.5m INTERVALS (MAX.) AT THE DOWNSLOPE EDGE OF THE TRENCH. ENSURE ANY STAR PICKETS ARE FITTED WITH SAFETY CAPS.
4. FIX SELF-SUPPORTING GEOTEXTILE TO THE UPSLOPE SIDE OF THE POSTS ENSURING IT GOES TO THE BASE OF THE TRENCH. FIX THE GEOTEXTILE WITH WIRE TIES OR AS RECOMMENDED BY THE MANUFACTURER. ONLY USE GEOTEXTILE SPECIFICALLY PRODUCED FOR SEDIMENT FENCING. THE USE OF SHADE CLOTH FOR THIS PURPOSE IS NOT SATISFACTORY.
5. JOIN SECTIONS OF FABRIC AT A SUPPORT POST WITH A 150mm OVERLAP.
6. BACKFILL THE TRENCH OVER THE BASE OF THE FABRIC AND COMPACT IT THOROUGHLY OVER THE GEOTEXTILE.

Issue	Description	Date	Design	Check	ARCHITECT/CLIENT	PROJECT:	CIVIL - HYDRAULICS		 BIJAYA GIRI (MIEAust, CPEng, NER) Prime Consulting Engineers Pty Ltd THE COPY RIGHT OF THIS DRAWING REMAINS WITH PRIME CONSULTING ENGINEERS PTY. LTD.		Prime Consulting Engineers CIVIL - STRUCTURAL - HYDRAULICS A.B.N. 34 641 874 795 Level M/ 394 LANE COVE ROAD, MACQUARIE PARK, NSW 2113 e: info@primeengineers.com.au
-------	-------------	------	--------	-------	------------------	----------	--------------------	--	--	---	--

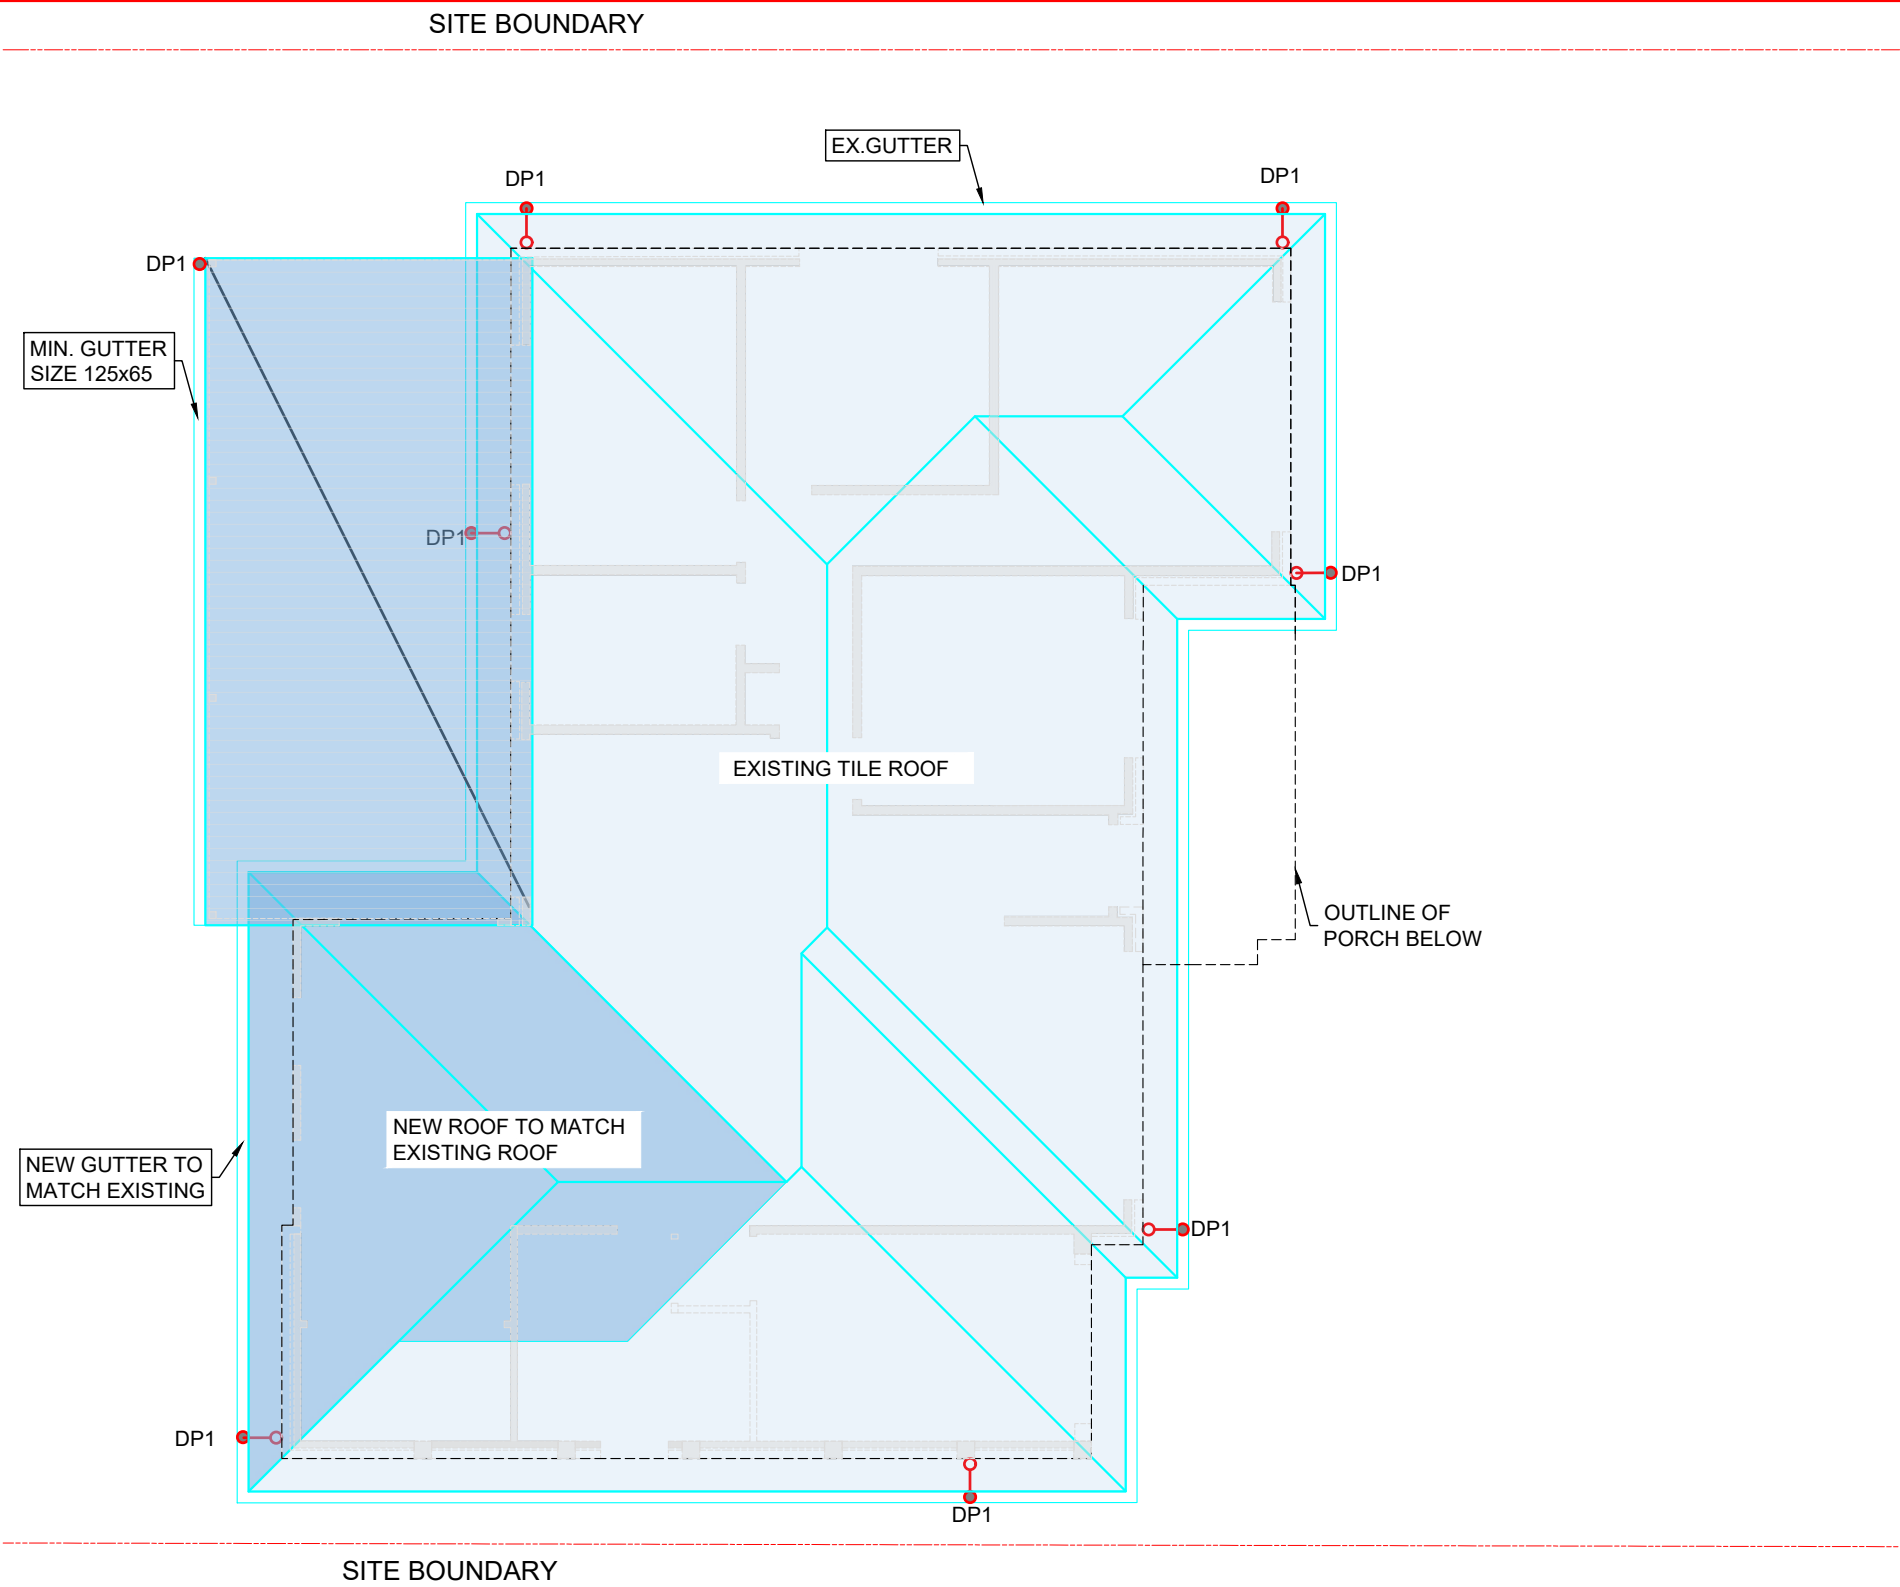

LEGEND:

- DP1 NEW DOWNPIPE (Ø100 mm uPVC)
- SW1 → NEW Ø100 uPVC STORMWATER PIPE MIN. 1% FALL (U.N.O)
- - - - - SEDIMENT CONTROL FENCE
- 600x600 GRATED PIT

ROOF DRAINAGE PLAN

SCALE 1:100


Issue	Description	Date	Design	Check	ARCHITECT/CLIENT	PROJECT:	CIVIL - HYDRAULICS	<div><div><div>REGISTERED</div><div>NER</div><div>Engineers Australia</div></div><div>BIJAYA GIRI (MIEAust, CPEng, NER) Prime Consulting Engineers Pty Ltd</div><div>THE COPY RIGHT OF THIS DRAWING REMAINS WITH PRIME CONSULTING ENGINEERS PTY. LTD.</div></div>	<div><div>PCE</div><div>Prime Consulting Engineers</div><div>CIVIL - STRUCTURAL - HYDRAULICS A.B.N. 34 641 874 795 Level M/ 394 LANE COVE ROAD, MACQUARIE PARK, NSW 2113 e: info@primeengineers.com.au w: www.primeengineers.com.au p: 02 8964 1818 m: 0466 053 516</div></div>	
A	For Review	27/02/2025	KK	SD	JAH DESIGN/ FRANK & LISA D'URSO	HYDRAULIC DETAILS FOR PROPOSED ALTERATIONS & ADDITIONS AT 147 FRENCHS FOREST ROAD WEST, FRENCHS FOREST, NSW 2086	Size A3			Scale U.N.O 1:100
B	For Submission	08/05/2025	KK	SD						
						TITLE: ROOF DRAINAGE PLAN	DWG no. H-25-1240	Sheet no. 02		

LEGEND:

- DP1

NEW DOWNPIPE (Ø100 mm uPVC)
- SW1

NEW Ø100 uPVC STORMWATER PIPE MIN. 1% FALL (U.N.O)
- SEDIMENT CONTROL FENCE
- 600x600 GRATED PIT

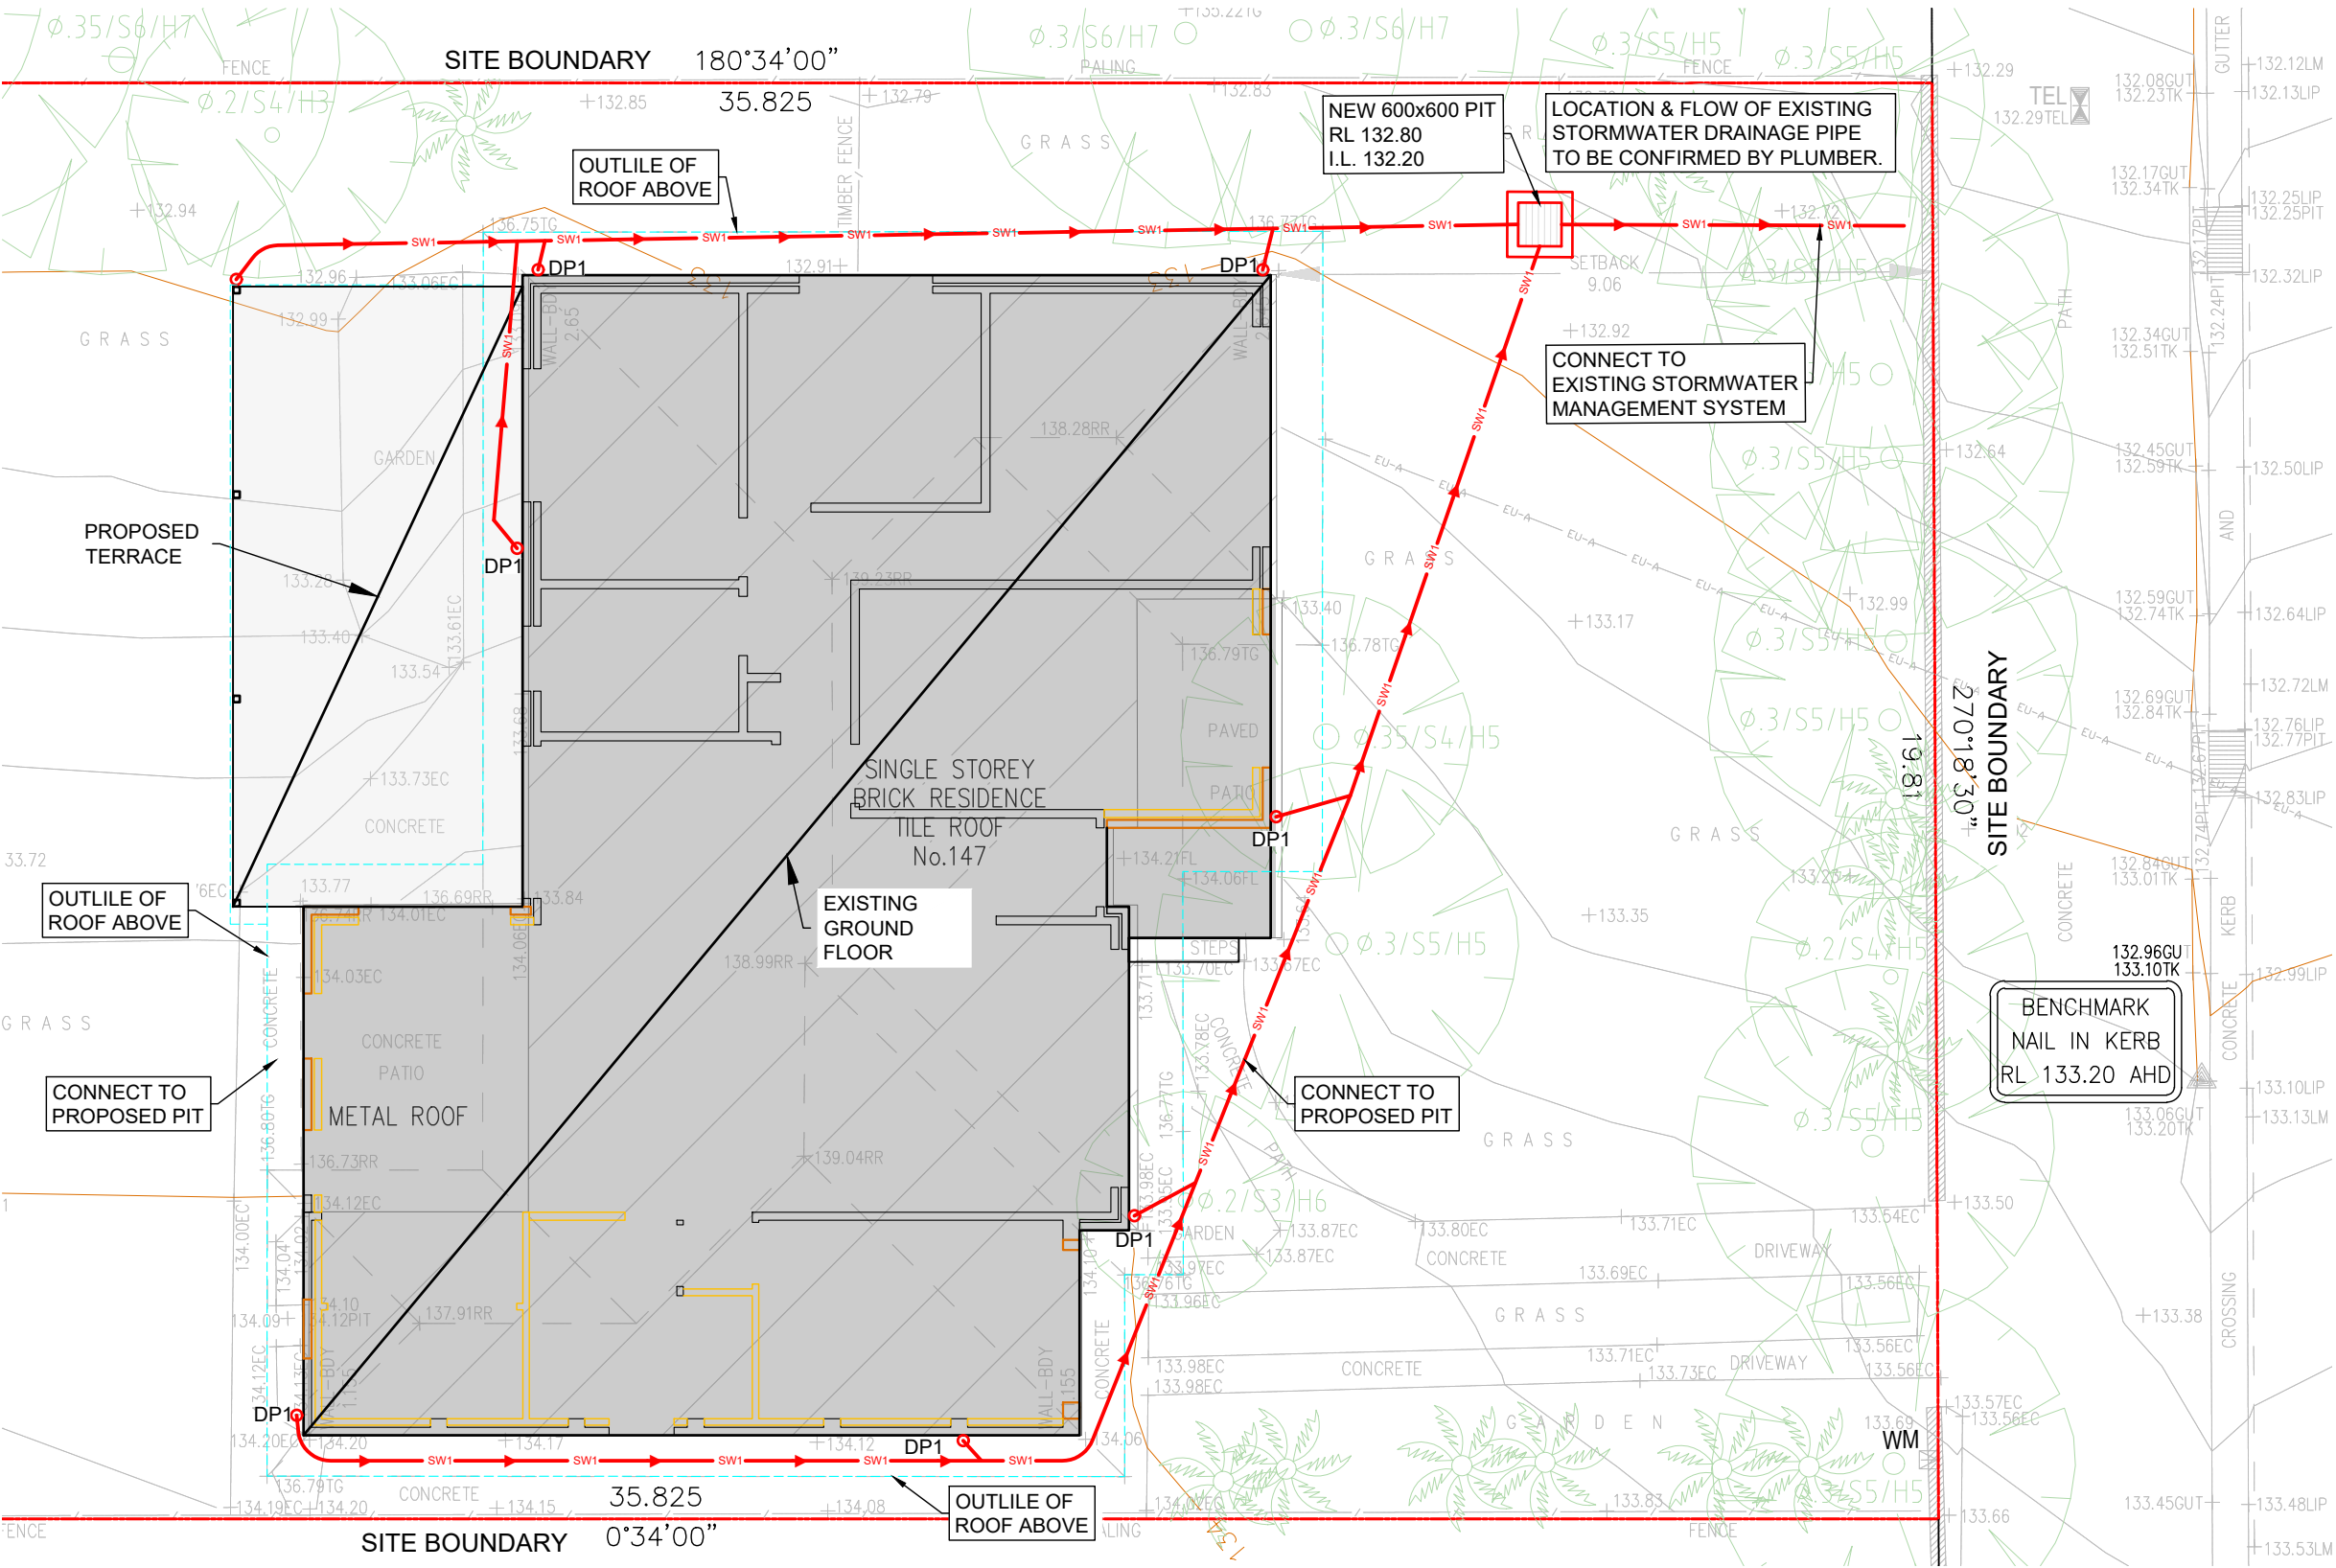

GROUND FLOOR DRAINAGE PLAN

SCALE 1:100

Issue	Description	Date	Design	Check	ARCHITECT/CLIENT
A	For Review	27/02/2025	KK	SD	JAH DESIGN/ FRANK & LISA D'URSO
B	For Submission	08/05/2025	KK	SD	

PROJECT:
HYDRAULIC DETAILS FOR PROPOSED
ALTERATIONS & ADDITIONS AT 147 FRENCHS
FOREST ROAD WEST, FRENCHS FOREST,
NSW 2086

TITLE: GROUND FLOOR DRAINAGE PLAN

CIVIL - HYDRAULICS

Size A3	Scale U.N.O 1:100
DWG no. H-25-1240	Sheet no. 03

REGISTERED
NER
Engineers Australia

BIJAYA GIRI (MIEAust, CPEng, NER)
Prime Consulting Engineers Pty Ltd

THE COPY RIGHT OF THIS DRAWING REMAINS WITH PRIME
CONSULTING ENGINEERS PTY. LTD.

PCE

Prime Consulting Engineers

CIVIL - STRUCTURAL - HYDRAULICS

A.B.N. 34 641 874 795

Level M/ 394 LANE COVE ROAD, MACQUARIE PARK, NSW 2113

e: info@primeengineers.com.au

p: 02 8964 1818

A.B.N. 34 641 874 795

Level M/ 394 LANE COVE ROAD, MACQUARIE PARK, NSW 2113

w: www.primeengineers.com.au

m: 0466 053 516

NOTE:

FOR RETENTION WATER TO BE USED IN THE GREY WATER SYSTEM, GUTTERS MUST BE FITTED WITH GUTTER GUARDS AND DOWNPIPES FITTED WITH FIRST FLUSH DIVERTER SYSTEMS.


ALL PIPELINES MUST BE ACCESSIBLE FOR CLEANING THROUGH CLEANING EYES.

CONNECTION INTO THE GREY WATER SYSTEM MUST COMPLY WITH SYDNEY WATER GUIDELINES.

NOTE:


ALL GUTTERS MUST BE FITTED WITH GUTTER GUARDS AND DOWN PIPES FITTED WITH FIRST FLUSH DIVERTER SYSTEMS.

ALL PIPELINES MUST BE ACCESSIBLE FOR CLEANING THROUGH CLEANING EYES.

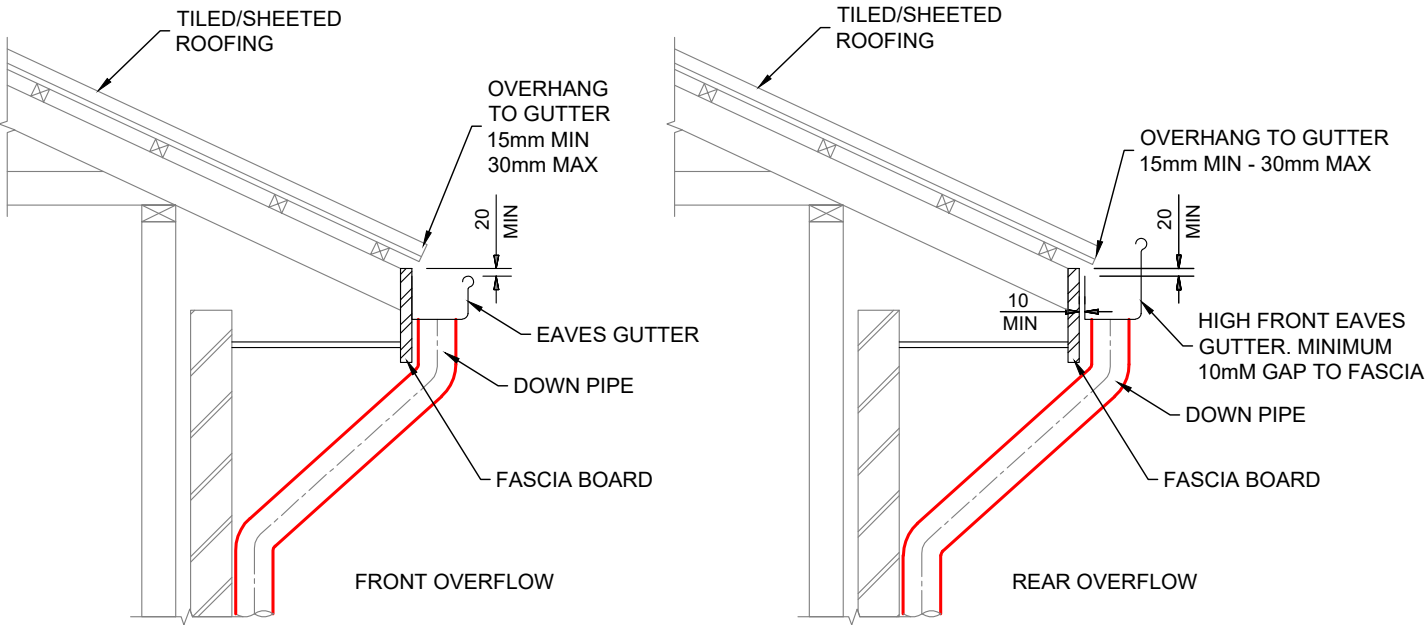


TYPICAL EAVES GUTTER DETAIL

SCALE 1:20

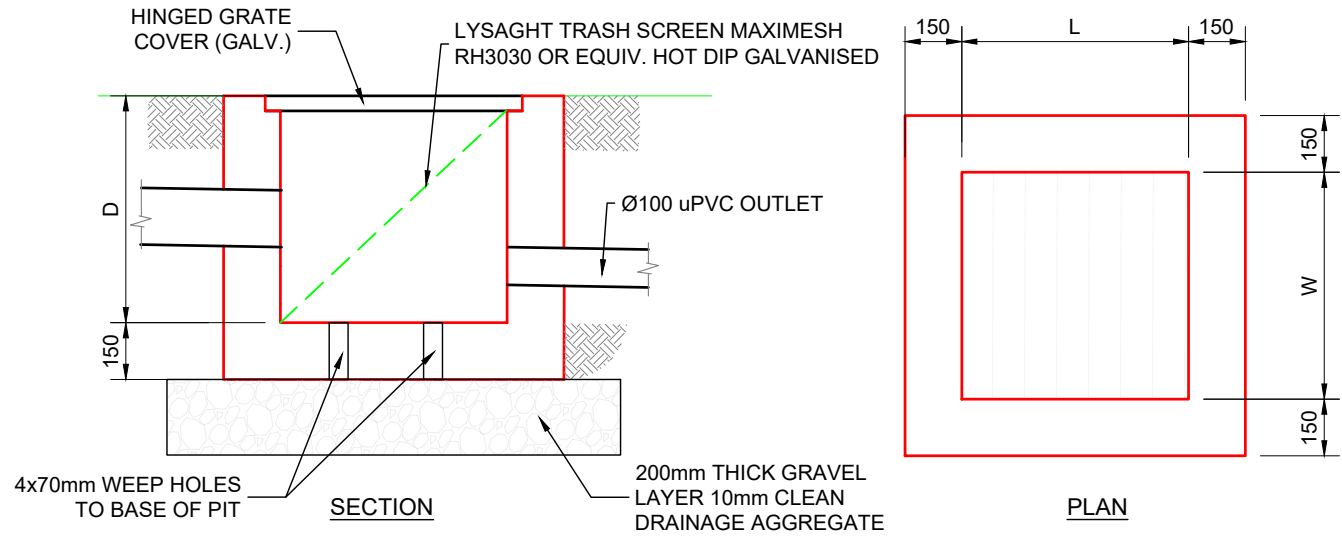

TYPICAL GRATED PIT DETAIL

SCALE 1:20

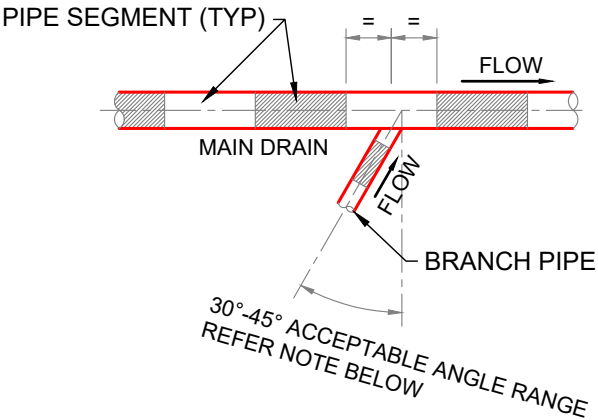

PREFERRED BRANCH LOCATION
ALONG MAIN DRAIN PLAN

Issue		Description	Date	Design	Check	ARCHITECT/CLIENT	PROJECT:	CIVIL - HYDRAULICS		<div><div><div>REGISTERED</div><div>NER</div><div>Engineers Australia</div></div><div>THE COPY RIGHT OF THIS DRAWING REMAINS WITH PRIME CONSULTING ENGINEERS PTY. LTD.</div></div>	<div><div>BIJAYA GIRI (MIEAust, CPEng, NER)</div><div>Prime Consulting Engineers Pty Ltd</div></div>	<div><div>PCE</div><div>Prime Consulting Engineers</div><div>CIVIL - STRUCTURAL - HYDRAULICS</div><div>A.B.N. 34 641 874 795</div><div>Level M/ 394 LANE COVE ROAD, MACQUARIE PARK, NSW 2113</div><div>e: info@primeengineers.com.au</div><div>p: 02 8964 1818</div><div>w: www.primeengineers.com.au</div><div>m: 0466 053 516</div></div>
A	For Review	27/02/2025	KK	SD	JAH DESIGN/ FRANK & LISA D'URSO	HYDRAULIC DETAILS FOR PROPOSED ALTERATIONS & ADDITIONS AT 147 FRENCHS FOREST ROAD WEST, FRENCHS FOREST, NSW 2086	Size	Scale U.N.O				
B	For Submission	08/05/2025	KK	SD			A3	1:100				
							DWG no.	Sheet no.				
							H-25-1240	04				
						TITLE: DETAILS						


LEGEND:

- DP1

NEW DOWNPIPE (Ø100 mm uPVC)
- SW1

NEW Ø100 uPVC STORMWATER PIPE MIN. 1% FALL (U.N.O)
- SEDIMENT CONTROL FENCE


600x600 GRATED PIT

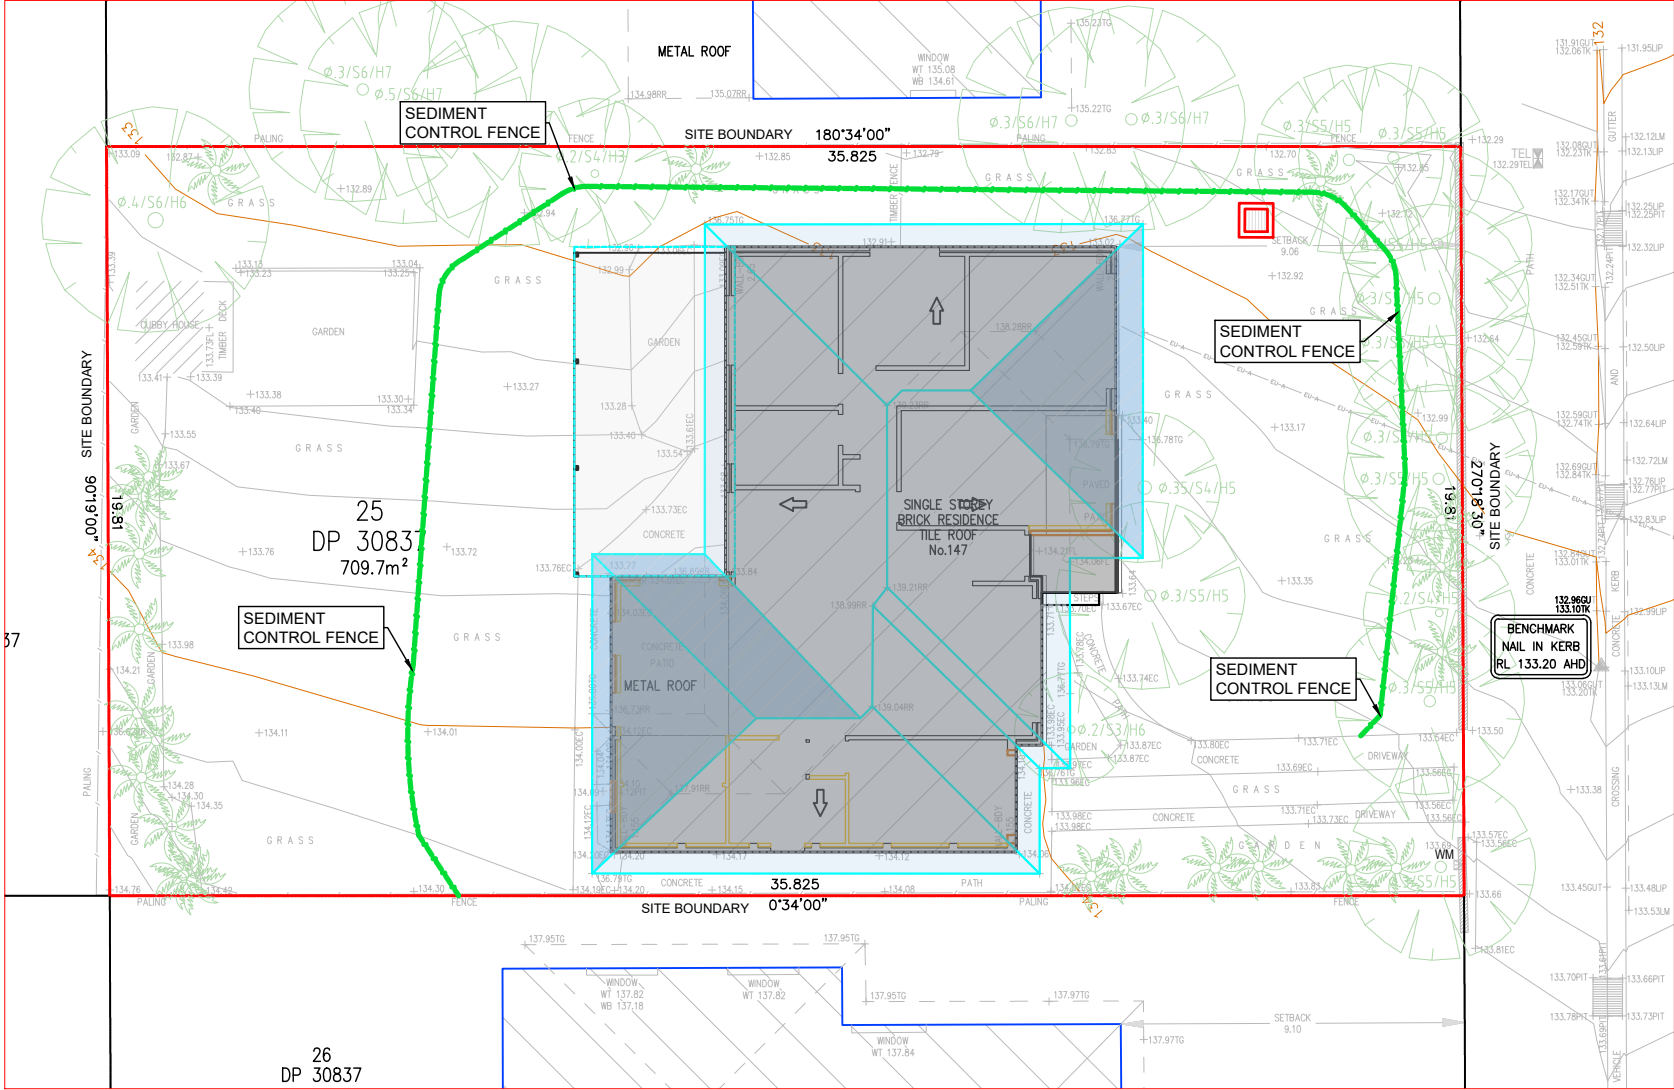

SEDIMENT CONTROL PLAN
SCALE 1:200

SEDIMENT FENCE CONSTRUCTION NOTES:


1. CONSTRUCT SEDIMENT FENCES AS CLOSE AS POSSIBLE TO BEING PARALLEL TO THE CONTOURS OF THE SITE, BUT WITH SMALL RETURNS AS SHOWN IN THE DRAWING TO LIMIT THE CATCHMENT AREA OF ANY ONE SECTION. THE CATCHMENT AREA SHOULD BE SMALL ENOUGH TO LIMIT WATER FLOW IF CONCENTRATED AT ONE POINT TO 50 LITRES PER SECOND IN THE DESIGN STORM EVENT, USUALLY THE 10-YEAR EVENT. CUT A 150mm DEEP TRENCH ALONG THE UPSLOPE LINE OF THE FENCE FOR THE BOTTOM OF THE FABRIC TO BE ENTRENCHED.
2. DRIVE 1.5m LONG STAR PICKETS INTO GROUND @ 2.5m INTERVALS (MAX.) AT THE DOWNSLOPE EDGE OF THE TRENCH. ENSURE ANY STAR PICKETS ARE FITTED WITH SAFETY CAPS. FIX SELF-SUPPORTING GEOTEXTILE TO THE UPSLOPE SIDE OF THE POSTS ENSURING IT GOES TO THE BASE OF THE TRENCH.
3. FIX THE GEOTEXTILE WITH WIRE TIES OR AS RECOMMENDED BY THE MANUFACTURER. ONLY USE GEOTEXTILE SPECIFICALLY PRODUCED FOR SEDIMENT FENCING. THE USE OF SHADE CLOTH FOR THIS PURPOSE IS NOT SATISFACTORY.
4. JOIN SECTIONS OF FABRIC AT A SUPPORT POST WITH A 150mm OVERLAP. BACKFILL THE TRENCH
5. OVER THE BASE OF THE FABRIC AND COMPACT IT THOROUGHLY OVER THE GEOTEXTILE.

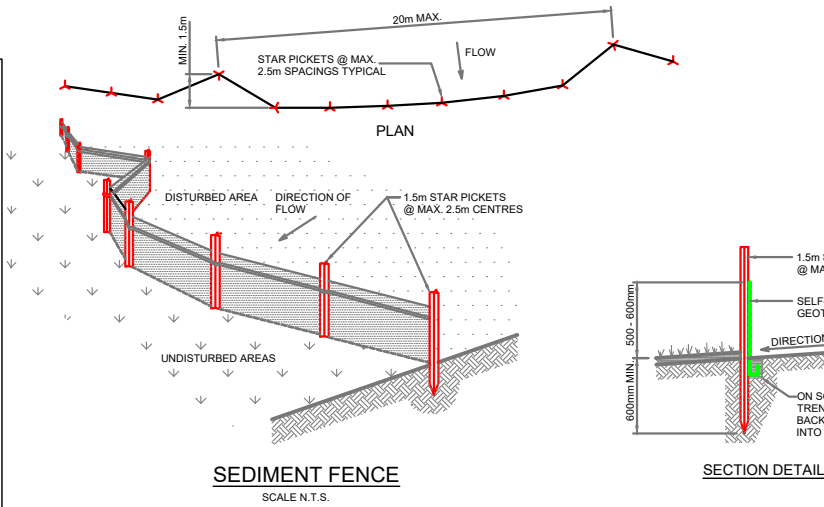

TYP. SEDIMENTATION & EROSION CONTROL DETAILS
N.T.S

NOTES


1. PLACE STOCKPILES MORE THAN 2 (PREFERABLY 5) METRES FROM EXISTING VEGETATION, CONCENTRATED WATER FLOW, ROADS AND HAZARD AREAS.
2. CONSTRUCT ON THE CONTOUR AS LOW, FLAT, ELONGATED MOUNDS.
3. WHERE THERE IS SUFFICIENT AREA, TOPSOIL STOCKPILES SHALL BE LESS THAN 2 METERS IN HEIGHT.
4. FOLLOWING THE APPROVED ESCP OR SWMP TO REDUCE THE C-FACTOR TO LESS THAN 0.10. CONSTRUCT EARTH BANKS ON THE UP-SLOPE SIDE TO DIVERT WATER AROUND STOCKPILES AND SEDIMENT FENCES 1 TO 2 METRES DOWNSLOPE.
5. STOCKPILE TO BE COVERED DURING WIND AND RAIN WEATHER CONDITIONS. PROTECTIVE GROUND COVER TO BE PLACED AS FAR AS PRACTICABLE AND MAINTAINED.

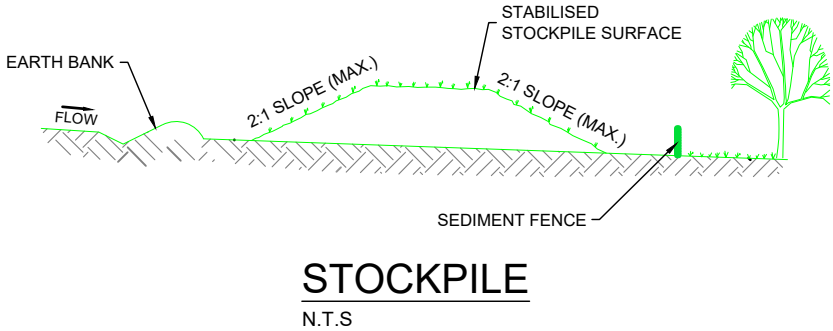

STOCKPILE
N.T.S

CONSTRUCTION NOTES:

1. STRIP THE TOPSOIL, LEVEL THE SITE AND COMPACT THE SUBGRADE.
2. COVER THE AREA WITH NEEDLE-PUNCHED GEOTEXTILE.
3. CONSTRUCT A 200mm THICK PAD OVER THE GEOTEXTILE USING ROAD BASED OR 30mm AGGREGATE
4. ENSURE THE STRUCTURE IS AT LEAST 15m LONG OR TO BUILD ALIGNMENT AND AT LEAST 3 METRES WIDE.
5. WHERE A SEDIMENT FENCE JOINS ONTO THE STABILIZED ACCESS, CONSTRUCT A HUMPS IN THE STABILIZED ACCESS TO DIVERT WATER TO THE SEDIMENT FENCE.

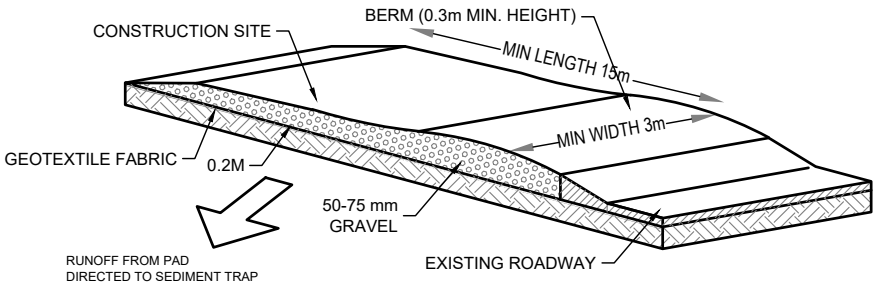

STABILIZED SITE ACCESS
N.T.S

Issue	Description	Date	Design	Check	ARCHITECT/CLIENT
A	For Review	27/02/2025	KK	SD	JAH DESIGN/ FRANK & LISA D'URSO
B	For Submission	08/05/2025	KK	SD	

PROJECT:
HYDRAULIC DETAILS FOR PROPOSED
ALTERATIONS & ADDITIONS AT 147 FRENCHS
FOREST ROAD WEST, FRENCHS FOREST,
NSW 2086

TITLE: SEDIMENT CONTROL PLAN

CIVIL - HYDRAULICS

Size
A3

DWG no.
H-25-1240

Scale U.N.O
1:100

Sheet no.
01



BIJAYA GIRI (MIEAust, CPEng, NER)
Prime Consulting Engineers Pty Ltd

THE COPY RIGHT OF THIS DRAWING REMAINS WITH PRIME
CONSULTING ENGINEERS PTY. LTD.



Prime Consulting Engineers

CIVIL - STRUCTURAL - HYDRAULICS A.B.N. 34 641 874 795
Level M/ 394 LANE COVE ROAD, MACQUARIE PARK, NSW 2113
e: info@primeengineers.com.au w: www.primeengineers.com.au
p: 02 8964 1818 m: 0466 053 516