

22 May 2023

General Manager
Northern Beaches Council
725 Pittwater Rd
DEE WHY NSW 2099

Dear Sir/Madam

Re: Stormwater Management Plan – 75 Innes Road, Manly Vale

With reference to the Development Application for the above property, please find copies of the site Stormwater Management Plan, STORM-1, for your perusal.

The plans show the proposed roofed area, along with the surrounding landscaped and hardstand areas, discharging to the kerb and gutter in Innes Road.


This is to certify that the Stormwater Management Plan layout as shown on Plan STORM-1 by Taylor Consulting Civil & Structural Engineers has been designed in accordance with section 3.1.2, 'Drainage', of the Building Code of Australia Housing Provision, AS/NZS 3500.3.2 – Stormwater Drainage and Northern Beaches Council's Water Management for Development Policy.

Should you require any further information please contact the undersigned.


Yours faithfully
TAYLOR CONSULTING

D M SCHAEFER - Director
B.E. Civil – Hons. M.I.E. Aust. N.E.R.



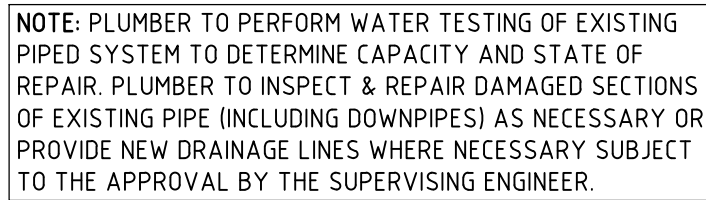



NOTE: CHECK & LOCATE DEPTH OF EXISTING MAINS & SERVICES PRIOR TO CONSTRUCTION OF STORMWATER SYSTEM AS VARIATIONS IN POSITION OF MAINS COULD AFFECT DRAINAGE CONSTRUCTION DETAILS

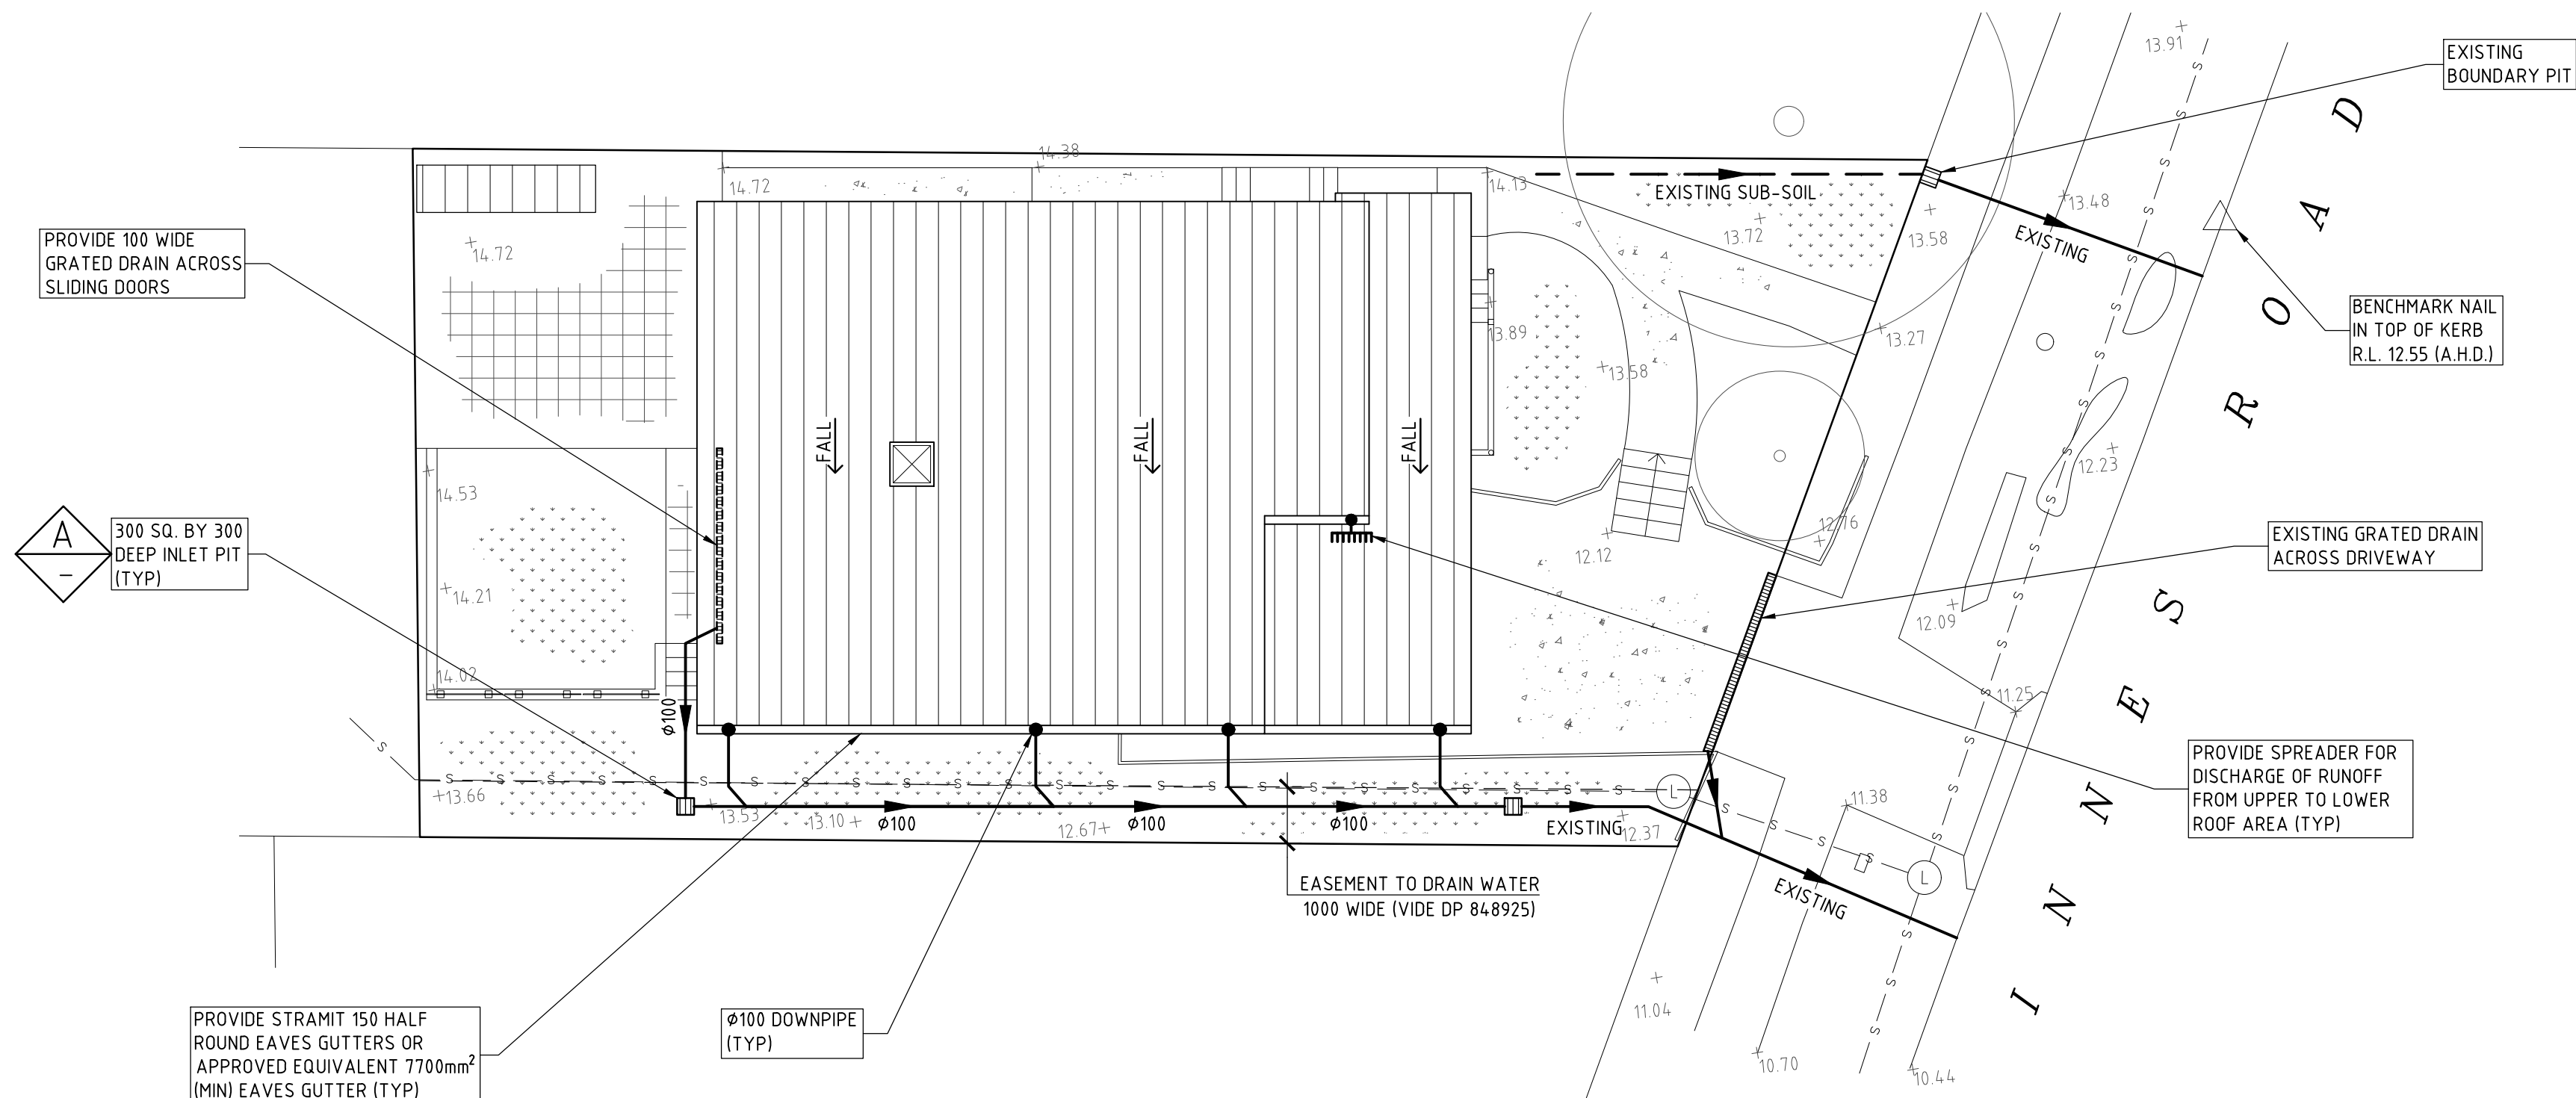

SITE DRAINAGE PLAN

SCALE 1:100

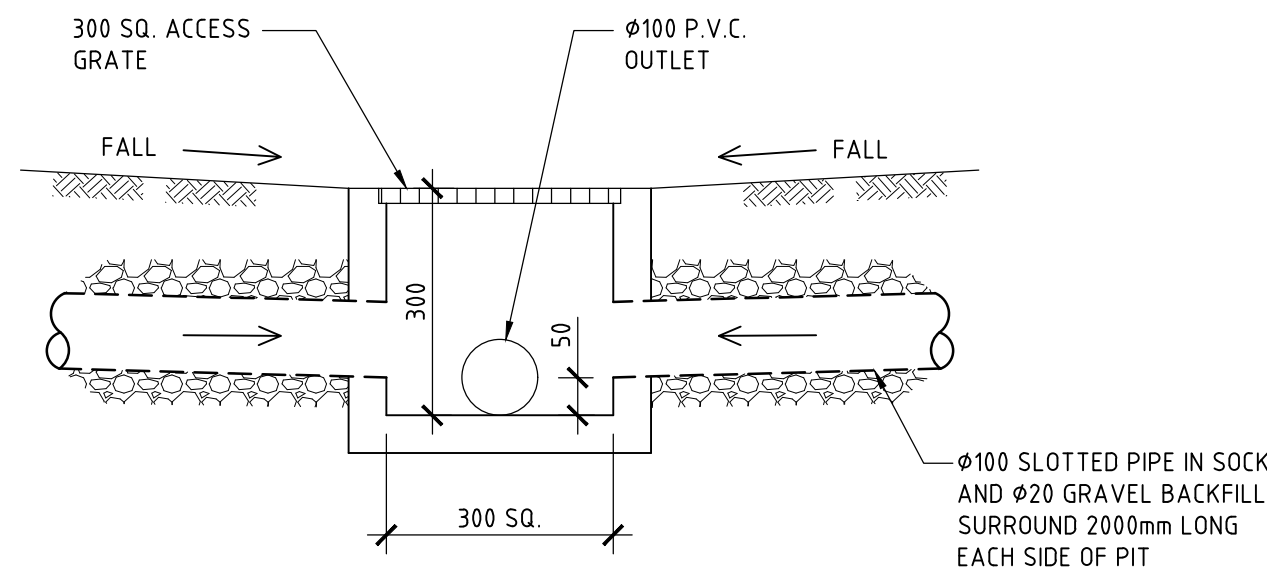

DETAIL 

SCALE 1:10

TYPICAL SURFACE
INLET PIT DETAIL

4. * DENOTES EXISTING GROUND LEVEL.
2. FALL STORMWATER PIPES AT 1% MIN. UNLESS OTHERWISE NOTED.
3. SUB-SOIL DRAINAGE TO BE CONNECTED TO THE SITE DRAINAGE SYSTEM AS NECESSARY.
4. SURFACE GRATES 300 SQ. UNLESS OTHERWISE NOTED.
5. ALL STORMWATER PIPES TO HAVE SOLVENT CEMENT WATERTIGHT JOINTS.
6. CHECK & LOCATE DEPTH OF EXISTING MAINS & SERVICES PRIOR TO CONSTRUCTION OF STORMWATER SYSTEM AS VARIATIONS IN POSITION OF MAINS COULD AFFECT DRAINAGE CONSTRUCTION DETAILS.
7. INSPECTIONS MUST BE UNDERTAKEN BY THIS OFFICE (BY PRIOR ARRANGEMENT WITH ENGINEER) DURING CONSTRUCTION TO ENABLE FULL CERTIFICATION UPON COMPLETION OF WORKS.
8. ALL CONSTRUCTION OF COUNCIL DRAINAGE WORKS TO COMPLY WITH COUNCIL STANDARD.
9. REMOVE REDUNDANT DRAINAGE PITS & SEAL PIPES.
10. PIT BENCHING TO BE HALF THE OUTGOING PIPE DIAMETER. CONCRETE FOR BENCHING TO BE 20 MPa MASS CONCRETE.
11. APPROVED PRE-CAST PITS MAY BE USED.
12. ALL PIPES TO BE LAID ON COMPACTED FINE CRUSHED ROCK OR SAND BEDDING 75mm THICK & PIPES BACKFILLED WITH SAND TO 300mm ABOVE TOP OF PIPE. ELSE ATTACHED TO UNDERSIDE OF STRUCTURE AT 600mm c/c AS NECESSARY.
13. PIPE ROUTES SHOWN ARE INDICATIVE ONLY AND SHOULD BE AS NECESSARY ACCORDING TO SITE CONDITIONS & FREE POSITIONS ETC. CONFIRM SIGNIFICANT CHANGES IN PIPES SYSTEM DETAILS WITH SUPERVISING ENGINEER PRIOR TO COMMENCEMENT OF DRAINAGE CONSTRUCTION WORKS.
14. CONTRACTOR SHALL ENSURE THAT SERVICES TO BUILDINGS NOT AFFECTED BY THE WORKS ARE NOT DISRUPTED. CONTRACTOR SHALL CONSTRUCT TEMPORARY SERVICES TO MAINTAIN SUPPLY OF WATER TO BUILDINGS WHERE REQUIRED. ONCE WORKS ARE COMPLETE AND COMMISSIONED THE CONTRACTOR SHALL REMOVE ALL TEMPORARY SERVICES AND MAKE GOOD ALL DISTURBED AREAS.
15. STORMWATER SYSTEM REQUIRES SIGNIFICANT MAINTENANCE DUE TO POTENTIAL HIGH POLLUTANT LOAD. FILTERS AND POLLUTANT TRAPS SHOULD BE CHECKED AFTER LARGE STORM EVENTS AND CLEANED EVERY 6 MONTHS.
16. PLUMBING AND DRAINAGE WORKS TO COMPLY WITH AS-3500, THE NATIONAL DRAINAGE & PLUMBING CODE.
17. WHERE POSSIBLE DRAINAGE LINES SHALL BE LAID IN AREAS PREVIOUSLY DISTURBED BY OTHER SITE WORKS AND FOLLOW TOPOGRAPHICAL FEATURES TO REDUCE IMPACT AND AVOID TREE ROOTS.
18. THIS STORMWATER MAINTENANCE PLAN HAS BEEN PREPARED FOR SUBMISSION TO COUNCIL (CERTIFIER) AND DOES NOT NECESSARILY CONTAIN ALL APPROPRIATE INFORMATION TO ENABLE AN ISSUE TO PLUMBER/BUILDER FOR CONSTRUCTION CONTACT TAYLOR CONSULTING FOR MORE INFORMATION.

SITE AREA = 299.2 m² (100%)
 PROPOSED IMPERVIOUS AREA = 227 m² (76%)
 PROPOSED LANDSCAPED AREA = 72.2 m² (24%)
 EXISTING IMPERVIOUS AREA = 237.2 m² (80%)
 EXISTING LANDSCAPED AREA = 61.93 m² (20%)

[illegible]

TITLE
STORMWATER MANAGEMENT PLAN
75 INNES ROAD, MANLY VALE

BE Civil (Hons) MIE Aust

1:100
1:10



DRAWING NO
STORM-1