



eiaustralia

Contamination | Remediation | Geotechnical

JAK NEWPORT PTY LTD



Geotechnical Investigation

54-58 Beaconsfield Street, Newport, NSW



E26083.G03_Rev2
29 May 2024

Document Control

Report Title: Geotechnical Investigation, 54-58 Beaconsfield Street, Newport, NSW

Report No: E26083.G03_Rev2

Copies	Recipient
1 Soft Copy (PDF – Secured, issued by email)	Kevin Lam JAK Newport Pty Ltd 10 James Street WATERLOO NSW 2017
2 Original (Saved to Digital Archives) (\\Pahlei-au\$\07 - Projects\E26083_JAK Projects_Newport_GI\05_Deliverables\Work in Progress\E26083.G03_Rev2 - Geotechnical Investigation Report.docx)	EI Australia Suite 6.01, 55 Miller Street, PYRMONT NSW 2009

Author	Technical Reviewer
	

Kaiyu Xu Geotechnical Engineer		Stephen Kim Senior Geotechnical Engineer	
Revision	Details	Date	Amended By
	Original	11 October 2023	
1	Updated architectural drawings	6 May 2024	KX
2	Updated recommendation to include landslide risk assessment	29 May 2024	KX/WD

© 2024 EI Australia (EI) ABN: 42 909 129 957

This report is protected by copyright law and may only be reproduced, in electronic or hard copy format, if it is copied and distributed in full and with prior written permission by EI.

Table of Contents

	Page Number
1. INTRODUCTION	1
1.1 Background	1
1.2 Proposed Development	1
1.3 Objectives	1
1.4 Scope of Works	2
1.5 Constraints	3
2. SITE DESCRIPTION	4
2.1 Site Description and Identification	4
2.2 Local Land Use	5
2.3 Regional Setting	5
3. INVESTIGATION RESULTS	7
3.1 Stratigraphy	7
3.2 Groundwater Observations	8
3.3 Test Results	8
4. RECOMMENDATIONS	10
4.1 Geotechnical Issues	10
4.2 Dilapidation Surveys	10
4.3 Excavation Methodology	10
4.3.1 <i>Excavation Assessment</i>	10
4.3.2 <i>Excavation Monitoring</i>	11
4.4 Groundwater Considerations	12
4.5 Excavation Retention	13
4.5.1 <i>Support Systems</i>	13
4.5.2 <i>Geotechnical Hazard Risk Zone</i>	13
4.5.3 <i>Slope Stability & Risk Assessment</i>	14
4.5.4 <i>Retaining Wall Design Parameters</i>	15
4.6 Foundations	18
4.7 Basement Floor Slab	18
5. FURTHER GEOTECHNICAL INPUTS	19
6. STATEMENT OF LIMITATIONS	20
REFERENCES	21
ABBREVIATIONS	21

Schedule of Tables

Table 1-1	Augering and Rock Coring Depths	2
Table 1-2	Hand Augering and DCP Depths	3
Table 2-1	Summary of Site Information	4
Table 2-2	Summary of Local Land Use	5
Table 2-3	Topographic and Geological Information	5
Table 3-1	Summary of Subsurface Conditions	7
Table 3-2	Groundwater Levels	8
Table 3-3	Summary of Soil Laboratory Test Results	8
Table 4-1	Property Risk Assessment for Proposed Development	14
Table 4-2	Geotechnical Design Parameters	17

Appendices

FIGURES

- Figure 1 Site Locality Plan
- Figure 2 Borehole Location Plan

APPENDIX A – BOREHOLE LOGS AND EXPLANATORY NOTES

APPENDIX B – LABORATORY CERTIFICATES

APPENDIX C – VIBRATION LIMITS

APPENDIX D – IMPORTANT INFORMATION

1. Introduction

1.1 Background

At the request of JAK Newport Pty Ltd (the Client), EI Australia (EI) has carried out a Geotechnical Investigation (GI) for the proposed development at 54-58 Beaconsfield Street, Newport, NSW (the Site).

This GI report has been prepared to provide advice and recommendations to assist in the preparation of designs for the proposed development. The investigation has been carried out in accordance with the agreed scope of works outlined in EI's proposal referenced P21473.1, dated 22nd June 2023, and with the Client's signed authorisation to proceed, dated 28th July 2023.

1.2 Proposed Development

The following documents, supplied by the Client, were used to assist with the preparation of this GI report:

- Site Survey Plan prepared by SCS Engineering Surveyors – Job Number 18084, Drawings No. 18084-DET-01 dated 22 April 2023;
- Architectural Drawings prepared by PBD Architects – Project Number 2311, Drawing Nos. DA000 to DA004, DA100 to DA104, DA200, DA201, and DA300 to DA302, Issue B, dated 2 May 2024; and
- Geotechnical Assessment Report prepared by JK Geotechnics – Job Number 32714BCrpt, dated 29 October 2019.

Based on the provided documents, EI understands that the proposed development involves the demolition of the existing site structures and the construction of a three-storey residential development overlying a single-level basement. The basement level is proposed to have a Finished Floor Level (FFL) of between RL 13.0m AHD. A Bulk Excavation Level (BEL) of approximately RL 12.7m AHD is assumed, which includes allowance for the construction of the basement slab. To achieve the BEL, excavation depths from 3.7m to 10.7m Below Existing Ground Level (BEGL) have been estimated. Locally deeper excavations may be required for footings, lift overrun pits, crane pads, and service trenches.

1.3 Objectives

The objective of the GI was to assess site surface and subsurface conditions at six borehole locations, and to provide preliminary geotechnical advice and recommendations addressing the following:

- Excavation methodologies and monitoring requirements
- Groundwater considerations
- Vibration considerations
- Excavation support requirements, including preliminary geotechnical design parameters for retaining walls and shoring systems
- Building foundation options, including;
 - Preliminary design parameters

- Earthquake loading factor in accordance with AS1170.4:2007
- The requirement for additional geotechnical works

1.4 Scope of Works

The scope of works for the GI included:

- Preparation of a Work Health and Safety Plan;
- Review of relevant geological maps for the project area;
- Site walkover inspection by a Geotechnical Engineer to assess topographical features and site conditions;
- Scanning of proposed borehole locations for buried conductive services using a licensed service locator with reference to Dial Before You Dig (DBYD) plans;
- Auger drilling of three boreholes (BH1M, BH2, BH3M) by a track-mounted drill rig using solid flight augers equipped with a 'Tungsten-Carbide' (T-C) bit. The boreholes were auger drilled to depths as shown in **Table1-1** below.
- Continuation of BH1M, BH2, BH3M using NMLC diamond coring techniques to termination depths shown above in **Table 1-1**. The rock core photographs are presented in **Appendix A**

Table 1-1 Augering and Rock Coring Depths

Borehole ID	Augering		Rock Coring	
	Depth (m)	RL (m AHD)	Depth (m)	RL (m AHD)
BH1M	4.48	13.02	9.62	7.88
BH2	2.46	16.84	9.05	10.25
BH3M	6.45	13.15	12.00	7.60

- Standard Penetration Testing (SPT) was carried out (as per AS 1289.6.3.1-2004), where possible, during auger drilling of the boreholes to assess soil strength/relative densities
- Measurements of groundwater seepage/levels, where possible, in the augered sections of the boreholes during and shortly after completion of auger drilling
- The strength of the bedrock in the augered sections of the boreholes was assessed by observation of the auger penetration resistance using a T-C drill bit and examination of the recovered rock cuttings. It should be noted that rock strengths assessed from augered boreholes are approximate and strength variances can be expected.
- The approximate surface levels shown on the borehole logs were interpolated from spot levels shown on the supplied survey plan. Approximate borehole locations are shown on **Figure 2**
- Hand auger drilling of three boreholes (BH4, BH5, and BH6) within grassy areas of the site to a refusal depth of 0.8m BEGL (RL 23.7m)

- Three Dynamic Cone Penetrometer (DCP) tests (DCP1, DCP2 and DCP3) were carried out adjacent to BH4, BH5 and BH6 these were carried out to refusal depths of 0.5m (RL 23.9m), 0.75m (RL 23.7m) and 0.7m BEGL (RL 23.8m), respectively;

Table 1-2 Hand Augering and DCP Depths

Borehole ID	Hand Auger Depth		DCP Depth	
	Depth (m)	RL (m AHD)	Depth (m)	RL (m AHD)
BH4	1.1	22.4	1.7	21.8
BH5	1.2	19.8	1.9	19.1
BH6	0.9	19.1	1.6	18.4

- Borehole BH1M and BH3M were converted into groundwater monitoring wells with depths of 9.62m BEL (RL 7.88m) and 12.0m BEGL (RL 7.6m) to allow for long-term groundwater monitoring
- Soil and rock samples were sent to STS Geotechnics Pty Ltd (STS) and SGS Australia (SGS), which are National Australian Testing Authority (NATA) accredited laboratories, for testing and storage.
- Preparation of this GI report.

EI's Geotechnical Engineer was present full-time onsite to set out the borehole locations, direct the testing and sampling, log the subsurface conditions and record groundwater levels.

1.5 Constraints

The GI was limited by the intent of the investigation and the presence of existing site structures. The discussions and advice presented in this report are preliminary and intended to assist in the preparation of initial designs for the proposed development. Further additional investigations in the form of boreholes in the northern areas of the site are required following demolition of the existing structures. Further geotechnical inspections should be carried out during construction to confirm the geotechnical and groundwater models, and the preliminary design parameters provided in this report.

2. Site Description

2.1 Site Description and Identification

The site identification details and associated information are presented in **Table 2-1** below while the site locality is shown on **Figure 1**. An aerial photograph of the site is presented in **Plate 1** below.

Table 2-1 Summary of Site Information

Information	Detail
Street Address	54-58 Beaconsfield Street, Newport, NSW
Lot and Deposited Plan (DP) Identification	Lot 7B DP 162021, Lot 6 DP 1096088, 5B DP 158658
Brief Site Description	<p>At the time of our investigation, the three lots were occupied by single storey weatherboard residential dwellings. The dwellings are accessed by a concrete driveway extending uphill from Beaconsfield Street, the driveways varied from fair to poor. The remaining areas of the site were covered with lawns and garden areas.</p> <p>The site frontage separating the development site from Beaconsfield, was formed with the use of battered soil, and minor retaining walls.</p>
Site Area	The site area is approximately 2,114m ² (based on the provided survey plan referenced above).



Plate 1: Aerial photograph of the site (source: Metromap, dated 6/5/23)

2.2 Local Land Use

The site is situated within an area of residential use. Current uses on surrounding land at the time of our presence on site are described in **Table 2-2** below. For the sake of this report, the site boundary adjacent to Beaconsfield Street shall be adopted as the Southern site boundary.

Table 2-2 Summary of Local Land Use

Direction Relative to Site	Land Use Description
North	<p>The northern site boundary adjoins a series of residential properties:</p> <p>19 Queens Parade, a residential brick building offset approximately 16m North-East from the site boundary, with an in ground pool about 2m from the site boundary.</p> <p>15-17 Queens Parade, a concrete and masonry apartment and townhouse complex with an excavated basement carpark of unknown depth. This development is offset approximately 6m from the site boundary.</p> <p>11 Queens Parade forms part of a larger development enclosed within SP 105766. This development wraps around the northern and western boundary of the site. Various sections of this development have excavated ground floors and basement levels. The offset from the northern and western boundary varies between 1m and 6m.</p>
East	<p>Property at 52 Beaconsfield Street is a double-storey weathered board residential house, with attached carport, lawns and a concrete driveway. The main house has an offset of about 3m from the eastern boundary.</p>
South	<p>Beaconsfield Street is two lane asphalt paved road. Beyond this is a series of brick and masonry dwellings. These structures are set back from the site boundary between 20 and 35m.</p>
West	<p>11 Queens Parade. Various sections of this property have excavated ground floors and basement levels; however there is no basement excavation beneath the western site elevation. The offset of the building from the western boundary varies between 1m and 4m.</p>

2.3 Regional Setting

The site topography and geological information for the locality is summarised in **Table 2-3** below.

Table 2-3 Topographic and Geological Information

Attribute	Description
Topography	<p>The site is located on the high north side of the road within gentle to moderately (8-10°), South-West dipping topography with site levels varying from R.L. 16.1m AHD at the South-West site corner to R.L. 23.52m AHD at the North-East site corner.</p>
Regional Geology	<p>Information on regional sub-surface conditions, referenced from NSW Department of Mineral Resources. NSW Seamless Geology Data Package, Catalogue Number: 9232 indicates the site to be underlain by the Buralow Formation (member of the Gosford Subgroup), a fine-grained, micaceous, quartz- to quartz-lithic sandstone; interbedded with siltstone, grey shale and red-brown claystone.</p>



Plate 2: Excerpt of geological map showing location of site.

3. Investigation Results

3.1 Stratigraphy

For the development of a site-specific geotechnical model, the stratigraphy observed in the GI has been grouped into five geotechnical units. A summary of the subsurface conditions across the site, interpreted from the assessment results, is presented in **Table 3-1** below. More detailed descriptions of subsurface conditions at each borehole location are available on the borehole logs presented in **Appendix A**. The details of the methods of soil and rock classifications, explanatory notes and abbreviations adopted on the borehole logs are also presented in **Appendix A**.

Table 3-1 Summary of Subsurface Conditions

Unit	Material ²	Depth to Top of Unit (m BEGL) ¹	RL of Top of Unit (m AHD) ¹	Observed Thickness (m)	Comments
1	Fill/Topsoil	0.00	17.5 to 23.5	0.4 to 0.8	Fill and topsoil was assessed, based on our observations during drilling and DCP/SPT tests to be poorly compacted. Sections of concreted driveway were cracked and degrading.
2	Residual Soil	0.4 to 0.8	16.85 to 22.7	3.83 to 5.9 ₃	High plasticity, stiff to very stiff becoming hard silty clay and sandy clay with trace ironstone gravels, grading into extremely weathered sandstone with depth. SPT values ranged from 17 to refusal indicated by hammer bounce.
3	Class V Sandstone	4.48 to 6.45	13.02 to 14.58	0.62 to 0.67	Distinctly weathered, very low to low strength sandstone, with very closely spaced defects.
4	Class IV Sandstone	4.72 to 5.15	12.35 to 14.58	1.45 to 2.08	Distinctly to slightly weathered, low to medium strength sandstone with siltstone laminations. The sandstone generally consisted of closely spaced defects. Unit 4 was not observed in BH3M.
5	Class III Sandstone	6.6 to 7.07	10.9 to 12.53	- ⁴	Slightly weathered to fresh, high strength sandstone. The Sandstone generally consisted of moderately spaced defects. We note that in BH3M, thinly laminated laminites (comprising of sandstone and siltstone) was noted between 10.0m to 10.7m BEGL, or RL 9.6m to 8.9m.

Note 1 Approximate depth and level at the time of our assessment. Depths and levels may vary across the site.

Note 2 For more detailed descriptions of the subsurface conditions, reference should be made to the borehole logs attached to **Appendix A**.

Note 3 Observed up to termination depth in BH4 to BH6.

Note 4 Observed up to termination depth in BH1M to BH3M.

3.2 Groundwater Observations

No groundwater or significant seepage was observed during or after auger drilling of the boreholes. Water circulation due to coring within the boreholes prevented further observations of groundwater levels within BH1M, BH2 and BH3M.

Groundwater monitoring wells were installed in BH1M and BH3M. The groundwater levels were then measured within the monitoring wells as per **Table 3-2** below:

Table 3-2 Groundwater Levels

Borehole ID	Measurement Date	Depth to Groundwater (m BEGL)	Groundwater RL (m AHD)
BH1M	3/8/23	5.65	11.85
BH3M	3/8/23	6.76	12.84

3.3 Test Results

Three soil samples were selected for laboratory testing to assess the following:

- Atterberg Limits and Linear Shrinkage
- Soil aggressivity (pH, chloride and sulfate content and electrical conductivity).

A summary of the soil test results is provided in **Table 3-2 and Table 3-3** below. Laboratory test certificates are presented in **Appendix B**.

Table 3-3 Summary of Soil Laboratory Test Results

Test/ Sample ID	BH1M_1.5-1.95	BH1M_3.0-3.45	BH3_3.0-3.45
Unit	2	2	2
Material Description ¹	Silty CLAY	Silty CLAY	Silty CLAY
Aggressivity	Chloride Cl (ppm)	-	140
	Sulfate SO ₄ (ppm)	-	47
	pH	-	4.9
	Electrical Conductivity (µS/cm)	-	110
Moisture Content (%)	6.6	16.9	8.5
Atterberg Limits	Liquid Limit (%)	-	60.0
	Plastic Limit (%)	-	24.0
	Plasticity Index (%)	-	36.0
	Linear Shrinkage (%)	-	15.0

Note 1 More detailed descriptions of the subsurface conditions at each borehole location are available on the borehole logs presented in **Appendix A**.

The Atterberg Limits result on the selected clay sample indicated clays to be highly plastic and moderate shrink-swell potential.

The assessment indicated low permeability soil was present above the groundwater table. In accordance with Tables 6.4.2(C) and 6.5.2(C) of AS 2159:2009 'Piling – Design and

Installation', the results of the pH, chloride and sulfate content and electrical conductivity of the soil provided the following exposure classifications:

- 'Mild' for buried concrete structural elements; and
- 'Non-Aggressive' for buried steel structural elements.

23 selected rock core samples were tested by Macquarie to estimate the Point Load Strength Index (Is_{50}) values to assist with rock strength assessment. The results of the testing are summarised on the attached borehole logs.

The point load strength index tests correlated reasonably well with our field assessments of rock strength. The approximate Unconfined Compressive Strength (UCS) of the rock core, estimated from correlations with the point load strength index test results, varied from <1 MPa to 80 MPa.

4. Recommendations

4.1 Geotechnical Issues

Based on the results of the assessment, we consider the following to be the main geotechnical issues for the proposed development:

- Basement excavation and retention to limit lateral deflections and ground loss as a result of excavations, resulting in damage to nearby structures
- Rock excavation
- Foundation design for building loads

4.2 Dilapidation Surveys

Prior to excavation and construction, we recommend that detailed dilapidation surveys be carried out on all structures and infrastructures surrounding the site that falls within the zone of influence of the excavation to allow assessment of the recommended vibration limits and protect the client against spurious claims of damage. The zone of influence of the excavation is defined by a distance back from the excavation perimeter of twice the total depth of the excavation. The reports would provide a record of existing conditions prior to commencement of the work. A copy of each report should be provided to the adjoining property owner who should be asked to confirm that it represents a fair assessment of existing conditions. The reports should be carefully reviewed prior to demolition and construction.

4.3 Excavation Methodology

4.3.1 Excavation Assessment

Prior to any excavation commencing, we recommend that reference be made to the Safe Work Australia Excavation Work Code of Practice, dated January 2020.

EI understands, based on the client supplied Architectural Drawings, that the proposed basement will require a BEL of RL 12.7m AHD including an allowance for the construction of a basement slab. To achieve the BEL excavation depths ranging from 3.7m to 10.7m BEGL are assumed. Locally deeper excavations for footings, service trenches, crane pads and lift overrun pits may be required.

Based on the borehole logs, the proposed basement excavations will therefore extend through all soil and rock units as outlined in **Table 3-1** above. As such, an engineered retention system must be installed prior to excavation commencing.

Units 1 and 2 could be excavated using buckets of large earthmoving Hydraulic Excavators, particularly if fitted with 'Tiger Teeth'. Excavation of Units 3, 4 and 5 (where encountered) may present hard ripping, or "hard rock" excavation conditions. Ripping would require a high capacity and heavy bulldozer for effective production. Wear and tear should also be allowed for. The use of a smaller size bulldozer will result in lower productivity and higher wear and tear, and this should be allowed for. Alternatively, hydraulic rock breakers, rock saws, ripping hooks or rotary grinders could be used, though productivity would be lower and equipment wear increased, and this should be allowed for.

Should rock hammers be used for the excavation of bedrock, excavation should commence away from the adjoining structures and the transmitted vibrations monitored to assess how close the hammer can operate to the adjoining structures while maintaining transmitted

vibrations within acceptable limits. To fall within these limits, we recommend that the size of rock hammers does not exceed a medium sized rock hammer (900 kg) such as a Krupp 580, and be trialled with a vibration monitor prior to use. The transmitted vibrations from rock hammers should be measured to determine how close each individual hammer can operate to the adjoining buildings.

The vibration measurements can be carried out using either an attended or an unattended vibration monitoring system. An unattended vibration monitoring system must be fitted with an alarm in the form of a strobe light or siren or alerts sent directly to the site supervisor to make the plant operator aware immediately when the vibration limit is exceeded. The vibration monitor must be set to trigger the alarm when the overall Peak Particle Velocity (PPV) exceeds set limits outlined by a vibration monitoring plan. Reference should be made to **Appendix C** for a guide to acceptable limits of transmitted vibrations.

If it is found that the transmitted vibrations by the use of rock hammers are unacceptable, then it would be necessary to change to a smaller excavator with a smaller rock hammer, or to a rotary grinder, rock saws, jackhammers, ripping hooks, chemical rock splitting and milling machines. Although these are likely to be less productive, they would reduce or possibly eliminate risks of damage to adjoining properties through vibration effects transmitted via the ground. Such equipment would also be required for detailed excavation, such as footings or service trenches, and for trimming of faces. Final trimming of faces may also be completed using a grinder attachment rather than a rock breaker in order to assist in limiting vibrations. The use of rotary grinders generally generates dust and this may be suppressed by spraying with water.

To assist in reducing vibrations and over-break of the sandstone, we recommend that initial saw cutting of the excavation perimeters through the bedrock may be provided using rock saw attachments fitted to the excavator. Rock sawing of the excavation perimeter has several advantages as it often reduces the need for rock bolting as the cut faces generally remain more stable and require a lower level of rock support than hammer cut excavations, ground vibrations from rock saws are minimal and the saw cuts will provide a slight increase in buffer distance for use of rock hammers. However, the effectiveness of such an approach must be confirmed by the results of vibration monitoring.

Groundwater seepage monitoring should be carried out during bulk excavation works and prior to finalising the design of a pump out facility. Outlets into the stormwater system will require Council approval.

Furthermore, any existing buried services, which run below the site, will require diversion prior to the commencement of excavation or alternatively be temporarily supported during excavation, subject to permission or other instructions from the relevant service authorities. Enquiries should also be made for further information and details, such as invert levels, on the buried services.

4.3.2 Excavation Monitoring

Consideration should be made to the impact of the proposed development upon neighbouring structures, roadways and services. Basement excavation retention systems should be designed so as to limit lateral deflections.

Contractors should also consider the following limits associated with carrying out excavation and construction activities:

- Limit lateral deflection of temporary or permanent retaining structures;
- Limit vertical settlements of ground surface at common property boundaries and services easement; and

- Limit Peak Particle Velocities (PPV) from vibrations, caused by construction equipment or excavation, experienced by any nearby structures and services.

Monitoring of deflections of retaining structures and surface settlements should be carried out by a registered surveyor at agreed points along the excavation boundaries and along existing building foundations / services/ pavements and other structures located within or near the zone of influence of the excavation. Owners of existing services adjacent to the site should be consulted to assess appropriate deflection limits for their infrastructures. Measurements should be taken in the following sequence:

- Before commencing installation of retaining structures where appropriate to determine the baseline readings. Two independent sets of measurements must be taken confirming measurement consistency;
- After installation of the retaining structures, but before commencement of excavation;
- After excavation to the first row of supports or anchors, but prior to installation of these supports or anchors;
- After excavation to any subsequent rows of supports or anchors, but prior to installation of these supports or anchors;
- After excavation to the base of the excavation;
- After de-stressing and removal of any rows of supports or anchors; and
- One month after completion of the permanent retaining structure or after three consecutive measurements not less than a week apart showing no further movements, whichever is the latter.

4.4 Groundwater Considerations

Groundwater was observed in all monitoring wells as detailed in **Table 3-2**, the highest recorded groundwater was measured just above the proposed BEL for the lowest basement level RL of 12.7m AHD. The groundwater levels are within Class IV sandstone bedrock.

Based on the low permeability of the bedrock profile any groundwater inflows into the excavation should not have an adverse impact on the proposed development or on the neighbouring sites and should be manageable. However, we expect that some seepage inflows into the excavation along the soil/rock interface and through any defects within the sandstone bedrock (such as jointing, and bedding planes, etc.) particularly following a period of heavy rainfall. The initial flows into the excavation may be locally high, but would be expected to decrease considerably with time as the bedding seams/joints are drained. We recommend that monitoring of seepage be implemented during the excavation works to confirm the capacity of the drainage system.

We expect that any seepage that does occur will be able to be controlled by a conventional sump and pump system. We recommend that a sump-and-pump system be used both during construction and for permanent groundwater control below the basement floor slab.

In the long term, drainage should be provided behind all basement retaining walls, around the perimeter of the basement and below the basement slab. The completed excavation should be inspected by the hydraulic engineer to confirm that adequate drainage has been allowed for. Drainage should be connected to the sump-and-pump system and discharging into the stormwater system. The permanent groundwater control system should take into account any possible soluble substances in the groundwater which may dictate whether or not groundwater can be pumped into the stormwater system.

The design of drainage and pump systems should take the above issues into account along with careful ongoing inspections and maintenance programs.

For the design of a drained basement, council and DPE may require seepage analysis as well as long-term groundwater monitoring to confirm the suitability of a drained basement for this development.

4.5 Excavation Retention

4.5.1 Support Systems

From a geotechnical perspective, it is critical to maintain the stability of all adjacent structures and infrastructures during demolition, excavation and construction works.

Based on the provided architectural plans, the basement has limited setbacks from the site boundaries, such that the zone of influence of the excavation extends beyond site boundaries. Based on the depth of the excavation, the encountered subsurface conditions and limited setbacks, temporary batters are not recommended for this site. Unsupported vertical cuts in soil are not recommended for this site, due to the risk of soil slumping especially during or following a period of wet weather. Soil slumping may result in injury to personnel and/or damage to nearby structures/infrastructures and equipment.

A suitable retention system will be required for the support of the excavation. For this site, EI recommends an anchored and/or propped soldier pile wall with mass concrete in between the piles be founded into Unit 5 - *Class III Sandstone* below BEL.

Due to the presence of the basement structures adjacent to the site, anchors installation may not be possible and internal props may be required. Details of nearby basements, shoring pile walls and anchors must be obtained and reviewed by EI prior to final design.

Bored piles are considered to be the most suitable for this site. Tremie pumps may be required where high groundwater seepage inflows are present during the drilling of the bored piles. However, relatively large capacity piling rigs will be required for drilling through the Sandstone bedrock. The proposed pile locations should take into account the presence of buried services.

Further advice should be sought from prospective piling contractors who should be provided with a copy of this report.

Working platforms may also be required. We can complete the design of the working platform, when commissioned to do so.

4.5.2 Geotechnical Hazard Risk Zone

With reference to Pittwater Council's LEP 2014 Geotechnical Risk Management Map (GTH_015), the site is classified as being outside of the H1 and H2 landslip hazard zones as shown in **Plate 3** below.

However, in accordance with Clause 3.2(b)(iv) of Pittwater 21 Development Control Plan (DCP) Appendix 5 – Geotechnical Risk Management Policy for Pittwater – 2009, the site has excavation greater than 1.5 metres deep below the existing surface. Hence, the site requires a Geotechnical Landslip Risk Assessment to be conducted, which is detailed in the Section 4.5.3 below.

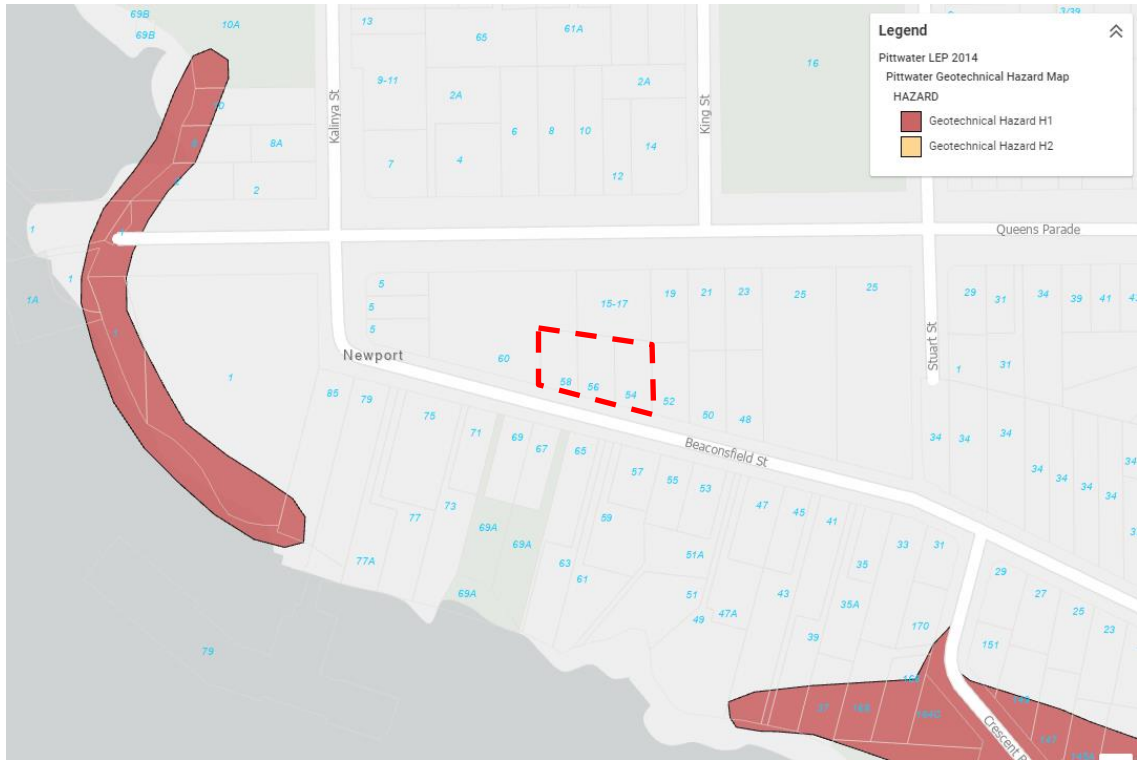


Plate 3: Site location over geotechnical hazard map (Pittwater LEP 2014)

4.5.3 Slope Stability & Risk Assessment

Risk assessment for the proposed development at this site, and their identified following risks for the property, are summarised in **Table 4-1** below.

Table 4-1 Property Risk Assessment for Proposed Development

	Hazard	Likelihood	Consequences	Risk
A	Rapid and significant erosion/slumping of slope on the northern side of the development as a result of water flows from upslope	Unlikely for a site with slope of about 8-10 degrees with surface runoff control measures and appropriately designed and constructed retaining walls	Minor	Low
B	Rapid collapse of unsupported excavation	Likely	Medium	High
C	Rapid collapse of proposed retaining walls	Rare – for engineer designed, inspected and constructed wall	Major	Low
D	Minor creep effects on landscaping walls	Possible	Insignificant	Very Low
E	Major rapid soil mass movement and impact to building	Unlikely for a site with engineer designed retaining structures and no features (cliff lines undercuts or floaters) observed suggesting incipient instability	Medium	Low

In the case of collapse of an unsupported excavation (Hazard B), the High Risk outcome for property damage is unacceptable, however it can and will be reduced to Low Risk through the

recommended engineering controls herein, namely the excavation must be fully supported by an engineer-designed support system throughout the construction stage.

- All excavation must be fully supported in accordance with engineering design reviewed prior to commencement of construction by EI as part of the Form 2b certification process.

A quantitative assessment of risk for loss of life (person most at risk) related to the identified slope instability hazards have been calculated for the completed development in the order of 5×10^{-8} per annum.

Contingent on the recommendations of this report being faithfully implemented, it is concluded that, the proposed development will achieve the "Acceptable Risk Management" criteria for both property and loss of life under current and foreseeable conditions and that the site is suitable for the proposed development, in accordance with the requirements of the Pittwater Geotechnical Risk Management Policy 2007.

It is recommended that site inspections during and after completion of construction works should be carried out to ensure that there is no ensuing risk of slope instability.

4.5.4 Retaining Wall Design Parameters

The following parameters may be used for static design of temporary and permanent retaining walls at the subject site:

- Conventional free-standing cantilever walls which support areas where movement is of little concern (i.e. where only gardens or open areas are to be retained), may be designed using a triangular lateral earth pressure distribution and an 'active' earth pressure coefficient, K_a , as shown in **Table 4-2**.
- Cantilevered walls, where the tops of which are restrained by the floor slabs of the permanent structure or which support movement sensitive elements, should be designed using a triangular lateral earth pressure distribution and an 'at rest' earth pressure coefficient, K_0 , as shown in **Table 4-2** below
- For progressively anchored or propped walls where minor movements can be tolerated (provided there are no buried movement sensitive services), we recommend the use of a trapezoidal earth pressure distribution of $5H$ kPa for soil, where H is the retained height in meters. These pressures should be assumed to be uniform over the central 50% of the support system, tapering to nil at top and bottom
- For progressively anchored or propped walls which support areas which are highly sensitive to movement (such as areas where movement sensitive structures or infrastructures or buried services are located in close proximity), we recommend the use of a trapezoidal earth pressure distribution of $8H$ kPa for soil, where 'H' is the retained height in meters. These pressures should be assumed to be uniform over the central 50% of the support system, tapering to nil at top and bottom
- All surcharge loading affecting the walls (including from construction equipment, construction loads, adjacent high level footings, etc.) should be adopted in the retaining wall design as an additional surcharge using an 'at rest' earth pressure coefficient, K_0
- The retaining walls should be designed as drained and measures are to be taken to provide complete and permanent drainage behind the walls. Strip drains protected with a non-woven geotextile fabric should be used behind the shotcrete infill panels for soldier pile walls. The embedded pipes must, however, be wrapped with a non-woven geotextile fabric (such as Bidim A34) to act as a filter against subsoil erosion

- For piles embedded into Unit 4 or better, the allowable lateral toe resistance values outlined in **Table 4-2** below may be adopted. These values assume excavation is not carried out within the zone of influence of the wall toe and the rock does not contain adverse defects etc. The upper 0.3m depth of the socket should not be taken into account to allow for tolerance and disturbance effects during excavation.
- If temporary anchors extend beyond the site boundaries, then permission from the neighbouring properties would need to be obtained prior to installation. Also, the presence of neighbouring basements and/or services and their levels must be confirmed prior to finalising anchor design.
- Anchors should have their bond length within Unit 3 or better. For the design of anchors bonded into Unit 3 or better, the allowable bond stress value outlined in **Table 4-2** below may be used, subject to the following conditions:
 1. Anchor bond lengths of at least 3m behind the 'active' zone of the excavation (taken as a 45 degree zone above the base of the excavation) is provided;
 2. Overall stability, including anchor group interaction, is satisfied;
 3. All anchors should be proof loaded to at least 1.33 times the design working load before locked off at working load. Such proof loading is to be witnessed by an engineer independent of the anchoring contractor. We recommend that only experienced contractors be considered for anchor installation with appropriate insurances;
 4. If permanent anchors are to be used, these must have appropriate corrosion provisions for longevity.

Table 4-2 Geotechnical Design Parameters

Material ¹		Unit 1: Fill	Unit 2: Residual Soil	Unit 3: Class V Sandstone	Unit 4: Class IV Sandstone	Unit 5: Class III Sandstone
Bulk Unit Weight (kN/m ³)		17	19	24	24	24
Friction Angle, ϕ' (°)		27	25	35	40	50
Earth Pressure Coefficient ^s	At rest, K_o ³	0.55	0.58	0.43	-	-
	Active, K_a ³	0.38	0.41	0.27	-	-
	Passive, K_p ³	2.66	2.46	3.69	-	-
Allowable Bearing Pressure (kPa) ⁵		-	150	800	1500	3500
Allowable Shaft Adhesion (kPa) ^{4,5}	in Compression	-	-	80	150	350
	in Uplift	-	-	40	75	175
Allowable Toe Resistance (kPa)		-	-	-	500	1000
Allowable Bond Stress (kPa)		-	-	50	100	250
Earthquake Site Risk Classification		<ul style="list-style-type: none"> ▪ AS 1170.4:2007 indicates an earthquake subsoil class of Class C_e (Shallow Soil) ▪ AS 1170.4:2007 indicates that the hazard factor (z) for Sydney is 0.08. 				

Notes:

- 1 More detailed descriptions of subsurface conditions are available on the borehole logs presented in **Appendix A**.
- 2 Approximate levels of top of unit at the time of our investigation. Levels may vary across the site.
- 3 Earth pressures are provided on the assumption that the ground behind the retaining walls is horizontal.
- 4 Side adhesion values given assume there is intimate contact between the pile and foundation material and should achieve a clean socket roughness category R2 or better. Design engineer to check both 'piston pull-out' and 'cone liftout' mechanics in accordance with AS4678-2002 Earth Retaining Structures.
- 5 To adopt these parameters we have assumed that:
 - Footings have a nominal socket of at least 0.5m, into the relevant founding material;
 - For piles, there is intimate contact between the pile and foundation material (a clean socket roughness category of R2 or better);
 - Potential soil and groundwater aggressivity will be considered in the design of piles and footings;
 - Piles should be drilled in the presence of a Geotechnical Engineer prior to pile construction to verify that ground conditions meet design assumptions. Where groundwater ingress is encountered during pile excavation, concrete is to be placed as soon as possible upon completion of pile excavation. Pile excavations should be pumped dry of water prior to pouring concrete, or alternatively a tremmie system could be used;
 - The bases of all pile, pad and strip footing excavations are cleaned of loose and softened material and water is pumped out prior to placement of concrete;
 - The concrete is poured on the same day as drilling, inspection and cleaning.
 - The allowable bearing pressures given above are based on serviceability criteria of settlements at the footing base/pile toe of less than or equal to 1% of the minimum footing dimension (or pile diameter).

4.6 Foundations

The most competent foundation stratum at the site is the Unit 5 Class III Sandstone bedrock and in view of the shallow depths to Class III Sandstone, we recommend that building is supported on pad and pile footings founded into Unit 5 Sandstone bedrock. However, the option of high level footings founded in Unit 4 sandstone is also provided.

Following bulk excavation to RL 12.7m AHD, we expect Unit 3 Residual Clay or Unit 4 Class IV Sandstone materials to be exposed at the majority of the site at BEL. All footings in Unit 4 may be designed as shallow pad/strip footings for an allowable bearing capacity of 1500kPa.

Footings extended into Unit 5 Class III Sandstone may be designed for an allowable bearing capacity of 3500kPa. However piles or deep pad footings may be required in the south-west corner of the site to reach Class III Sandstone.

We note that no cored boreholes were completed at the rear of the site due to site access. We recommend that additional cored boreholes be completed to the rear to confirm the quality of sandstone in this area following demolition.

Geotechnical inspections of foundations are recommended to determine that the required bearing capacity has been achieved and to determine any variations that may occur between the boreholes and inspected locations.

4.7 Basement Floor Slab

Following bulk excavations for the proposed basement, sandstone bedrock is expected to be exposed at the basement floor BEL.

Following the removal of all loose and softened materials, we recommend that underfloor drainage be provided and should comprise a strong, durable, single sized washed aggregate such as 'blue metal gravel'. Joints in the concrete floor slab should be designed to accommodate shear forces but not bending moments by using dowelled and keyed joints. The basement floor slab should be isolated from columns. The completed excavation should be inspected by the hydraulic engineer to confirm the extent of the drainage required.

In addition, a system of sub-soil drains comprising a durable single sized aggregate with perforated drains/pipes leading to sumps should be provided. The basement floor slab should be isolated from columns.

Permission may need to be obtained from the NSW Department of Primary Industries (DPI) and possibly Council for any permanent discharge of seepage into the drainage system. Given the subsurface conditions, we expect that seepage volumes would be low and within the DPI limits. However, if permission for discharge is not obtained, the basement may need to be designed as a tanked basement.

5. Further Geotechnical Inputs

Below is a summary of the previously recommended additional work that needs to be carried out:

- Additional Geotechnical Investigation in the form of three cored boreholes to confirm the depth and quality of Unit 5 Sandstone bedrock in the northern elevation
- Long term groundwater monitoring and seepage modelling
- Stability assessment of temporary batters using computer modelling, if required
- Dilapidation surveys
- Design of working platforms (if required) for construction plant by an experienced and qualified geotechnical engineer
- Classification of all excavated material transported off site
- Witnessing installation of support measures and proof-testing of anchors (if required)
- Geotechnical inspections of all new footings/piles by an experienced geotechnical professional before concrete or steel are placed to verify their bearing capacity and the in-situ nature of the founding strata
- Ongoing monitoring of groundwater inflows into the bulk excavation

We recommend that a meeting be held after initial structural design has been completed to confirm that our recommendations have been correctly interpreted. We also recommend a meeting at the commencement of construction to discuss the primary geotechnical issues and inspection requirements.

6. Statement of Limitations

This report has been prepared for the exclusive use of Kevin Lam and JAK Newport Pty Ltd who is the only intended beneficiary of EI's work. The scope of the assessment carried out for the purpose of this report is limited to those agreed with Kevin Lam and JAK Newport Pty Ltd

No other party should rely on the document without the prior written consent of EI, and EI undertakes no duty, or accepts any responsibility or liability, to any third party who purports to rely upon this document without EI's approval.

EI has used a degree of care and skill ordinarily exercised in similar investigations by reputable members of the geotechnical industry in Australia as at the date of this document. No other warranty, expressed or implied, is made or intended. Each section of this report must be read in conjunction with the whole of this report, including its appendices and attachments.

The conclusions presented in this report are based on a limited investigation of conditions, with specific sampling and test locations chosen to be as representative as possible under the given circumstances.

EI's professional opinions are reasonable and based on its professional judgment, experience, training and results from analytical data. EI may also have relied upon information provided by the Client and other third parties to prepare this document, some of which may not have been verified by EI.

EI's professional opinions contained in this document are subject to modification if additional information is obtained through further investigation, observations, or validation testing and analysis during construction. In some cases, further testing and analysis may be required, which may result in a further report with different conclusions.

We draw your attention to the document "Important Information", which is included in **Appendix D** of this report. The statements presented in this document are intended to advise you of what your realistic expectations of this report should be. The document is not intended to reduce the level of responsibility accepted by EI, but rather to ensure that all parties who may rely on this report are aware of the responsibilities each assumes in so doing.

Should you have any queries regarding this report, please do not hesitate to contact EI.

References

- AS1289.6.3.1:2004, *Methods of Testing Soils for Engineering Purposes*, Standards Australia.
- AS1726:2017, *Geotechnical Site Investigations*, Standards Australia.
- AS2159:2009, *Piling – Design and Installation*, Standards Australia.
- AS3600:2009, *Concrete Structures*, Standards Australia
- Safe Work Australia Excavation Work Code of Practice, dated January 2020 – WorkCover NSW
- NSW Department of Finance and Service, Spatial Information Viewer, maps.six.nsw.gov.au.
- NSW Department of Mineral Resources. NSW Seamless Geology Data Package, Catalogue Number: 9232, Version 0221 - 2.1, COLQUHOUN G.P., HUGHES K.S., DEYSSING L., BALLARD J.C., FOLKES C.B, PHILLIPS G., TROEDSON A.L. & FITZHERBERT J.A. 2021. New South Wales Seamless Geology dataset, version 2.1 [Digital Dataset]. Geological Survey of New South Wales, Department of Regional NSW, Maitland.
- Geoscience Australia and Australian Stratigraphy Commission. (2017). Australian Stratigraphic Units Database.


Abbreviations

AHD	Australian Height Datum
AS	Australian Standard
BEL	Bulk Excavation Level
B EGL	Below Existing Ground Level
BH	Borehole
DBYD	Dial Before You Dig
DP	Deposited Plan
EI	EI Australia
GI	Geotechnical Investigation
NATA	National Association of Testing Authorities, Australia
RL	Reduced Level
SPT	Standard Penetration Test
T-C	Tungsten-Carbide
UCS	Unconfined Compressive Strength



Figures

Figure 1 Site Locality Plan

Figure 2 Borehole Location Plan

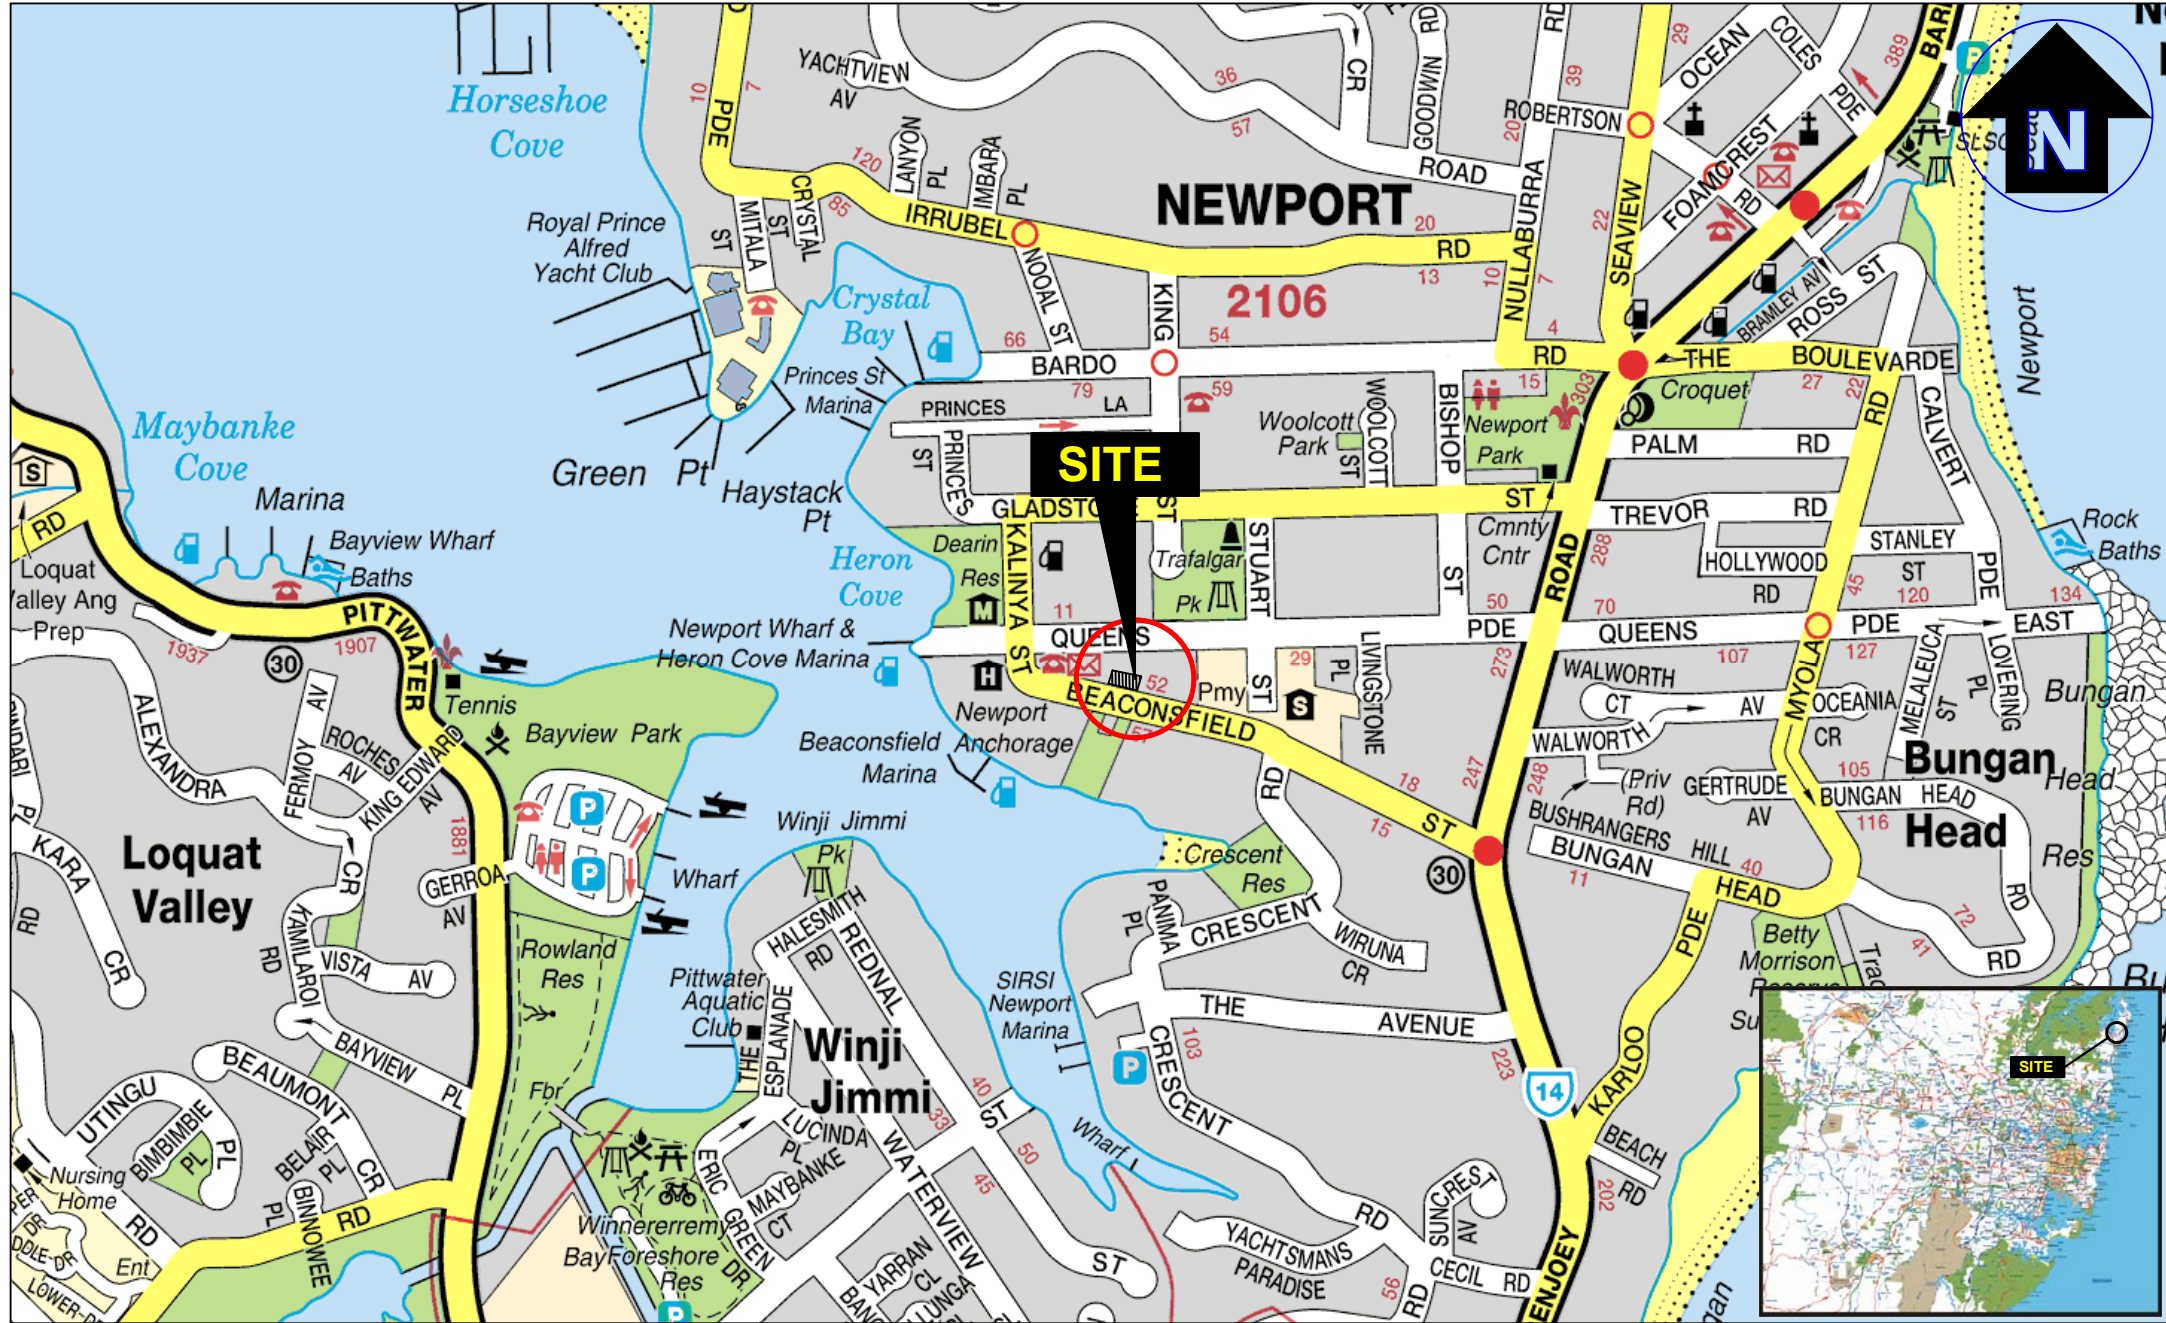

Drawn:	J.O.
Approved:	S.K.
Date:	11/10/2023
Scale:	Not To Scale

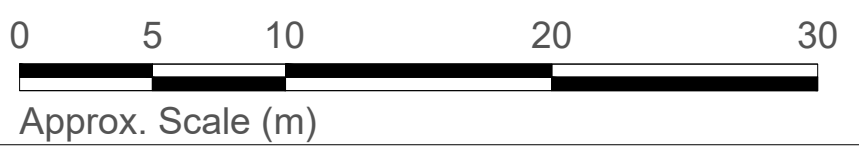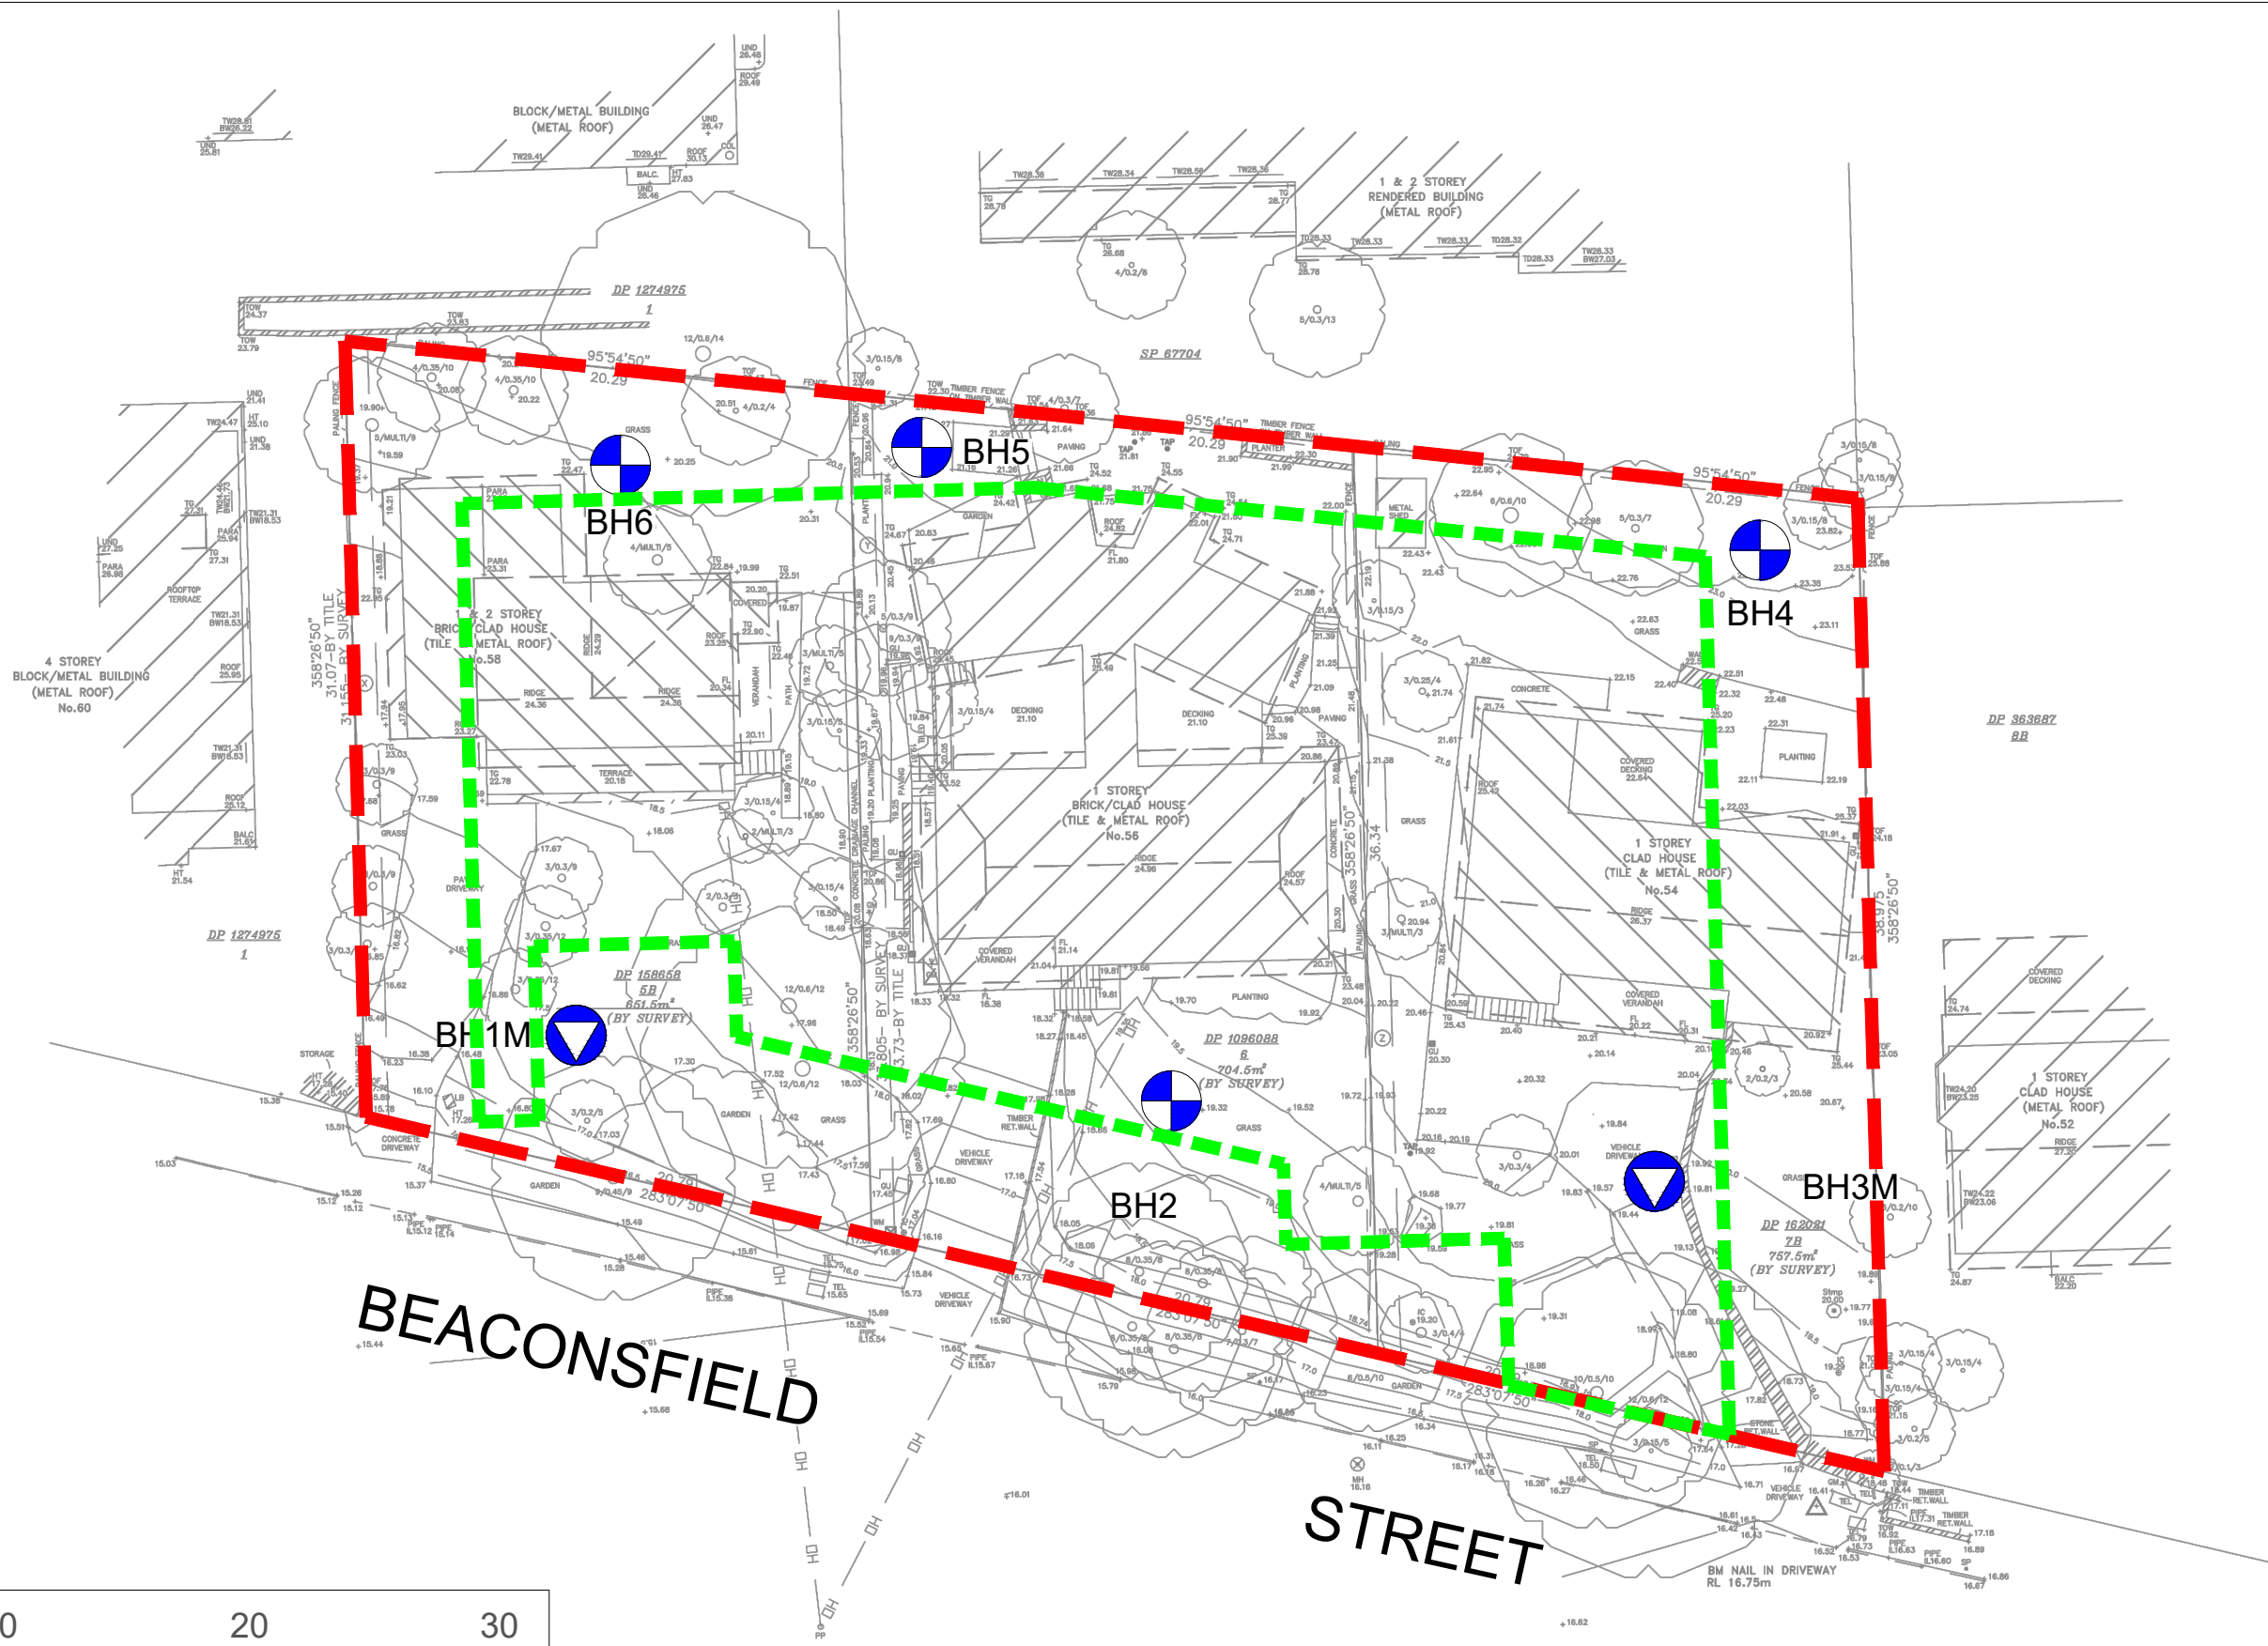

Map Source: SCSEngineeringSurveyors - Job No. 18084, Drawing No. 18084-DET-01, Sheet 1 of 1, Dated 22/04/2023

LEGEND (All Locations are Approximate)

- Site boundary
- Basement boundary
- ⊕ Borehole locations
- ⊕ Monitoring well locations



Drawn:	K.P.
Approved:	K.X.
Date:	06-05-24

JAK Newport Pty Ltd
 Geotechnical Investigation
 54-58 Beaconsfield Street, Newport NSW
 Borehole Location Plan

Figure:	2
Project:	E26083.G03

Appendix A – Borehole Logs And Explanatory
Notes



BOREHOLE LOG

BH ID: BH1M

Location 54-58 Beaconsfield Street, Newport	Started 06 July 2023
Client JAK Newport	Completed 06 July 2023
Job No. E26083	Logged By DD Date 06 July 2023
Sheets 1 of 2	Review By SK Date 10 October 2023

Drilling Contractor Geosense Drilling Engineers	Surface RL ≈17.50 m (AHD)	Northing 6274211.5196 (MGA 2020 Zone 56)
Plant Comacchio Geo 205	Inclination 90°	Easting 343349.5257 (MGA 2020 Zone 56)

METHOD	GROUND WATER LEVELS	SAMPLES & FIELD TESTS	SAMPLE RECOVERY	DEPTH (m)	GRAPHIC LOG	RL (m(AHD))	MATERIAL DESCRIPTION	MOISTURE CONDITION	CONSISTENCY / REL. DENSITY	MATERIAL ORIGIN & OBSERVATIONS
AD/T	GWNE	BH1M_1.50-1.95 SPT 1.50-1.95 6,12,18 N=30 BH1M_3.00-3.45 SPT 3.00-3.45 10,18,20 N=38 SPT 4.00-4.25 18,22/100 mm HB N=R		0.00		17.50	TOPSOIL: Clayey SILT: low plasticity, dark brown, with fine grained sand, with rootlets, no odour	M < PL	-	TOPSOIL
				0.65		16.85	Silty CLAY: high plasticity, mottled grey-red, with fine to medium sub-angular to sub-rounded iron indurated siltstone			RESIDUAL SOIL
				3.45	14.05	From 3.45m, high plasticity, mottled red and grey, with ironstone gravels, grading into extremely weathered material				
				4.48	13.02	<i>Log continued on next page.</i>				

This log should be read in conjunction with EI Australia's accompanying explanatory notes.



BOREHOLE LOG

BH ID: BH1M

Location 54-58 Beaconsfield Street, Newport
Client JAK Newport
Job No. E26083
Sheets 1 of 1

Started 06 July 2023
Completed 06 July 2023
Logged By DD **Date** 06 July 2023
Review By SK **Date** 10 October 2023

Drilling Contractor Geosense Drilling Engineers **Surface RL** ≈17.50 m (AHD) **Northing** 6274211.5196 (MGA 2020 Zone 56)
Plant Comacchio Geo 205 **Inclination** 90° **Easting** 343349.5257 (MGA 2020 Zone 56)

WATER	SAMPLES & FIELD TESTS	DEPTH (m)	GRAPHIC LOG	RL (mAHD)	MATERIAL DESCRIPTION	MOISTURE CONDITION	BACKFILL DETAILS	STANDPIPE DETAILS
		0.00		17.50	TOPSOIL: Clayey SILT: low plasticity, dark brown, with fine grained sand, with rootlets, no odour			Well Stickup =0.0m (RL 17.50m)
		0.65		16.85	Silty CLAY: high plasticity, mottled grey-red, with fine to medium sub-angular to sub-rounded iron indurated siltstone		Cuttings 0.00m - 1.00m	
GWNE	BH1M_1.50-1.95 SPT 1.50-1.95 6,12,18 N=30	1				M < PL		
		2						0.0m - 4.0m PVC casing (50mm Ø)
		3					Bentonite 1.00m - 4.00m	
	BH1M_3.00-3.45 SPT 3.00-3.45 10,18,20 N=38	3.45		14.05	From 3.45m, high plasticity, mottled red and grey, with ironstone gravels, grading into extremely weathered material			
		4						
	SPT 4.00-4.25 18,22/100 mm HB N=R	4						
	BH1M_4.50-4.80	4.48		43.02	LAMINITE: orange-grey, very thinly bedded			
90%		5						
		5.15		12.35	LAMINITE: dark grey Siltstone [20%], and grey fine grained Sandstone [80%], thinly bedded			
		6						
		6.60		10.90	SANDSTONE: fine grained, grey and interbedded dark grey siltstone, medium bedded			
		7					Sand 4.00m - 9.62m	4.0m - 9.62m PVC screen (50mm Ø)
95%		8						
		8.77		8.73	From 8.77m, From 8.77m, increasing Siltstone lamination, thinly bedded			
		9						
		7.88			Terminated at 9.62m. Target Depth Reached.			
		10						

This log should be read in conjunction with EI Australia's accompanying explanatory notes.

Project	Proposed Residential Development	Depth Range	4.48m to 9.62m BEGL
Location	54-58 Beaconsfield Street, Newport NSW	Contractor	Geosense Drilling Pty Ltd
Position	See Figure 2	Drill Rig	Comacchio Geo 205
Job No.	E26083.G03	Surface RL	≈17.50m AHD
Client	JAK Newport Pty Ltd	Inclination	-90°
		Box	1 of 1
		Logged	DD Date 6/11/2023
		Checked	SK Date 10/10/2023



Location 54-58 Beaconsfield Street, Newport	Started 06 July 2023
Client JAK Newport	Completed 06 July 2023
Job No. E26083	Logged By DD Date 06 July 2023
Sheets 1 of 2	Review By SK Date 10 October 2023

Drilling Contractor Geosense Drilling Engineers	Surface RL ≈19.30 m (AHD)	Northing 6274174.8975 (MGA 2020 Zone 56)
Plant Comacchio Geo 205	Inclination 90°	Easting 343393.1808 (MGA 2020 Zone 56)

METHOD	GROUND WATER LEVELS	SAMPLES & FIELD TESTS	SAMPLE RECOVERY	DEPTH (m)	GRAPHIC LOG	RL (m(AHD))	MATERIAL DESCRIPTION	MOISTURE CONDITION	CONSISTENCY / REL. DENSITY	MATERIAL ORIGIN & OBSERVATIONS
ADT	GWNE	BH2_0.50-0.95 SPT 0.50-0.95 9,9,15 N=24		0.00		19.30	TOPSOIL: Silty CLAY: high plasticity, dark brown, with rootlets, trace fine grained sand, no odour	M = PL	-	TOPSOIL
		BH2_1.50-1.90 SPT 1.50-1.90 12,18,18/100 mm HB N=R		0.55		18.75	Silty CLAY: high plasticity, mottled grey and red, with fine to medium sub-angular to sub-rounded iron indurated siltstone, no odour	M < PL	Vst - H	RESIDUAL SOIL
				2.46		16.84	<i>Log continued on next page.</i>			
				3						
				4						
				5						
				6						
				7						
				8						
				9						
				10						

CORE PHOTOGRAPH OF BOREHOLE: BH2

Project	Proposed Residential Development	Depth Range	2.46m to 9.05m BEGL
Location	54-58 Beaconsfield Street, Newport NSW	Contractor	Geosense Drilling Pty Ltd
Position	See Figure 2	Drill Rig	Comacchio Geo 205
Job No.	E26083.G03	Logged	DD Date 7/7/2023
Client	JAK Newport Pty Ltd	Surface RL	≈ 19.3m AHD
		Inclination	-90°
		Box	1-2 of 2
		Checked	SK Date 10/10/2023





BOREHOLE LOG

BH ID: BH3M

Location 54-58 Beaconsfield Street, Newport
Client JAK Newport
Job No. E26083
Sheets 1 of 3

Started 07 July 2023
Completed 07 July 2023
Logged By DD **Date** 07 July 2023
Review By SK **Date** 10 October 2023

Drilling Contractor Geosense Drilling Engineers **Surface RL** ≈19.40 m (AHD) **Latitude** -
Plant Comacchio Geo 205 **Inclination** 90° **Longitude** -

METHOD	GROUND WATER LEVELS	SAMPLES & FIELD TESTS	SAMPLE RECOVERY	DEPTH (m)	GRAPHIC LOG	RL (m(AHD))	MATERIAL DESCRIPTION	MOISTURE CONDITION	CONSISTENCY / REL. DENSITY	MATERIAL ORIGIN & OBSERVATIONS
DT				0.00		19.40	CONCRETE: 150mm thick	-	-	CONCRETE
				0.15		19.25	FILL: Silty SAND: dark brown, with clay, no odour	M	-	FILL
		BH3M_1.50-1.95 SPT 1.50-1.95 8,8,12 N=20		0.55		18.85	Silty CLAY: high plasticity, mottled grey and red, with fine to medium sub-angular to sub-rounded iron indurated siltstone, no odour			RESIDUAL SOIL
AD/T	GWNE	BH3M_3.00-3.45 SPT 3.00-3.45 12,16,22 N=38		3				M < PL	VSt	
		BH3M_4.50-4.95 SPT 4.50-4.95 12,18,22 N=40		5					H	
		BH3M_6.00-6.45 SPT 6.00-6.45 3,7,10 N=17		6					St	
				6.47		12.93	Log continued on next page.			
				7						
				8						
				9						
				10						

This log should be read in conjunction with EI Australia's accompanying explanatory notes.



BOREHOLE LOG

BH ID: BH3M

Location 54-58 Beaconsfield Street, Newport
Client JAK Newport
Job No. E26083
Sheets 3 of 3

Started 07 July 2023
Completed 07 July 2023
Logged By DD **Date** 07 July 2023
Review By SK **Date** 10 October 2023

Drilling Contractor Geosense Drilling Engineers **Surface RL** ≈19.40 m (AHD) **Latitude** -
Plant Comacchio Geo 205 **Inclination** 90° **Longitude** -

METHOD	Flush Return	TCR %	RQD %	DEPTH (m)	GRAPHIC LOG	RL (mAHD)	MATERIAL DESCRIPTION	WEATHERING	ESTIMATED STRENGTH Is(50)						DISCONTINUITIES & ADDITIONAL DATA	FRACTURE SPACING				
									VL ₀₋₁	L ₀₋₃	M ₁	H ₃	VH ₁₀	EH		30	100	300	1000	3000
	90%	100	39	10.05		9.35	From 8.57m, From 8.57m, with Siltstone Laminations LAMINITE: pale grey fine grained sandstone, dark grey siltstone, laminated	MW												
				10.75		8.65	SANDSTONE: grey, with dark grey interbedded Siltstone, medium bedded	FR												
				12.00		7.40	Terminated at 12.00m. Target Depth Reached.							11.79: JT 60° RO CN						
				13																
				14																
				15																
				16																
				17																
				18																
				19																
				20																

This log should be read in conjunction with EI Australia's accompanying explanatory notes.



BOREHOLE LOG

BH ID: BH3M

Location 54-58 Beaconsfield Street, Newport
Client JAK Newport
Job No. E26083
Sheets 1 of 2

Started 07 July 2023
Completed 07 July 2023
Logged By DD **Date** 07 July 2023
Review By SK **Date** 10 October 2023

Drilling Contractor Geosense Drilling Engineers **Surface RL** ≈19.40 m (AHD) **Latitude** -
Plant Comacchio Geo 205 **Inclination** 90° **Longitude** -

WATER	SAMPLES & FIELD TESTS	DEPTH (m)	GRAPHIC LOG	RL (mAHD)	MATERIAL DESCRIPTION	MOISTURE CONDITION	BACKFILL DETAILS	STANDPIPE DETAILS
		0.00		19.40	CONCRETE: 150mm thick	-		Well Stickup =0.0m (RL 19.40m)
		0.15		19.25	FILL: Silty SAND: dark brown, with clay, no odour	M		
		0.55		18.85	Silty CLAY: high plasticity, mottled grey and red, with fine to medium sub-angular to sub-rounded iron indurated siltstone, no odour		Cuttings 0.00m - 2.00m	0.0m - 3.0m PVC casing (50mm Ø)
GWNE	BH3M_1.50-1.95 SPT 1.50-1.95 8,8,12 N=20	1						
	BH3M_3.00-3.45 SPT 3.00-3.45 12,16,22 N=38	3				M < PL	Bentonite 2.00m - 3.00m	
	BH3M_4.50-4.95 SPT 4.50-4.95 12,18,22 N=40	5						
	BH3M_6.00-6.45 SPT 6.00-6.45 3,7,10 N=17	6						
		6.47		12.93	SANDSTONE: orange-brown, very thinly bedded			
		7						
		7.08		12.32	From 7.08m, SANDSTONE: fine grained, pale grey, medium bedded		Sand 3.00m - 12.00m	3.0m - 12.0m PVC screen (50mm Ø)
85%		8						
		8.57		10.83	From 8.57m, From 8.57m, with Siltstone Laminations			
90%		9						
		10						

This log should be read in conjunction with EI Australia's accompanying explanatory notes.

Project	Proposed Residential Development	Depth Range	6.47m to 12.0m BEGL
Location	54-58 Beaconsfield Street, Newport NSW	Contractor	Geosense Drilling Pty Ltd
Position	See Figure 2	Drill Rig	Comacchio Geo 205
Job No.	E26083.G03	Surface RL	≈19.4m AHD
Client	JAK Newport Pty Ltd	Inclination	-90°
		Box	1-2 of 2
		Logged	DD Date 10/7/2023
		Checked	SK Date 10/10/2023





BOREHOLE LOG

BH ID: BH3M

Location 54-58 Beaconsfield Street, Newport	Started 07 July 2023
Client JAK Newport	Completed 07 July 2023
Job No. E26083	Logged By DD Date 07 July 2023
Sheets 2 of 2	Review By SK Date 10 October 2023

Drilling Contractor Geosense Drilling Engineers	Surface RL ≈19.40 m (AHD)	Latitude -
Plant Comacchio Geo 205	Inclination 90°	Longitude -

WATER	SAMPLES & FIELD TESTS	DEPTH (m)	GRAPHIC LOG	RL (mAHD)	MATERIAL DESCRIPTION	MOISTURE CONDITION	BACKFILL DETAILS	STANDPIPE DETAILS
		10.05		9.35	From 8.57m, From 8.57m, with Siltstone Laminations LAMINITE: pale grey fine grained sandstone, dark grey siltstone, laminated			
		10.75		8.65	SANDSTONE: grey, with dark grey interbedded Siltstone, medium bedded			
		11						
		12		7.40	Terminated at 12.00m. Target Depth Reached.			
		13						
		14						
		15						
		16						
		17						
		18						
		19						
		20						

This log should be read in conjunction with EI Australia's accompanying explanatory notes.



BOREHOLE LOG

BH ID: BH4

Location 54-58 Beaconsfield Street, Newport
Client JAK Newport
Job No. E26083
Sheets 1 of 1

Started 07 July 2023
Completed 07 July 2023
Logged By DD **Date** 07 July 2023
Review By SK **Date** 10 October 2023

Drilling Contractor Geosense Drilling Engineers **Surface RL** ≈23.50 m (AHD) **Latitude** -
Plant Hand Portable Rig **Inclination** 90° **Longitude** -

METHOD	GROUND WATER LEVELS	SAMPLES & FIELD TESTS	SAMPLE RECOVERY	DEPTH (m)	GRAPHIC LOG	RL (m(AHD))	MATERIAL DESCRIPTION	MOISTURE CONDITION	CONSISTENCY / REL. DENSITY	DCP BLOWS	MATERIAL ORIGIN & OBSERVATIONS
				0.00		23.50	TOPSOIL: Silty CLAY: low plasticity, dark brown, with rootlets, with fine grained sand, no odour	M ≈ PL	-		TOPSOIL
				0.80		22.70	Silty CLAY: high plasticity, mottled grey and red, with fine to medium sub-angular to sub-rounded iron indurated siltstone, no odour	M < PL	St - VSt		RESIDUAL SOIL
				1.10		22.40	Terminated at 1.10m. Practical Auger Refusal.				

This log should be read in conjunction with EI Australia's accompanying explanatory notes.



BOREHOLE LOG

BH ID: BH5

Location 54-58 Beaconsfield Street, Newport **Started** 07 July 2023
Client JAK Newport **Completed** 07 July 2023
Job No. E26083 **Logged By** DD **Date** 07 July 2023
Sheets 1 of 1 **Review By** SK **Date** 10 October 2023

METHOD		SAMPLES & FIELD TESTS	SAMPLE RECOVERY	DEPTH (m)	GRAPHIC LOG	RL (mAHD)	MATERIAL DESCRIPTION	MOISTURE CONDITION	CONSISTENCY / REL. DENSITY	DCP BLOWS	MATERIAL ORIGIN & OBSERVATIONS
GROUND WATER LEVELS											
HA	GWNE			0.00		21.00	TOPSOIL: Clayey SILT: low plasticity, dark brown, with rootlets, trace fine grained sand, no odour	M ≈ PL	-		TOPSOIL
				0.40		20.60	Silty CLAY: high plasticity, mottled grey-red, with fine to medium sub-angular to sub-rounded iron indurated siltstone, no odour	M < PL	St	4, 5, 5, 7, 7, 9, 8, 9, 12	RESIDUAL SOIL
				1		19.80	Terminated at 1.20m. Practical Auger Refusal.			10, 6, 7, 18, 7, 22, 11	
				2							
				3							
				4							
				5							

This log should be read in conjunction with EI Australia's accompanying explanatory notes.



BOREHOLE LOG

BH ID: BH6

Location 54-58 Beaconsfield Street, Newport **Started** 07 July 2023
Client JAK Newport **Completed** 07 July 2023
Job No. E26083 **Logged By** DD **Date** 07 July 2023
Sheets 1 of 1 **Review By** SK **Date** 10 October 2023

METHOD		SAMPLES & FIELD TESTS	SAMPLE RECOVERY	DEPTH (m)	GRAPHIC LOG	RL (m(AHD))	MATERIAL DESCRIPTION	MOISTURE CONDITION	CONSISTENCY / REL. DENSITY	DCP BLOWS	MATERIAL ORIGIN & OBSERVATIONS
GROUND WATER LEVELS											
HA	GWNE			0.00		20.50	TOPSOIL: Silty CLAY: low plasticity, dark brown, with fine grained sand, with rootlets, no odour	M < PL	-	1, 2, 2	TOPSOIL
				0.55		19.95	Silty CLAY: high plasticity, mottled grey and red, with fine to medium sub-angular to sub-rounded iron indurated siltstone, no odour	M < PL	St	5, 12, 9, 10	RESIDUAL SOIL
				1		19.60	Terminated at 0.90m. Practical Auger Refusal.			11, 11, 9, 9, 9, 16, 6	

This log should be read in conjunction with EI Australia's accompanying explanatory notes.

EXPLANATION OF NOTES, ABBREVIATIONS & TERMS USED ON BOREHOLE AND TEST PIT LOGS

DRILLING/EXCAVATION METHOD

HA	Hand Auger	ADH	Hollow Auger	NQ	Diamond Core - 47 mm
DT	Diatube Coring	RT	Rotary Tricone bit	NMLC	Diamond Core - 52 mm
NDD	Non-destructive digging	RAB	Rotary Air Blast	HQ	Diamond Core - 63 mm
AD*	Auger Drilling	RC	Reverse Circulation	HMLC	Diamond Core - 63 mm
*V	V-Bit	PT	Push Tube	EX	Tracked Hydraulic Excavator
*T	TC-Bit, e.g. AD/T	WB	Washbore	HAND	Excavated by Hand Methods

PENETRATION RESISTANCE

L	Low Resistance	Rapid penetration/ excavation possible with little effort from equipment used.
M	Medium Resistance	Penetration/ excavation possible at an acceptable rate with moderate effort from equipment used.
H	High Resistance	Penetration/ excavation is possible but at a slow rate and requires significant effort from equipment used.
R	Refusal/Practical Refusal	No further progress possible without risk of damage or unacceptable wear to equipment used.

These assessments are subjective and are dependent on many factors, including equipment power and weight, condition of excavation or drilling tools and experience of the operator.

WATER

 **Standing Water Level**

 **Partial water loss**

 **Water Seepage**

 **Complete Water Loss**




GWNO GROUNDWATER NOT OBSERVED - Observation of groundwater, whether present or not, was not possible due to drilling water, surface seepage or cave-in of the borehole/ test pit.

GWNE GROUNDWATER NOT ENCOUNTERED - Borehole/ test pit was dry soon after excavation. However, groundwater could be present in less permeable strata. Inflow may have been observed had the borehole/ test pit been left open for a longer period.

SAMPLING AND TESTING

SPT	Standard Penetration Test to AS1289.6.3.1-2004
4,7,11 N=18	4,7,11 = Blows per 150mm. N = Blows per 300mm penetration following a 150mm seating drive
30/80mm	Where practical refusal occurs, the blows and penetration for that interval are reported, N is not reported
RW	Penetration occurred under the rod weight only, N<1
HW	Penetration occurred under the hammer and rod weight only, N<1
HB	Hammer double bouncing on anvil, N is not reported
Sampling	
DS	Disturbed Sample
ES	Sample for environmental testing
BDS	Bulk disturbed Sample
GS	Gas Sample
WS	Water Sample
U50	Thin walled tube sample - number indicates nominal sample diameter in millimetres
Testing	
FP	Field Permeability test over section noted
FVS	Field Vane Shear test expressed as uncorrected shear strength (sv= peak value, sr= residual value)
PID	Photoionisation Detector reading in ppm
PM	Pressuremeter test over section noted
PP	Pocket Penetrometer test expressed as instrument reading in kPa
WPT	Water Pressure tests
DCP	Dynamic Cone Penetrometer test
CPT	Static Cone Penetration test
CPTu	Static Cone Penetration test with pore pressure (u) measurement

GEOLOGICAL BOUNDARIES

	= Observed Boundary (position known)		= Observed Boundary (position approximate)		= Boundary (interpreted or inferred)
---	--------------------------------------	---	--	---	--------------------------------------

ROCK CORE RECOVERY








TCR=Total Core Recovery (%)

RQD = Rock Quality Designation (%)

$$= \frac{\text{Length of core recovered}}{\text{Length of core run}} \times 100$$

$$= \frac{\sum \text{Axial lengths of core} > 100\text{mm}}{\text{Length of core run}} \times 100$$

METHOD OF SOIL DESCRIPTION USED ON BOREHOLE AND TEST PIT LOGS

	FILL		ORGANIC SOILS (OL, OH or Pt)		CLAY (CL, CI or CH)
	COUBLES or BOULDERS		SILT (ML or MH)		SAND (SP or SW)
	GRAVEL (GP or GW)	Combinations of these basic symbols may be used to indicate mixed materials such as sandy clay			

CLASSIFICATION AND INFERRED STRATIGRAPHY

Soil is broadly classified and described in Borehole and Test Pit Logs using the preferred method given in AS 1726:2017, Section 6.1 – Soil description and classification.


PARTICLE SIZE CHARACTERISTICS

Fraction	Components	Sub Division	Size mm
Oversize	BOULDERS		>200
	COBBLES		63 to 200
Coarse grained soil	GRAVEL	Coarse	19 to 63
		Medium	6.7 to 19
		Fine	2.36 to 6.7
	SAND	Coarse	0.6 to 2.36
		Medium	0.21 to 0.6
		Fine	0.075 to 0.21
Fine grained soil	SILT		0.002 to 0.075
	CLAY		<0.002

GROUP SYMBOLS

Major Divisions	Symbol	Description	
COARSE GRAINED SOILS More than 65% of soil excluding oversize fraction is greater than 0.075mm	GRAVEL More than 50% of coarse fraction is >2.36mm	GW	Well graded gravel and gravel-sand mixtures, little or no fines, no dry strength.
		GP	Poorly graded gravel and gravel-sand mixtures, little or no fines, no dry strength.
		GM	Silty gravel, gravel-sand-silt mixtures, zero to medium dry strength.
	SAND More than 50% of coarse fraction is <2.36 mm	GC	Clayey gravel, gravel-sand-clay mixtures, medium to high dry strength.
		SW	Well graded sand and gravelly sand, little or no fines, no dry strength.
		SP	Poorly graded sand and gravelly sand, little or no fines, no dry strength.
FINE GRAINED SOILS More than 35% of soil excluding oversized fraction is less than 0.075mm	Liquid Limit less < 50%	SM	Silty sand, sand-silt mixtures, zero to medium dry strength.
		SC	Clayey sand, sandy-clay mixtures, medium to high dry strength.
		ML	Inorganic silts of low plasticity, very fine sands, rock flour, silty or clayey fine sands, zero to medium dry strength.
	Liquid Limit > 50%	CL, CI	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, medium to high dry strength.
		OL	Organic silts and organic silty clays of low plasticity, low to medium dry strength.
		MH	Inorganic silts of high plasticity, high to very high dry strength.
Highly Organic soil	PT	CH	Inorganic clays of high plasticity, high to very high dry strength.
		OH	Organic clays of medium to high plasticity, medium to high dry strength.
		PT	Peat muck and other highly organic soils.

PLASTICITY PROPERTIES

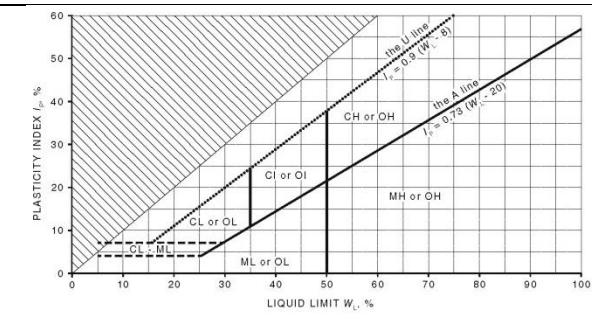

MOISTURE CONDITION

Symbol	Term	Description
D	Dry	Non-cohesive and free-running.
M	Moist	Soils feel cool, darkened in colour. Soil tends to stick together.
W	Wet	Soils feel cool, darkened in colour. Soil tends to stick together, free water forms when handling.

Moisture content of cohesive soils shall be described in relation to plastic limit (PL) or liquid limit (LL) for soils with higher moisture content as follows: Moist, dry of plastic limit ($w < PL$); Moist, near plastic limit ($w \approx PL$); Moist, wet of plastic limit ($w < PL$); Wet, near liquid limit ($w \approx LL$); Wet, wet of liquid limit ($w > LL$).

CONSISTENCY

Symbol	Term	Undrained Shear Strength (kPa)	SPT "N" #
VS	Very Soft	≤ 12	≤ 2
S	Soft	>12 to ≤ 25	>2 to ≤ 4
F	Firm	>25 to ≤ 50	>4 to 8
St	Stiff	>50 to ≤ 100	>8 to 15
VSt	Very Stiff	>100 to ≤ 200	>15 to 30
H	Hard	>200	>30
Fr	Friable	-	-

DENSITY

Symbol	Term	Density Index %	SPT "N" #
VL	Very Loose	≤ 15	0 to 4
L	Loose	>15 to ≤ 35	4 to 10
MD	Medium Dense	>35 to ≤ 65	10 to 30
D	Dense	>65 to ≤ 85	30 to 50
VD	Very Dense	>85	Above 50

In the absence of test results, consistency and density may be assessed from correlations with the observed behaviour of the material. # SPT correlations are not stated in AS1726:2017, and may be subject to corrections for overburden pressure, moisture content of the soil, and equipment type.

MINOR COMPONENTS

Term	Assessment Guide	Proportion by Mass
Add 'Trace'	Presence just detectable by feel or eye but soil properties little or no different to general properties of primary component	Coarse grained soils: ≤ 5% Fine grained soil: ≤ 15%
Add 'With'	Presence easily detectable by feel or eye but soil properties little or no different to general properties of primary component	Coarse grained soils: 5 - 12% Fine grained soil: 15 - 30%
Prefix soil name	Presence easily detectable by feel or eye in conjunction with the general properties of primary component	Coarse grained soils: >12% Fine grained soil: >30%

CLASSIFICATION AND INFERRED STRATIGRAPHY

Rock is broadly classified and described in Borehole and Test Pit Logs using the preferred method given in AS1726 – 2017, Section 6.2 – Rock identification, description and classification.

ROCK MATERIAL STRENGTH CLASSIFICATION

Symbol	Term	Point Load Index, $Is_{(50)}$ [#] (MPa)	Field Guide
VL	Very Low	0.03 to 0.1	Material crumbles under firm blows with sharp end of pick; can be peeled with knife; too hard to cut a triaxial sample by hand. Pieces up to 30 mm can be broken by finger pressure.
L	Low	0.1 to 0.3	Easily scored with a knife; indentations 1 mm to 3 mm show in the specimen with firm blows of pick point; has dull sound under hammer. A piece of core 150 mm long by 50 mm diameter may be broken by hand. Sharp edges of core may be friable and break during handling.
M	Medium	0.3 to 1	Readily scored with a knife; a piece of core 150 mm long by 50 mm diameter can be broken by hand with difficulty.
H	High	1 to 3	A piece of core 150 mm long by 50 mm diameter cannot be broken by hand but can be broken with pick with a single firm blow; rock rings under hammer.
VH	Very High	3 to 10	Hand specimen breaks with pick after more than one blow; rock rings under hammer.
EH	Extremely High	>10	Specimen requires many blows with geological pick to break through intact material; rock rings under hammer.

[#] **Rock Strength Test Results** ▼ Point Load Strength Index, $Is_{(50)}$, Axial test (MPa)

● Point Load Strength Index, $Is_{(50)}$, Diametral test (MPa)

Relationship between rock strength test result ($Is_{(50)}$) and unconfined compressive strength (UCS) will vary with rock type and strength, and should be determined on a site-specific basis. However UCS is typically 20 x $Is_{(50)}$.

ROCK MATERIAL WEATHERING CLASSIFICATION

Symbol	Term	Field Guide
RS	Residual Soil	Soil developed on extremely weathered rock; the mass structure and substance fabric are no longer evident; there is a large change in volume but the soil has not been significantly transported.
XW	Extremely Weathered	Rock is weathered to such an extent that it has soil properties - i.e. it either disintegrates or can be remoulded, in water.
DW	Distinctly Weathered	Rock strength usually changed by weathering. The rock may be highly discoloured, usually by iron staining. Porosity may be increased by leaching, or may be decreased due to deposition of weathering products in pores. In some environments it is convenient to subdivide into Highly Weathered and Moderately Weathered, with the degree of alteration typically less for MW.
	MW	
SW	Slightly Weathered	Rock slightly discoloured but shows little or no change of strength relative to fresh rock.
FR	Fresh	Rock shows no sign of decomposition or staining.

ABBREVIATIONS AND DESCRIPTIONS FOR ROCK MATERIAL AND DEFECTS

CLASSIFICATION AND INFERRED STRATIGRAPHY

Rock is broadly classified and described in Borehole and Test Pit Logs using the preferred method given in AS1726 – 2017, Section 6.2 – Rock identification, description and classification.

DETAILED ROCK DEFECT SPACING

Defect Spacing		Bedding Thickness (Stratification)	
Term	Description	Term	Spacing (mm)
Massive	No layering apparent	Thinly laminated	<6
		Laminated	6 – 20
Indistinct	Layering just visible; little effect on properties	Very thinly bedded	20 – 60
		Thinly bedded	60 – 200
Distinct	Layering (bedding, foliation, cleavage) distinct; rock breaks more easily parallel to layering	Medium bedded	200 – 600
		Thickly bedded	600 – 2,000
		Very thickly bedded	> 2,000

ABBREVIATIONS AND DESCRIPTIONS FOR DEFECT TYPES

Defect Type	Abbr.	Description
Joint	JT	Surface of a fracture or parting, formed without displacement, across which the rock has little or no tensile strength. May be closed or filled by air, water or soil or rock substance, which acts as cement.
Bedding Parting	BP	Surface of fracture or parting, across which the rock has little or no tensile strength, parallel or sub-parallel to layering/ bedding. Bedding refers to the layering or stratification of a rock, indicating orientation during deposition, resulting in planar anisotropy in the rock material.
Contact	CO	The surface between two types or ages of rock.
Sheared Surface	SSU	A near planar, curved or undulating surface which is usually smooth, polished or slickensided.
Sheared Seam/ Zone (Fault)	SS/SZ	Seam or zone with roughly parallel almost planar boundaries of rock substance cut by closely spaced (often <50 mm) parallel and usually smooth or slickensided joints or cleavage planes.
Crushed Seam/ Zone (Fault)	CS/CZ	Seam or zone composed of disoriented usually angular fragments of the host rock substance, with roughly parallel near-planar boundaries. The brecciated fragments may be of clay, silt, sand or gravel sizes or mixtures of these.
Extremely Weathered Seam/ Zone	XWS/XWZ	Seam of soil substance, often with gradational boundaries, formed by weathering of the rock material in places.
Infilled Seam	IS	Seam of soil substance, usually clay or clayey, with very distinct roughly parallel boundaries, formed by soil migrating into joint or open cavity.
Vein	VN	Distinct sheet-like body of minerals crystallised within rock through typically open-space filling or crack-seal growth.

NOTE: Defects size of <100mm SS, CS and XWS. Defects size of >100mm SZ, CZ and XWZ.

ABBREVIATIONS AND DESCRIPTIONS FOR DEFECT SHAPE AND ROUGHNESS

Shape	Abbr.	Description	Roughness	Abbr.	Description
Planar	PR	Consistent orientation	Polished	POL	Shiny smooth surface
Curved	CU	Gradual change in orientation	Slickensided	SL	Grooved or striated surface, usually polished
Undulating	UN	Wavy surface	Smooth	SM	Smooth to touch. Few or no surface irregularities
Stepped	ST	One or more well defined steps	Rough	RO	Many small surface irregularities (amplitude generally <1mm). Feels like fine to coarse sandpaper
Irregular	IR	Many sharp changes in orientation	Very Rough	VR	Many large surface irregularities, amplitude generally >1mm. Feels like very coarse sandpaper

Orientation:
Vertical Boreholes – The dip (inclination from horizontal) of the defect.
Inclined Boreholes – The inclination is measured as the acute angle to the core axis.

ABBREVIATIONS AND DESCRIPTIONS FOR DEFECT COATING

ABBREVIATIONS AND DESCRIPTIONS FOR DEFECT COATING			DEFECT APERTURE		
Coating	Abbr.	Description	Aperture	Abbr.	Description
Clean	CN	No visible coating or infilling	Closed	CL	Closed.
Stain	SN	No visible coating but surfaces are discoloured by staining, often limonite (orange-brown)	Open	OP	Without any infill material.
Veneer	VNR	A visible coating of soil or mineral substance, usually too thin to measure (< 1 mm); may be patchy	Infilled	-	Soil or rock i.e. clay, silt, talc, pyrite, quartz, etc.

Appendix B – Laboratory Certificates

Atterberg Limits and Linear Shrinkage Report

Project: 54 - 58 BEACONSFIELD STREET, NEWPORT

Project No.: 31380

Client: EI AUSTRALIA

Report No.: 23/2518

Address: Suite 6.01, 55 Miller Street, Pyrmont NSW 2009

Report Date: 1/08/2023


Test Method: AS1289.3.1.2,3.2.1,3.4.1,2.1.1

Page: 1 of 2

Sampling Procedure: Samples Supplied By Client (Not covered under NATA Scope of Accreditation)

STS / Sample No.	7854D-L/1				
Sample Location	Borehole 1M				
Material Description	Silty Clay, red brown grey/yellow, trace of gravel (CL)				
Depth (m)	3.0 - 3.45				
Sample Date	8/72023				
Sample History	Oven Dried				
Method of Preparation	Dry Sieved				
Liquid Limit (%)	60				
Plastic Limit (%)	24				
Plasticity Index	36				
Linear Shrinkage (%)	15.0				
Mould Size (mm)	250				
Crumbing	N				
Curling	N				

Remarks:



Approved Signatory.....

Technician: DH

Orlando Mendoza - Laboratory Manager

Moisture Content of Soil and Aggregate Samples

Project: 54 - 58 BEACONSFIELD STREET, NEWPORT

Project No.: 31380

Client: EI AUSTRALIA

Report No.: 23/2518

Address: Suite 6.01, 55 Miller Street, Pyrmont NSW 2009

Report Date: 1/08/2023


Test Method: AS1289.2.1.1

Page: 2 of 2

Sampling Procedure: Samples Supplied By Client (Not covered under NATA Scope of Accreditation)

STS / Sample No.	7854D-L/1					
Sample Location	Borehole 1M					
Material Description	Silty Clay, red brown grey/yellow, trace of gravel (CL)					
Depth (mm)	3.0 - 3.45					
Sample Date	8/07/2023					
Moisture Content (%)	16.9					

Remarks:



Approved Signatory.....

Technician: DH

Orlando Mendoza - Laboratory Manager

Appendix C – Vibration Limits

German Standard DIN 4150 – Part 3: 1999 provides guideline levels of vibration velocity for evaluating the effects of vibration in structures. The limits presented in this standard are generally considered to be conservative.

The DIN 4150 values (maximum levels measured in any direction at the foundation, OR, maximum levels measured in (x) or (y) directions, in the plane of the uppermost floor), are summarised in **Table A** below.

It should be noted that peak vibration velocities higher than the minimum figures in **Table A** for low frequencies may be quite ‘safe’, depending on the frequency content of the vibration and the actual conditions of the structures.

It should also be noted that these levels are ‘safe limits’, up to which no damage due to vibration effects has been observed for the particular class of building. ‘Damage’ is defined by DIN 4150 to include even minor non-structural cracking in cement render, the enlargement of cracks already present, and the separation of partitions or intermediate walls from load bearing walls. Should damage be observed at vibration levels lower than the ‘safe limits’, then it may be attributed to other causes. DIN 4150 also states that when vibration levels higher than the ‘safe limits’ are present, it does not necessarily follow that damage will occur. Values given are only a broad guide.

Table A DIN 4150 – Structural Damage – Safe Limits for Building Vibration

Group	Type of Structure	Peak Vibration Velocity (mm/s)			
		At Foundation Level at a Frequency of:			Plane of Floor of Uppermost Storey
		Less than 10 Hz	10 Hz to 50 Hz	50 Hz to 100 Hz	All Frequencies
1	Buildings used for commercial purposes, industrial buildings and buildings of similar design	20	20 to 40	40 to 50	40
2	Dwellings and buildings of similar design and/or use	5	5 to 15	15 to 20	15
3	Structures that because of their particular sensitivity to vibration, do not correspond to those listed in Group 1 and 2 and have intrinsic value (e.g. buildings that are under a preservation order)	3	3 to 8	8 to 10	8

Note: For frequencies above 100 Hz, the higher values in the 50 Hz to 100 Hz column should be used.

Appendix D – Important Information

SCOPE OF SERVICES

The geotechnical report (“the report”) has been prepared in accordance with the scope of services as set out in the contract, or as otherwise agreed, between the Client And EI Australia (“EI”). The scope of work may have been limited by a range of factors such as time, budget, access and/or site disturbance constraints.

RELIANCE ON DATA

EI has relied on data provided by the Client and other individuals and organizations, to prepare the report. Such data may include surveys, analyses, designs, maps and plans. EI has not verified the accuracy or completeness of the data except as stated in the report. To the extent that the statements, opinions, facts, information, conclusions and/or recommendations (“conclusions”) are based in whole or part on the data, EI will not be liable in relation to incorrect conclusions should any data, information or condition be incorrect or have been concealed, withheld, misrepresented or otherwise not fully disclosed to EI.

GEOTECHNICAL ENGINEERING

Geotechnical engineering is based extensively on judgment and opinion. It is far less exact than other engineering disciplines. Geotechnical engineering reports are prepared for a specific client, for a specific project and to meet specific needs, and may not be adequate for other clients or other purposes (e.g. a report prepared for a consulting civil engineer may not be adequate for a construction contractor). The report should not be used for other than its intended purpose without seeking additional geotechnical advice. Also, unless further geotechnical advice is obtained, the report cannot be used where the nature and/or details of the proposed development are changed.

LIMITATIONS OF SITE INVESTIGATION

The investigation programme undertaken is a professional estimate of the scope of investigation required to provide a general profile of subsurface conditions. The data derived from the site investigation programme and subsequent laboratory testing are extrapolated across the site to form an inferred geological model, and an engineering opinion is rendered about overall subsurface conditions and their likely behaviour with regard to the proposed development. Despite investigation, the actual conditions at the site might differ from those inferred to exist, since no subsurface exploration program, no matter how comprehensive, can reveal all subsurface details and anomalies. The engineering logs are the subjective interpretation of subsurface conditions at a particular location and time, made by trained personnel. The actual interface between materials may be more gradual or abrupt than a report indicates.

SUBSURFACE CONDITIONS ARE TIME DEPENDENT

Subsurface conditions can be modified by changing natural forces or man-made influences. The report is based on conditions that existed at the time of subsurface exploration. Construction operations adjacent to the site, and natural events such as floods, or ground water fluctuations, may also affect subsurface conditions, and thus the continuing adequacy of a geotechnical report. EI should be kept apprised of any such events, and should be consulted to determine if any additional tests are necessary.

VERIFICATION OF SITE CONDITIONS

Where ground conditions encountered at the site differ significantly from those anticipated in the report, either due to natural variability of subsurface conditions or construction activities, it is a condition of the report that EI be notified of any variations and be provided with an opportunity to review the recommendations of this report. Recognition of change of soil and rock conditions requires experience and it is recommended that a suitably experienced geotechnical engineer be engaged to visit the site with sufficient frequency to detect if conditions have changed significantly.

REPRODUCTION OF REPORTS

This report is the subject of copyright and shall not be reproduced either totally or in part without the express permission of this Company. Where information from the accompanying report is to be included in contract documents or engineering specification for the project, the entire report should be included in order to minimize the likelihood of misinterpretation from logs.

REPORT FOR BENEFIT OF CLIENT

The report has been prepared for the benefit of the Client and no other party. EI assumes no responsibility and will not be liable to any other person or organisation for or in relation to any matter dealt with or conclusions expressed in the report, or for any loss or damage suffered by any other person or organisation arising from matters dealt with or conclusions expressed in the report (including without limitation matters arising from any negligent act or omission of EI or for any loss or damage suffered by any other party relying upon the matters dealt with or conclusions expressed in the report). Other parties should not rely upon the report or the accuracy or completeness of any conclusions and should make their own inquiries and obtain independent advice in relation to such matters.

OTHER LIMITATIONS

EI will not be liable to update or revise the report to take into account any events or emergent circumstances or fact occurring or becoming apparent after the date of the report.