


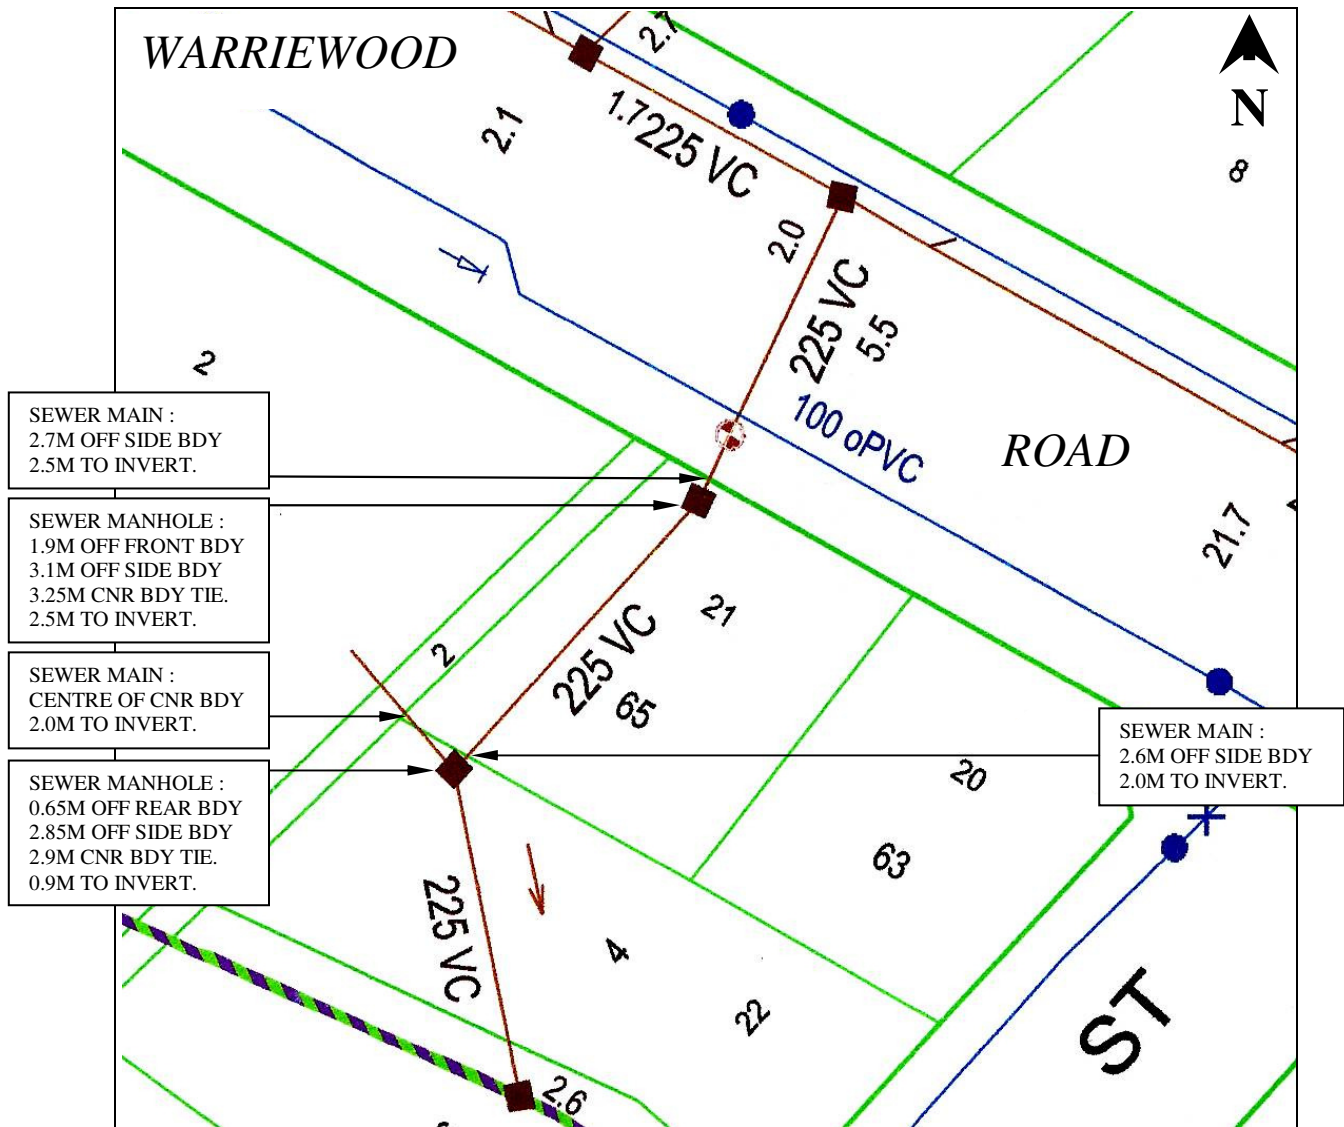

SERVICE PROTECTION REPORT

Supplier No: 1165**Property Address:** 65 WARRIEWOOD ROAD WARRIEWOOD.

SYDNEY WATER ASSETS MUST BE POTHOLED BY HAND PRIOR TO EXCAVATION / PIERING / CONSTRUCTION WORK.

Asset Location Method: Electronic Equipment / Accessing Structures.

Pipe Size: 225mm

Pipe Type: VC.

Strata: Clay

Asset Indicators: Paint mark on Boundaries.

NB : ALL MEASUREMENTS TAKEN OFF BOUNDARY PEGS / RET. WALLS ONLY.

I, Greg McCarthy of All Sydney Side Lines Pty Ltd, being accredited to carry out a Service Protection Report, certify that the information shown on the report has been prepared in accordance with the relevant instructions and accept full responsibility for the accuracy of the information on the report.

Report completed by: Greg McCarthy

Signature:

Date: 7/11/2020.