



---

**REPORT TO**  
**P-3 LIVING**

**ON**  
**GEOTECHNICAL ASSESSMENT**

**FOR**  
**PROPOSED ALTERATIONS AND ADDITIONS**

**AT**  
**7 BRUCE AVENUE, MANLY, NSW**

Date: 15 June 2021  
Ref: 31325SFrptRev2

**JKGeotechnics**  
[www.jkgeotechnics.com.au](http://www.jkgeotechnics.com.au)

T: +61 2 9888 5000  
JK Geotechnics Pty Ltd  
ABN 17 003 550 801



Report prepared by:



**Owen Fraser**  
Associate | Geotechnical Engineer

Report reviewed by:



**Paul Stubbs**  
Principal | Geotechnical Engineer

For and on behalf of  
JK GEOTECHNICS  
PO BOX 976  
NORTH RYDE BC NSW 1670

#### DOCUMENT REVISION RECORD

Report Reference	Report Status	Report Date
31325SFrpt	Final Report	9 April 2018
31325SFrptRev1	Revision 1	18 April 2018
31325SFrptRev2	Revision 2	15 June 2021

© Document copyright of JK Geotechnics

This report (which includes all attachments and annexures) has been prepared by JK Geotechnics (JKG) for its Client, and is intended for the use only by that Client.

This Report has been prepared pursuant to a contract between JKG and its Client and is therefore subject to:

- a) JKG's proposal in respect of the work covered by the Report;
- b) The limitations defined in the Client's brief to JKG;
- c) The terms of contract between JKG and the Client, including terms limiting the liability of JKG.

If the Client, or any person, provides a copy of this Report to any third party, such third party must not rely on this Report, except with the express written consent of JKG which, if given, will be deemed to be upon the same terms, conditions, restrictions and limitations as apply by virtue of (a), (b), and (c) above.

Any third party who seeks to rely on this Report without the express written consent of JKG does so entirely at their own risk and to the fullest extent permitted by law, JKG accepts no liability whatsoever, in respect of any loss or damage suffered by any such third party.

At the Company's discretion, JKG may send a paper copy of this report for confirmation. In the event of any discrepancy between paper and electronic versions, the paper version is to take precedence. The USER shall ascertain the accuracy and the suitability of this information for the purpose intended; reasonable effort is made at the time of assembling this information to ensure its integrity. The recipient is not authorised to modify the content of the information supplied without the prior written consent of JKG.



## Table of Contents

<b>1</b>	<b>INTRODUCTION</b>	<b>1</b>
<b>2</b>	<b>INVESTIGATION PROCEDURE</b>	<b>1</b>
<b>3</b>	<b>RESULTS OF INVESTIGATION</b>	<b>1</b>
3.1	Site Description	1
3.2	Subsurface Conditions	3
<b>4</b>	<b>COMMENTS AND RECOMMENDATIONS</b>	<b>3</b>
4.1	Slope Stability	3
4.2	Excavation Conditions	4
4.2.1	Site Preparation	4
4.2.2	Excavation Methods	4
4.2.3	Potential Vibration Risks	4
4.2.4	Groundwater Seepage	5
4.2.5	Excavation Support	5
4.3	Retaining Walls	6
4.4	Footings	6
4.5	Further Geotechnical Input	7
<b>5</b>	<b>GENERAL COMMENTS</b>	<b>7</b>

### ATTACHMENTS

Figure 1: Site Location Plan

Figure 2: Geotechnical Site Plan

Figure 3: Cross-Sectional Sketch A-A

Vibration Emission Design Goals

Report Explanation Notes

## **1 INTRODUCTION**

This report presents the results of geotechnical assessment for the proposed alterations and additions at 7 Bruce Avenue, Manly, NSW. A site location plan is presented as Figure 1. The assessment was commissioned by Phillipe Remond of P-3 Living by signed Acceptance of Proposal form. The assessment was carried out in general accordance with our proposal, Ref: P46622YF, dated 16 February 2018. This revision of the report (Rev2) supersedes our previous revision (Rev1)

We understand from the supplied architectural drawings prepared by Durbach Block Jaggers (Project No. 1682, Dwg A-DA2-100-000, A-DA2-110-001 to 005, A-DA2-210-001 to 004, A-DA2-310-001 to 002, A-DA2-510-001 to 004, Rev4 dated 07/06/2021) the proposed alterations and additions will comprise demolition of a large portion of existing internal and external walls and also the roof to construct a new terrace level and expand the ground and lower levels. However, the overall building footprint will remain relatively unchanged and consequently only minor excavations will occur along the north-eastern side of the house for the new staircase and garden planter boxes. The existing lower level will be lowered by about 0.9m

The assessment was limited to assessing geotechnical subsurface conditions from surface observations as a basis for comments and recommendations on slope stability, excavation conditions, excavation support, retention and footings.

## **2 INVESTIGATION PROCEDURE**

The assessment involved the following procedure:

- A desktop study of nearby geotechnical investigations.
- Review of published information including geological maps
- A walkover of the site and surrounds by our Senior Geotechnical Engineer on 15 March 2018 to map geological and relevant topographical features.

The principal geomorphological features are presented on the attached Figure 2 and a cross-sectional sketch (Figure 3) orientated north-west to south-east. The figures have been based upon the supplied survey plan prepared by Norton Survey Partners (Ref: 25186, Sheet 1 dated 02/12/16). The datum for Reduced Levels (RL) is the Australian Height Datum. The relative levels referenced within this report were generally interpolated from spot heights shown on the survey plan and are therefore approximate.

## **3 RESULTS OF INVESTIGATION**

### **3.1 Site Description**

The site is located on the eastern side of Smedley's Point peninsular which extends southward into North Harbour. The site is an 'L' shaped property with the main body being roughly rectangular in plan measuring

22m (north-west to south-east) by 13m (north-east to south-west) and with a 13m long arm occupied by a garage which extends south-west towards Bruce Avenue. Site surface levels range from about RL12.2m on the uphill side of the site near Bruce Avenue to RL0.5m at the waterfront on the rock shelf.

The site has a south-western street frontage on Bruce Avenue and at the time of the assessment the foreshore property was occupied by a two storey brick house over an underfloor boatshed at its south-eastern end. The existing house itself generally appeared to be in good condition with no visible cracking based upon a cursory external inspection. The external areas of the property comprised a mixture of concrete paved areas, grass and garden beds and exposed sandstone bedrock. There were several low height retaining walls of both brick and cemented sandstone block construction. The external structures were typically in moderate to good condition, with some minor cracking up to 2mm observed and surficial weathering.

Sandstone bedrock was exposed over the lower portion of the site within, and around, the existing boatshed and also below the existing patio. Based upon our examination of the bedrock using a geopick, the bedrock was generally assessed to be slightly weathered and at least medium strength. Furthermore, based upon observations from within the subject site of sandstone outcrops within the neighbouring north-eastern and north-western properties and along Bruce Avenue, there appears to be at least three stepped rock shelves that intersect the subject site. The vertical faces of the rock shelves generally have an approximate north to south orientation and vary in height roughly between 1m and 5m. Groundwater seepage was regularly observed over the sandstone outcrops.

The north-eastern neighbouring property, No. 1 Bruce Avenue, contained tiered garden areas stepping down the hillside via low height retaining walls and sandstone outcrops. A three storey house was set back uphill from the boundary roughly 10m from the common boundary. Surface levels across the boundary were relatively consistent with local cross falls similar to those of the subject site, except for a short section less than 3m long adjacent to the sites' north-eastern external staircase where the neighbouring property is up to 0.5m above the subject site.

The north-western neighbouring properties, No. 3 and 5 Bruce Avenue, contained two to three storey brick and cement rendered buildings. The building at No. 3 was set back roughly 8m from the site boundary, however there was a retaining wall set back about 3m from the boundary that appeared in very poor condition. At the time of the site walkover, the wall was temporarily propped by timbers that were founded on a sandstone outcrop within the neighbouring site. The building within No. 5 was set back approximately 1.2m from the site boundary although external paved and gravelled areas appear to extend to the boundary.

The neighbouring south-western property contained a two storey cement rendered building that generally appeared to be in good condition based upon a cursory inspection from within the subject site. The building was generally set back 1m or more from the common boundary except for some low height boundary walls.

### **3.2 Subsurface Conditions**

The 1:100,000 Geological Map of Sydney indicates the site is underlain by Hawkesbury Sandstone of the Wianamatta Group. The presence of sandstone was confirmed by the presence of outcrops. The following should be read with reference to Figures 2 and 3.

Based upon our observations and consideration of the geological setting and topography of the site, the soil cover is inferred to be generally shallow (less than 1m) over the sandstone bedrock. However, we note the fill may be locally deeper behind existing retaining walls which will be dependent on the wall height. Our inspection indicated no evidence of any recent mass soil slope instability or major rock falls within the subject site.

Sandstone outcrops were observed across the site and also within adjacent properties and along Bruce Avenue. From our examination of the sandstone outcrops, we assessed the bedrock to be slightly weathered and of at least medium strength. This is consistent with the sandstone outcrops observed within the adjacent properties and from our past assessment at 5 Bruce Avenue. The sandstone bedrock appears to step down to the south-east towards Manly Cove.

We observed groundwater seepage flows over the sandstone outcrops which we expect to have originated at the soil/rock interface and through defects in the sandstone.

## **4 COMMENTS AND RECOMMENDATIONS**

### **4.1 Slope Stability**

Using the terminology and methodology presented in AGS2007c (Reference 1) and the above observations, we have assessed the likelihood of instability during construction to be 'Rare' and the likelihood of instability of the proposed development to be 'Unlikely', provided the recommendations in the following sections of this report are followed. The consequences to property, should the above instability occur, are considered to be 'Minor'. The risk to property is therefore 'Low', which is 'acceptable' in accordance with the criteria given in Reference 1.

Adopting the above 'Rare' and 'Unlikely' likelihood of instability together with typical temporal, vulnerability, evacuation and spatial factors, the risk to life for the person most at risk would be less than  $10^{-6}$ , which is 'Acceptable' in accordance with the criteria given in Reference 1.

We consider that our risk analysis has shown that the proposed development can achieve 'Acceptable' risk criteria, provided the recommendations presented in the sections which follow are adopted.

## **4.2 Excavation Conditions**

### **4.2.1 Site Preparation**

Following demolition of existing buildings and structures, site preparation will require stripping of vegetation and topsoil. Following this, any obvious deleterious or contaminated existing fill should be removed. These stripped materials should be taken offsite as they are not suitable for reuse as engineered fill. The topsoil may, however, be separately stockpiled and used for subsequent landscaping purposes.

### **4.2.2 Excavation Methods**

Excavation recommendations provided below should be completed by reference to the latest version of SafeWork Australia Code of Practice 'Excavation Work'.

We generally expect only relatively minor excavations of less than 1m to achieve the required levels, otherwise the majority of the proposed work consists of internal alterations and additions, however we expect that additional footings will need to be excavated. The excavations are likely to encounter a shallow layer of soils overlying sandstone bedrock of relatively good quality and of at least medium strength. Furthermore, given the site geometry/topography and considering the majority of the existing structure will remain, we expect that only a small sized excavator may be able to access the site. Where access is not possible, the works must be completed using hand tools only.

The soil cover should be readily excavated using conventional earthworks equipment (eg. hydraulic excavators) or by hand tools. The inferred underlying bedrock will likely comprise of 'hard rock' excavation conditions and so will likely need to be excavated using hydraulic rock hammers attached to a small excavator and/or hand operated jack hammers. Alternatively, rock grinders and saws may be used for excavation of the bedrock. Productivity in the medium strength or better sandstone will be slow and high equipment wear should be expected. Rock saws may also be used to create 'smooth' finishes on cut faces and aid in detailed excavation of footings, services trenches etc.

When using the rock breakers, saws and ripping attachments, the resulting dust should be suppressed by spraying with water. Care will be required to control ground vibrations associated with the use of rock breakers during rock excavation, and further advice is provided in Section 4.2.3, below.

### **4.2.3 Potential Vibration Risks**

We recommend that considerable caution be taken during rock excavation on this site as there will likely be direct transmission of ground vibrations to neighbouring structures, buildings and infrastructure. Whilst rock excavations will likely be limited, there are a number of structures within close proximity to the boundaries. Additionally, we note the conditions outlined within the Draft version of the Terrestrial Biodiversity Report prepared by GIS Environmental Consultants dated 17/11/2017 which states that "rock removal is not to be carried out using pneumatic hammers" due to the presence of penguin colonies. As such, rock hammers will

not be used and instead low vibration equipment, such as rotary grinders and rock saws will need to be utilised which should not pose vibration risks.

Regardless, if hydraulic rock hammers attached to an excavator were to be used or there are any concerns during demolition or construction, we recommend initial quantitative vibration monitoring to determine whether vibrations emitted exceed the attached 'Vibrations Emission Design Goals'. Given the rock equipment to be used (i.e. small excavator, hand tools), we believe that ground borne vibrations are unlikely to be an issue, however the contractor should be made aware of the potential risks.

#### **4.2.4 Groundwater Seepage**

Groundwater seepage was observed over some of the exposed sandstone outcrops, and we expect this groundwater originated at the soil/rock interface and through defects in the bedrock. We expect groundwater inflows will be localised and of small volume, except perhaps following heavy rainfall events. Regardless, we expect groundwater inflows will be easily managed by conventional sump and pump or gravity drainage techniques.

Inspection and monitoring of groundwater seepage during bulk excavations is recommended, so that any unexpected conditions can be timeously addressed. We further recommend that a toe drain be formed at the base of all cut rock faces to collect groundwater and lead it to a sump for disposal.

#### **4.2.5 Excavation Support**

Excavations through the shallow soil profile may be temporarily battered to a side slope no steeper than 1 Vertical (V) in 2 Horizontal (H). On the basis of the provided architectural drawings and survey plan, it would appear that temporary batters can generally be accommodated within the site geometry. However, possible seepage at the soil-rock interface may cause localised instability of soil batters, and allowance should be made for sand bagging.

We expect that good quality sandstone or low or higher strength may be cut vertically. However, localised stabilisation measures may be necessary if adverse defects (such as inclined joints or bedding) are found. Treatment for zones requiring stabilisation may include rock bolting, shotcreting, underpinning, etc. Clay seams occurring in permanently exposed sandstone slopes may also require 'dental' treatment. Notwithstanding, the exposed sandstone bedrock observed across the site appears to be stable without the need for further stabilisation works. We note however, that sandstone bedrock is likely to be exposed below pavements and behind retaining walls. Furthermore, there was exposed sandstone bedrock within the existing boatshed which was not accessible. As such, during construction we recommend an inspection by a geotechnical engineer of all exposed sandstone cut faces to assess whether any stabilisation measures are required.



### 4.3 Retaining Walls

We expect that low height retaining walls may be required, primarily for landscaping purposes. Given the inferred shallow soil cover across the site, we recommend all retaining walls are uniformly founded on the underlying sandstone bedrock. The retaining walls should be designed using the following parameters:

- Conventional free-standing cantilever walls which support areas where movement is not of concern (i.e. landscape walls), may be designed using a triangular lateral earth pressure distribution with an 'active' earth pressure coefficient,  $K_a$ , of 0.33, for the soil profile, assuming a horizontal retained surface.
- Walls which are propped by the proposed structure or which support movement sensitive elements, should be designed using a triangular lateral earth pressure distribution and an 'at rest' earth pressure coefficient,  $K_o$ , of 0.6, for the soil profile, assuming a horizontal retained surface.
- A bulk unit weight of  $20\text{kN/m}^3$  should be adopted for the soil profile.
- All surcharge loads affecting the walls (eg. adjacent high level footings, construction loads, traffic, etc) should be taken into account in the wall design using the appropriate earth pressure coefficient from above.
- Retaining walls should be designed as drained and measures taken to provide permanent and effective drainage of the ground behind the walls. The subsoil drains must incorporate a non-woven geotextile fabric (eg. Bidim A34) to act as a filter against subsoil erosion.
- For lateral toe restraint, walls less than 1m high founded at the crest of a sandstone cut face can be provided with dowels which are grouted into holes drilled down and away from the cut face at  $30^\circ$ . An allowable bond stress of  $200\text{kPa}$  should be adopted for dowel design but the lateral load capacity of the rock is very limited and the dowels should have a minimum embedment length of 500mm. Alternatively, if the footing is founded in sandstone bedrock below bulk excavation, the footing can be keyed into the underlying bedrock and an allowable lateral stress of  $200\text{kPa}$  may be adopted for key depth design.

### 4.4 Footings

Based on our assessment, we expect sandstone bedrock to be exposed within any excavations and at footing level. As such, a 'Class A' site is therefore applicable in accordance with AS2870-2011, *'Residential Slabs and Footings'*. We recommend that all new footings be uniformly supported on sandstone bedrock. Pad and strip footings would be appropriate or for light structures just a levelling strip may be adequate. Pad and strip footings founded in sandstone bedrock may be designed for an allowable bearing pressure of  $1,000\text{kPa}$ .

We recommend that the footing excavations be inspected by a geotechnical engineer to confirm that a suitable founding material has been exposed.

With respect to earthquakes, the site classifies as 'Class  $B_e$ -Rock', in accordance with AS1170.4. A Hazard Factor (Z) of 0.08 is applicable for Sydney.

#### **4.5 Further Geotechnical Input**

The following is a summary of the further geotechnical input which is required and which has been detailed in the preceding sections of this report:

- If hydraulic rock hammers are used, initial quantitative vibration monitoring during rock excavation.
- Geotechnical inspection of sandstone cut rock faces.
- Monitoring of groundwater seepage into the excavations.
- Geotechnical inspection of footings.

#### **5 GENERAL COMMENTS**


The recommendations presented in this report include specific issues to be addressed during the construction phase of the project. In the event that any of the construction phase recommendations presented in this report are not implemented, the general recommendations may become inapplicable and JK Geotechnics accept no responsibility whatsoever for the performance of the structure where recommendations are not implemented in full and properly tested, inspected and documented.

This report provides advice on geotechnical aspects for the proposed civil and structural design. As part of the documentation stage of this project, Contract Documents and Specifications may be prepared based on our report. However, there may be design features we are not aware of or have not commented on for a variety of reasons. The designers should satisfy themselves that all the necessary advice has been obtained. If required, we could be commissioned to review the geotechnical aspects of contract documents to confirm the intent of our recommendations has been correctly implemented.

A waste classification will need to be assigned to any soil excavated from the site prior to offsite disposal. Subject to the appropriate testing, material can be classified as Virgin Excavated Natural Material (VENM), General Solid, Restricted Solid or Hazardous Waste. Analysis takes seven to 10 working days to complete, therefore, an adequate allowance should be included in the construction program unless testing is completed prior to construction. If contamination is encountered, then substantial further testing (and associated delays) should be expected. We strongly recommend that this issue is addressed prior to the commencement of excavation on site.

This report has been prepared for the particular project described and no responsibility is accepted for the use of any part of this report in any other context or for any other purpose. If there is any change in the proposed development described in this report then all recommendations should be reviewed. Copyright in this report is the property of JK Geotechnics. We have used a degree of care, skill and diligence normally exercised by consulting engineers in similar circumstances and locality. No other warranty expressed or implied is made or intended. Subject to payment of all fees due for the assessment, the client alone shall have a licence to use this report. The report shall not be reproduced except in full.



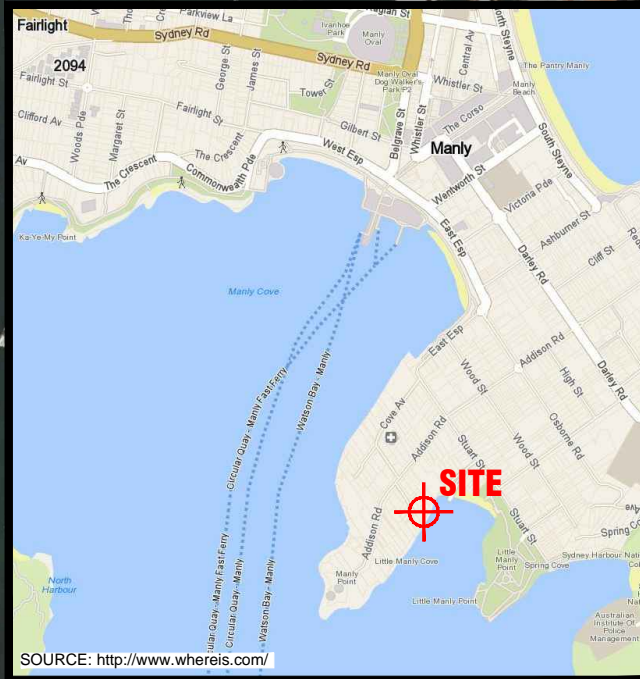

AERIAL IMAGE SOURCE: GOOGLE EARTH PRO 7.1.5.1557  
AERIAL IMAGE ©: 2015 GOOGLE INC.

Title:

## SITE LOCATION PLAN

Location:

7 BRUCE AVENUE  
MANLY, NSW

Report No:

31325SF

Figure No:

1

This plan should be read in conjunction with the JK Geotechnics report.




# JK Geotechnics





PLOT DATE: 10/04/2018 12:02:18 PM DWG FILE: S:\6 GEOTECHNICAL\6F GEOTECHNICAL JOBS\31000\S\31325\F MANLY\CAD\31325SF.DWG



© JK GEOTECHNICS

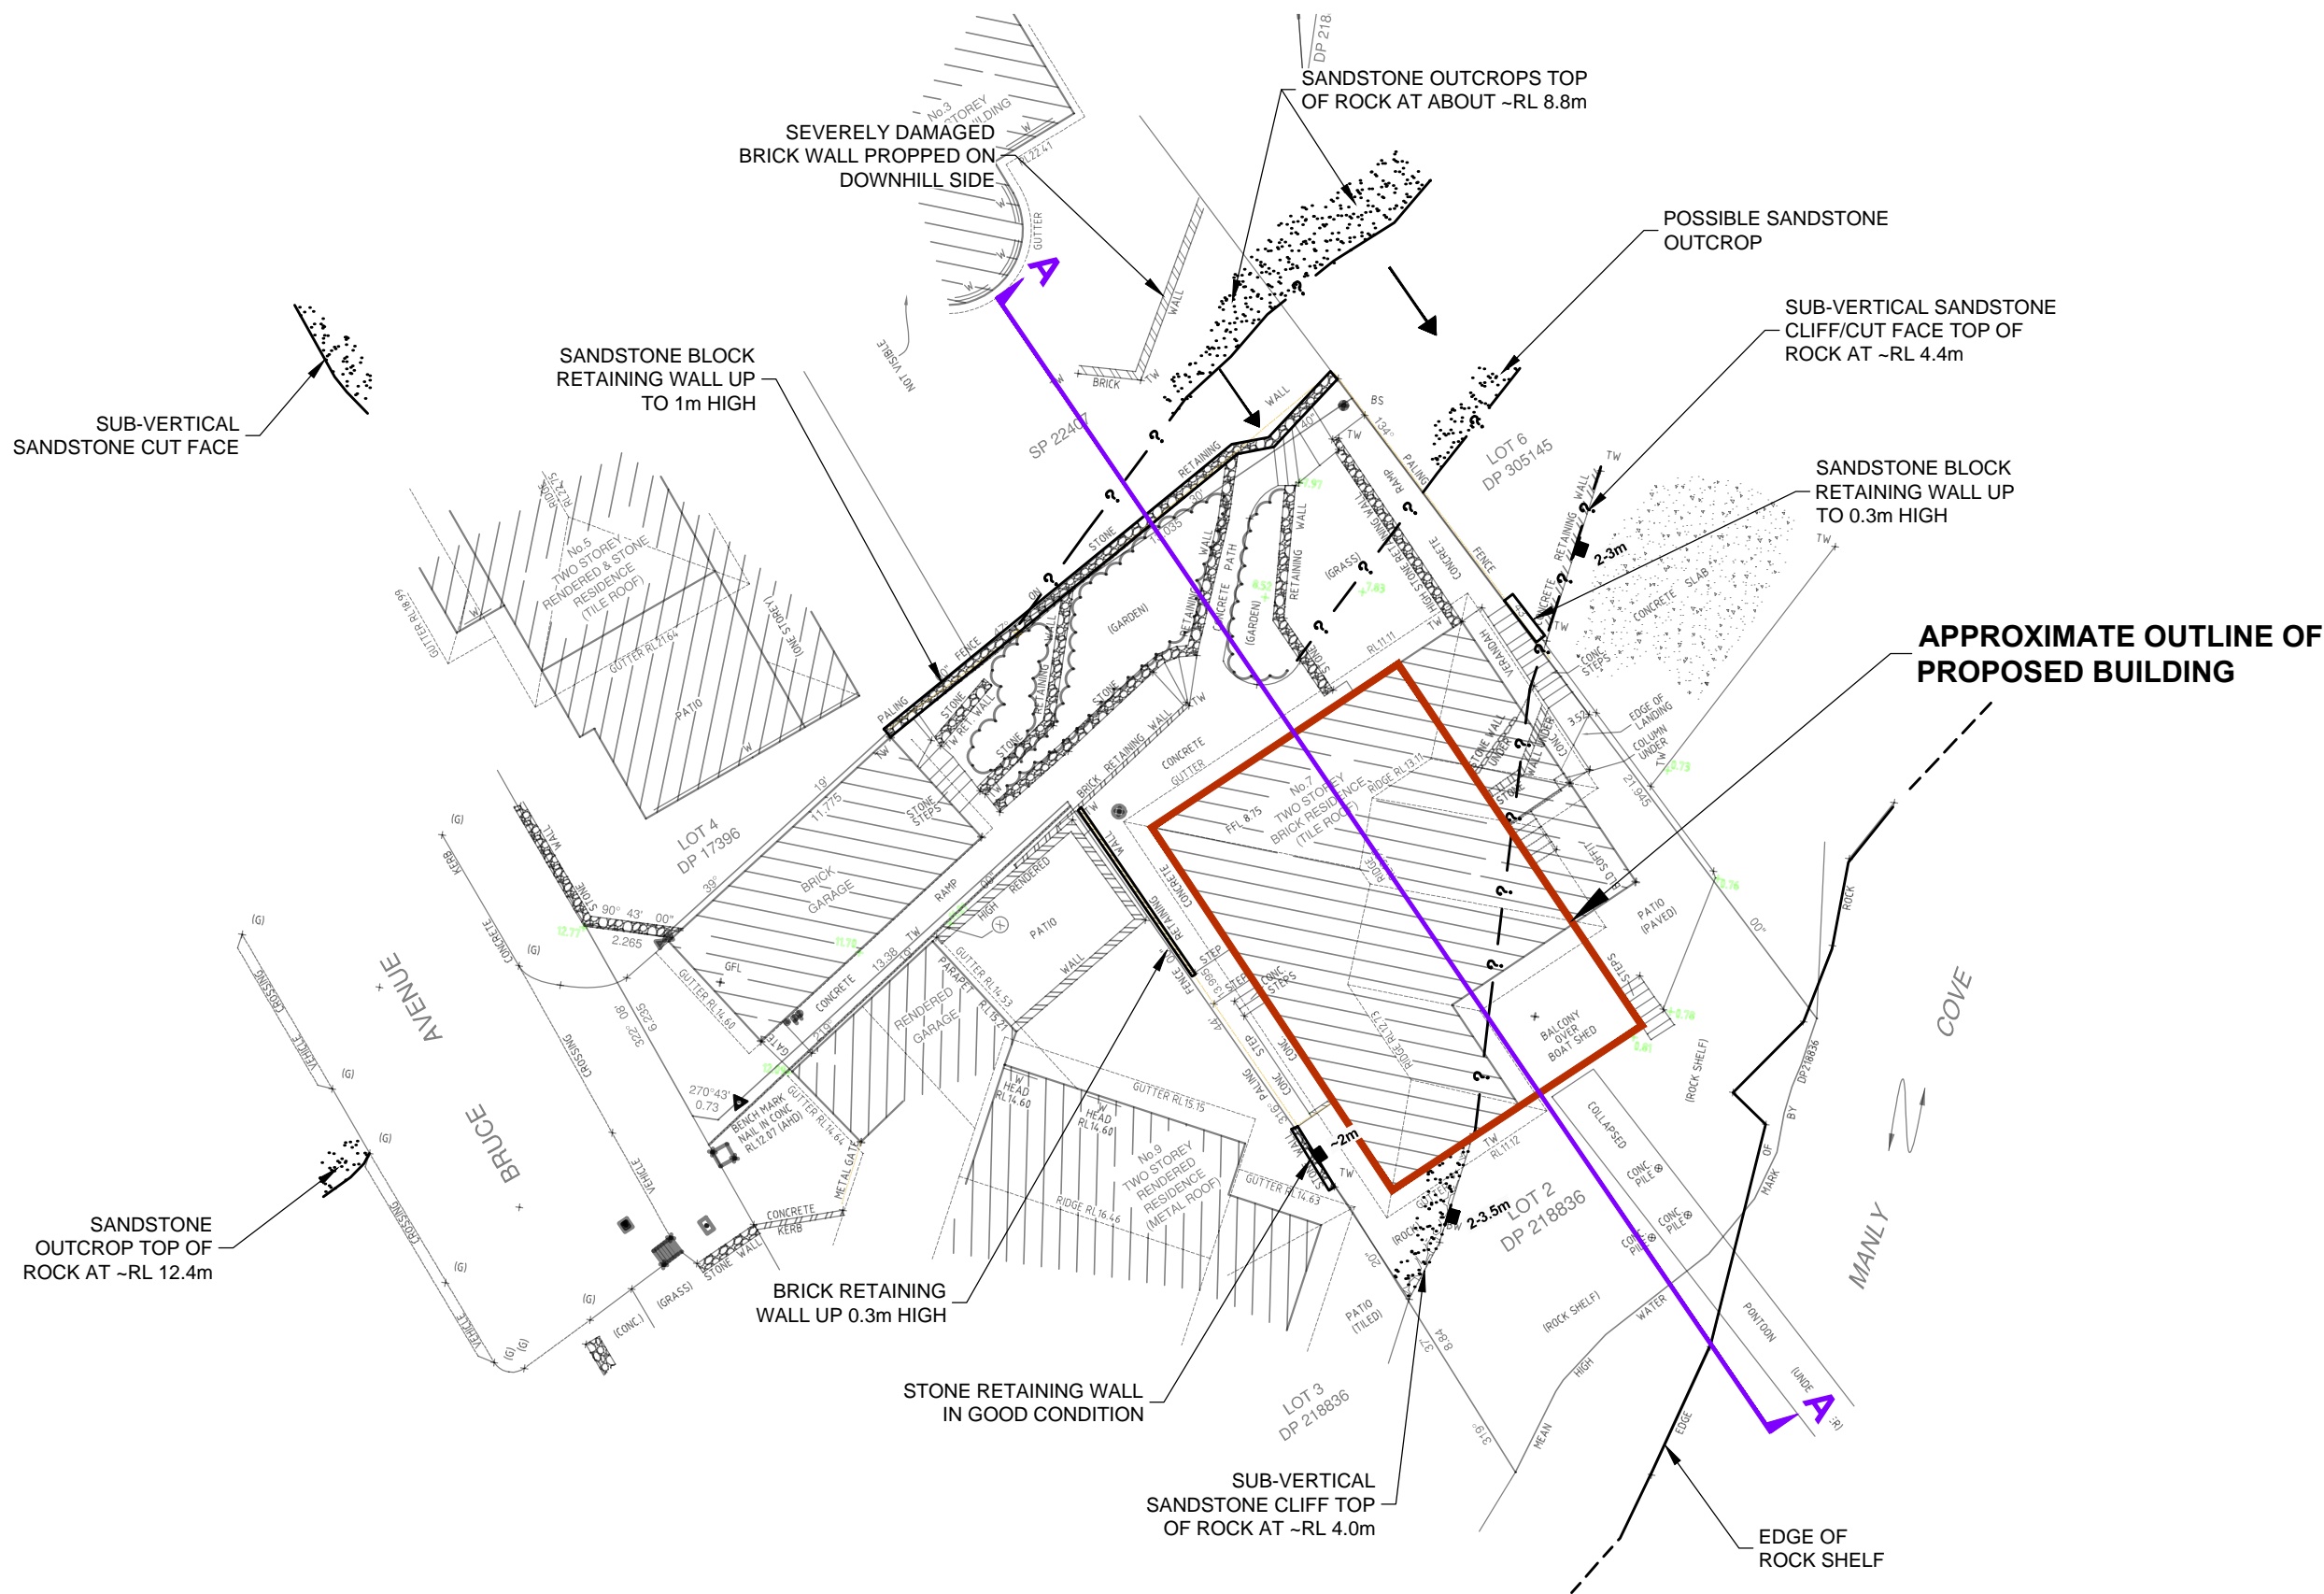

This plan should be read in conjunction with the JK Geotechnics report.

Title: <b>GEOTECHNICAL SITE PLAN</b>	
Location: 7 BRUCE AVENUE MANLY, NSW	
Report No: 31325SF	Figure No: 2
<b>JK Geotechnics</b>	



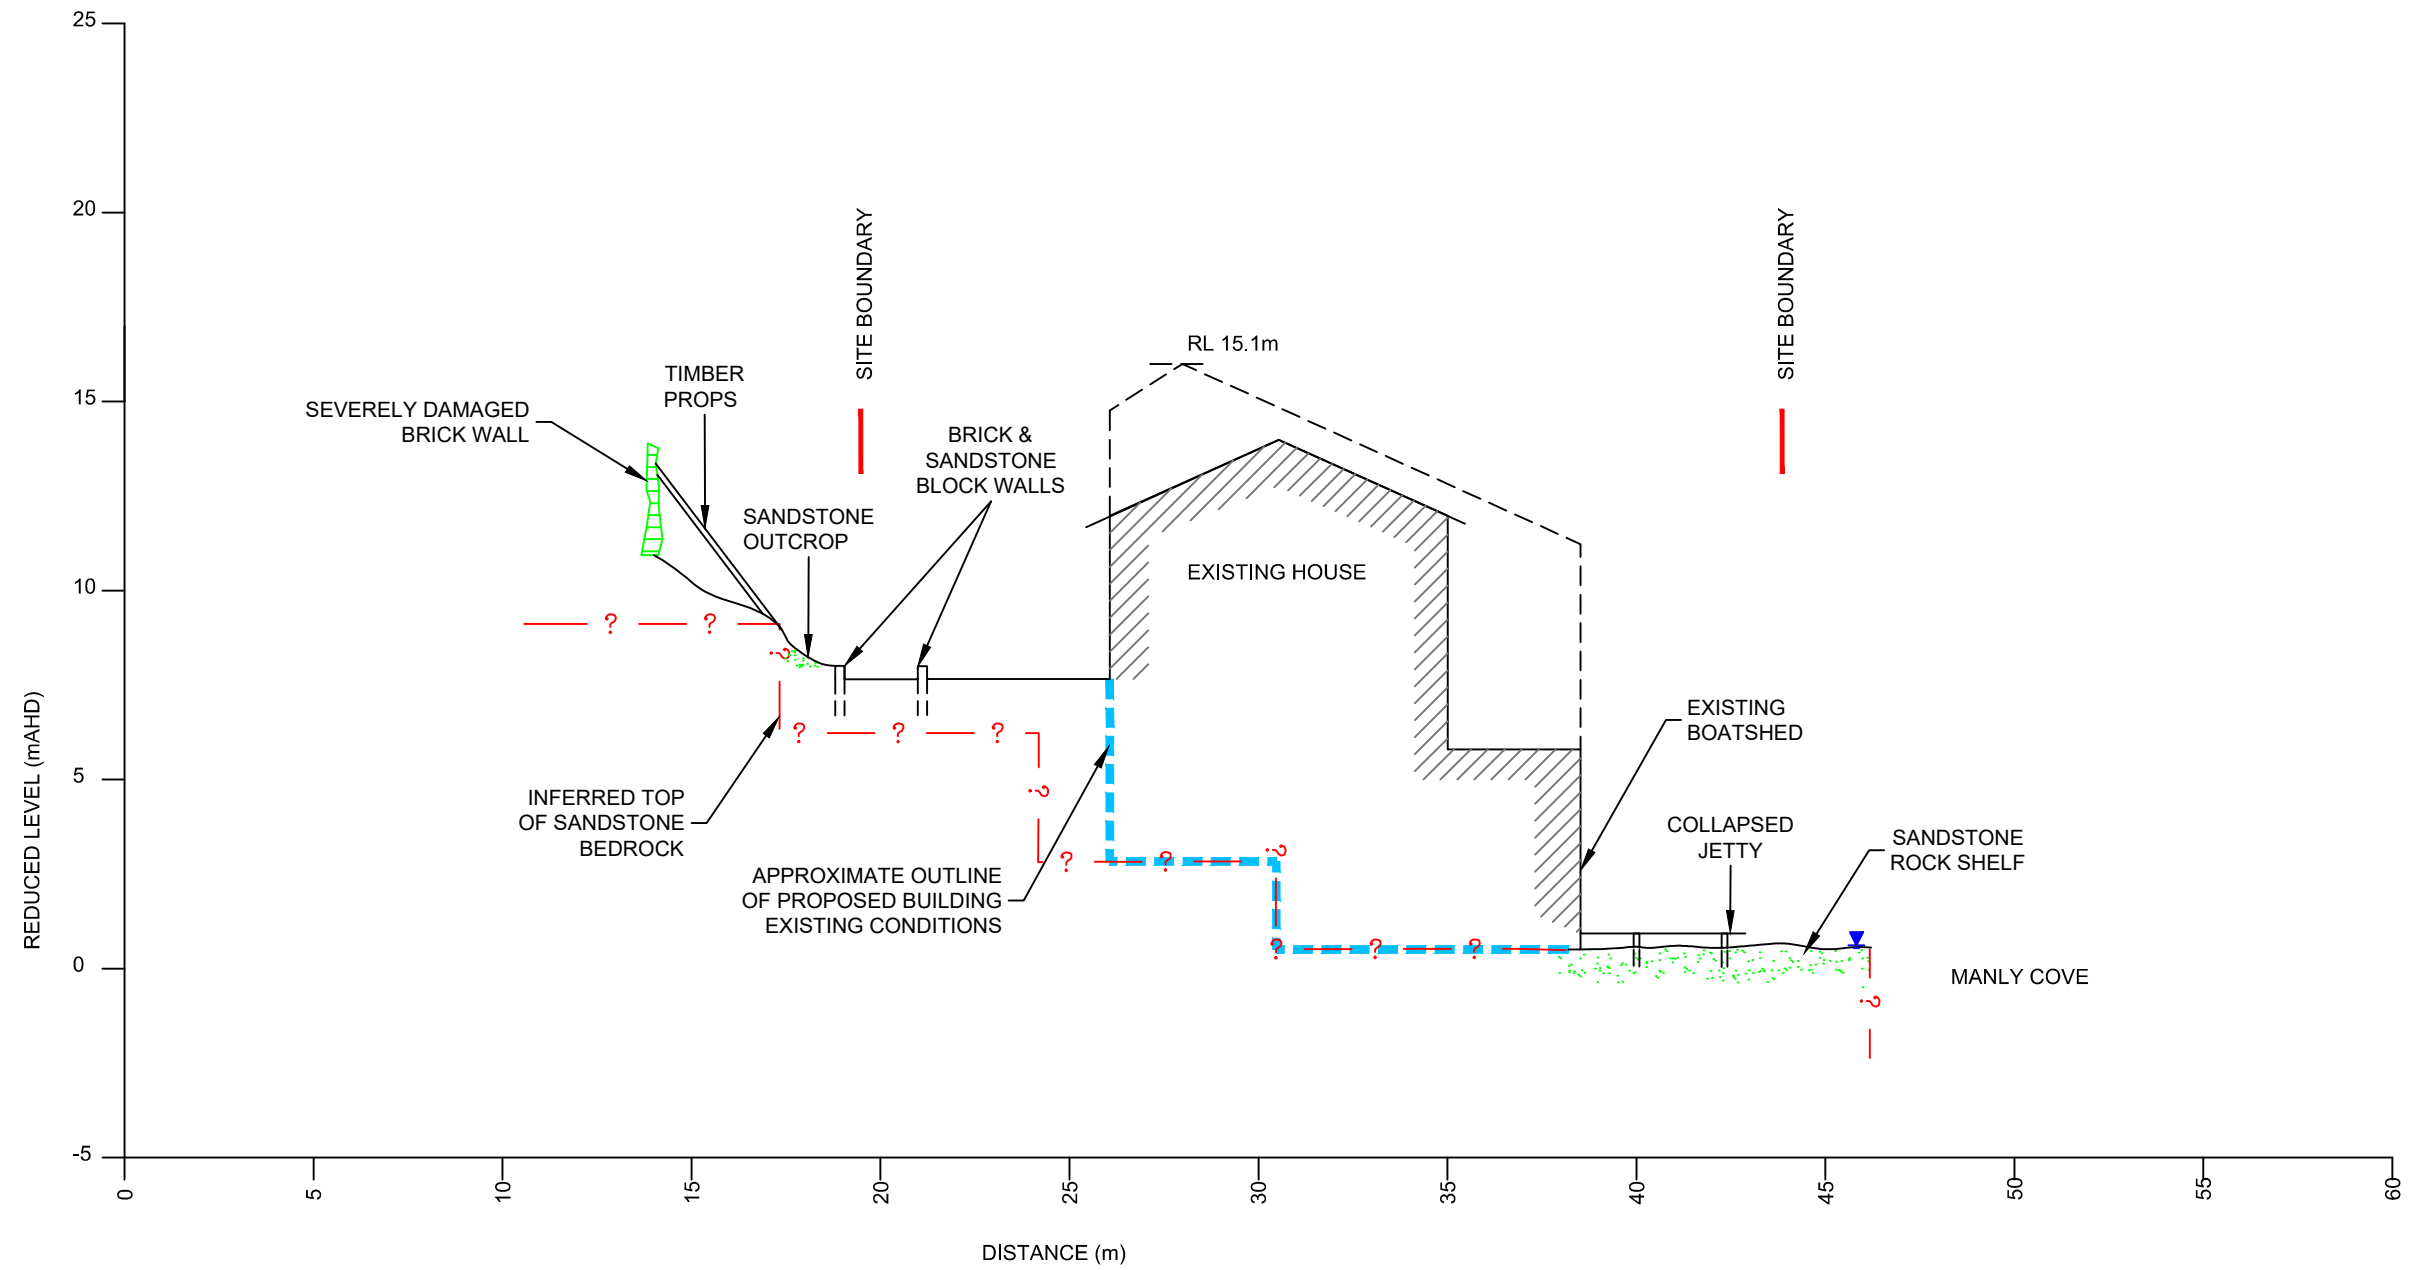

This plan should be read in conjunction with the JK Geotechnics report.

Title: <b>CROSS SECTIONAL SKETCH A-A</b>	
Location: 7 BRUCE AVENUE MANLY, NSW	
Report No: 31325SF	Figure No: 3
<b>JKGeotechnics</b>	



# REPORT EXPLANATION NOTES

## INTRODUCTION

These notes have been provided to amplify the geotechnical report in regard to classification methods, field procedures and certain matters relating to the Comments and Recommendations section. Not all notes are necessarily relevant to all reports.

The ground is a product of continuing natural and man-made processes and therefore exhibits a variety of characteristics and properties which vary from place to place and can change with time. Geotechnical engineering involves gathering and assimilating limited facts about these characteristics and properties in order to understand or predict the behaviour of the ground on a particular site under certain conditions. This report may contain such facts obtained by inspection, excavation, probing, sampling, testing or other means of investigation. If so, they are directly relevant only to the ground at the place where and time when the investigation was carried out.

## DESCRIPTION AND CLASSIFICATION METHODS

The methods of description and classification of soils and rocks used in this report are based on Australian Standard 1726:2017 'Geotechnical Site Investigations'. In general, descriptions cover the following properties – soil or rock type, colour, structure, strength or density, and inclusions. Identification and classification of soil and rock involves judgement and the Company infers accuracy only to the extent that is common in current geotechnical practice.

Soil types are described according to the predominating particle size and behaviour as set out in the attached soil classification table qualified by the grading of other particles present (eg. sandy clay) as set out below:

Soil Classification	Particle Size
Clay	< 0.002mm
Silt	0.002 to 0.075mm
Sand	0.075 to 2.36mm
Gravel	2.36 to 63mm
Cobbles	63 to 200mm
Boulders	> 200mm

Non-cohesive soils are classified on the basis of relative density, generally from the results of Standard Penetration Test (SPT) as below:

Relative Density	SPT 'N' Value (blows/300mm)
Very loose (VL)	< 4
Loose (L)	4 to 10
Medium dense (MD)	10 to 30
Dense (D)	30 to 50
Very Dense (VD)	> 50

Cohesive soils are classified on the basis of strength (consistency) either by use of a hand penetrometer, vane shear, laboratory testing and/or tactile engineering examination. The strength terms are defined as follows.

Classification	Unconfined Compressive Strength (kPa)	Indicative Undrained Shear Strength (kPa)
Very Soft (VS)	≤ 25	≤ 12
Soft (S)	> 25 and ≤ 50	> 12 and ≤ 25
Firm (F)	> 50 and ≤ 100	> 25 and ≤ 50
Stiff (St)	> 100 and ≤ 200	> 50 and ≤ 100
Very Stiff (VSt)	> 200 and ≤ 400	> 100 and ≤ 200
Hard (Hd)	> 400	> 200
Friable (Fr)	Strength not attainable – soil crumbles	

Rock types are classified by their geological names, together with descriptive terms regarding weathering, strength, defects, etc. Where relevant, further information regarding rock classification is given in the text of the report. In the Sydney Basin, 'shale' is used to describe fissile mudstone, with a weakness parallel to bedding. Rocks with alternating inter-laminations of different grain size (eg. siltstone/claystone and siltstone/fine grained sandstone) is referred to as 'laminite'.

## SAMPLING

Sampling is carried out during drilling or from other excavations to allow engineering examination (and laboratory testing where required) of the soil or rock.

Disturbed samples taken during drilling provide information on plasticity, grain size, colour, moisture content, minor constituents and, depending upon the degree of disturbance, some information on strength and structure. Bulk samples are similar but of greater volume required for some test procedures.

Undisturbed samples are taken by pushing a thin-walled sample tube, usually 50mm diameter (known as a U50), into the soil and withdrawing it with a sample of the soil contained in a relatively undisturbed state. Such samples yield information on structure and strength, and are necessary for laboratory determination of shrink-swell behaviour, strength and compressibility. Undisturbed sampling is generally effective only in cohesive soils.

Details of the type and method of sampling used are given on the attached logs.

## INVESTIGATION METHODS

The following is a brief summary of investigation methods currently adopted by the Company and some comments on their use and application. All methods except test pits, hand auger drilling and portable Dynamic Cone Penetrometers require the use of a mechanical rig which is commonly mounted on a truck chassis or track base.

**Test Pits:** These are normally excavated with a backhoe or a tracked excavator, allowing close examination of the insitu soils and 'weaker' bedrock if it is safe to descend into the pit. The depth of penetration is limited to about 3m for a backhoe and up to 6m for a large excavator. Limitations of test pits are the problems associated with disturbance and difficulty of reinstatement and the consequent effects on close-by structures. Care must be taken if construction is to be carried out near test pit locations to either properly recompact the backfill during construction or to design and construct the structure so as not to be adversely affected by poorly compacted backfill at the test pit location.

**Hand Auger Drilling:** A borehole of 50mm to 100mm diameter is advanced by manually operated equipment. Refusal of the hand auger can occur on a variety of materials such as obstructions within any fill, tree roots, hard clay, gravel or ironstone, cobbles and boulders, and does not necessarily indicate rock level.

**Continuous Spiral Flight Augers:** The borehole is advanced using 75mm to 115mm diameter continuous spiral flight augers, which are withdrawn at intervals to allow sampling and insitu testing. This is a relatively economical means of drilling in clays and in sands above the water table. Samples are returned to the surface by the flights or may be collected after withdrawal of the auger flights, but they can be very disturbed and layers may become mixed. Information from the auger sampling (as distinct from specific sampling by SPTs or undisturbed samples) is of limited reliability due to mixing or softening of samples by groundwater, or uncertainties as to the original depth of the samples. Augering below the groundwater table is of even lesser reliability than augering above the water table.

**Rock Augering:** Use can be made of a Tungsten Carbide (TC) bit for auger drilling into rock to indicate rock quality and continuity by variation in drilling resistance and from examination of recovered rock cuttings. This method of investigation is quick and relatively inexpensive but provides only an indication of the likely rock strength and predicted values may be in error by a strength order. Where rock strengths may have a significant impact on construction feasibility or costs, then further investigation by means of cored boreholes may be warranted.

**Wash Boring:** The borehole is usually advanced by a rotary bit, with water being pumped down the drill rods and returned up the annulus, carrying the drill cuttings. Only major changes in stratification can be assessed from the cuttings, together with some information from "feel" and rate of penetration.

**Mud Stabilised Drilling:** Either Wash Boring or Continuous Core Drilling can use drilling mud as a circulating fluid to stabilise the borehole. The term 'mud' encompasses a range of products ranging from bentonite to polymers. The mud tends to mask the cuttings and reliable identification is only possible from intermittent intact sampling (eg. from SPT and U50 samples) or from rock coring, etc.

**Continuous Core Drilling:** A continuous core sample is obtained using a diamond tipped core barrel. Provided full core recovery is achieved (which is not always possible in very low strength rocks and granular soils), this technique provides a very reliable (but relatively expensive) method of investigation. In rocks, NMLC or HQ triple tube core barrels, which give a core of about 50mm and 61mm diameter, respectively, is usually used with water flush. The length of core recovered is compared to the length drilled and any length not recovered is shown as NO CORE. The location of NO CORE recovery is determined on site by the supervising engineer; where the location is uncertain, the loss is placed at the bottom of the drill run.

**Standard Penetration Tests:** Standard Penetration Tests (SPT) are used mainly in non-cohesive soils, but can also be used in cohesive soils, as a means of indicating density or strength and also of obtaining a relatively undisturbed sample. The test procedure is described in Australian Standard 1289.6.3.1–2004 (R2016) *'Methods of Testing Soils for Engineering Purposes, Soil Strength and Consolidation Tests – Determination of the Penetration Resistance of a Soil – Standard Penetration Test (SPT)'*.

The test is carried out in a borehole by driving a 50mm diameter split sample tube with a tapered shoe, under the impact of a 63.5kg hammer with a free fall of 760mm. It is normal for the tube to be driven in three successive 150mm increments and the 'N' value is taken as the number of blows for the last 300mm. In dense sands, very hard clays or weak rock, the full 450mm penetration may not be practicable and the test is discontinued.

The test results are reported in the following form:

- In the case where full penetration is obtained with successive blow counts for each 150mm of, say, 4, 6 and 7 blows, as

N = 13  
4, 6, 7

- In a case where the test is discontinued short of full penetration, say after 15 blows for the first 150mm and 30 blows for the next 40mm, as

N > 30  
15, 30/40mm

The results of the test can be related empirically to the engineering properties of the soil.

A modification to the SPT is where the same driving system is used with a solid 60° tipped steel cone of the same diameter as the SPT hollow sampler. The solid cone can be continuously driven for some distance in soft clays or loose sands, or may be used where damage would otherwise occur to the SPT. The results of this Solid Cone Penetration Test (SCPT) are shown as 'N<sub>c</sub>' on the borehole logs, together with the number of blows per 150mm penetration.

### Cone Penetrometer Testing (CPT) and Interpretation:

The cone penetrometer is sometimes referred to as a Dutch Cone. The test is described in Australian Standard 1289.6.5.1–1999 (R2013) *'Methods of Testing Soils for Engineering Purposes, Soil Strength and Consolidation Tests – Determination of the Static Cone Penetration Resistance of a Soil – Field Test using a Mechanical and Electrical Cone or Friction-Cone Penetrometer'*.

In the tests, a 35mm or 44mm diameter rod with a conical tip is pushed continuously into the soil, the reaction being provided by a specially designed truck or rig which is fitted with a hydraulic ram system. Measurements are made of the end bearing resistance on the cone and the frictional resistance on a separate 134mm or 165mm long sleeve, immediately behind the cone. Transducers in the tip of the assembly are electrically connected by wires passing through the centre of the push rods to an amplifier and recorder unit mounted on the control truck. The CPT does not provide soil sample recovery.

As penetration occurs (at a rate of approximately 20mm per second), the information is output as incremental digital records every 10mm. The results given in this report have been plotted from the digital data.

The information provided on the charts comprise:

- Cone resistance – the actual end bearing force divided by the cross sectional area of the cone – expressed in MPa. There are two scales presented for the cone resistance. The lower scale has a range of 0 to 5MPa and the main scale has a range of 0 to 50MPa. For cone resistance values less than 5MPa, the plot will appear on both scales.
- Sleeve friction – the frictional force on the sleeve divided by the surface area – expressed in kPa.
- Friction ratio – the ratio of sleeve friction to cone resistance, expressed as a percentage.

The ratios of the sleeve resistance to cone resistance will vary with the type of soil encountered, with higher relative friction in clays than in sands. Friction ratios of 1% to 2% are commonly encountered in sands and occasionally very soft clays, rising to 4% to 10% in stiff clays and peats. Soil descriptions based on cone resistance and friction ratios are only inferred and must not be considered as exact.

Correlations between CPT and SPT values can be developed for both sands and clays but may be site specific.

Interpretation of CPT values can be made to empirically derive modulus or compressibility values to allow calculation of foundation settlements.

Stratification can be inferred from the cone and friction traces and from experience and information from nearby boreholes etc. Where shown, this information is presented for general guidance, but must be regarded as interpretive. The test method provides a continuous profile of engineering properties but, where precise information on soil classification is required, direct drilling and sampling may be preferable.

There are limitations when using the CPT in that it may not penetrate obstructions within any fill, thick layers of hard clay and very dense sand, gravel and weathered bedrock. Normally a 'dummy' cone is pushed through fill to protect the equipment. No information is recorded by the 'dummy' probe.

**Flat Dilatometer Test:** The flat dilatometer (DMT), also known as the Marchetti Dilometer comprises a stainless steel blade having a flat, circular steel membrane mounted flush on one side.

The blade is connected to a control unit at ground surface by a pneumatic-electrical tube running through the insertion rods. A gas tank, connected to the control unit by a pneumatic cable, supplies the gas pressure required to expand the membrane. The control unit is equipped with a pressure regulator, pressure gauges, an audio-visual signal and vent valves.

The blade is advanced into the ground using our CPT rig or one of our drilling rigs, and can be driven into the ground using an SPT hammer. As soon as the blade is in place, the membrane is inflated, and the pressure required to lift the membrane (approximately 0.1mm) is recorded. The pressure then required to lift the centre of the membrane by an additional 1mm is recorded. The membrane is then deflated before pushing to the next depth increment, usually 200mm down. The pressure readings are corrected for membrane stiffness.

The DMT is used to measure material index ( $I_D$ ), horizontal stress index ( $K_D$ ), and dilatometer modulus ( $E_D$ ). Using established correlations, the DMT results can also be used to assess the 'at rest' earth pressure coefficient ( $K_0$ ), over-consolidation ratio (OCR), undrained shear strength ( $C_u$ ), friction angle ( $\phi$ ), coefficient of consolidation ( $C_h$ ), coefficient of permeability ( $K_h$ ), unit weight ( $\gamma$ ), and vertical drained constrained modulus ( $M$ ).

The seismic dilatometer (SDMT) is the combination of the DMT with an add-on seismic module for the measurement of shear wave velocity ( $V_s$ ). Using established correlations, the SDMT results can also be used to assess the small strain modulus ( $G_0$ ).

**Portable Dynamic Cone Penetrometers:** Portable Dynamic Cone Penetrometer (DCP) tests are carried out by driving a 16mm diameter rod with a 20mm diameter cone end with a 9kg hammer dropping 510mm. The test is described in Australian Standard 1289.6.3.2–1997 (R2013) *'Methods of Testing Soils for Engineering Purposes, Soil Strength and Consolidation Tests – Determination of the Penetration Resistance of a Soil – 9kg Dynamic Cone Penetrometer Test'*.

The results are used to assess the relative compaction of fill, the relative density of granular soils, and the strength of cohesive soils. Using established correlations, the DCP test results can also be used to assess California Bearing Ratio (CBR).

Refusal of the DCP can occur on a variety of materials such as obstructions within any fill, tree roots, hard clay, gravel or ironstone, cobbles and boulders, and does not necessarily indicate rock level.



**Vane Shear Test:** The vane shear test is used to measure the undrained shear strength ( $C_u$ ) of typically very soft to firm fine grained cohesive soils. The vane shear is normally performed in the bottom of a borehole, but can be completed from surface level, the bottom and sides of test pits, and on recovered undisturbed tube samples (when using a hand vane).

The vane comprises four rectangular blades arranged in the form of a cross on the end of a thin rod, which is coupled to the bottom of a drill rod string when used in a borehole. The size of the vane is dependent on the strength of the fine grained cohesive soils; that is, larger vanes are normally used for very low strength soils. For borehole testing, the size of the vane can be limited by the size of the casing that is used.

For testing inside a borehole, a device is used at the top of the casing, which suspends the vane and rods so that they do not sink under self-weight into the 'soft' soils beyond the depth at which the test is to be carried out. A calibrated torque head is used to rotate the rods and vane and to measure the resistance of the vane to rotation.

With the vane in position, torque is applied to cause rotation of the vane at a constant rate. A rate of  $6^\circ$  per minute is the common rotation rate. Rotation is continued until the soil is sheared and the maximum torque has been recorded. This value is then used to calculate the undrained shear strength. The vane is then rotated rapidly a number of times and the operation repeated until a constant torque reading is obtained. This torque value is used to calculate the remoulded shear strength. Where appropriate, friction on the vane rods is measured and taken into account in the shear strength calculation.

## LOGS

The borehole or test pit logs presented herein are an engineering and/or geological interpretation of the subsurface conditions, and their reliability will depend to some extent on the frequency of sampling and the method of drilling or excavation. Ideally, continuous undisturbed sampling or core drilling will enable the most reliable assessment, but is not always practicable or possible to justify on economic grounds. In any case, the boreholes or test pits represent only a very small sample of the total subsurface conditions.

The terms and symbols used in preparation of the logs are defined in the following pages.

Interpretation of the information shown on the logs, and its application to design and construction, should therefore take into account the spacing of boreholes or test pits, the method of drilling or excavation, the frequency of sampling and testing and the possibility of other than 'straight line' variations between the boreholes or test pits. Subsurface conditions between boreholes or test pits may vary significantly from conditions encountered at the borehole or test pit locations.

## GROUNDWATER

Where groundwater levels are measured in boreholes, there are several potential problems:

- Although groundwater may be present, in low permeability soils it may enter the hole slowly or perhaps not at all during the time it is left open.
- A localised perched water table may lead to an erroneous indication of the true water table.
- Water table levels will vary from time to time with seasons or recent weather changes and may not be the same at the time of construction.
- The use of water or mud as a drilling fluid will mask any groundwater inflow. Water has to be blown out of the hole and drilling mud must be washed out of the hole or 'reverted' chemically if reliable water observations are to be made.

More reliable measurements can be made by installing standpipes which are read after the groundwater level has stabilised at intervals ranging from several days to perhaps weeks for low permeability soils. Piezometers, sealed in a particular stratum, may be advisable in low permeability soils or where there may be interference from perched water tables or surface water.

## FILL

The presence of fill materials can often be determined only by the inclusion of foreign objects (eg. bricks, steel, etc) or by distinctly unusual colour, texture or fabric. Identification of the extent of fill materials will also depend on investigation methods and frequency. Where natural soils similar to those at the site are used for fill, it may be difficult with limited testing and sampling to reliably assess the extent of the fill.

The presence of fill materials is usually regarded with caution as the possible variation in density, strength and material type is much greater than with natural soil deposits. Consequently, there is an increased risk of adverse engineering characteristics or behaviour. If the volume and quality of fill is of importance to a project, then frequent test pit excavations are preferable to boreholes.

## LABORATORY TESTING

Laboratory testing is normally carried out in accordance with Australian Standard 1289 *'Methods of Testing Soils for Engineering Purposes'* or appropriate NSW Government Roads & Maritime Services (RMS) test methods. Details of the test procedure used are given on the individual report forms.

## ENGINEERING REPORTS

Engineering reports are prepared by qualified personnel and are based on the information obtained and on current engineering standards of interpretation and analysis. Where the report has been prepared for a specific design proposal (eg. a three storey building) the information and interpretation may not be relevant if the design proposal is changed (eg. to a twenty storey building). If this happens, the Company will be pleased to review the report and the sufficiency of the investigation work.

Reasonable care is taken with the report as it relates to interpretation of subsurface conditions, discussion of geotechnical aspects and recommendations or suggestions for design and construction. However, the Company cannot always anticipate or assume responsibility for:

- Unexpected variations in ground conditions – the potential for this will be partially dependent on borehole spacing and sampling frequency as well as investigation technique.
- Changes in policy or interpretation of policy by statutory authorities.
- The actions of persons or contractors responding to commercial pressures.
- Details of the development that the Company could not reasonably be expected to anticipate.

If these occur, the Company will be pleased to assist with investigation or advice to resolve any problems occurring.

#### **SITE ANOMALIES**

In the event that conditions encountered on site during construction appear to vary from those which were expected from the information contained in the report, the Company requests that it immediately be notified. Most problems are much more readily resolved when conditions are exposed rather than at some later stage, well after the event.

#### **REPRODUCTION OF INFORMATION FOR CONTRACTUAL PURPOSES**

Where information obtained from this investigation is provided for tendering purposes, it is recommended that all information, including the written report and discussion, be made available. In circumstances where the discussion or comments section is not relevant to the contractual situation, it may be appropriate to prepare a specially edited document. The Company would

be pleased to assist in this regard and/or to make additional report copies available for contract purposes at a nominal charge.

Copyright in all documents (such as drawings, borehole or test pit logs, reports and specifications) provided by the Company shall remain the property of Jeffery and Katauskas Pty Ltd. Subject to the payment of all fees due, the Client alone shall have a licence to use the documents provided for the sole purpose of completing the project to which they relate. Licence to use the documents may be revoked without notice if the Client is in breach of any obligation to make a payment to us.

#### **REVIEW OF DESIGN**

Where major civil or structural developments are proposed or where only a limited investigation has been completed or where the geotechnical conditions/constraints are quite complex, it is prudent to have a joint design review which involves an experienced geotechnical engineer/engineering geologist.

#### **SITE INSPECTION**

The Company will always be pleased to provide engineering inspection services for geotechnical aspects of work to which this report is related.

Requirements could range from:

- i) a site visit to confirm that conditions exposed are no worse than those interpreted, to
- ii) a visit to assist the contractor or other site personnel in identifying various soil/rock types and appropriate footing or pile founding depths, or
- iii) full time engineering presence on site.

## SYMBOL LEGENDS

### SOIL



FILL



TOPSOIL



CLAY (CL, CI, CH)



SILT (ML, MH)



SAND (SP, SW)



GRAVEL (GP, GW)



SANDY CLAY (CL, CI, CH)



SILTY CLAY (CL, CI, CH)



CLAYEY SAND (SC)



SILTY SAND (SM)



GRAVELLY CLAY (CL, CI, CH)



CLAYEY GRAVEL (GC)



SANDY SILT (ML, MH)



PEAT AND HIGHLY ORGANIC SOILS (Pt)

### ROCK



CONGLOMERATE



SANDSTONE



SHALE/MUDSTONE



SILTSTONE



CLAYSTONE



COAL



LAMINITE



LIMESTONE



PHYLLITE, SCHIST



TUFF



GRANITE, GABBRO



DOLERITE, DIORITE



BASALT, ANDESITE



QUARTZITE

### OTHER MATERIALS



BRICKS OR PAVERS



CONCRETE



ASPHALTIC CONCRETE

## CLASSIFICATION OF COARSE AND FINE GRAINED SOILS

Major Divisions		Group Symbol	Typical Names	Field Classification of Sand and Gravel	Laboratory Classification	
Coarse grained soil (more than 65% of soil excluding oversize fraction is greater than 0.075mm)	GRAVEL (more than half of coarse fraction is larger than 2.36mm)	GW	Gravel and gravel-sand mixtures, little or no fines	Wide range in grain size and substantial amounts of all intermediate sizes, not enough fines to bind coarse grains, no dry strength	≤ 5% fines	$C_u > 4$ $1 < C_c < 3$
		GP	Gravel and gravel-sand mixtures, little or no fines, uniform gravels	Predominantly one size or range of sizes with some intermediate sizes missing, not enough fines to bind coarse grains, no dry strength	≤ 5% fines	Fails to comply with above
		GM	Gravel-silt mixtures and gravel-sand-silt mixtures	'Dirty' materials with excess of non-plastic fines, zero to medium dry strength	≥ 12% fines, fines are silty	Fines behave as silt
		GC	Gravel-clay mixtures and gravel-sand-clay mixtures	'Dirty' materials with excess of plastic fines, medium to high dry strength	≥ 12% fines, fines are clayey	Fines behave as clay
	SAND (more than half of coarse fraction is smaller than 2.36mm)	SW	Sand and gravel-sand mixtures, little or no fines	Wide range in grain size and substantial amounts of all intermediate sizes, not enough fines to bind coarse grains, no dry strength	≤ 5% fines	$C_u > 6$ $1 < C_c < 3$
		SP	Sand and gravel-sand mixtures, little or no fines	Predominantly one size or range of sizes with some intermediate sizes missing, not enough fines to bind coarse grains, no dry strength	≤ 5% fines	Fails to comply with above
		SM	Sand-silt mixtures	'Dirty' materials with excess of non-plastic fines, zero to medium dry strength	≥ 12% fines, fines are silty	N/A
		SC	Sand-clay mixtures	'Dirty' materials with excess of plastic fines, medium to high dry strength	≥ 12% fines, fines are clayey	

### Laboratory Classification Criteria

A well graded coarse grained soil is one for which the coefficient of uniformity  $C_u > 4$  and the coefficient of curvature  $1 < C_c < 3$ . Otherwise, the soil is poorly graded. These coefficients are given by:

$$C_u = \frac{D_{60}}{D_{10}} \quad \text{and} \quad C_c = \frac{(D_{30})^2}{D_{10} D_{60}}$$


Where  $D_{10}$ ,  $D_{30}$  and  $D_{60}$  are those grain sizes for which 10%, 30% and 60% of the soil grains, respectively, are smaller.

### NOTES:

- For a coarse grained soil with a fines content between 5% and 12%, the soil is given a dual classification comprising the two group symbols separated by a dash; for example, for a poorly graded gravel with between 5% and 12% silt fines, the classification is GP-GM.
- Where the grading is determined from laboratory tests, it is defined by coefficients of curvature ( $C_c$ ) and uniformity ( $C_u$ ) derived from the particle size distribution curve.
- Clay soils with liquid limits  $> 35\%$  and  $\leq 50\%$  may be classified as being of medium plasticity.
- The U line on the Modified Casagrande Chart is an approximate upper bound for most natural soils.

Major Divisions		Group Symbol	Typical Names	Field Classification of Silt and Clay			Laboratory Classification
				Dry Strength	Dilatancy	Toughness	% < 0.075mm
ine grained soils (more than 35% of soil excluding oversize fraction is less than 0.075mm)	SILT and CLAY (low to medium plasticity)	ML	Inorganic silt and very fine sand, rock flour, silty or clayey fine sand or silt with low plasticity	None to low	Slow to rapid	Low	Below A line
		CL, CI	Inorganic clay of low to medium plasticity, gravelly clay, sandy clay	Medium to high	None to slow	Medium	Above A line
		OL	Organic silt	Low to medium	Slow	Low	Below A line
	SILT and CLAY (high plasticity)	MH	Inorganic silt	Low to medium	None to slow	Low to medium	Below A line
		CH	Inorganic clay of high plasticity	High to very high	None	High	Above A line
		OH	Organic clay of medium to high plasticity, organic silt	Medium to high	None to very slow	Low to medium	Below A line
	Highly organic soil	Pt	Peat, highly organic soil	–	–	–	–

### Modified Casagrande Chart for Classifying Silts and Clays according to their Behaviour

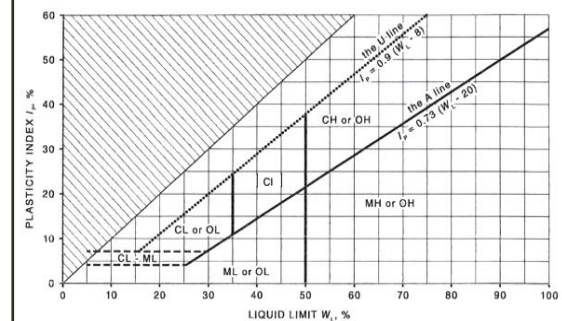

## LOG SYMBOLS

Log Column	Symbol	Definition
Groundwater Record	▼	Standing water level. Time delay following completion of drilling/excavation may be shown.
	C	Extent of borehole/test pit collapse shortly after drilling/excavation.
	▶	Groundwater seepage into borehole or test pit noted during drilling or excavation.
Samples	ES	Sample taken over depth indicated, for environmental analysis.
	U50	Undisturbed 50mm diameter tube sample taken over depth indicated.
	DB	Bulk disturbed sample taken over depth indicated.
	DS	Small disturbed bag sample taken over depth indicated.
	ASB	Soil sample taken over depth indicated, for asbestos analysis.
	ASS	Soil sample taken over depth indicated, for acid sulfate soil analysis.
	SAL	Soil sample taken over depth indicated, for salinity analysis.
Field Tests	N = 17 4, 7, 10	Standard Penetration Test (SPT) performed between depths indicated by lines. Individual figures show blows per 150mm penetration. 'Refusal' refers to apparent hammer refusal within the corresponding 150mm depth increment.
	N <sub>c</sub> = 5 7 3R	Solid Cone Penetration Test (SCPT) performed between depths indicated by lines. Individual figures show blows per 150mm penetration for 60° solid cone driven by SPT hammer. 'R' refers to apparent hammer refusal within the corresponding 150mm depth increment.
	VNS = 25	Vane shear reading in kPa of undrained shear strength.
	PID = 100	Photoionisation detector reading in ppm (soil sample headspace test).
Moisture Condition (Fine Grained Soils)  (Coarse Grained Soils)	w > PL	Moisture content estimated to be greater than plastic limit.
	w ≈ PL	Moisture content estimated to be approximately equal to plastic limit.
	w < PL	Moisture content estimated to be less than plastic limit.
	w ≈ LL	Moisture content estimated to be near liquid limit.
	w > LL	Moisture content estimated to be wet of liquid limit.
	D	DRY – runs freely through fingers.
	M	MOIST – does not run freely but no free water visible on soil surface.
	W	WET – free water visible on soil surface.
Strength (Consistency) Cohesive Soils	VS	VERY SOFT – unconfined compressive strength ≤ 25kPa.
	S	SOFT – unconfined compressive strength > 25kPa and ≤ 50kPa.
	F	FIRM – unconfined compressive strength > 50kPa and ≤ 100kPa.
	St	STIFF – unconfined compressive strength > 100kPa and ≤ 200kPa.
	VSt	VERY STIFF – unconfined compressive strength > 200kPa and ≤ 400kPa.
	Hd	HARD – unconfined compressive strength > 400kPa.
	Fr	FRIABLE – strength not attainable, soil crumbles.
	( )	Bracketed symbol indicates estimated consistency based on tactile examination or other assessment.
Density Index/ Relative Density (Cohesionless Soils)	VL	VERY LOOSE
	L	LOOSE
	MD	MEDIUM DENSE
	D	DENSE
	VD	VERY DENSE
	( )	Bracketed symbol indicates estimated density based on ease of drilling or other assessment.
Hand Penetrometer Readings	300	Measures reading in kPa of unconfined compressive strength. Numbers indicate individual test results on representative undisturbed material unless noted otherwise.
	250	



Log Column	Symbol	Definition
Remarks	'V' bit 'TC' bit $T_{60}$ Soil Origin	Hardened steel 'V' shaped bit. Twin pronged tungsten carbide bit. Penetration of auger string in mm under static load of rig applied by drill head hydraulics without rotation of augers. The geological origin of the soil can generally be described as: RESIDUAL – soil formed directly from insitu weathering of the underlying rock. No visible structure or fabric of the parent rock. EXTREMELY WEATHERED – soil formed directly from insitu weathering of the underlying rock. Material is of soil strength but retains the structure and/or fabric of the parent rock. ALLUVIAL – soil deposited by creeks and rivers. ESTUARINE – soil deposited in coastal estuaries, including sediments caused by inflowing creeks and rivers, and tidal currents. MARINE – soil deposited in a marine environment. AEOLIAN – soil carried and deposited by wind. COLLUVIAL – soil and rock debris transported downslope by gravity, with or without the assistance of flowing water. Colluvium is usually a thick deposit formed from a landslide. The description 'slopewash' is used for thinner surficial deposits. LITTORAL – beach deposited soil.

## Classification of Material Weathering

Term		Abbreviation		Definition
Residual Soil		RS		Material is weathered to such an extent that it has soil properties. Mass structure and material texture and fabric of original rock are no longer visible, but the soil has not been significantly transported.
Extremely Weathered		XW		Material is weathered to such an extent that it has soil properties. Mass structure and material texture and fabric of original rock are still visible.
Highly Weathered	Distinctly Weathered (Note 1)	HW	DW	The whole of the rock material is discoloured, usually by iron staining or bleaching to the extent that the colour of the original rock is not recognisable. Rock strength is significantly changed by weathering. Some primary minerals have weathered to clay minerals. Porosity may be increased by leaching, or may be decreased due to deposition of weathering products in pores.
Moderately Weathered		MW		The whole of the rock material is discoloured, usually by iron staining or bleaching to the extent that the colour of the original rock is not recognisable, but shows little or no change of strength from fresh rock.
Slightly Weathered		SW		Rock is partially discoloured with staining or bleaching along joints but shows little or no change of strength from fresh rock.
Fresh		FR		Rock shows no sign of decomposition of individual minerals or colour changes.

**NOTE 1:** The term 'Distinctly Weathered' is used where it is not practicable to distinguish between 'Highly Weathered' and 'Moderately Weathered' rock. 'Distinctly Weathered' is defined as follows: 'Rock strength usually changed by weathering. The rock may be highly discoloured, usually by iron staining. Porosity may be increased by leaching, or may be decreased due to deposition of weathering products in pores'. There is some change in rock strength.

## Rock Material Strength Classification

Term	Abbreviation	Uniaxial Compressive Strength (MPa)	Guide to Strength	
			Point Load Strength Index $Is_{(50)}$ (MPa)	Field Assessment
Very Low Strength	VL	0.6 to 2	0.03 to 0.1	Material crumbles under firm blows with sharp end of pick; can be peeled with knife; too hard to cut a triaxial sample by hand. Pieces up to 30mm thick can be broken by finger pressure.
Low Strength	L	2 to 6	0.1 to 0.3	Easily scored with a knife; indentations 1mm to 3mm show in the specimen with firm blows of the pick point; has dull sound under hammer. A piece of core 150mm long by 50mm diameter may be broken by hand. Sharp edges of core may be friable and break during handling.
Medium Strength	M	6 to 20	0.3 to 1	Scored with a knife; a piece of core 150mm long by 50mm diameter can be broken by hand with difficulty.
High Strength	H	20 to 60	1 to 3	A piece of core 150mm long by 50mm diameter cannot be broken by hand but can be broken by a pick with a single firm blow; rock rings under hammer.
Very High Strength	VH	60 to 200	3 to 10	Hand specimen breaks with pick after more than one blow; rock rings under hammer.
Extremely High Strength	EH	> 200	> 10	Specimen requires many blows with geological pick to break through intact material; rock rings under hammer.

## Abbreviations Used in Defect Description

Cored Borehole Log Column	Symbol Abbreviation	Description
Point Load Strength Index	• 0.6	Axial point load strength index test result (MPa)
	x 0.6	Diametral point load strength index test result (MPa)
Defect Details – Type	Be	Parting – bedding or cleavage
	CS	Clay seam
	Cr	Crushed/sheared seam or zone
	J	Joint
	Jh	Healed joint
	Ji	Incipient joint
	XWS	Extremely weathered seam
	Degrees	Defect orientation is measured relative to normal to the core axis (ie. relative to the horizontal for a vertical borehole)
	P	Planar
	C	Curved
	Un	Undulating
	St	Stepped
	Ir	Irregular
	Vr	Very rough
	R	Rough
	S	Smooth
	Po	Polished
	Sl	Slickensided
	Ca	Calcite
	Cb	Carbonaceous
	Clay	Clay
	Fe	Iron
	Qz	Quartz
	Py	Pyrite
	Cn	Clean
	Sn	Stained – no visible coating, surface is discoloured
	Vn	Veneer – visible, too thin to measure, may be patchy
	Ct	Coating ≤ 1mm thick
	Filled	Coating > 1mm thick
	mm.t	Defect thickness measured in millimetres