




Reference number 4879

Member of the Fire Protection Association of Australia

Lot 13, DP 27432, 9 Willow Way, Forestville, NSW 2087.

Monday, 25 November 2024

Prepared by:	Matthew Willis <i>BPAD – Level 3 Certified Practitioner</i> Certification No: BPD-PA 09337		25/11/2024
Can this proposal comply with AS3959-2018 (inc section 7.5, 7.5.1, 7.5.2, 7.5.3, 7.5.4 (where applicable) of the Rural Fire Services document Planning for Bushfire Protection 2019)?	Yes		
What is the recommended AS 3959-2018 level of compliance?	BAL-19		
Can this development comply with the requirements of PBP?	Yes		
Plans by "Bungalow Homes" (Appendix 1) dated.	5/8/24		

© This document is copyright. It is a breach of copyright for this document to be used to support a development application or any other purpose for any persons/entities other than those for whom this document was prepared. Other than for the purpose for which this document has been prepared and subject to conditions prescribed under the Copyright Act no part of this document may in any form nor by any means be reproduced or stored in a retrieval system or transmitted without the prior written permission of the company (Bushfire Planning Services Pty Ltd ACN 115 714 826).



Bushfire Planning Services

15 Parkcrest Place

Kenthurst NSW 2156

02 96543228

0428408577

mattw@bushfireconsultants.com.au

Bushfire Risk Assessment

Monday, 25 November 2024

Contact

Anita Gleeson
Bungalow Homes
Po Box 215
Collaroy NSW 2097
9145 9032

Subject Property

Lot 13, DP 27432
9 Willow Way
Forestville NSW 2087

Document tracking.

Date	Reason for change	Author

BUSHFIRE RISK ASSESSMENT CERTIFICATE

THIS FORM IS TO BE COMPLETED BY A RECOGNISED CONSULTANT IN BUSHFIRE RISK ASSESSMENT IN ACCORDANCE WITH SECTION 4.14 OF THE ENVIRONMENTAL PLANNING AND ASSESSMENT ACT.

Property Address	Lot 13, DP 27432, number 9 Willow Way Forestville
Description of the Proposal	Construction of a detached secondary dwelling
Plan Reference	5/8/24
BAL Rating	BAL-19

I, Matthew Willis of Bushfire Planning Services Pty Ltd have carried out a bushfire risk assessment on the above-mentioned proposal and property. A detailed Bushfire Assessment Report is attached which includes the submission requirements set out in Planning for Bushfire Protection 2019 together with recommendations as to how the relevant Specifications and requirements are to be achieved.

I hereby advise, in accordance with Section 4.14 of the Environmental Planning and Assessment Act 1979 No 203:

1. That I am a person recognised by the NSW Rural Fire Service as a qualified consultant in bushfire risk assessment; and

2. That subject to the recommendations contained in the attached Bushfire Risk Assessment Report the proposed development conforms to the relevant specifications and requirements*

*The relevant specifications and requirements being specifications and requirements of the document entitled Planning for Bush Fire Protection prepared by the NSW Rural Fire Service in co-operation with the Department of Planning and any other document as prescribed by Section 4.14 of the Environmental Planning and Assessment Act 1979 No 203.

I am aware that the Bushfire Assessment Report, prepared for the above-mentioned site is to be submitted in support of a development application for this site and will be relied upon by Northern Beaches Council as the basis for ensuring that the bushfire risk management aspects of the proposed development have been addressed in accordance with Planning for Bushfire Protection 2019.

REPORT REFERENCE	<i>Monday, 25 November 2024</i>
REPORT DATE	<i>Monday, 25 November 2024</i>
CERTIFICATION NO/ACCREDITED SCHEME	<i>FPA A BPAD A BPD-PA 09337</i>

Attachments:

- Bushfire Risk Assessment Report
- Recommendations

SIGNATURE: ---



DATE: -----Monday, 25 November 2024

Contents.

1	Executive Summary.	5
2	General.	6
3	Block Description.	6
4	Vegetation.	8
5	Known constraints on subject block.	10
6	Slope.	10
7	Utilities.	11
7.1	Water.	11
7.2	Electricity	11
7.3	Gas	11
8	Access/Egress.	11
9	Compliance with Planning for Bushfire Protection setbacks.	12
10	Siting.	14
11	Construction and design.	14
12	Utilities.	14
12.1	Water.	14
12.2	Electricity and Gas.	14
13	Asset Protection Zone (APZ).	15
14	Landscaping.	15
15	Constraints on the subject block.	16
16	Access/Egress.	16
17	Compliance or non compliance with the specifications and requirements for bushfire protection measures.	16
18	Conclusions.	17
19	References.	19
20	Appendix 1 - Plans .	20

1 Executive Summary.

Bushfire Planning Services has been requested by Anita Gleeson from Bungalow Homes to supply a bushfire compliance report on lot 13, DP 27432, 9 Willow Way, Forestville.

The works proposed for the subject lot are for the construction of a detached secondary dwelling, see attached plans for details.

The subject lot is on the southern side of Willow Way and at its closest point to the hazard the proposed new work has a separation distance to the north-east of approximately 26.62m.

The vegetation that is considered to be the hazard to this proposal is situated on land that slopes down slope away from the property at an angle of approximately 6.68°.

For the purposes of this assessment this vegetation is considered to be Forest.

The remaining vegetation within the study area is contained within the boundaries of established allotments and is managed land and of low threat to this proposal.

The calculations and assumptions outlined in this report show that the development will be required to comply with the construction requirements of AS 3959-2018 BAL-19 and any additional construction requirements contained within section 7.5, 7.5.1, 7.5.2, 7.5.3, 7.5.4 (where applicable) of the Rural Fire Services document Planning for Bushfire Protection 2019.

The following table is a summary of the pertinent findings of this assessment.

Aspect	North	East	South	West
Vegetation type	Managed land	Managed land/forest	Managed land	Managed land
Slope	N/A	5-10 degrees downslope	N/A	N/A
Setback within lot 13	N/A	N/A	N/A	N/A
Setback outside lot 13	N/A	26.62m	N/A	N/A
Total setback	N/A	26.62m	N/A	N/A
Bal level	N/A	BAL-19 ¹	N/A	N/A

Note: The above table is a summary of the significant variables used to determine the highest BAL for this proposal. THIS TABLE IS NOT INTENDED FOR CONSTRUCTION! Only the highest BAL level is shown, aspects marked as N/A will still have a BAL. Refer to section 11 for construction requirements for these other aspects.

¹ Per method 2 calculations.

2 General.

This proposal relates to the construction of a detached secondary dwelling on the subject lot and its ability to comply with the rules and regulations for building in a bushfire prone area.

The methodology used on this report is based on Planning for Bushfire Protection 2019 (PBP) as published by the New South Wales Rural Fire Service.

Any wording that appears in *blue italics* is quotes from Planning for Bushfire Protection 2019. Some of the measurements used in this report have been taken from aerial photographs and as such are approximate only.

3 Block Description.


The subject block is situated on the southern side of Willow Way in an established area of Forestville.

The lot currently contains a single-level class 1 dwelling.


The lands surrounding the proposed site on the subject lot to a distance of at least 26.62m contain existing development or land that is otherwise not considered to be a significant bushfire hazard.

- Lot; 13
- DP; 27432.
- LGA; Northern Beaches.
- Area; 759.6m².
- Address; 9 Willow Way, Forestville.

This section has been left blank.

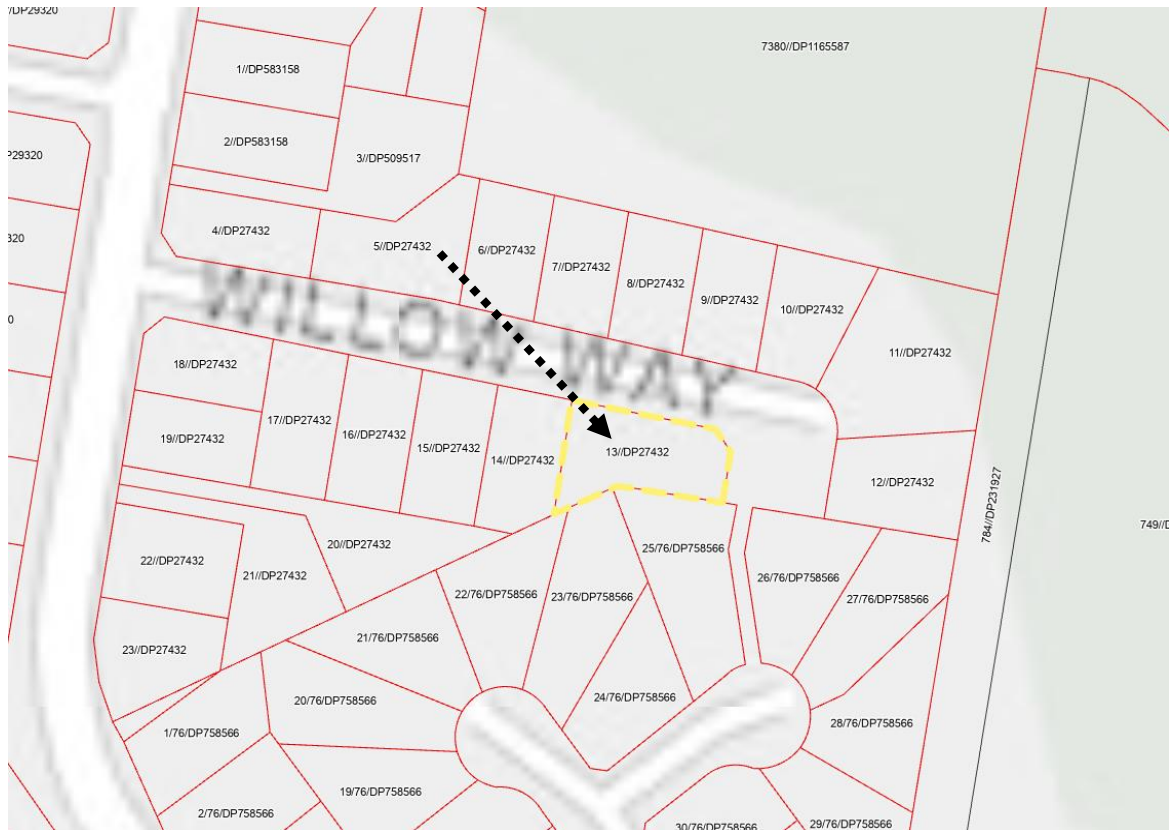

Map 1 shows the cadastral layout around the subject lot.

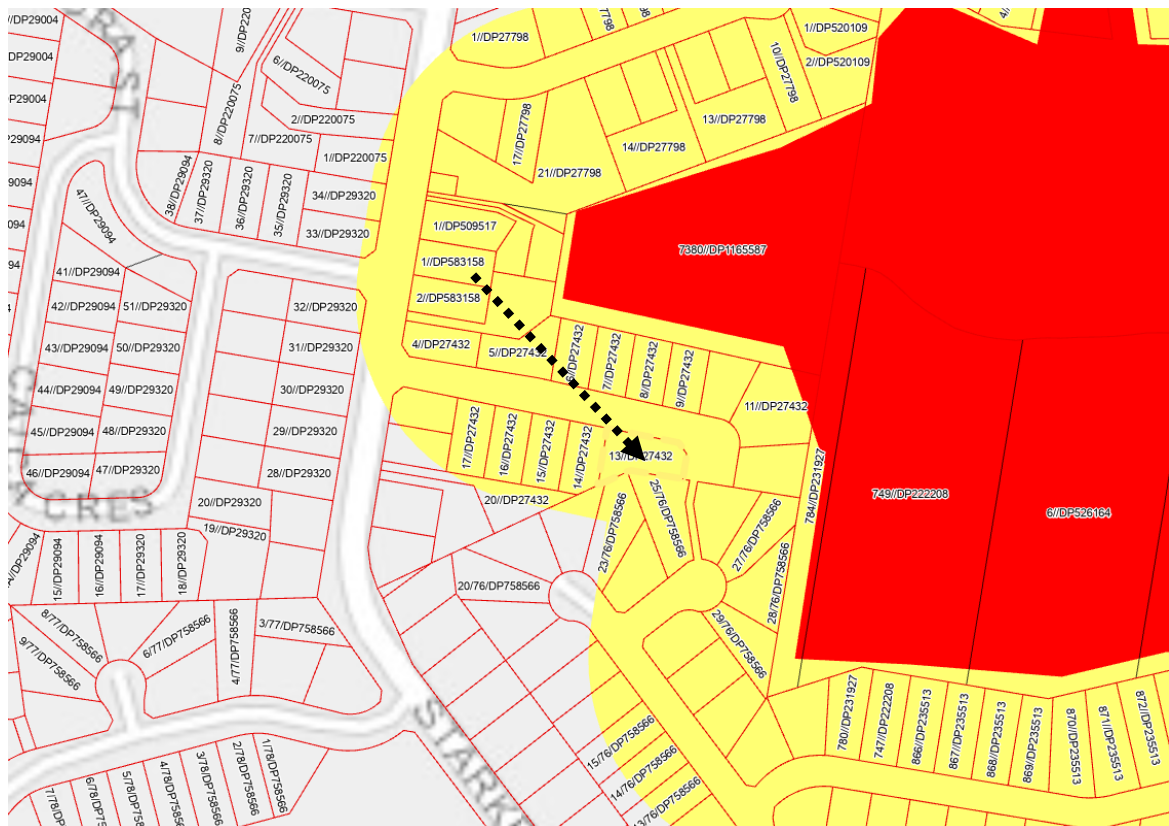

Map 2 is an extract from the councils' bushfire prone land map. The map shows lot 13 to be within the buffer zone of category 1 bushfire vegetation.

4 Vegetation.

The study area for the vegetation is 140m surrounding the subject block.

The vegetation within the study area for this development is considered to be largely managed land.

The major potential hazard to this development is the vegetation within an area of undeveloped land to the north-east.

For the purpose of this assessment and compliance with Planning for Bushfire Protection this area of undeveloped land is considered to be Sydney Coastal Dry Sclerophyll Forest and is the hazard to this proposal.

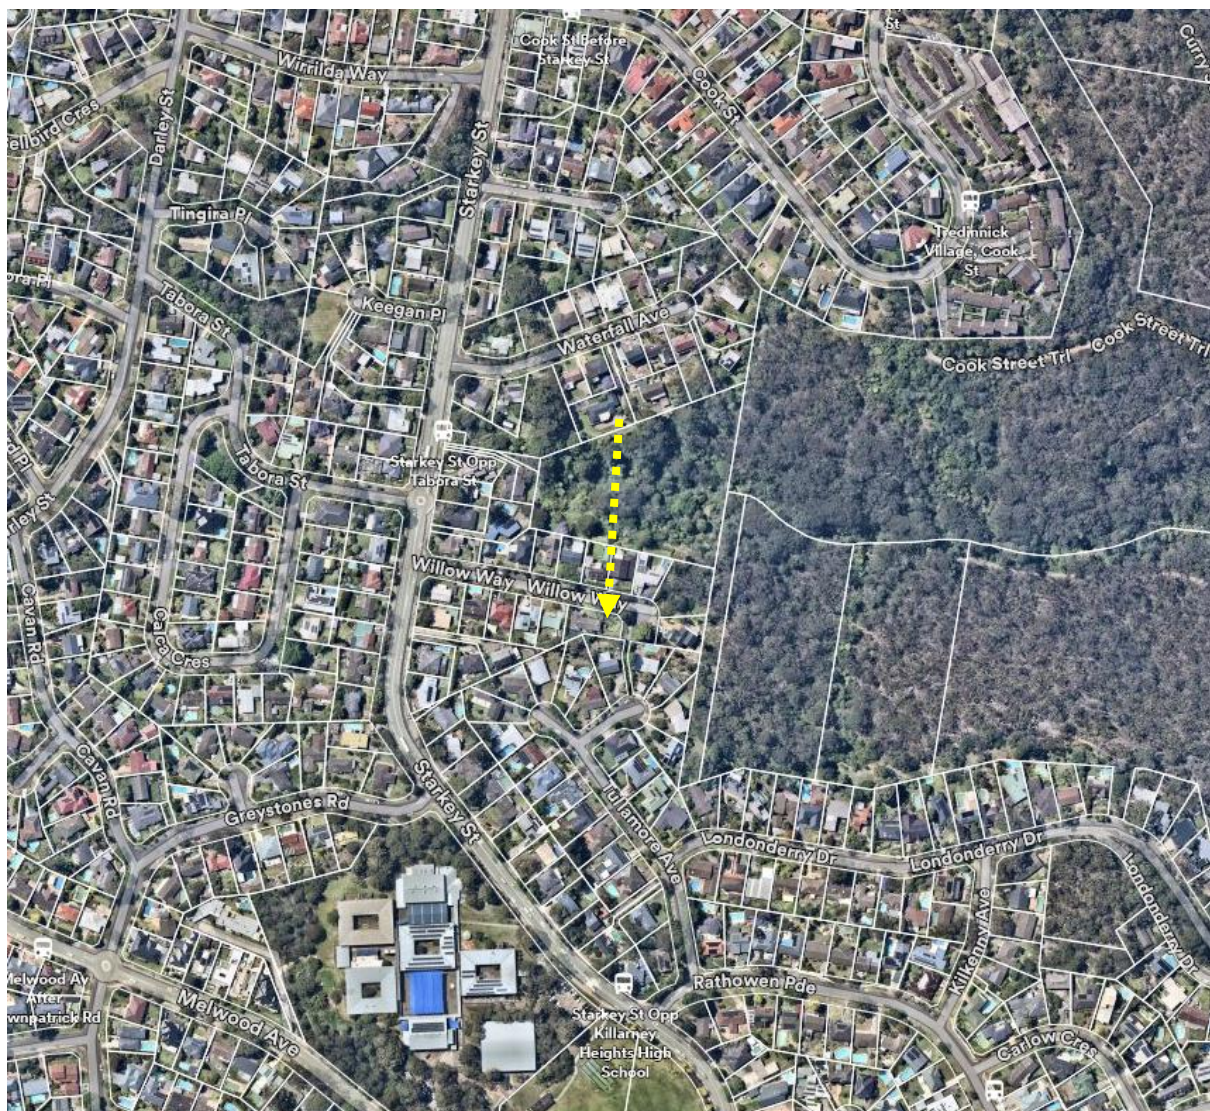


Photo 1 - An overview of the vegetation within the general area.



Photo 2 is a closer view of the vegetation in the area.

Table 1 outlines the vegetation orientation and distance from the development area.

Aspect	North	East	South	West
Vegetation type	Managed land	Managed land/forest	Managed land	Managed land
Setback within lot 13	N/A	N/A	N/A	N/A
Off-site setback	N/A	26.62m	N/A	N/A
Total setback	N/A	26.62m	N/A	N/A

Table 1 - Any aspect marked with "N/A" in the table above indicates that it is considered there is none or only a secondary hazard in that direction.

This area has been left intentionally blank.

5 Known constraints on subject block.

I have not been informed or know of any places of cultural or environmental significance within the boundaries of the subject block. Given the nature of the surrounding land it is considered highly unlikely that anything of significance will be affected by this development.

6 Slope.

The slope of the land beneath the hazard that is most likely to influence bushfire behaviour has been calculated by topographical map analysis to a distance of 100m from the subject lot.

An extract of the topographical map for the area is shown below and the relevant slope analysis is shown in Table 2.



Table 2 shows the slope beneath the hazard.

Aspect	North	East	South	West
Slope	N/A	5-10 degrees downslope	N/A	N/A


Table 2 - Any aspect marked with "N/A" in the table above indicates that it is considered there is no hazard in that direction.

7 Utilities.

7.1 Water.

The subject block will be serviced by a reticulated water supply.

The following map is an extract from Sydney waters hydrant map. Hydrants are indicated by a blue dot on a blue line. As can be seen there is at least one hydrant point indicated within close proximity of the property.

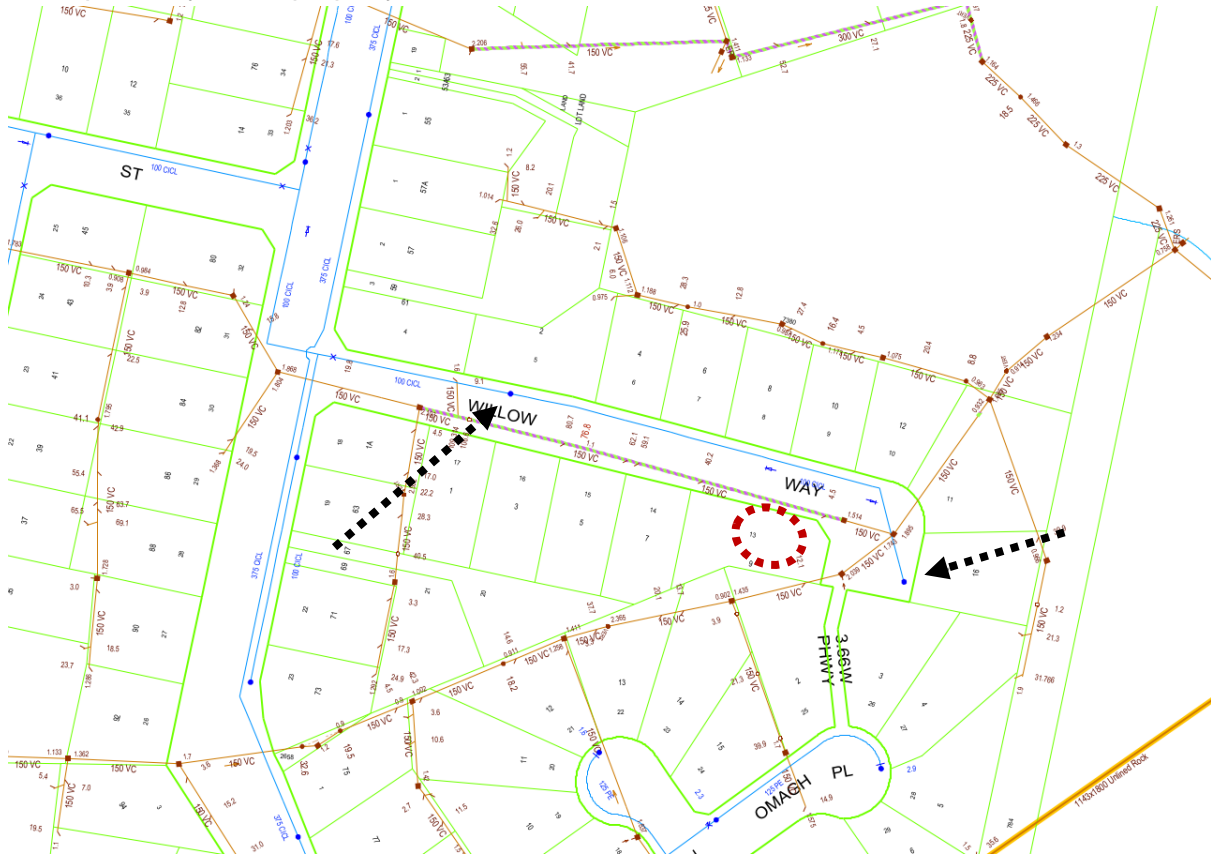

7.2 Electricity

Main's electricity is available to the block.

7.3 Gas

It is unknown if either bottled, or mains gas is to be altered or installed in this proposal.

8 Access/Egress.

Access to the development site will be via a short private driveway from Willow Way.

All roads in the vicinity are considered to be capable of carrying emergency services vehicles and pedestrian access onto the lot is also considered to be adequate.

Analysis of development and recommendation.

9 Compliance with Planning for Bushfire Protection setbacks.

This assessment is a performance based assessment using Method 2 or AS3959.

The variables used in the assessment are as follows.

FDI = 100

Vegetation = Sydney Coastal Dry Sclerophyll Forest

Fuel loads = As per the Comprehensive Fuel Load guide.

Separation distance = 26.62m

Effective slope = 6.68 deg downslope

Site slope = 4.17 deg downslope

Fire head width = 13m

Method 2 of AS3959-2018 is a bushfire risk assessment method that involves a detailed computer modelling and simulation process to determine the Bushfire Attack Level (BAL) of a building or structure.

Method 2 is a more complex and comprehensive method compared to Method 1 (standard assessment process), which is a simpler and more prescriptive method based on a set of standard rules. Method 2 allows for a more tailored and site-specific approach to bushfire risk assessment, considering various site-specific factors such as the type and density of vegetation in the surrounding area, the slope of the land and the distance of the building from the vegetation.

Method 2 involves a detailed assessment of the site-specific factors that can impact the potential bushfire risk to a building. Some of the key variables used in this method include:

1. Vegetation type and density: The type and density of vegetation in the surrounding area can impact the intensity and spread of a bushfire, as well as the likelihood of ember attack.
2. Slope of the land: The slope of the land can impact the speed and intensity of a bushfire, as well as the potential for radiant heat and ember attack.
3. Distance from vegetation: The distance between the building and the surrounding vegetation will impact the potential for radiant heat and ember attack.
4. Terrain features: Other terrain features, such as gullies or ridges, can impact the potential for radiant heat and ember attack.
5. Weather conditions: Weather conditions such as wind speed and direction, temperature, and humidity can impact the behaviour and intensity of a bushfire.

The process of Method 2 involves inputting all of the relevant site-specific factors into a computer model, which then simulates the behaviour of a bushfire in the area and calculates the level of risk to the building based on factors such as ember attack, radiant heat, and direct flame contact.

Overall, Method 2 provides a more accurate and comprehensive approach to bushfire risk assessment compared to Method 1. It allows for a more tailored and site-specific assessment, considering all relevant factors that may impact the potential bushfire risk to a building, and therefore provides a more accurate determination of the BAL and the level of protection required for the building to withstand a bushfire event.

The following table shows the inputs, site specific variables as shown above and results the for the method 2 calculations.

Site Street Address:	9 Willow Way, Forestville		
Assessor:	Matthew Willis; Bushfire Planning Services		
Local Government Area:	Northern Beaches	Alpine Area:	No
Equations Used			
Transmissivity: Fuss and Hammins, 2002			
Flame Length: RFS PBP, 2001/Vesta/Catchpole			
Rate of Fire Spread: Noble et al., 1980			
Radiant Heat: Drysdale, 1985; Sullivan et al., 2003; Tan et al., 2005			
Peak Elevation of Receiver: Tan et al., 2005			
Peak Flame Angle: Tan et al., 2005			
Run Description:	North-east		
<u>Vegetation Information</u>			
Vegetation Type:	Sydney Coastal DSF		
Vegetation Group:	Dry Sclerophyll Forests (Shrubby)		
Vegetation Slope:	6.68 Degrees	Vegetation Slope Type:	Downslope
Surface Fuel Load(t/ha):	21.3	Overall Fuel Load(t/ha):	27.3
Vegetation Height(m):	1.4	Only Applicable to Shrub/Scrub and Vesta	
<u>Site Information</u>			
Site Slope:	4.17 Degrees	Site Slope Type:	Downslope
Elevation of Receiver(m):	Default	APZ/ Separation(m):	26.62
<u>Fire Inputs</u>			
Veg./Flame Width(m):	13	Flame Temp(K):	1090
<u>Calculation Parameters</u>			
Flame Emissivity:	95	Relative Humidity(%):	25
Heat of Combustion(kJ/kg)	18600	Ambient Temp(K):	308
Moisture Factor:	5	FDI:	100
<u>Program Outputs</u>			
Level of Construction:	BAL FZ	Peak Elevation of Receiver(m):	7.61
Radiant Heat(kW/m2):	14.9	Flame Angle (degrees):	40
Flame Length(m):	29.62	Maximum View Factor:	0.232
Rate Of Spread (km/h):	4.05	Inner Protection Area(m):	27
Transmissivity:	0.846	Outer Protection Area(m):	0
Fire Intensity(kW/m):	57162		

As can be seen above the expected radiant heat on the closest part of the proposed new building is 14.9kw/m² making BAL-19 the appropriate construction level for this proposal.

10 Siting.

The current site provides adequate separation between the proposed building and surrounding vegetation for a compliant structure to be built.

Recommendation;

Nil.

11 Construction and design.

All new work is to be undertaken in accordance with the relevant requirements of the NCC and AS3959 2018. The following recommendations are a minimum level of construction. Constructing the proposal to a higher level than that recommended is allowable under AS3959.

Recommendation; all new work.

1. New construction shall comply with the requirements of section 3 of Australian Standard AS3959-2018 "Construction of buildings in bush fire-prone areas" and,
2. New construction shall also comply with the requirements of BAL-19 Australian Standard AS3959-2018 "Construction of buildings in bush fire-prone areas" or NASH Standard "National Standard Steel Framed Construction in Bushfire Areas" and any additional construction requirements contained within section 7.5, 7.5.1, 7.5.2, 7.5.3, 7.5.4 (where applicable) of the Rural Fire Services document Planning for Bushfire Protection 2019.
3. New roofing valleys and guttering should be fitted with a non-combustible leaf protection to stop the accumulation of debris.

AS-3959 2018 is available as PDF from;

https://infostore.saiglobal.com/en-au/standards/as-3959-2018-122340_saig_as_as_2685241/

12 Utilities.

12.1 Water.

The proposed development will have access to a reticulated water supply. There is at least one hydrant indicated within the required distance from the dwelling.

Recommendation;

Nil.

12.2 Electricity and Gas.

Recommendation;

4. Any new electricity or gas connections are to comply with the requirements of table 7.4a of Planning for Bushfire Protection.

13 Asset Protection Zone (APZ).

The Asset Protection Zone is *“An area surrounding a development managed to reduce the bushfire hazard to an acceptable level. The width of an APZ will vary with slope, vegetation and construction level”*.

Recommendation;

5. At the commencement of building works and in perpetuity the entire property shall be managed as an Asset Protection Zone in accordance with the requirements of Planning for Bushfire Protection, the RFS document Standards for Asset Protection Zones and in a manner that does not create a bushfire hazard to the property.

14 Landscaping.

Recommendation;

6. Any new fencing is to be constructed in accordance with section 7.6 of Planning for Bushfire Protection 2019.
7. Any new landscaping to the site is to comply with the principles of Appendix 4 and section 3.7 of Planning for Bush Fire Protection 2019. In this regard the following landscaping principles are, where applicable, to be incorporated into the development²:
 - Suitable impervious areas being provided immediately surrounding the building such as courtyards, paths and driveways;
 - Grassed areas/mowed lawns/ or ground cover plantings being provided in close proximity to the building;
 - Restrict planting in the immediate vicinity of the building which may over time and if not properly maintained come in contact with the building;
 - Maximum tree cover should be less than 30%, and maximum shrub cover less than 20%;
 - Planting should not provide a continuous canopy to the building (i.e. trees or shrubs should be isolated or located in small clusters);
 - When considering landscape species consideration needs to be given to estimated size of the plant at maturity;
 - Avoid species with rough fibrous bark, or which retain/shed bark in long strips or retain dead material in their canopies;
 - Use smooth bark species of trees species which generally do not carry a fire up the bark into the crown;

²Refer to referenced documents for a complete description.

- Avoid planting of deciduous species that may increase fuel at surface/ ground level (i.e. leaf litter);
- Avoid climbing species to walls and pergolas;
- Locate combustible materials such as woodchips/mulch, flammable fuel stores away from the building;
- Locate combustible structures such as garden sheds, pergolas and materials such timber garden furniture way from the building; and
- Use of low flammability vegetation species.

15 Constraints on the subject block.

None known.

Recommendation;

Nil

16 Access/Egress.

All roads in the area are considered to be capable of handling emergency service vehicles. Access from the roadway onto the property is also considered to be adequate for firefighting purposes.

Recommendation

Nil

17 Compliance or non compliance with the specifications and requirements for bushfire protection measures.

<p>APZ</p> <p>A defensible space is provided onsite.</p> <p>An APZ is provided and maintained for the life of the development.</p>	<p>Achievable with the implementation of the recommendations in section 13</p>
<p>SITING AND DESIGN:</p> <p>Buildings are sited and designed to minimise the risk of bush fire attack.</p>	<p>Achievable with the implementation of the recommendations in section 10</p>
<p>CONSTRUCTION STANDARDS:</p> <p>It is demonstrated that the proposed building can withstand bush fire attack in the form of wind, smoke, embers, radiant heat and flame contact.</p>	<p>Achievable with the implementation of the recommendations in section 11</p>

ACCESS Safe, operational access is provided (and maintained) for emergency services personnel in suppressing a bush fire while residents are seeking to relocate, in advance of a bush fire, (satisfying the intent and performance criteria for access roads in sections 4.1.3 and 4.2.7).	Achievable with the implementation of the recommendations in section 16
WATER AND UTILITY SERVICES: <ul style="list-style-type: none"> adequate water and electricity services are provided for firefighting operations Gas and electricity services are located so as not to contribute to the risk of fire to a building. 	Achievable with the implementation of the recommendations in section 12
LANDSCAPING: <ul style="list-style-type: none"> it is designed and managed to minimise flame contact and radiant heat to buildings, and the potential for wind driven embers to cause Ignitions. 	Achievable with the implementation of the recommendations in section 14

18 Conclusions.

Based on the above report and with the implementation of the recommendation contained within this report the consent authority should determine that this development can comply with the requirements of AS 3959-2018 and 'Planning for Bushfire Protection' guidelines.

The recommendations contained within this report are to be implemented in their entirety. Changing one aspect may have an adverse effect on the rest of the recommendations.

Bushfires are affected by many external influences such as climactic conditions, vegetation type, moisture content of the fuel, slope of the land and human intervention to name a few and are difficult to predict.

This report does not intend to provide a guarantee that the subject property will survive if a bushfire should impact the surrounding area. The purpose of this report is to show the developments level of compliance or in some cases non-compliance with the New South Wales legislation regarding building in bushfire prone areas.

Where non-compliance is found measures will be suggested that should make the building less susceptible to the various attack mechanisms of a bushfire and comply with the performance requirements of the Building Code of Australia.

The opinions expressed in this report are based on the writers' experience and interpretation of the relevant guidelines and standards. Notwithstanding the above, these guidelines and standards are open to interpretation. All care has been taken to ensure that the opinions expressed in this report are consistent with past successful outcomes.

Some of the information used in the compilation of this assessment has been provided by the proponent or the proponent's representatives. While we believe this information to be true and have accepted the information in good faith however this company or its

representatives will not accept any responsibility if the provided information is determined to be incorrect.

This document is to assist the consenting authorities with their assessment of this proposal. The recommendations contained in this assessment reflect the normal conditions that are typically applied by the consent authority for a proposal such as this however the conditions of consent for the proposal will be supplied by the certifying authority on approval of the development and may not necessarily be the same as the recommendations of this assessment.

The recommendations in this assessment are for planning guidance only, construction details and compliance with all building requirements are the responsibility of the Architect/Designer, Builder and Certifier.

To avoid confusion, unless specifically referenced by the consenting authority, it is strongly recommended that once this proposal has been approved that this document is no longer referenced and that only the official conditions of consent as reflected in documentation by the certifying body are used for construction guidance.

If any further clarification is required for this report, please do not hesitate to contact me using the details above.

Yours Sincerely






Matthew Willis

*Grad Dip Planning for Bushfire Prone Areas
Bushfire Planning Services Pty Limited*


19 References.

- *Australian Building Codes Board (2019). National Construction Code Volume One - Building Code of Australia. ABCB*
- *Australian Building Codes Board (2019). National Construction Code Volume two - Building Code of Australia. ABCB.*
- *Keith, D.A. (2004). Ocean Shores to Desert Dunes: The Native Vegetation of New South Wales and the ACT. NSW Department of Environment and Conservation.*
- *National Association of Steel Framed Housing (2014). "Steel Framed Construction in Bush Fire Areas. NASH*
- *Ramsay, C and Rudolph, L (2003) "Landscape and Building Design for Bush fire Areas". CSIRO Publishing, Collingwood.*
- *Resources and Energy NSW (2016). ISSC 3 Guide for the Managing Vegetation in the Vicinity of Electrical Assets. NSW Government*
- *Rural Fire Service NSW (2005) "Standards for Asset Protection Zones"*
- *Standards Australia (2018). "AS 3959, Construction of buildings in bush fire prone areas".*
- *Standards Australia (2018). "AS/NZS 1530.8.1 Methods for fire tests on building materials, components and structures - Tests on elements of construction for buildings exposed to simulated bush fire attack - Radiant heat and small flaming sources".*
- *Standards Australia (2018). "AS/NZS 1530.8.2 Methods for fire tests on building materials, components and structures - Tests on elements of construction for buildings exposed to simulated bush fire attack - Large flaming sources".*
- *Standards Australia (2014). "AS/NZS 1596 The storage and handling of LP Gas".*

20 Appendix 1 - Plans .

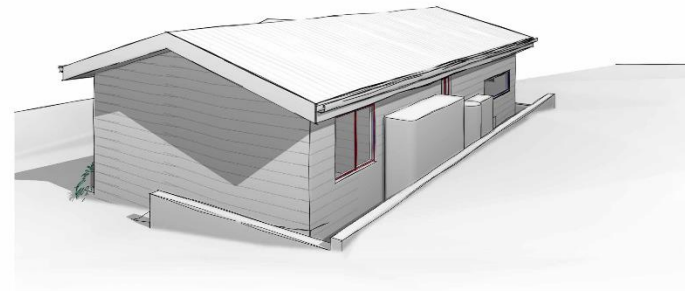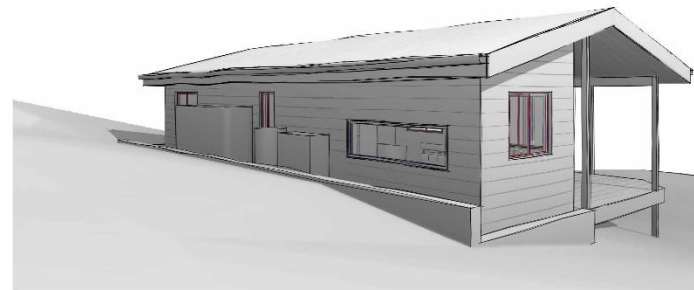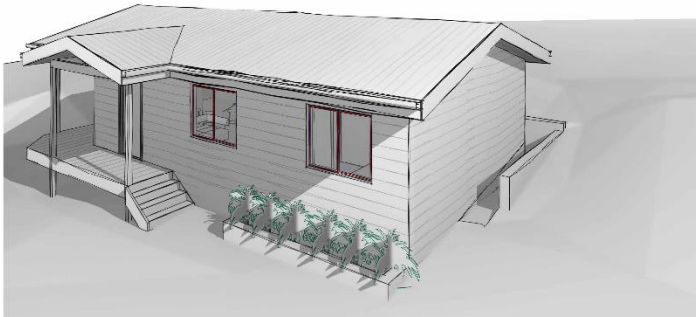

<p>GENERAL NOTES:</p> <p>All dimensions are to be confirmed on site by the builder/subcontractor. Any discrepancies must be reported to the Designer before commencement of any work.</p> <p>No Survey has been made on the boundaries, all bearings, distances and areas have been taken from the contour survey plan. A Survey must be carried out to confirm the exact boundary locations.</p> <p>No construction work shall commence until a site survey confirming the site boundaries has been completed. The contractor is to ensure that the boundary setbacks are confirmed and used. The boundary setbacks take precedence over all other dimensions. The Survey work must be performed by a registered Surveyor.</p> <p>In the event of encountering any discrepancies on these drawings, specification or subsequent instructions issued, the Builder/subcontractor shall contact the Designer before proceeding further with any work.</p> <p>All construction, control joints and expansion joints in the wall, floor, other baulks shall be in strict accordance with the Structural Engineering details. No joints or breaks other than specified, are allowed without written permission from the Engineer.</p> <p>Measurements for the fabrication of secondary components such as, windows, doors, internal frames, structural steel components and the like, are not to be taken from these documents. Measurements must be taken on site to suit the work on construction.</p> <p>All structural components shall be in strict accordance to details and specifications as prepared by a structural engineer.</p> <p>All existing structures need to be examined for structural adequacy, and it is the Contractor's responsibility to ensure that a certificate of structural adequacy is available prior to the start of any work.</p>	<table><tr><th>drawn</th><th>date</th><th>issue</th><th>description</th></tr><tr><td>LS</td><td>05/08/24</td><td>A</td><td>ISSUE FOR DA</td></tr><tr><td>LS</td><td>13/09/24</td><td>B</td><td>ISSUE FOR DA</td></tr><tr><td>LS</td><td>27/09/24</td><td>C</td><td>ISSUE FOR DA</td></tr><tr><td>LS</td><td>14/10/24</td><td>D</td><td>ISSUE FOR DA</td></tr><tr><td>LS</td><td>10/11/24</td><td>E</td><td>ISSUE FOR DA</td></tr></table>	drawn	date	issue	description	LS	05/08/24	A	ISSUE FOR DA	LS	13/09/24	B	ISSUE FOR DA	LS	27/09/24	C	ISSUE FOR DA	LS	14/10/24	D	ISSUE FOR DA	LS	10/11/24	E	ISSUE FOR DA	<p>project</p> <p>PROPOSED CONSTRUCTION OF A GRANNY FLAT AT 9 WILLOW WAY FORESTVILLE NSW 2087 LOT 13 DP27432</p> <p>client</p> <p>MAI POON</p> <p>drawn</p> <p>3D VIEWS</p> <p>project no. date</p> <p>24-48 05/08/24</p> <p>sheet no. scale @ A3</p> <p>0,2</p> <p>issue checked</p> <p>E ?</p>	<p>BPAD</p> <p>ACCREDITED BUILDING DESIGNER</p> <p>6/7 Parkes Street, Parramatta NSW 2150 www.rkdesigns.com.au admin@rkdesigns.com.au 02 9632 4797 abr. 68 655 200 340 spaces designed for life</p> <p>RK DESIGNS</p>
drawn	date	issue	description																								
LS	05/08/24	A	ISSUE FOR DA																								
LS	13/09/24	B	ISSUE FOR DA																								
LS	27/09/24	C	ISSUE FOR DA																								
LS	14/10/24	D	ISSUE FOR DA																								
LS	10/11/24	E	ISSUE FOR DA																								

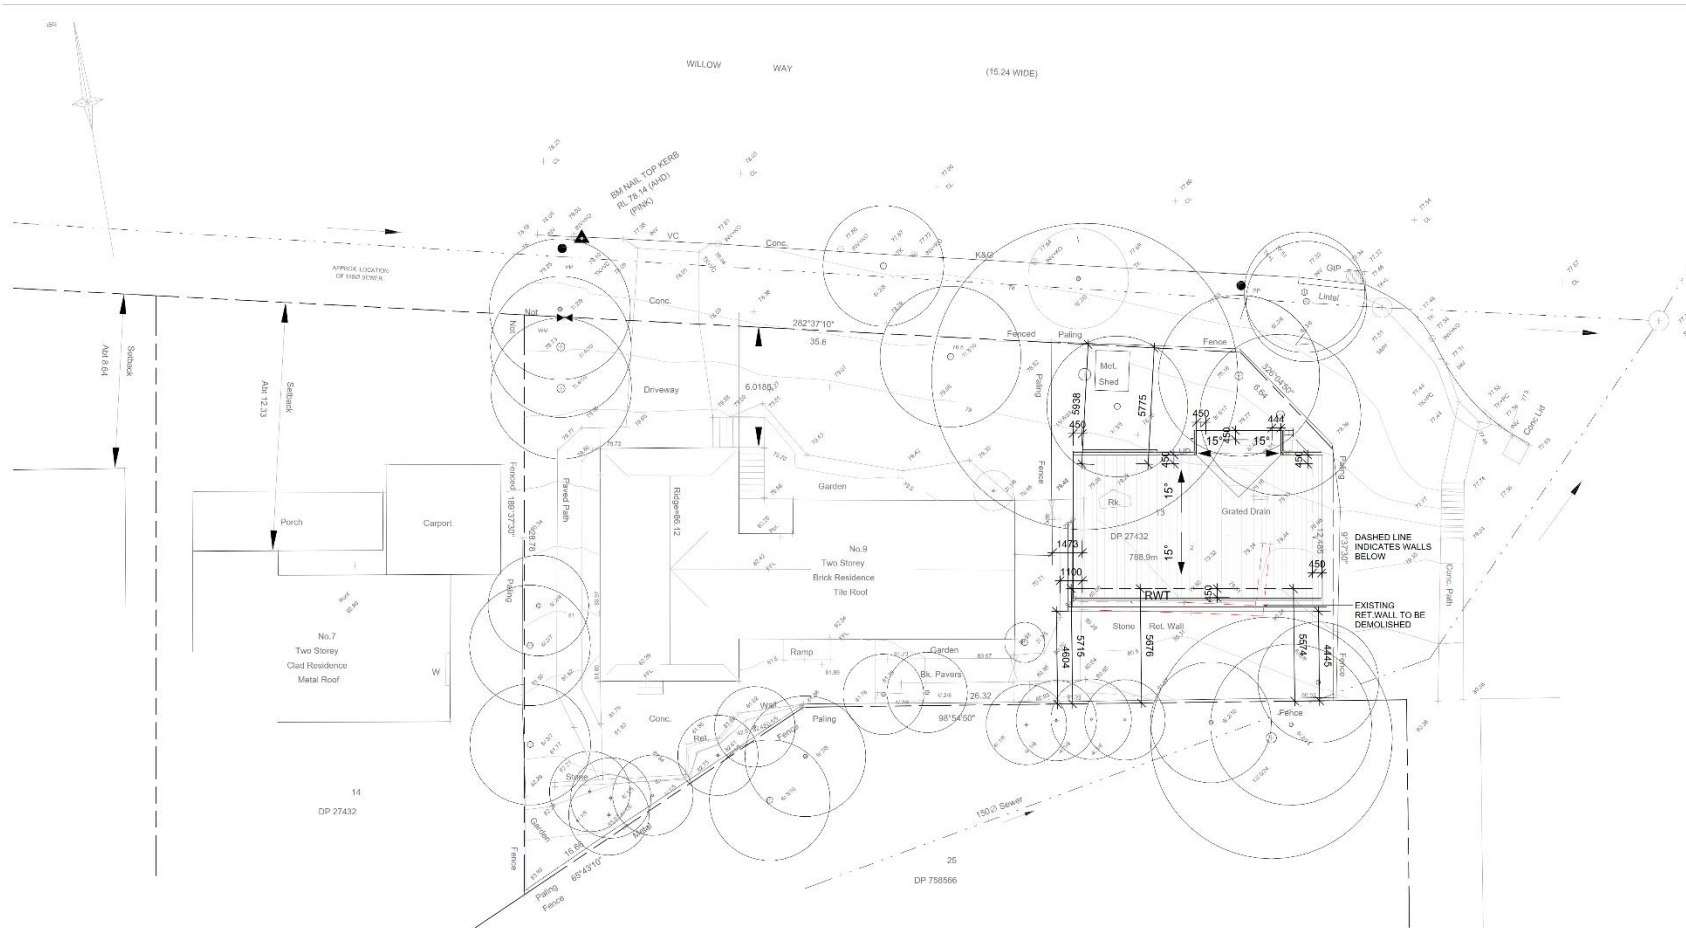

PRELIMINARY
DO NOT USE FOR CONSTRUCTION

1

SITE AND ROOF PLAN

1 : 200



GENERAL NOTES
All dimensions are to be confirmed on site by the builder/subcontractor, any incongruities must be reported to the Designer before commencement of any work.
No survey has been made on the boundaries, all bearings, distances and areas have been taken from the contour survey plan. A Survey must be carried out to confirm the exact boundary locations.
No construction work shall commence until a site survey confirming the site boundaries has been completed. The contractor is to ensure that the boundary setbacks are confirmed and used. The boundary setbacks take precedence over all other dimensions. The Survey work must be performed by a registered Surveyor.
In the event of encountering any discrepancies on these drawings, specification or subsequent instructions issued, the Builder/Subcontractor shall contact the Designer before proceeding further with any work.
All construction, control joints and expansion joints in the wall, floors, other locations shall be in strict accordance with the Structural Engineering details. No joints or breaks other than specified, are allowed without written permission from the Engineer.
Measurements for the fabrication of secondary components such as, windows, doors, internal frames, structural steel components and the like, are not to be taken from these documents. Measurements must be taken on site to suit the work as constructed.
All structural components shall be in strict accordance to details and specifications as prepared by a structural engineer.
All existing structures need to be examined for structural adequacy, and it is the Contractor's responsibility to ensure that a certificate of structural adequacy is available prior to the start of any work.

drawn	date	issue	description
LS	05/08/24	A	ISSUE FOR DA
LS	13/09/24	B	ISSUE FOR DA
LS	27/09/24	C	ISSUE FOR DA
LS	14/10/24	D	ISSUE FOR DA
LS	18/11/24	E	ISSUE FOR DA

project
PROPOSED CONSTRUCTION OF A GRANNY FLAT AT 9
WILLOW WAY FORESTVILLE NSW 2087 LOT 13 DP27432

client
MAI POON




true north
drawing
SITE AND ROOF PLAN
project no 24-48
date 05/08/24
sheet no 1

scale @ A3 1 : 200
issue E
checked ?



6/7 Parkes Street,
Parramatta NSW 2150
www.rkdesigns.com.au
admin@rkdesigns.com.au
02 9633 4797
abn. 68 609 200 369
spaces designed for life

RK
DESIGNS

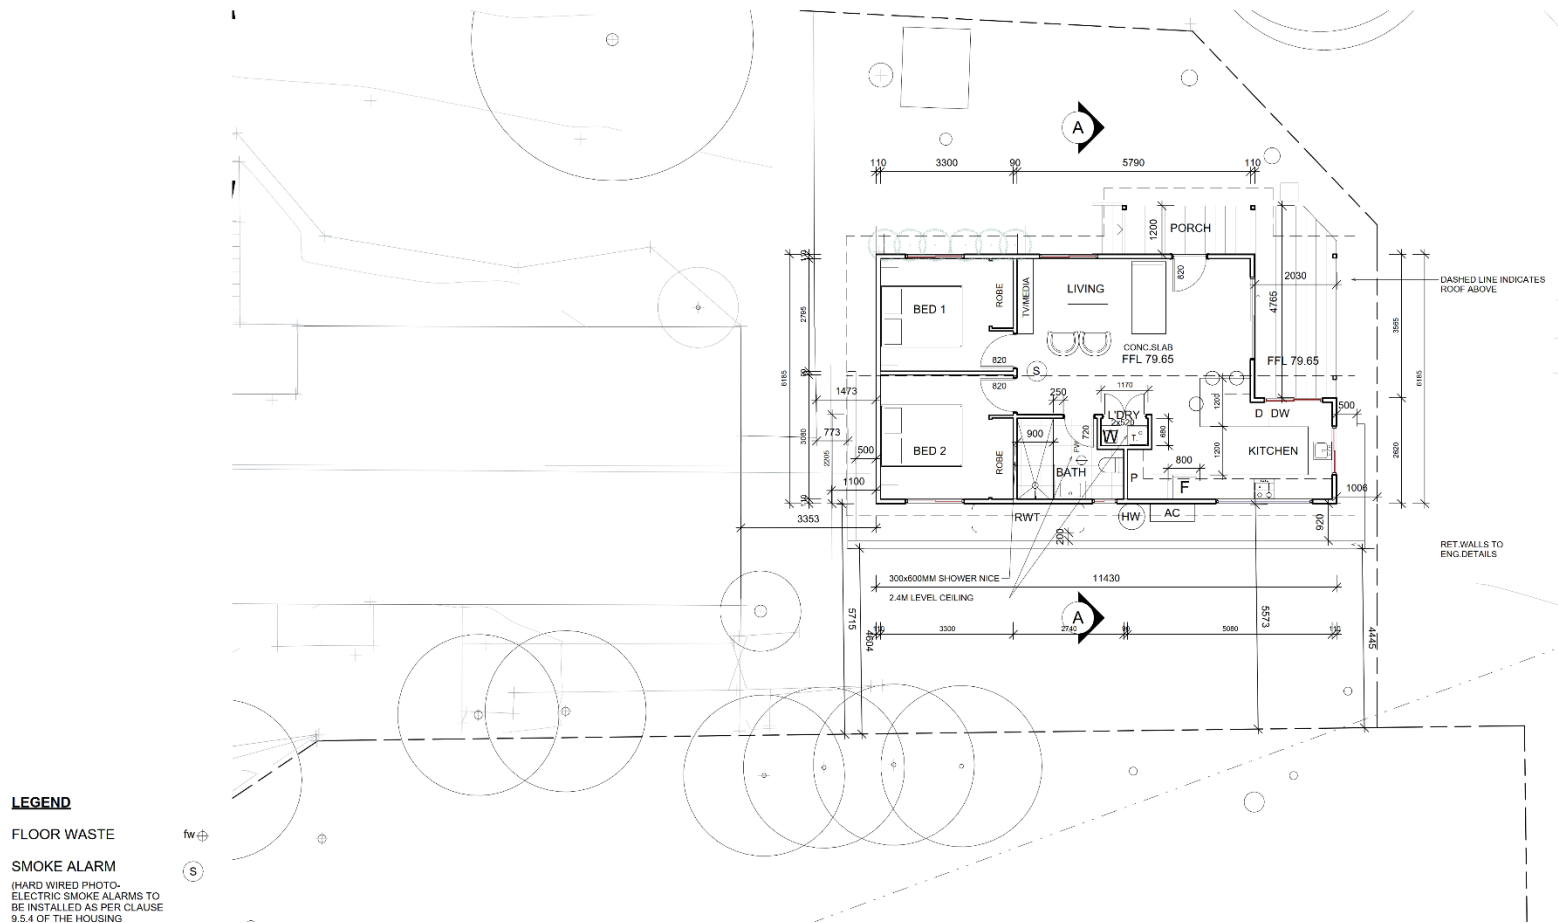

GENERAL NOTES

All dimensions are to be confirmed on site by the builder/subcontractor, any incongruities must be reported to the Designer before commencement of any work.

No survey has been made on the boundaries, all bearings, distances and areas have been taken from the contour survey plan. A Survey must be carried out to confirm the exact boundary locations.

No construction work shall commence until a site survey confirming the site boundaries has been completed. The contractor is to ensure that the boundary setbacks are confirmed and used, the boundary setbacks take precedence over all other dimensions. The Survey work must be performed by a registered Surveyor.

In the event of encountering any discrepancies on these drawings, specification or subsequent instructions issued, the Builder/Subcontractor shall contact the Designer before proceeding further with any work.

All construction, control joints and expansion joints in the wall, floors, other locations shall be in strict accordance with the Structural Engineering details. No joints or breaks other than specified, are allowed without written permission from the Engineer.

Measurements for the fabrication of secondary components such as, windows, doors, internal frames, structural steel components and the like, are not to be taken from these documents. Measurements must be taken on site to suit the work as constructed.

All structural components shall be in strict accordance to details and specifications as prepared by a structural engineer.

All existing structures need to be examined for structural adequacy, and it is the Contractor's responsibility to ensure that a certificate of structural adequacy is available prior to the start of any work.

drawn	date	issue	description
LS	05/08/24	A	ISSUE FOR DA
LS	13/09/24	B	ISSUE FOR DA
LS	27/09/24	C	ISSUE FOR DA
LS	14/10/24	D	ISSUE FOR DA
LS	18/11/24	E	ISSUE FOR DA

project
PROPOSED CONSTRUCTION OF A GRANNY FLAT AT 9 WILLOW WAY FORESTVILLE NSW 2087 LOT 13 DP27432

client
MAI POON








true north
drawing
GROUND FLOOR PLAN
project no. 24-48
date 05/08/24
sheet no. 2


6/7 Parkes Street,
Parramatta NSW 2150
www.rkdesigns.com.au
admin@rkdesigns.com.au
02 9633 4797
abn. 63 609 200 369
spaces designed for life



RK
DESIGNS

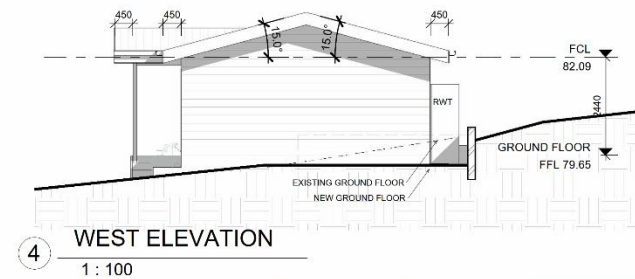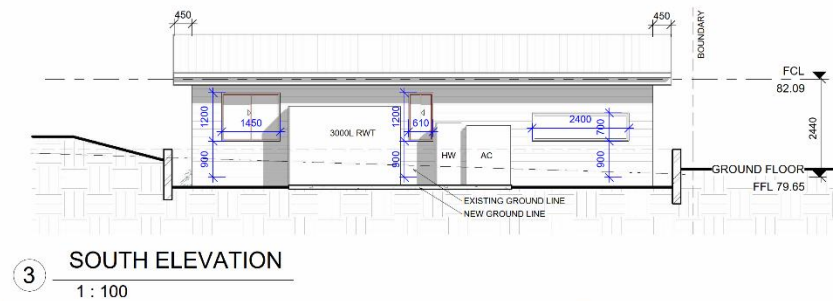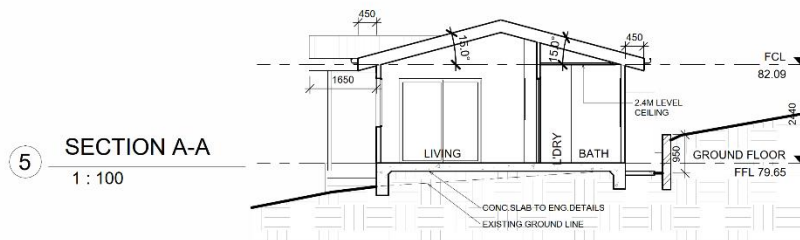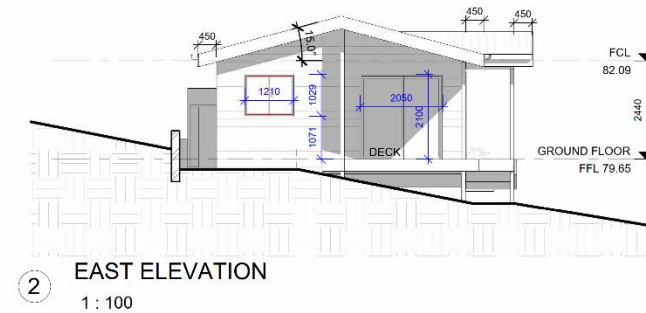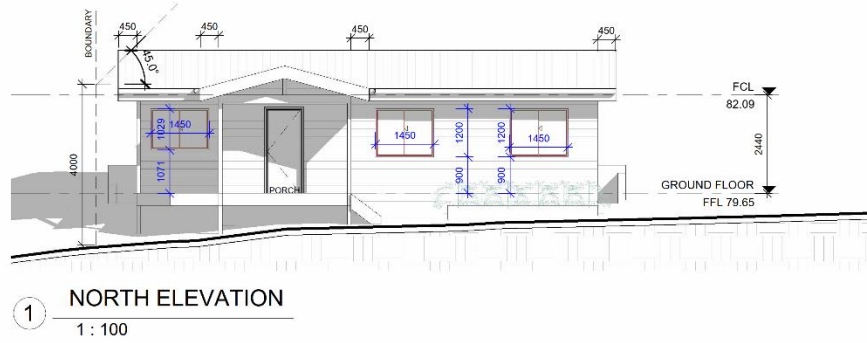

<p>GENERAL NOTES</p> <p>All dimensions are to be confirmed on site by the builder/subcontractor, any incongruities must be reported to the Designer before commencement of any work.</p> <p>No Survey has been made on the boundaries, all bearings, distances and areas have been taken from the contour survey plan. A Survey must be carried out to confirm the exact boundary locations.</p> <p>No construction work shall commence until a site survey confirming the site boundaries has been completed. The contractor is to ensure that the boundary setbacks are confirmed and used, the boundary setbacks take precedence over all other dimensions. The Survey work must be performed by a registered Surveyor.</p> <p>In the event of encountering any discrepancies on these drawings, specification or subsequent instructions issued, the Builder/Subcontractor shall contact the Designer before proceeding further with any work.</p> <p>All construction, control joints and expansion joints in the wall, floors, other locations shall be in strict accordance with the Structural Engineering details. No joints or breaks other than specified, are allowed without written permission from the Engineer.</p> <p>Measurements for the fabrication of ancillary components such as, windows, doors, internal frames, structural steel components and the like, are not to be taken from these documents. Measurements must be taken on site to suit the work as constructed.</p> <p>All structural components shall be in strict accordance to details and specifications as prepared by a structural engineer.</p> <p>All existing structures need to be examined for structural adequacy, and it is the Contractor's responsibility to ensure that a certificate of structural adequacy is available prior to the start of any work.</p>	<table> <tr> <th>drawn</th><th>date</th><th>issue</th><th>description</th></tr> <tr> <td>LS</td><td>05/08/24</td><td>A</td><td>ISSUE FOR DA</td></tr> <tr> <td>LS</td><td>13/09/24</td><td>B</td><td>ISSUE FOR DA</td></tr> <tr> <td>LS</td><td>27/09/24</td><td>C</td><td>ISSUE FOR DA</td></tr> <tr> <td>LS</td><td>14/10/24</td><td>D</td><td>ISSUE FOR DA</td></tr> <tr> <td>LS</td><td>18/11/24</td><td>E</td><td>ISSUE FOR DA</td></tr> </table>	drawn	date	issue	description	LS	05/08/24	A	ISSUE FOR DA	LS	13/09/24	B	ISSUE FOR DA	LS	27/09/24	C	ISSUE FOR DA	LS	14/10/24	D	ISSUE FOR DA	LS	18/11/24	E	ISSUE FOR DA	<p>project PROPOSED CONSTRUCTION OF A GRANNY FLAT AT 9 WILLOW WAY FORESTVILLE NSW 2087 LOT 13 DP27432</p> <p>client MAI POON</p> <p>drawing ELEVATIONS AND SECTION</p> <p>project no 24-48</p> <p>date 05/08/24</p> <p>sheet no 3</p> <p>scale @ A3 1:100</p> <p>issue checked E ?</p>	<p>6/7 Parkes Street, Parramatta NSW 2150 www.rkdesigns.com.au admin@rkdesigns.com.au 02 9633 4707 abn. 68 609 200 389 spaces designed for life</p> <p>RK DESIGNS</p>
drawn	date	issue	description																								
LS	05/08/24	A	ISSUE FOR DA																								
LS	13/09/24	B	ISSUE FOR DA																								
LS	27/09/24	C	ISSUE FOR DA																								
LS	14/10/24	D	ISSUE FOR DA																								
LS	18/11/24	E	ISSUE FOR DA																								

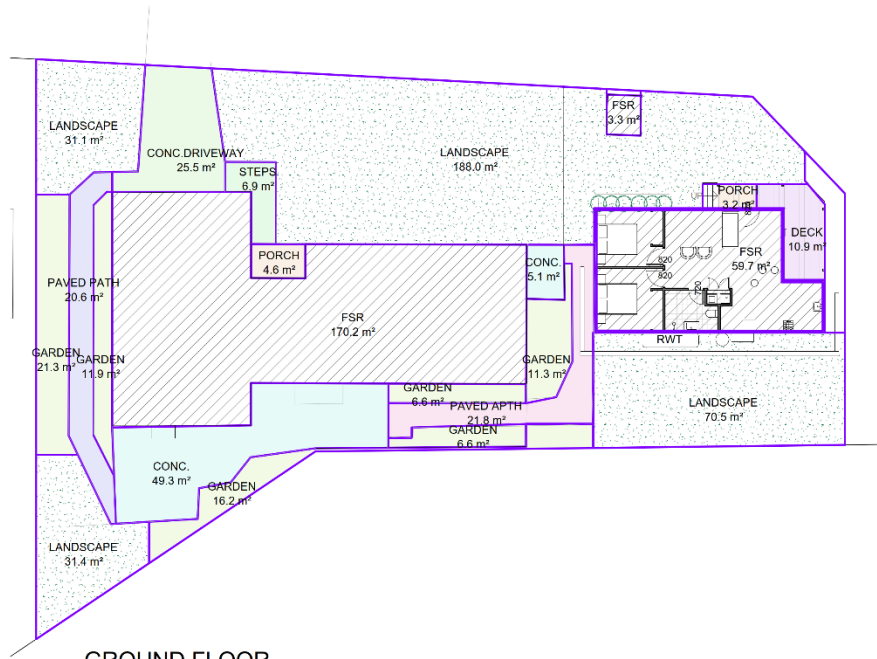

1 GROUND FLOOR
1 : 200

AREA CALCULATIONS SCHEDULE

NAME	LEVEL	COUNT	TOTAL
CONC.	GROUND FLOOR	2	54.3 m²
CONC.: 2			54.3 m²
CONC.DRIVEWAY	GROUND FLOOR	1	25.5 m²
CONC.DRIVEWAY: 1			25.5 m²
DECK	Not Placed	1	0.0 m²
DECK	GROUND FLOOR	1	10.9 m²
DECK: 2			10.9 m²
FSR	Not Placed	1	0.0 m²
FSR	GROUND FLOOR	3	233.3 m²
FSR: 4			233.3 m²
GARDEN	GROUND FLOOR	6	73.7 m²
GARDEN: 6			73.7 m²
LANDSCAPE	GROUND FLOOR	4	321.0 m²
LANDSCAPE: 4			321.0 m²
PAVED APTH	GROUND FLOOR	1	21.8 m²
PAVED APTH: 1			21.8 m²
PAVED PATH	GROUND FLOOR	1	20.6 m²
PAVED PATH: 1			20.6 m²
PORCH	GROUND FLOOR	2	7.8 m²
PORCH: 2			7.8 m²
STEPS	GROUND FLOOR	1	6.9 m²
STEPS: 1			6.9 m²

SITE AREA = 788.9 SQM

MINIMUM REQUIRED LANDSCAPED AREA = 40% = **315.56**

PROPOSED LANDSCAPED AREA = **321 SQM**

THEREFORE, THE PROPOSAL COMPLIES WITH WDCP

GENERAL NOTES
All dimensions are to be confirmed on site by the builder/subcontractor, any incongruities must be reported to the Designer before commencement of any work.
No survey has been made on the boundaries, all bearings, distances and areas have been taken from the contour survey plan. A Survey must be carried out to confirm the exact boundary locations.
No construction work shall commence until a site survey confirming the site boundaries has been completed. The Contractor is to ensure that the boundary setbacks are confirmed and used, the boundary setbacks take precedence over all other dimensions. The Survey work must be performed by a registered Surveyor.
In the event of encountering any discrepancies on these drawings, specification or subsequent instructions issued, the Builder/Subcontractor shall contact the Designer before proceeding further with any work.
All construction, control joints and expansion joints in the wall, floors, other locations shall be in strict accordance with the Structural Engineering details. No joints or breaks other than specified, are allowed without written permission from the Engineer.
Measurements for the fabrication of secondary components such as, windows, doors, internal frames, structural steel components and the like, are not to be taken from these documents. Measurements must be taken on site to suit the work as constructed.
All structural components shall be in strict accordance to details and specifications as prepared by a structural engineer.
All existing structures need to be examined for structural adequacy, and it is the Contractor's responsibility to ensure that a certificate of structural adequacy is available prior to the start of any work.

drawn	date	issue	description
LS	05/08/24	A	ISSUE FOR DA
LS	13/09/24	B	ISSUE FOR DA
LS	27/09/24	C	ISSUE FOR DA
LS	14/10/24	D	ISSUE FOR DA
LS	18/11/24	E	ISSUE FOR DA

project
PROPOSED CONSTRUCTION OF A GRANNY FLAT AT 9 WILLOW WAY FORESTVILLE NSW 2087 LOT 13 DP27432

client
MAI POON



true north drawing
AREA CALCULATIONS
project no. 24-48 date 05/08/24 sheet no. 4

scale @ A3 1 : 200 issue checked E ?



6/7 Parkes Street,
Parramatta NSW 2150
www.rkdesigns.com.au
admin@rkdesigns.com.au
02 9633 4797
abr. 68 669 200 369
spaces designed for life

RK
DESIGNS