



WA | QLD | NSW | VIC

www.structerre.com.au

PROPOSED NEW RETAINING WALL FOR



ANDREW IEMMA

INDEX TO SHEETS	
SHEET	TITLE
S-000	COVER SHEET & DRAWING LIST
S-001	GENERAL NOTES
S-002	STRUCTURAL NOTES
S-101	RETAINING WALL PLANS
S-201	RETAINING WALL DETAILS - SHEET 1
S-202	RETAINING WALL DETAILS - SHEET 2
S-203	TYPICAL BLOCKWORK NOTES & DETAILS
S-204	RETAINING WALL FOOTING STEP DETAILS



IMPORTANT NOTE:

IT IS THE RESPONSIBILITY OF THE CLIENT IN CONSULTATION WITH THEIR BUILDER TO CHECK AND VERIFY THE BUILDABILITY OF THE DESIGN AS PRESENTED AND REFER ANY CONCERNS BACK TO THE ENGINEER PRIOR TO CONSTRUCTION. THESE DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE PROJECT ARCHITECTURAL AND OTHER CONSULTANTS DRAWINGS AND SPECIFICATIONS.

IT IS ASSUMED THAT THE USER OF THESE DETAILS HAS A LEVEL OF FAMILIARITY AND COMPETENCY TO UNDERSTAND AND EXECUTE THE WORKS.

AT ALL TIMES COMMON SENSE IS TO BE USED

IF EVER IN DOUBT, ASK!

APPROVED

CLIENT
ANDREW IEMMA

CLIENT REFERENCE. No.

SHEET
COVER SHEET AND DRAWING LIST

PROJECT ADDRESS
LOT 7 NO. 10 COURTLEY ROAD,
BEACON HILL. NSW

TEL (02) 9475 3000 FAX (02) 9646 2311 EMAIL: sydney@structerre.com.au

REVISION
A
DATE
01/06/22

PROJECT NO.
3.22.5264.2
SHEET NO.
S-000

GENERAL NOTES:

- G.1.

THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH ALL ARCHITECTURAL AND OTHER CONSULTANTS DRAWINGS AND SPECIFICATIONS AND WITH SUCH OTHER WRITTEN INSTRUCTIONS AS MAY BE ISSUED DURING THE COURSE OF THE CONTRACT. ALL DISCREPANCIES SHALL BE REFERRED TO THE ARCHITECT/ENGINEER FOR DECISION BEFORE PROCEEDING WITH THE WORK.
- G.2.

DIMENSIONS SHALL NOT BE OBTAINED BY SCALING THE STRUCTURAL DRAWINGS.
- G.3.

SETTING OUT DIMENSIONS SHOWN ON THE DRAWINGS SHALL BE VERIFIED BY THE BUILDER.
- G.4.

DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED.
- G.5.

ALL WORKMANSHIP AND MATERIALS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CURRENT EDITIONS OF THE AS CODES AND THE BY-LAWS AND ORDINANCES OF THE RELEVANT BUILDING STATE AUTHORITY.
- G.6.

THIS REPORT IS BASED ON INFORMATION SUPPLIED BY THE CLIENT. IF ANY ASPECT OF THE SITE PREPARATION OR PROPOSED CONSTRUCTION CHANGES FROM THAT ORIGINALLY ADVISED, THE ENGINEER MUST BE NOTIFIED SO THAT ANY NECESSARY AMENDMENTS CAN BE MADE.
- G.7.

DEVELOPMENT APPLICATION DECISION NOTICE - FOR WORK REQUIRING BUILDING APPROVAL, THE DEVELOPMENT APPLICATION DECISION NOTICE, ISSUED BY THE COUNCIL OR BUILDING CERTIFIER MUST BE FORWARDED TO US PRIOR TO ARRANGING ANY INSPECTIONS WITH THIS OFFICE.

SITE CLASSIFICATION NOTES:

- S.C.1.

THIS REPORT HAS BEEN BASED UPON INFORMATION PROVIDED TO OUR OFFICE AND/OR GATHERED BY OUR STAFF.
- S.C.2.

THIS REPORT HAS BEEN PREPARED IN ACCORDANCE WITH AS 2870 AND RELEVANT STATE LEGISLATION.
- S.C.3.

SHOULD SOIL CONDITIONS ENCOUNTERED ON SITE DIFFER SIGNIFICANTLY FROM THOSE INDICATED IN THE SOIL TEST NOTED ABOVE, THE ENGINEER MUST BE NOTIFIED BEFORE PROCEEDING AS THE SITE CLASSIFICATION MAY NEED REVISING AND MODIFICATIONS TO THE DESIGN MAY BE REQUIRED.
- S.C.4.

THE SITE INVESTIGATION MAY BE RENDERED IRRELEVANT IF THE LOCATION OF PROPOSED STRUCTURES VARY FROM THAT SPECIFIED AT THE TIME OF THIS REPORT. THIS REPORT RELATES TO THE CONDITIONS EXISTING ON THE LAND AT THE TIME OF THE SITE INVESTIGATION. THIS REPORT IS BASED UPON THE PROPOSED CUT / FILL INFORMATION PROVIDED BY THE CLIENT. ANY UNADVISED EXTENSIVE CUTTING OR FILLING MAY RENDER THIS REPORT IRRELEVANT.
- S.C.5.

WHILE A REASONABLE EFFORT IS MADE TO ASSESS THE SITE'S SUITABILITY FOR THE PROPOSED CONSTRUCTION, THIS REPORT DOES NOT TAKE INTO ACCOUNT SLOPE STABILITY. IF REQUIRED BY THE COUNCIL, A SUITABLY QUALIFIED PERSON SHOULD BE ENGAGED TO UNDERTAKE A SLOPE STABILITY ASSESSMENT.

MISCELLANEOUS NOTES:

- M.1.

WHERE TERMITE PROTECTION IS REQUIRED, INSTALL IN ACCORDANCE WITH AS3660. BUILDER SHALL CONFIRM WITH OWNER THE PREFERRED METHOD OF TERMITE MANAGEMENT. OWNER IS RESPONSIBLE FOR ONGOING INSPECTION OF STRUCTURAL TIMBER ELEMENTS AND ENSURING THAT TERMITE MANAGEMENT SYSTEMS ARE NOT BREACHED.
- M.2.

THE RECOMMENDED DISTANCE THAT A NEW TREE SHOULD BE LOCATED FROM A DWELLING WOULD BE EQUAL OR GREATER THAN 75% OF THE MATURE HEIGHT FOR CLASS M SITES, 100% OF THE MATURE HEIGHT FOR CLASS H1 & H2 SITES, 150% OF THE MATURE HEIGHT FOR CLASS E SITES.

DRAINAGE NOTES:

- D.1.

ALL WORKMANSHIP AND MATERIAL SHALL BE IN ACCORDANCE WITH AS2870.
- D.2.

D.2. DRAINAGE SHALL BE CONSTRUCTED TO AVOID WATER PONDING AGAINST OR NEAR THE FOOTING. THE GROUND IN THE IMMEDIATE VICINITY OF THE PERIMETER FOOTING, INCLUDING THE GROUND UPHILL FROM THE SLAB ON

- D.3.

PLUMBING TRENCHES SHALL BE SLOPED AWAY FROM THE HOUSE AND SHALL BE BACKFILLED WITH CLAY IN THE TOP 300mm WITHIN 1.5m OF THE HOUSE. THE CLAY USED FOR BACKFILLING SHALL BE COMPACTED. WHERE PIPES PASS UNDER THE FOOTING SYSTEM, THE TRENCH SHALL BE BACKFILLED WITH CLAY OR CONCRETE TO RESTRICT THE INGRESS OF WATER BENEATH THE FOOTING SYSTEM.
- D.4.

EXCAVATIONS NEAR THE EDGE OF THE FOOTING SYSTEM SHALL BE BACKFILLED IN SUCH A WAY AS TO PREVENT ACCESS OF WATER TO THE FOUNDATION. FOR EXAMPLE, EXCAVATIONS SHOULD BE BACKFILLED ABOVE OR ADJACENT THE FOOTING WITH MOIST CLAY, COMPACTED BY HAND-RODDING/TAMPING. POROUS MATERIAL SUCH AS SAND, GRAVEL OR BUILDING RUBBLE SHOULD NOT BE USED.
- D.5.

WATER RUN-OFF SHALL BE COLLECTED AND CHanneled AWAY FROM THE HOUSE DURING CONSTRUCTION.
- D.6.

PENETRATIONS OF THE EDGE BEAMS AND FOOTING BEAMS ARE TO BE AVOIDED, BUT WHERE NECESSARY SHALL BE SLEEVED TO ALLOW FOR MOVEMENT.
- D.7.

CONNECTION OF STORMWATER DRAINS AND WASTE DRAINS SHALL INCLUDE FLEXIBLE CONNECTIONS.
- D.8.

ADDITIONAL PLUMBING REQUIREMENTS ARE NEEDED FOR MODERATELY, HEAVILY & EXTREMELY REACTIVE SITES IN ACCORDANCE WITH CLAUSE 6.6 (F) FROM AS 2870.
- D.9.

PLUMBING & DRAINAGE UNDER THE SLAB SHOULD BE AVOIDED WHERE PRACTICAL (REFER AS/NZS 3500 CLAUSE 4.10)
- D.10.

ALL PIPEWORK INCLUDING STORMWATER FITTINGS & ADAPTERS SHOULD BE PROTECTED FROM MECHANICAL DAMAGE.
- D.11.

PROVISIONS SHOULD BE MADE FOR THE CONNECTION OF OVERFLOW OR WATER DISCHARGE FROM FIXTURES SUCH AS HOT WATER SYSTEMS & AIR CONDITIONERS TO A DRAIN AS REQUIRED BY THE RELEVANT LOCAL AUTHORITY.
- PROPERTY MAINTENANCE NOTES:
- P.1.

THIS DESIGN IS BASED UPON THE NORMAL FOOTING PERFORMANCE CRITERIA PROVIDED IN TABLE 2.2 OF AS8270-2011 WITH DAMAGE CATEGORIES DETAILED IN APPENDIX C. IF THESE PERFORMANCE CRITERIA IS UNSUITABLE FOR THIS DWELLING PLEASE CONSULT THIS OFFICE FOR ADDITIONAL ENGINEERING ADVISE AND DESIGN SERVICES.

P.2.

THE OWNER'S ATTENTION IS DRAWN TO APPENDIX B 'PERFORMANCE CRITERIA AND FOUNDATION MAINTENANCE' AND APPENDIX C 'CLASSIFICATION OF DAMAGE DUE TO FOUNDATION MOVEMENTS' OF AS 2870-2011.

P.3.

WE ALSO DIRECT THE OWNER TO THE CSIRO PUBLICATION BTF 18 'FOUNDATION MAINTENANCE AND FOOTING PERFORMANCE: A HOMEOWNER'S GUIDE'. COPIES OF THIS PUBLICATION ARE AVAILABLE FROM CSIRO PUBLISHING ON PH: 1300-788-000 OR AT <http://www.publish.csiro.au/nid/18/pid/3612.htm>. THIS REPORT MAY BE RENDERED INVALID IF THE PROPERTY IS NOT MAINTAINED AS RECOMMENDED IN THIS PUBLICATION.

P.4.

THE LONG TERM PERFORMANCE OF DWELLING FOOTINGS IS DEPENDANT ON FACTORS SUCH AS SITE DRAINAGE, VEGETATION AND WATERING OF AREAS ADJACENT TO THE DWELLING.

P.5.

WATERING OF LAWNS AND GARDENS SHOULD BE CONSISTENT. OVER WATERING CAN DAMAGE FOOTINGS. EQUALLY FOOTINGS MAY BE DAMAGED BY PROLONGED PERIODS OF NEGLECT AFTER YEARS OF CAREFUL WATERING. LEAKING TAPS AND PIPES AND BLOCKED DRAINS SHOULD BE REPAIRED PROMPTLY. PROLONGED NEGLECT CAN LEAD TO DAMAGED FOOTINGS.
- | SUMMARY OF AS2870-2011 - TABLE 2.2 - Classification of normal site footing performance for brick veneer & full masonry construction | | |
|---|---|---|
| SITE CLASS | EXPECTED DAMAGE CATEGORIES | DAMAGE CATEGORIES (C1 & C2 OF APPENDIX C) |
| A & S | CATEGORY 0 & 1 | WALL CRACKS < 1mm
SLAB CRACKS < 1mm
LEVEL CHANGES < 8mm OVER 3m |
| M | OFTEN CATEGORY 1 & RARELY 2 | OFTEN WALL CRACKS <1 mm. & RARELY 1 < 5mm
SLAB CRACKS 1 < 2mm
LEVEL CHANGES 10 < 15mm OVER 3m |
| H1/H2 | OFTEN CATEGORY 1 & 2
RARELY CATEGORY 3 | OFTEN WALL CRACKS < 5 mm & RARELY 5 < 15mm
SLAB CRACKS 2 < 4mm
LEVEL CHANGES OF 15 < 25mm OVER 3m |
| E | OFTEN CATEGORY 3 OR MORE | OFTEN WALLS CRACKS 15 < 25mm
SLAB CRACKS 2 < 4mm OR MORE
LEVEL CHANGES > 25mm OVER 3m |
- ARTICULATED MASONRY NOTES:
- A.1.

THIS DESIGN ASSUMES THAT MASONRY ARTICULATION JOINTS WILL BE INSTALLED UNLESS NOTED OTHERWISE ON FOOTING & SLAB PLAN. ANY MASONRY ARTICULATION JOINTS SHALL BE POSITIONED IN ACCORDANCE WITH TECHNICAL NOTE 61 PRODUCED BY CEMENT CONCRETE & AGGREGATES AUSTRALIA AND AS 3700 SECTION 12.16.4. REFER TO TABLE BELOW FOR MAXIMUM SPACING AND MASONRY ARTICULATION PLAN (IF PROVIDED) FOR SPECIFIC LOCATIONS AND DETAILS FOR RENOVATIONS OR EXTENSIONS TO EXISTING STRUCTURES.

A.2.

MASONRY ARTICULATION JOINTS SHALL BE POSITIONED WHERE EVER NEW BRICKWORK MEETS OLD BRICKWORK.

A.3.

WHERE MASONRY ARTICULATION IS SHOWN BESIDE OPENINGS WITH BRICKWORK ABOVE THE OPENING, CARE SHOULD BE TAKEN TO PROVIDE A SLIP JOINT AROUND THE END OF THE LINTEL.

A.4.

WHERE MASONRY ARTICULATION IS SHOWN BESIDE OPENINGS, THE JOINT IS TO CONTINUE BETWEEN THE WINDOW/DOOR FRAME AND THE BRICKWORK TO THE FULL HEIGHT OF THE WALL. AT THESE LOCATIONS, THE FRAMES ARE TO BE FIXED WITH FASTENERS THAT WILL ALLOW MOVEMENT OF THE JOINT.
- | MAXIMUM SPACING OR ARTICULATION JOINTS TO AS 4773 (UNREINFORCED MASONRY) U.N.O | | | |
|---|-------------------------------|-----------------------------------|------------|
| SITE CLASS | CONSTRUCTION & SURFACE FINISH | JOINT SPACING (m) FOR WALL HEIGHT | |
| | | ≤ 4m HIGH | 4m TO 8.5m |
| A & S | NOT REQUIRED | - | - |
| M, M-D | EXTERNAL FACE FINISH | 6.0 | 4.2 |
| | EXTERNAL RENDERED/PAINTED | 5.5 | 3.9 |
| | INTERNAL FACE FINISH | 6.0 | 4.2 |
| | INTERNAL RENDERED/PAINTED | 5.5 | 3.9 |
| H1, H2, H1-D, H2-D | EXTERNAL FACE FINISH | 5.0- 5.5 | 3.5 - 3.9 |
| | EXTERNAL RENDERED/PAINTED | 4.5 - 5.5 | 3.2 - 3.5 |
| | INTERNAL FACE FINISH | 5.0 - 5.5 | 3.5 - 3.9 |
| | INTERNAL RENDERED/PAINTED | 4.5 - 5.0 | 3.2 - 3.5 |
| P, E, E-D | REFER NOTE 4 / LOCATIONS | - | - |
| NOTES: | | | |
| 1. AS DEFINED IN AS 2870 | | | |
| 2. USE MAXIMUM SPACING FOR EXPANSION OR CONTRACTION JOINTS | | | |
| 3. FOR H-D SITES USE THE SHORTER SPACING | | | |
| 4. FOR LOCATION OF JOINTS ON CLASS E, E-D & P SITES, REFER TO ENGINEER FOR ADVICE | | | |
- FOUNDATIONS AND FOOTINGS:
- F.1.

FOOTINGS SHALL BE PLACED CENTRALLY UNDER WALLS AND COLUMNS UNLESS OTHERWISE NOTED.

F.2.

ALL WORKMANSHIP & MATERIALS SHALL BE IN ACCORDANCE WITH AS 2870 & NATIONAL CONSTRUCTION CODE (N.C.C.)

F.3.

THE FOOTING DETAILS SHOWN ARE FOR THE SITE CLASSIFICATION STIPULATED. WHILST EVERY CARE HAS BEEN TAKEN TO VERIFY THAT THE INFORMATION SHOWN IS CORRECT, STRUCTERRE CONSULTING ENGINEERS TAKE NO RESPONSIBILITY FOR VARIATIONS WHICH MAY OCCUR DUE TO VARIATIONS IN SITE CONDITIONS.

F.4.

FILL USED IN THE CONSTRUCTION OF A SLAB EXCEPT WHERE THE SLAB IS SUSPENDED SHALL CONSIST OF A CONTROLLED FILL OR ROLLED FILL IN ACCORDANCE WITH AS 2870:

F.4.1.

ROLLED FILL CONSISTS OF MATERIAL COMPACTED IN LAYERS BY REPEATED ROLLING WITH AN EXCAVATOR. ROLLED FILL SHALL NOT EXCEED 600mm COMPACTED IN LAYERS NOT MORE THAN 300mm FOR SAND MATERIAL OR 400mm COMPACTED IN LAYERS NOT MORE THAN 150mm FOR OTHER MATERIAL.

F.4.2.

CONTROLLED FILL CONSISTS OF WELL GRADED SAND FILL UP TO 800mm DEEP, WELL COMPACTED IN NOT MORE THAN 300mm LAYERS BY VIBRATING PLATE OR VIBRATING ROLLER. NO SAND FILL UP TO 400mm DEEP, WELL COMPACTED IN NOT MORE THAN 150mm LAYERS BY A MECHANICAL ROLLER, CLAY FILL SHOULD BE MOIST DURING COMPACTION. THE DEPTHS OF FILL GIVEN ABOVE ARE DEPTHS MEASURED AFTER COMPACTION. FOR COMPACTED DEPTHS GREATER THAN THAT GIVEN ABOVE THE FILL SHALL BE SUBJECT TO CONTROL AND TESTING. IF TEST FAILS THEN PIERS ARE REQUIRED. CONTACT THIS OFFICE PRIOR TO FURTHER CONSTRUCTION.

F.5.

TOP SOIL CONTAINING GRASS ROOTS OR OTHER ORGANIC MATERIAL SHALL BE REMOVED FROM THE AREA ON WHICH THE SLAB IS TO REST.

F.6.

IF ANY FOOTING IS LOCATED SUCH THAT A LINE DRAWN AT 45 DEGREES (FOR CLAY AND 30 DEGREES FOR SAND) FROM ITS BASE INTERSECTS A PRIVATE SERVICE TRENCH, THEN PIERS ARE REQUIRED. SEE FOOTING & SLAB DETAILS FOR EXAMPLE.

F.7.

FOOTING & SLAB PIERS ARE REQUIRED WHERE UNCONTROLLED FILL UNDER THE EDGE BEAM/SLAB IS PRESENT.

F.8.

WHERE PIERS ARE USED TO SUPPORT A SLAB ON UNCONTROLLED FILL, PLUMBING AND DRAINAGE PIPES FOUNDED WITHIN SUCH FILL SHALL BE HUNG FROM THE SLAB MESH WITH NON-CORROSIVE STRAPS.

F.9.

FOR SATISFACTORY RESULTS, CONCRETE MUST BE CURED FOR AT LEAST 7 DAYS. CURING MAY BE ACHIEVED BY KEEPING THE CONCRETE MOIST, BY APPLYING A CURING COMPOUND, OR BY COVERING THE CONCRETE WITH A MOISTURE BARRIER. WHERE A CURING COMPOUND IS USED, IT MUST COMPLY WITH AS3799 & BE APPLIED TO THE MANUFACTURERS SPECIFICATIONS. MANY BUILDERS FIND THAT THE MOST SATISFACTORY WAY TO CURE A SLAB IS TO COVER IT WITH SHEETS OF POLYETHYLENE AS SOON AS POSSIBLE AFTER FINISHING. IF A SLAB IS MOIST WHEN COVERED AND THE POLYETHYLENE IS HELD SECURELY ONTO THE CONCRETE, THIS SYSTEM PROVIDES SATISFACTORY CURING OF THE CONCRETE.
- CONCRETE BLOCKWORK (EXCLUDES RETAINING WALLS):
- BM.1.

REINFORCED CONCRETE (R.C) BLOCKWORK TO CONFORM TO AS 3700 MASONRY STRUCTURES. BLOCKWORK SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF AS3700. UNCONFINED CHARACTERISTIC COMPRESSIVE STRENGTH OF CONCRETE MASONRY UNIT, f'uc = 15 MPa

BM.2.

MORTAR TYPE = M3


BM.3.

DESIGN CHARACTERISTIC COMPRESSIVE STRENGTH OF GROUT, f'cg = 20 MPa.

BM.4.

YIELD STRENGTH OF REINFORCEMENT - fsy = 500 MPa

BM.5.

CLEANOUT ALL CORES AFTER EACH DAYS LAYING. JOINTS TO BE TOOLED. CONTROL JOINTS TO BE PROVIDED AT 6.0 TO 8.0m CENTRES AND AS PER BLOCKWALL PLANS WHERE APPLICABLE.
- APPROVED
GERVASE PURICH
CIVIL ENGINEER
FIEAust. CPEng, NER, BPB, RBP, RPEQ No. 11656
- CLIENT
ANDREW IEMMA
- CLIENT REFERENCE. No.
- SHEET
GENERAL NOTES
- SCALE - N/A
- PROJECT ADDRESS
LOT 7 NO. 10 COURTLEY ROAD,
BEACON HILL. NSW
- 

TEL (02) 9475 3000 FAX (02) 9646 2311 EMAIL: sydney@structerre.com.au
- REVISION
A
- DATE
01/06/22
- PROJECT NO.
3.22.5264.2
- SHEET NO.
S-001

CONCRETE WORK:

- C.1. ALL WORKMANSHIP AND MATERIALS SHALL BE IN ACCORDANCE WITH AS 3600 & AS 2870. U.N.O
- C.2. CONCRETE QUALITY FOR CEMENT TYPE A & EXPOSURE CLASSIFICATION A1 SHALL BE AS TABULATED AND SHALL BE VERIFIED BY TESTS (REFER TABLE BELOW). U.N.O, SEE SLAB PLAN FOR A2, B & C CATEGORIES.

ELEMENT	SLUMP	AGG	CONCRETE GRADE	COVER U.N.O (mm)
SLABS ON GROUND	100mm	20mm	N20	20 TOP
				30 BTM. & SIDES
				40 TOP (EXT.)
FOOTINGS & PIERS	100mm	20mm	N20	50 TYPICAL
SUSPENDED SLAB	80mm	20mm	N32	30 TOP & SIDES
				20 BTM.
BEAMS	80mm	20mm	N32	45 TYPICAL
STAIRS	80mm	20mm	N32	45 TOP
				35 BTM.
WALLS	80mm	20mm	N32	30 SIDES (INT.)
				40 SIDES (EXT.)
COLUMNS	80mm	20mm	N32	40 TYPICAL

- C.3. SAMPLE AND TEST IN ACCORDANCE WITH AS 3600.
- C.4. ALL CONCRETE CONSTRUCTION TO BE COMPACTED WITH A MECHANICAL VIBRATOR.
- C.5. THOROUGHLY SCABBLE CONCRETE ON WHICH NEW CONCRETE IS TO BE POURED.
- C.6. ALL CONCRETE SHALL BE PLACED AND CURED IN ACCORDANCE WITH AS3600. WHERE CURING COMPOUNDS ARE USED, IT MUST COMPLY WITH AS3799 & BE APPLIED IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS & AS FOLLOWS:
- C.6.1. ONTO SLAB WITHIN 2HRS OF FINISHING OPERATION.
- C.6.2. ONTO WALLS AND COLUMNS IMMEDIATELY AFTER REMOVAL OF FORMWORK.
- C.7. SIZES OF CONCRETE ELEMENTS DO NOT INCLUDE THICKNESS OF APPLIED FINISHES.
- C.8. CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE TO THE APPROVAL OF THE ENGINEER.
- C.9. BEAM DEPTHS ARE WRITTEN FIRST AND INCLUDE SLAB THICKNESS, IF ANY.
- C.10. HORIZONTAL FORMWORK SHALL BE STRIPPED WHEN APPROVED BY THE ENGINEER.
- C.11. U.N.O NO ALLOWANCE HAS BEEN MADE FOR STACKED MATERIALS OR MACHINERY ON THE CONCRETE STRUCTURE.
- C.12. NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE ELEMENTS WITHOUT THE PRIOR APPROVAL OF THE ENGINEER.
- C.13. REINFORCEMENT IS REPRESENTED DIAGRAMMATICALLY, IT IS NOT NECESSARILY SHOWN IN TRUE PROJECTION.
- C.14. SPLICES IN REINFORCEMENT MADE IN POSITIONS OTHER THAN SHOWN SHALL BE TO THE APPROVAL OF THE ENGINEER. WHERE THE LAP LENGTH IS NOT SHOWN IT SHALL BE SUFFICIENT TO DEVELOP THE FULL STRENGTH OF THE REINFORCEMENT.
- C.15. WELDING OF REINFORCEMENT SHALL NOT BE PERMITTED UNLESS SHOWN ON THE STRUCTURAL DRAWINGS.
- C.16. PIPES OR CONDUITS SHALL NOT BE PLACED WITHIN THE CONCRETE COVER TO REINFORCEMENT WITHOUT THE APPROVAL OF THE ENGINEER.

- C.17. ALL REINFORCING BARS SHALL COMPLY WITH AS 4671. ALL FABRIC SHALL COMPLY WITH AS 4671 AND SHALL BE SUPPLIED IN FLAT SHEETS.
- C.18. REINFORCEMENT SYMBOLS:
N - DENOTES GRADE D500 HIGH STRENGTH DEFORMED BARS TO AS 4671.
R - DENOTES GRADE R250 HOT ROLLED PLAIN BARS TO AS 4671.
SL - DENOTES HARD-DRAWN WIRE SQUARE REINFORCING FABRIC TO AS 4671.
RL - DENOTES HARD-DRAWN WIRE RECTANGULAR REINFORCING FABRIC TO AS 4671.
L - DENOTES HARD-DRAWN WIRE TRENCH MESH TO AS 4671.
THE NUMBER IMMEDIATELY FOLLOWING THESE SYMBOLS IS THE BAR DIAMETER IN MILLIMETRES.
- C.19. FABRIC/MESH REINFORCEMENT TO BE LAPPED ONE MESH PLUS 30mm. LAPS IN POSITIONS OF MAXIMUM MOMENT ARE NOT PERMITTED.
- C.20. ALL REINFORCEMENT SHALL BE FIRMLY SUPPORTED ON INSULATED STEEL, PLASTIC OR CONCRETE CHAIRS GENERALLY AT NOT GREATER THAN 800 CENTRES BOTH WAYS. RODS SHALL BE TIED AT ALTERNATE INTERSECTIONS.
- C.21. ALL TENSILE REINFORCEMENT TO BE LAPPED AS SHOWN IN TABLE BELOW:

REINFORCEMENT BAR	N12	N16	N20	N24
LAP LENGTH	400	600	700	800

STRUCTURAL STEELWORK NOTES:

- S.1. DESIGN CONFORMS TO THE FOLLOWING STANDARDS:
AS 4100 - STEEL STRUCTURES.
AS/NZS 4600 - COLD-FORMED STEEL STRUCTURES.
FABRICATION AND ERECTION SHALL BE IN ACCORDANCE WITH THE PROVISIONS OF AS 4100.
- S.2. ALL STEELWORK SHALL BE TEMPORARILY BUT SECURELY BRACED UNTIL ALL FINAL BRACING, CLADDING AND STABILISING BRICK OR BLOCKWORK HAVE BEEN COMPLETED, TO MAINTAIN THE STRUCTURE IN A SAFE AND STABLE CONDITION DURING CONSTRUCTION.
- S.3. BASE PLATES SHALL BE GROUTED BEFORE THE MEMBER IS SUBSTANTIALLY LOADED. GROUT SHALL HAVE A MINIMUM STRENGTH f_c OF 25 MPa AND SHALL BE DRY PACK MORTAR RAMMED IN, OR AN APPROVED NON-SHRINK GROUT.
- S.4. U.N.O. ALL MATERIAL SHALL BE:
GRADE 250 HOT-ROLLED PLATES COMPLYING WITH AS/NZS 3678.
GRADE 300 UB, UC, PFC, EA, UA, FLATS & ROUNDS COMPLYING WITH AS/NZS 3679.1.
GRADE 300 WB, WC COMPLYING WITH AS/NZS 3679.2.
GRADE C350 CHS COMPLYING WITH AS 1163.
GRADE C450 RHS, SHS COMPLYING WITH AS 1163.
- S.5. WELDING SHALL BE IN ACCORDANCE WITH THE PROVISIONS OF AS/NZS 1554.1. WELDING CONSUMABLES SHALL BE GRADE E48XX OR W50X U.N.O. ALL WELDS SHALL BE 6mm CFW SP CATEGORY U.N.O. ALL BUTT WELDS SHALL BE SP CATEGORY U.N.O. INSPECTION IS REQUIRED IN ACCORDANCE WITH AS/NZS 1554.1. ALL GP / SP WELDS SHALL BE 100% VISUALLY SCANNED. SP FILLET WELDS SHALL HAVE 10% VISUAL EXAMINATION U.N.O SP BUTT WELDS SHALL HAVE 50% VISUAL EXAMINATION U.N.O. ALL GP WELDS SHALL HAVE 10% VISUAL EXAMINATION.
- S.6. BOLTS SHALL BE M16 DIAMETER U.N.O. BOLT CATEGORY IS TO BE 8.8/S COMPLYING WITH AS 4100, AS/NZS 1252 & AS/NZS 4291.1. U.N.O. PROVIDE DESIGN ENGINEER WITH EVIDENCE OF COMPLIANCE WITH THESE CODES. HOLDING DOWN BOLTS SHALL BE CATEGORY 4.6/S U.N.O. THREADS MAY BE INCLUDED IN THE SHEAR PLANES U.N.O. ALL BOLTS, NUTS AND WASHERS SHALL BE HOT DIP GALVANISED. BOLTS DENOTED 4.6/S ARE COMMERCIAL BOLTS OF STRENGTH GRADE 4.6 TO AS 1111 SNUG TIGHT.

- BOLTS DENOTED 8.8/S, 8.8/TB AND 8.8/TF ARE HIGH STRENGTH STRUCTURAL BOLTS OF STRENGTH GRADE 8.8 TO AS/NZS 1252 & AS/NZS 4291.1.
8.8/S DENOTES BOLTS SNUG TIGHT.
8.8/TB DENOTES BOLTS FULLY TENSIONED IN BEARING, TO AS 4100.
8.8/TF DENOTES BOLTS FULLY TENSIONED IN FRICTION, TO AS 4100 - MATING SURFACES MUST NOT BE PAINTED.
- S.7. ALL DETAILS, GAUGE LINES ETC. (WHERE NOT SPECIFICALLY SHOWN) ARE TO BE IN ACCORDANCE WITH AISC PUBLICATIONS "DESIGN CAPACITY TABLES FOR STRUCTURAL STEEL" AND "STANDARDISED STRUCTURAL CONNECTIONS". PLATES ARE TO BE 10mm THICK, CUT FROM STANDARD FLAT BARS U.N.O. ENDS OF HOLLOW SECTIONS SHALL BE SEALED WITH NOMINAL THICKNESS PLATES AND CONTINUOUSLY WELDED TO SEAL ENDS, UNO.
- S.8. THE STEEL FABRICATOR SHALL PROVIDE THE ENGINEER WITH 1 COPY OF WORKSHOP DRAWINGS FOR INSPECTION AT LEAST 7 DAYS BEFORE FABRICATION IS STARTED. STEELWORK IS NOT TO BE FABRICATED UNTIL WORKSHOP DRAWINGS ARE APPROVED.
- S.9. ALL DIMENSIONS ARE MILLIMETRES U.N.O.
- S.10. CORROSION PROTECTION
- S.10.1. INTERNAL STEELWORK (ENCLOSED)
- S.10.1.1. THE STEELWORK SHALL BE CLEANED TO AS 1627 CLASS 1 AND GIVEN ONE COAT OF ALKYD PRIMER TO GIVE A DRY FILM THICKNESS OF 50 MICRONS BEFORE DISPATCH TO SITE, UNLESS THE STEEL IS TO BE ENCASED IN CONCRETE OR IS DETAILED OTHERWISE. APPLY ONE FINISH COAT OF ALL WEATHER GLOSS ACRYLIC PAINT.
- S.10.2. EXTERNAL STEELWORK (UNENCLOSED)
- S.10.2.1. ALL STRUCTURAL STEELWORK WHICH IS EXPOSED OR IN CONTACT WITH EXPOSED BRICKWORK, AND ALL LINTELS, SHALL BE HOT DIP GALVANISED AFTER FABRICATION. STEELWORK GALVANISED AFTER FABRICATION SHALL COMPLY WITH AS/NZS 4680.
- S.10.2.2. AS AN ALTERNATIVE TO GALVANISING, ALL STRUCTURAL STEELWORK WHICH IS EXPOSED SHALL BE CLEANED TO AS 1627 CLASS 2 1/2 PREPARATION AND GIVEN A COAT OF INORGANIC ZINC SILICATE TO GIVE A DRY FILM THICKNESS OF 75 MICRONS BEFORE DISPATCH TO THE SITE, UNLESS THE STEEL IS TO BE ENCASED IN CONCRETE OR IS DETAILED OTHERWISE.
- S.10.2.3. REPAIR OF GALVANISED COATING AFTER WELDING PREPARATION - REMOVE ALL WELDING SCALE, SLAG & SHARP EDGES. POWER TOOL CLEAN TO AS 1627.2, CLASS 3, USING ABRASIVE WHEEL ON A POLISHER AT 3500RPM. DEGREASE & REMOVE ALL SURFACE CONTAMINANTS TO AS 1627.1.
- S.10.2.4. 'SEVERE' CORROSION ENVIRONMENT - APPLY 2 COATS OF 2-PACK EPOXY ZINC TO AS 3750.9, TO TOTAL 150um DFT, FOLLOWED BY 2 PACK EPOXY ENAMEL TO TOTAL 150um DFT.
- S.10.2.5. 'MODERATE' CORROSION ENVIRONMENT - APPLY A TOTAL OF 125um DFT OF DULUX METALSHIELD COLD GALV. PRIMER OR EQUIV IN 2 COATS, USING BRUSH OR SPRAY CAN.
- S.11. UNLESS NOTED OTHERWISE, PROTECTIVE COATINGS FOR STEELWORK SHALL BE AS TABULATED BELOW AND IN ACCORDANCE WITH VOL. 2 PART 3.4.4 OF THE NCC.

ENVIRONMENT (EXPOSURE CLASS AS PER AS 2312)	STRUCTURAL MEMBERS (NOT BUILT INTO MASONRY/CONCRETE)		LINTELS (BUILT INTO MASONRY OR CONCRETE)
	INTERNAL	EXTERNAL	
VERY LOW	R0	-	-
LOW	R0	R1	R2
MEDIUM	R0	R2	R3
HIGH	R1	R3	R4
VERY HIGH	R1	R4	R5
PROTECTIVE COATING SPECIFICATION TO AS 2699.3			

TIMBER NOTES:

- T.1. MANUFACTURED TIMBER ELEMENTS (e.g. LVL) EXPOSED TO WEATHERING SHALL BE L.O.S.P. TREATED TO H3 LEVEL. WHERE EXPOSED TO DIRECT SUN, FURTHER PROTECTION WITH A GOOD QUALITY PAINT SYSTEM IS REQUIRED.
- T.2. ALL WORK IN STRUCTURAL TIMBER TO BE IN ACCORDANCE WITH THE CURRENT EDITION OF AS 1684, SAA TIMBER FRAMING CODE AS 1720, SAA TIMBER ENGINEERING CODE AS 1320 - GLUED LAMINATED STRUCTURAL TIMBER
- T.3. BOLTS: ALL NUTS & BOLTS TO BE PROVIDED WITH WASHERS. ALL BOLTS TO BE TIGHTENED FINALLY BEFORE HANDOVER. BOLT HOLES TO BE 2mm OVERSIZE IN UNSEASONED TIMBER.
- T.4. UNLESS DETAILED OTHERWISE TIMBER MEMBERS TO BE FIXED WITH NOMINAL NAILING AS SPECIFIED IN AS 1684
- T.5. SIZES AND DETAILS NOT SHOWN SHALL COMPLY WITH AS 1684 ALL OPENINGS TO BE FULLY FLASHED WITH STD GALVANISED SHEET STEEL FLASHING.
- T.6. ALL BOLTS TO HAVE MILD STEEL GALVANISED WASHERS :
BOLTS UP TO 12mm DIA - 50x50x3 WASHERS
BOLTS UP TO 20mm DIA - 65x65x5 WASHERS


ROOF TRUSS NOTES:

- RT.1. THE BASIS OF DESIGN SHALL BE SAA LOADING CODE AS 1170.1; AS 1170.2 & SAA TIMBER STRUCTURE CODE AS 1720.1.
- RT.2. DESIGN THE ROOF TRUSSES AS PER THE WIND CLASSIFICATION AS SPECIFIED.
- RT.3. IN ADDITION TO THE NOMINATED PERMANENT BRACING, PROVIDE ANY ADDITIONAL PERMANENT BRACING REQUIRED FOR STRUCTURAL SUFFICIENCY OF THE TRUSS SYSTEM.
- RT.4. PROVIDE ANY TEMPORARY BRACING REQUIRED TO MAINTAIN THE STABILITY OF THE TRUSSES AT ALL STAGES OF ERECTION.
- RT.5. MAKE ALLOWANCES FOR SIZE AND LOCATION OF MECHANICAL SERVICES/AIRCONDITIONING DUCTWORK IF APPLICABLE.
- RT.6. SPAN TRUSSES ONLY BETWEEN THE NOMINATED SUPPORTS AND HOLDING DOWN POSITIONS INDICATED.
- RT.7. PROVIDE CERTIFICATION FROM A STRUCTURAL ENGINEER, AS DEFINED IN THE QUEENSLAND BUILDING BY-LAWS, THAT THE ROOF TRUSSES ARE STRUCTURALLY SUFFICIENT.

CLAY MASONRY NOTES:

- CM.1. DESIGN CONFORMS TO AS 3700 - MASONRY STRUCTURES. CONSTRUCT IN ACCORDANCE WITH THE PROVISIONS OF AS 3700. STRENGTH, f_{uc} = 12 MPa
SALT RESISTANCE GRADE = TO AS 3700
- CM.2. MORTAR TYPE = TO AS 3700
NOMINAL THICKNESS = 10mm
- CM.3. CORE-FILLING GROUT TO BRICK PIERS = 20 MPa.
- CM.4. WALL TIES TYPE = MEDIUM DUTY
DURABILITY CLASSIFICATION = TO AS 3700
FIXING = MIN. EMBEDMENT IN MORTAR 50mm. FACE FIXED VENEER TIES TO BE SCREW FIXED.
- CM.5. JOINTS TO BE TOOLED. CONTROL JOINTS TO BE PROVIDED AS PER FOUNDATION DESIGN ENGINEERING REPORT.

A

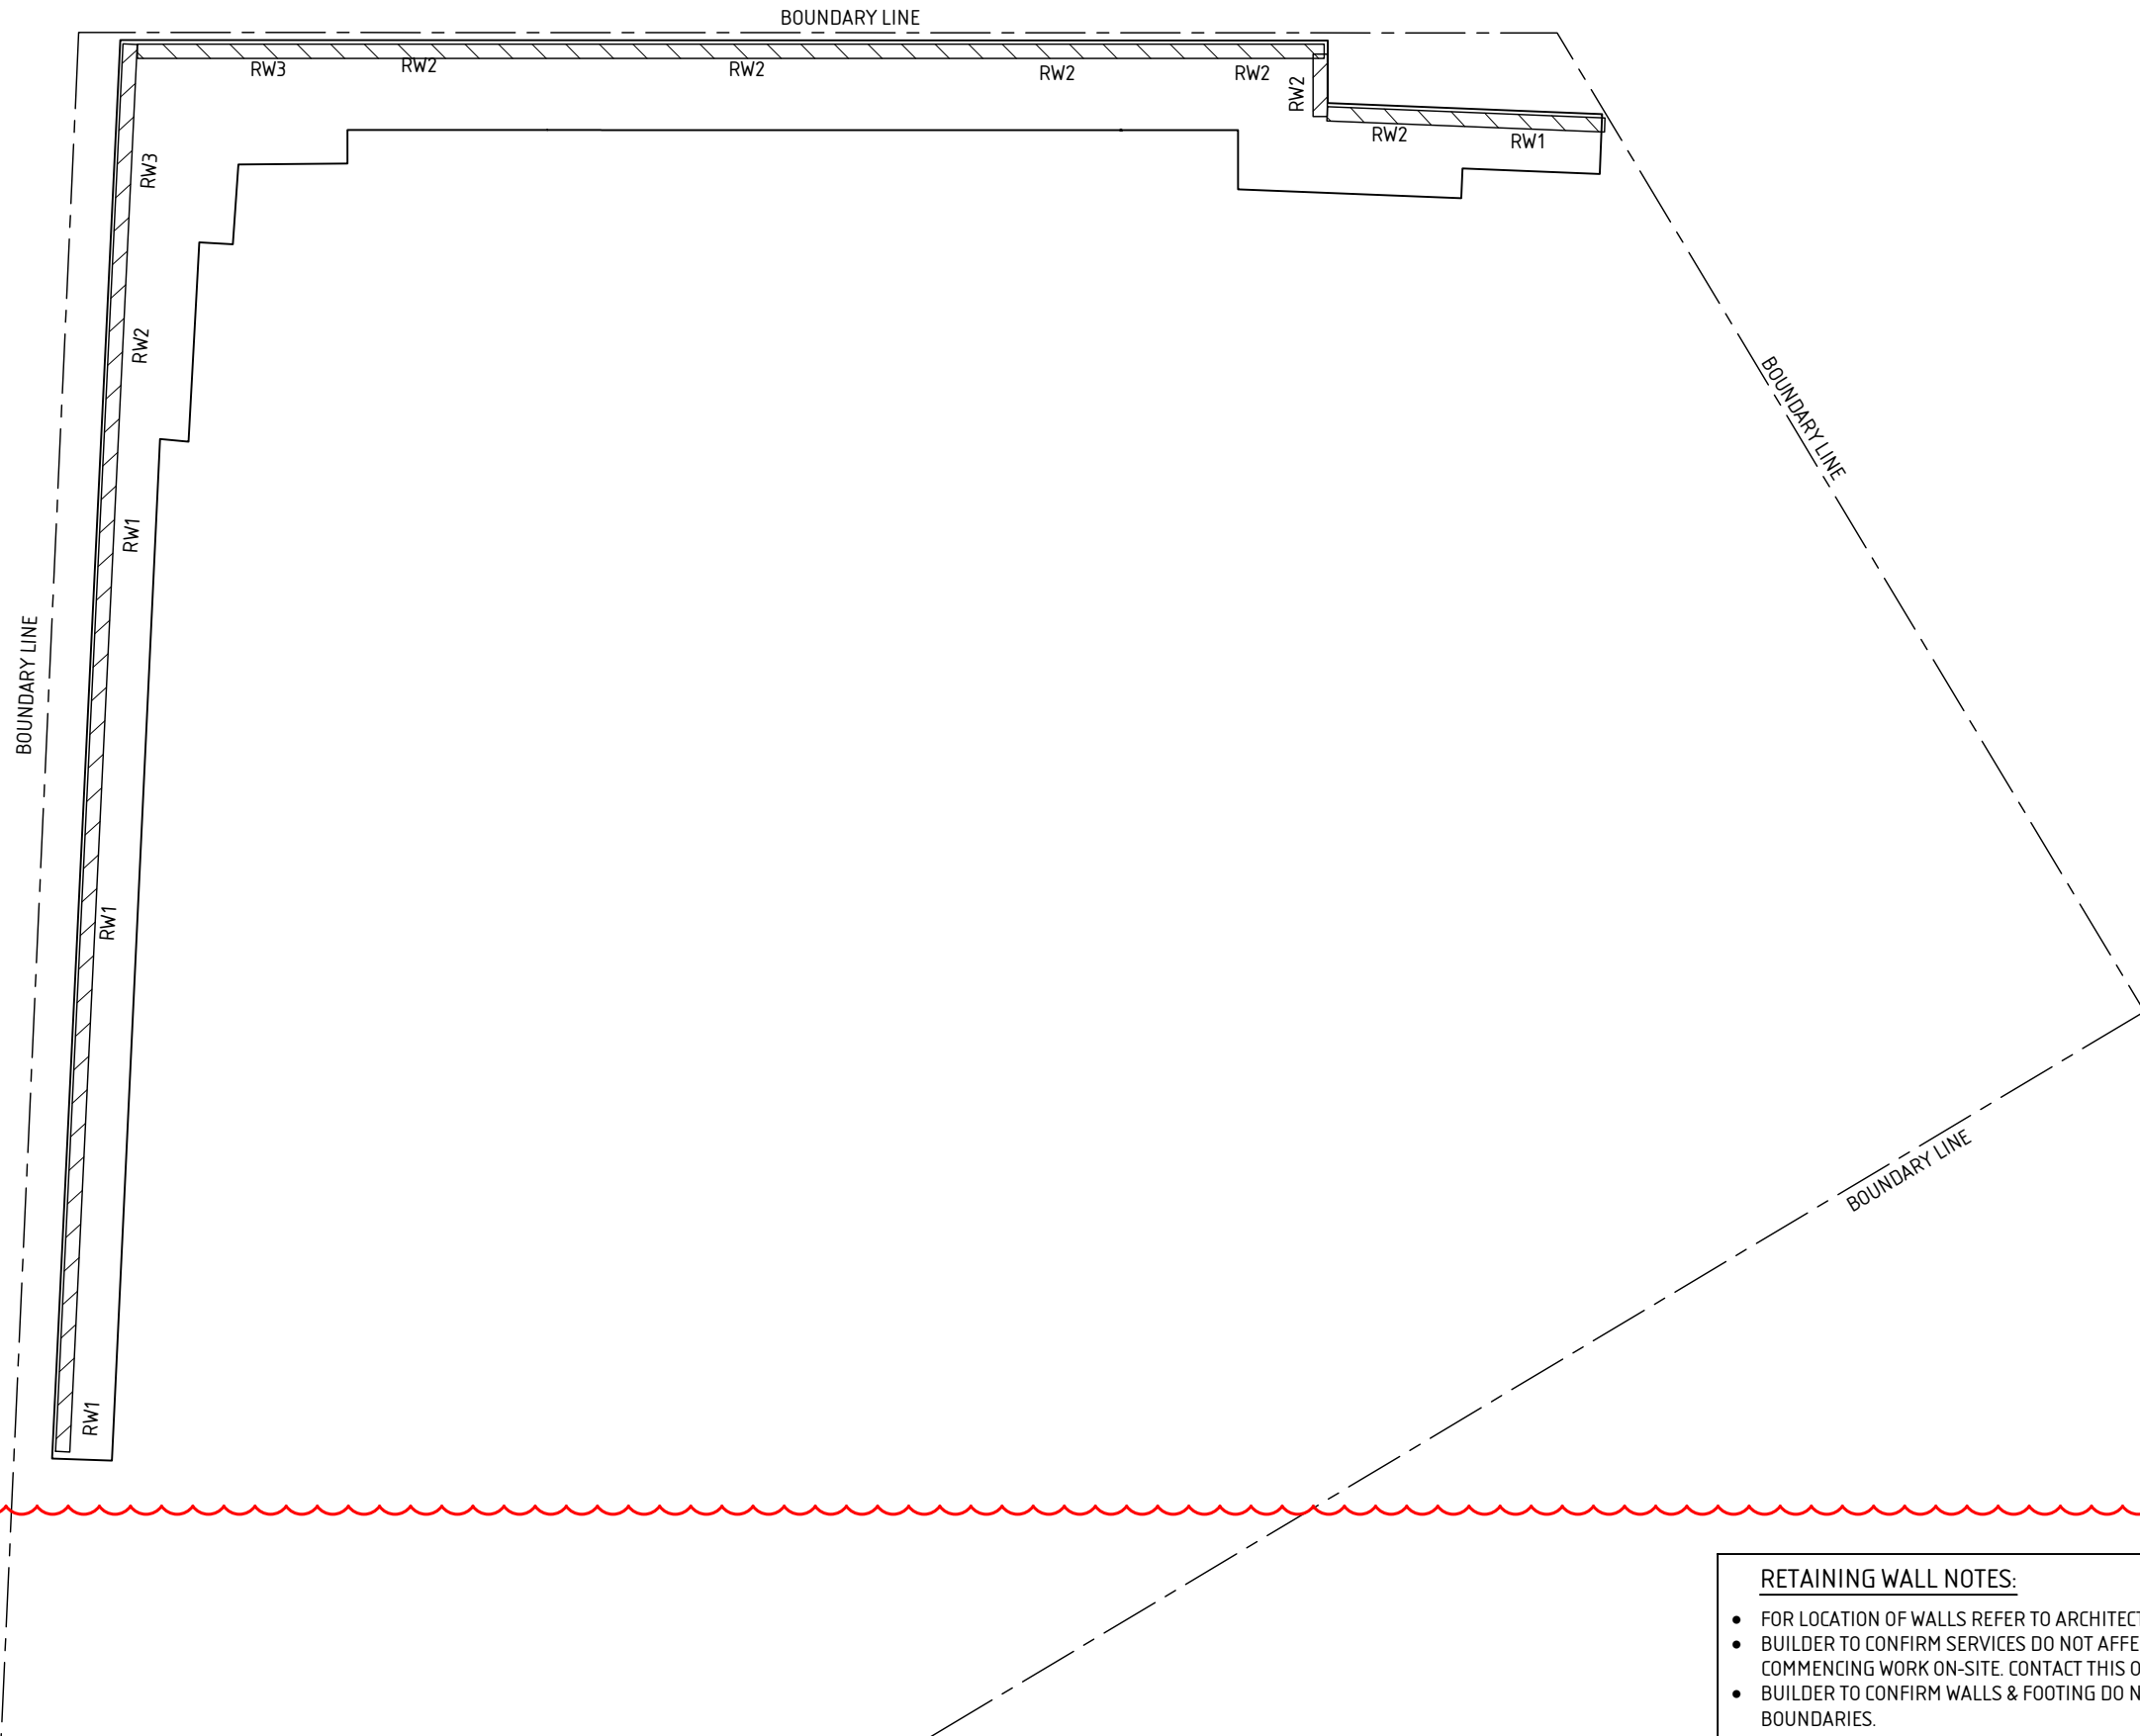

GEOTECHNICAL INFORMATION		
SOIL CLASSIFICATION:	P	(DESIGN M)
SOIL TEST REFERENCE:	2.22.2461.1	
DATE:	24/02/22	

- RETAINING WALL NOTES:**
- FOR LOCATION OF WALLS REFER TO ARCHITECTURAL PLANS.
 - BUILDER TO CONFIRM SERVICES DO NOT AFFECT STRUCTURE BEFORE COMMENCING WORK ON-SITE. CONTACT THIS OFFICE IF OTHERWISE.
 - BUILDER TO CONFIRM WALLS & FOOTING DO NOT ENCROACH OVER SITE BOUNDARIES.

NOTE:
REINFORCING STARTER BARS TO BE INSPECTED BY AN ENGINEER FROM THIS OFFICE PRIOR TO INSTALLATION OF BLOCK WALL.

APPROVED
GERVASE PURICH
CIVIL ENGINEER
FIEAust. CPEng, NER, BPB, RBP, RPEQ No. 11656

CLIENT
ANDREW IEMMA

CLIENT REFERENCE. No.

SHEET
RETAINING WALL PLANS

SCALE - 1:100 @ A3


PROJECT ADDRESS
LOT 7 NO. 10 COURTLEY ROAD,
BEACON HILL. NSW


TEL (02) 9475 3000 FAX (02) 9646 2311 EMAIL: sydney@strucerre.com.au

REVISION	A	PROJECT NO.	3.22.5264.2
DATE	01/06/22	SHEET NO.	S-101




NOTE: RETAINING WALL HAS BEEN DESIGNED TO ALLOW FOR EITHER 5kPa SURCHARGE OR A 20° BATTER.

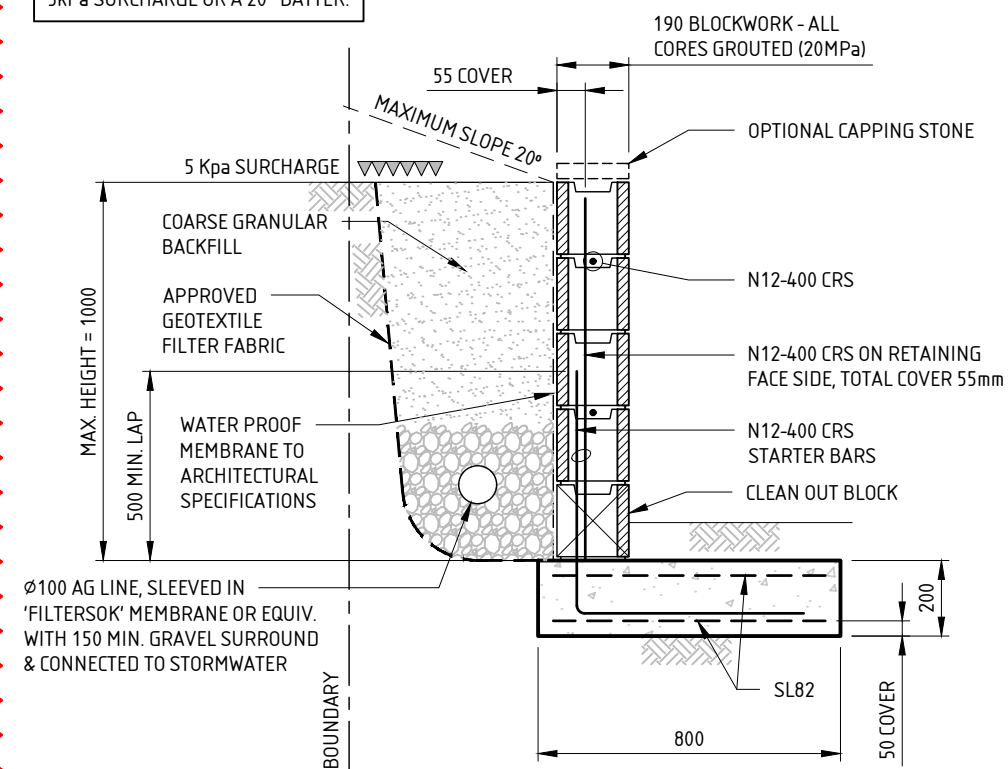


MAX. 1000mm TYPICAL RETAINING WALL DETAIL (RW1)

NOTE: RETAINING WALL HAS BEEN DESIGNED TO ALLOW FOR EITHER 5kPa SURCHARGE OR A 20° BATTER.

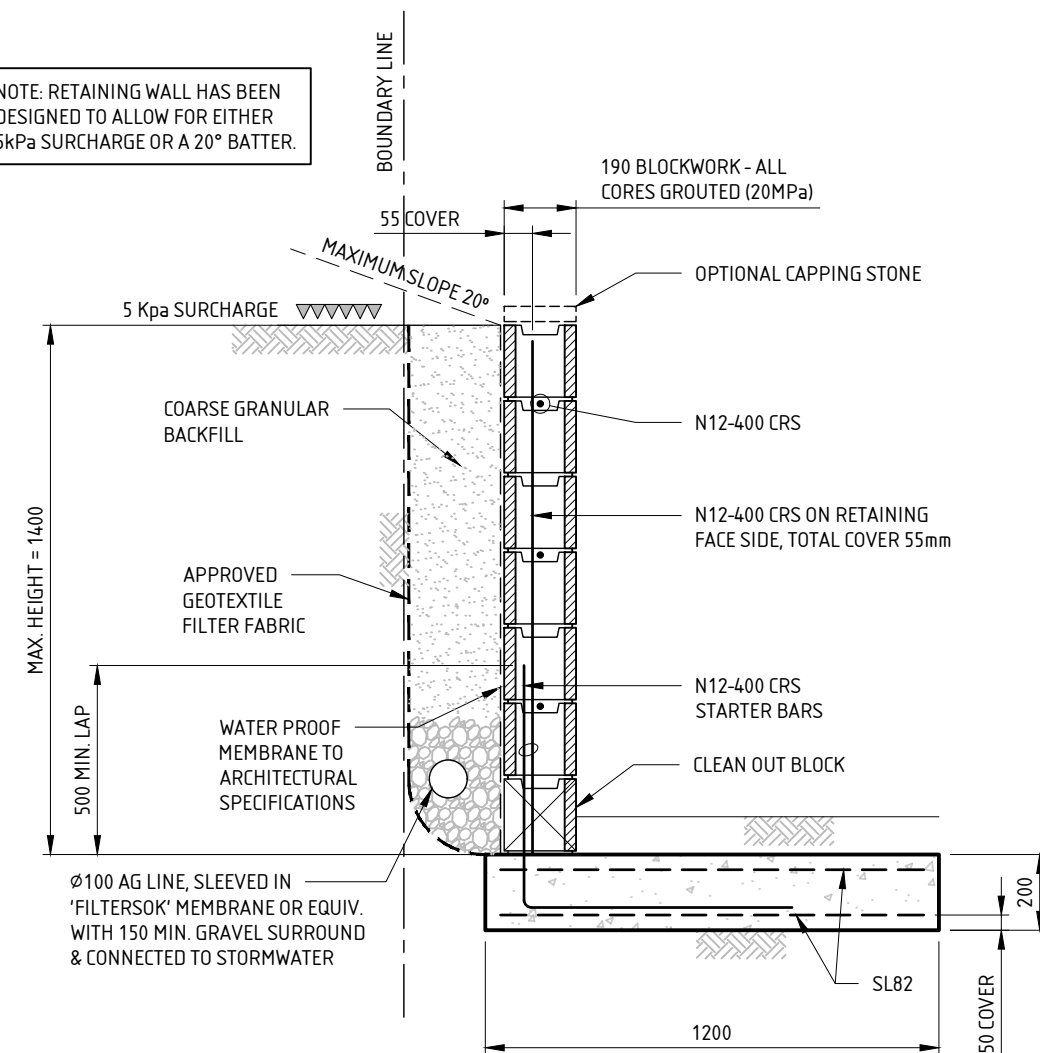

MAX. 1400mm TYPICAL RETAINING WALL DETAIL (RW2)

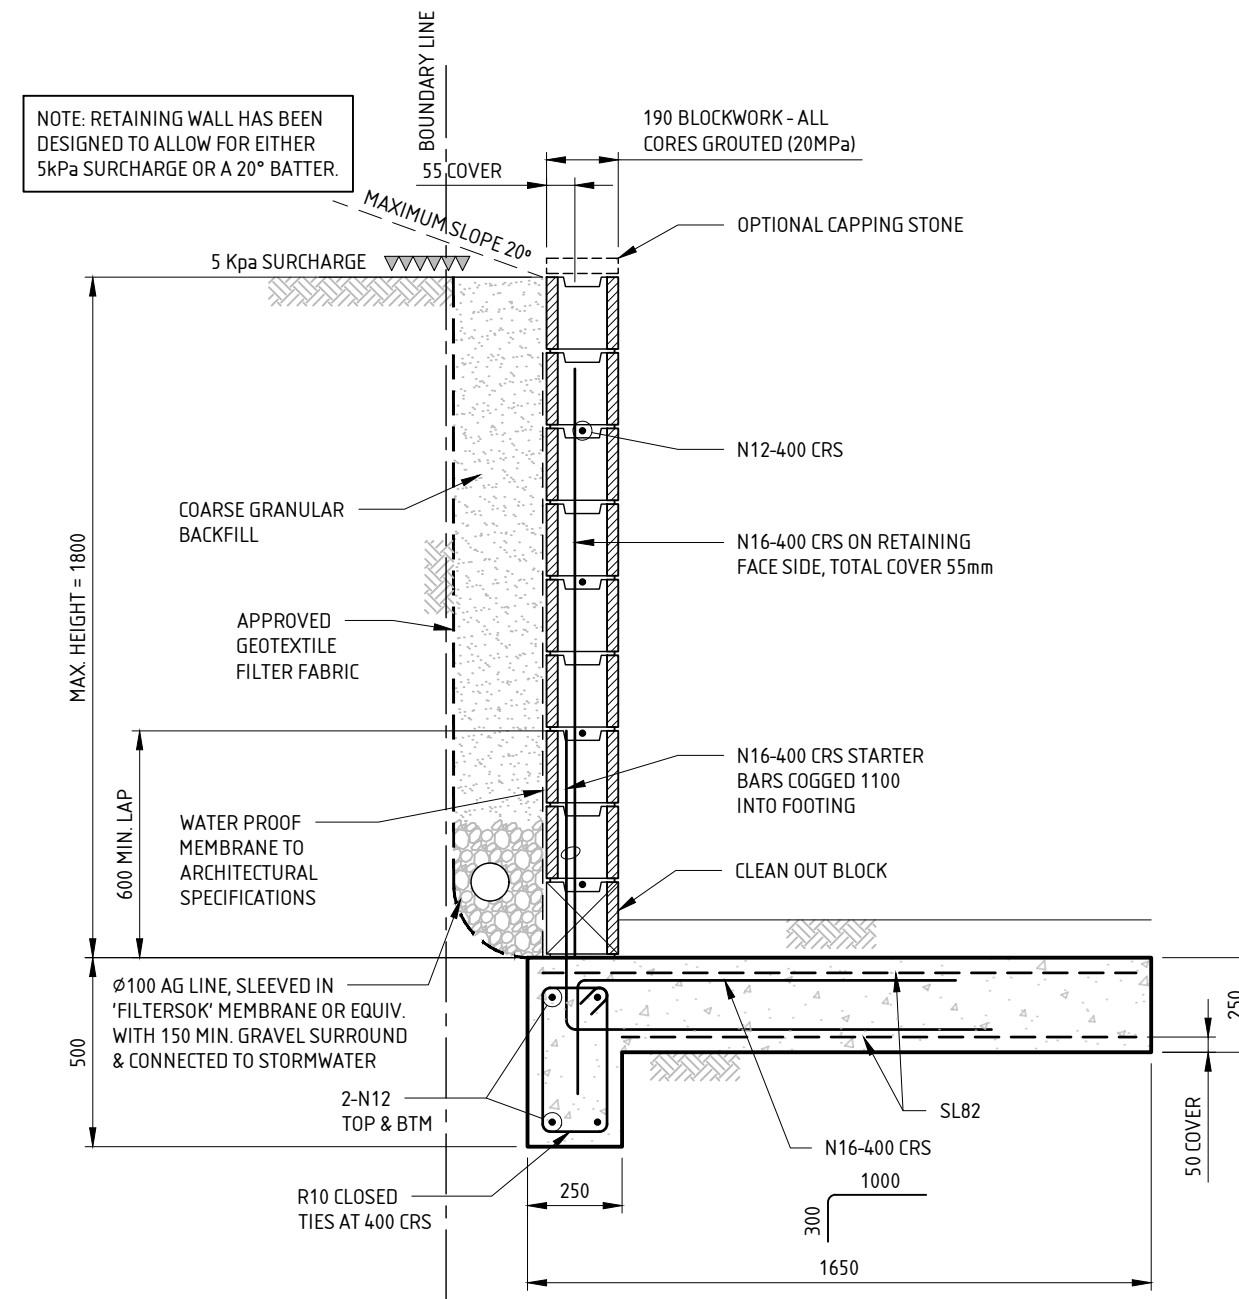


MAX. 1800mm TYPICAL
RETAINING WALL DETAIL (RW3)

BRICKWORK & BLOCKWORK

- B.1 ALL WORKMANSHIP AND MATERIALS SHALL BE IN ACCORDANCE WITH AS3700.
- B.2 STRENGTH OF BRICKS, CLASS OF BLOCKS AND TYPE OF MORTAR SHALL BE AS TABULATED, AND SHALL BE VERIFIED BY TESTS ACCORDING TO RELEVANT STANDARDS.


ELEMENT	MATERIAL	CHARACTERISTIC UNCONFINED COMPRESSIVE STRENGTH (f'_{uc})	MORTAR TYPE
WALL	BURNT CLAY	12MPa	1:1:6
WALL	CONC. BLOCK	15MPa	1:1:6

- B.3 BRICKWORK OR BLOCKWORK SUPPORTING CONCRETE OR STEEL MEMBERS SHALL BE TROWELLED SMOOTH AND SEPARATED AT THE BEARING SURFACE BY APPROVED JOINTING MATERIAL.
- B.4 BRICKWORK AND BLOCKWORK TO BE TIED TO COLUMNS, FLOOR SLABS AND BEAMS.
- B.5 CORES SHALL BE FILLED WITH CONCRETE OF STRENGTH $f'_{c} = 20\text{MPa}$. 10mm MAX. AGGREGATE SIZE AND A MAXIMUM SLUMP OF 225mm.
- B.6 CLEAN OUT OPENINGS ARE REQUIRED AT THE BASE OF ALL REINFORCED WALLS AND ABOVE HORIZONTAL CONSTRUCTION JOINTS.
- B.7 PROVIDE SEALED CONTROL JOINTS @ 8.0m CTRS MAX. ALL BRICKWORK SUPPORTING OR SUPPORTED BY CONCRETE FLOORS SHALL BE PROVIDED WITH VERTICAL JOINTS TO MATCH ANY CONTROL JOINTS IN THE CONCRETE.
- B.8 ALL BLOCKS SHALL BE DRY WHEN LAID. FACE SHELLS AND CROSS WEBS SHALL BE FULLY BEDDED.
- B.9 REINFORCEMENT PROJECTING FROM FOUNDATIONS OR SLABS INTO CORES SHALL BE SET ACCURATELY IN PLACE USING TEMPLATES TO ALIGN WITH THE CENTRE OF THE LENGTH OF CORES AND WITH COVER AS NOTED. COVER SHALL BE MEASURED FROM THE INNER FACE OF THE BLOCK U.N.O. AND SHALL BE SUCH THAT GROUT MAY BE SOLIDLY COMPACTED BETWEEN THE BAR AND THE SHELL. WHERE HORIZONTAL BARS ARE INDICATED, THE WEBS OF THE BLOCKS BELOW THE BARS SHALL BE CUT DOWN TO ACCOMMODATE THE BARS.
- B.10 CORES SHALL BE GROUTED WHERE INDICATED OR NOTED. GROUTING SHALL TAKE PLACE AT INTERVALS OF NOT MORE THAN 2400mm. GROUT SHALL BE PLACED IN LIFTS OF 1200mm AND COMPACTED BY POKER VIBRATOR. A SHORT TIME SHOULD ELAPSE BETWEEN SUCCESSIVE LIFTS TO ALLOW PLASTIC SETTLEMENT TO OCCUR.
- B.11 REINFORCED BLOCKWORK RETAINING WALLS SHALL NOT BE BACKFILLED UNTIL 14 DAYS AFTER THE WALL HAS BEEN GROUTED, OR IF APPLICABLE, UNTIL AFTER THE RETAINING SLAB OVER HAS BEEN POURED AND CURED FOR 7 DAYS. BACKFILL TO RETAINING WALLS TO BE FREE DRAINING GRANULAR MATERIAL PROVIDE SUBSOIL DRAIN OR WEEP HOLES.
- B.12 BRICKWORK SUPPORTING SLABS AND BEAMS SHALL HAVE GALVANISED SLIDING JOINT STRIPS COMPRISING 2 GALVANISED STRIPS WITH GRAPHITE GREASE BETWEEN THEM ('SWAN' JOINT STRIPS OR EQUIVALENT)
- B.13 NO MASONRY WALLS ARE TO BE ERECTED ON SUSPENDED SLABS OR BEAMS UNTIL ALL PROPPING HAS BEEN APPROVED.
- B.14 BUILDER TO PROVIDE TEMPORARY PROPPING TO ALL WALLS WHERE REQUIRED FOR STABILITY DURING CONSTRUCTION.
- B.15 NO CHASES OR RECESSES ARE PERMITTED IN LOAD BEARING MASONRY WITHOUT THE APPROVAL OF THE ENGINEER.

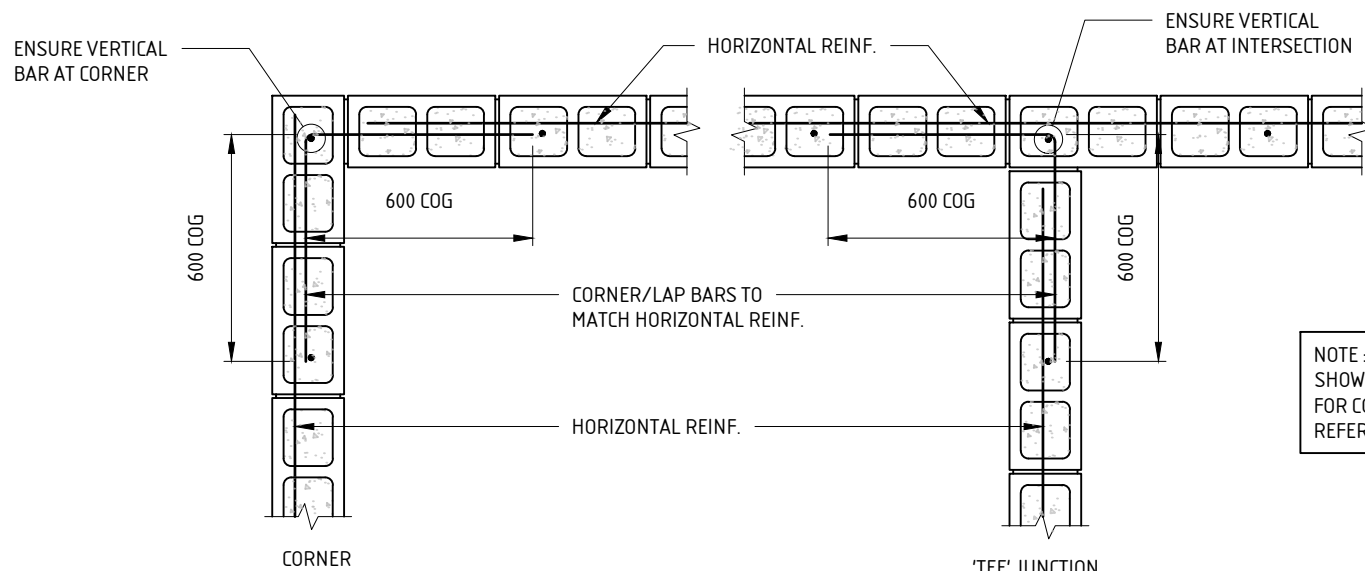


WALL INTERSECTIONS

NOTE : WALL VERTICAL BARS ARE SHOWN DIAGRAMMATICALLY ONLY. FOR CORRECT SPACING AND LOCATION REFER DETAILS ELSEWHERE.

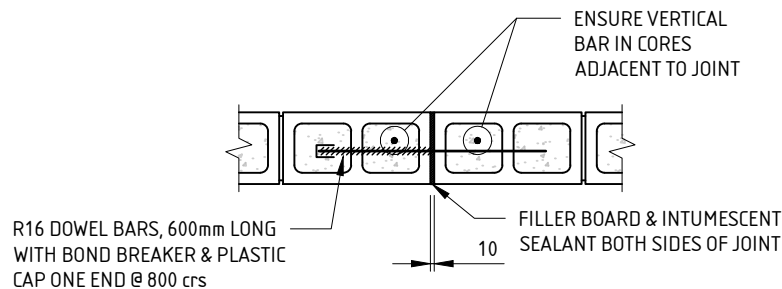





BLOCKWORK WALL CONTROL JOINT DETAIL

PROVIDE SEALED CONTROL JOINTS @ 8.0m CTRS MAX. ALL BLOCKWORK SUPPORTING OR SUPPORTED BY CONCRETE FLOORS SHALL BE PROVIDED WITH VERTICAL JOINTS TO MATCH ANY CONTROL JOINTS IN THE CONCRETE.

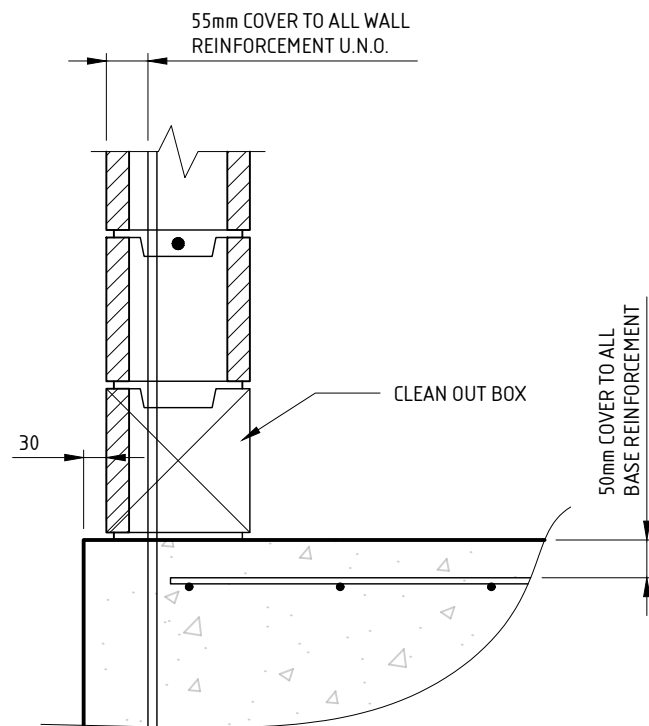

TYPICAL DETAIL

SCALE 1:10

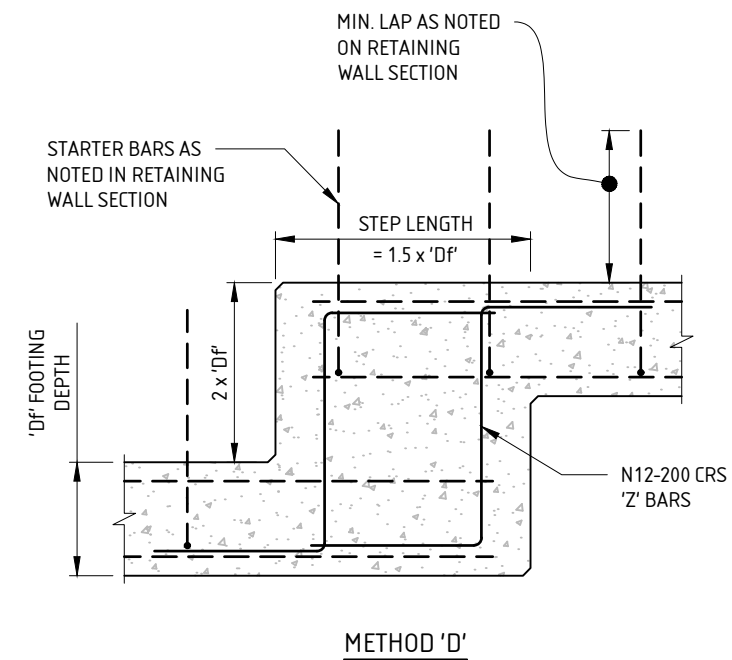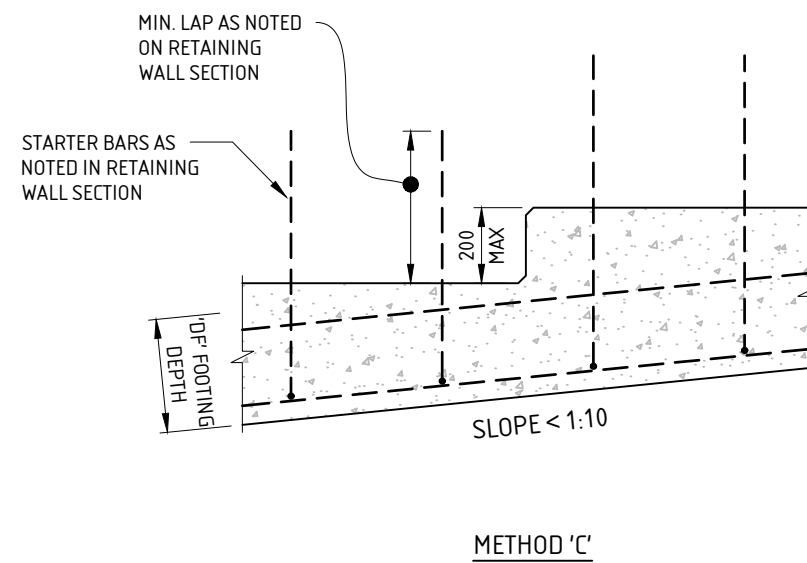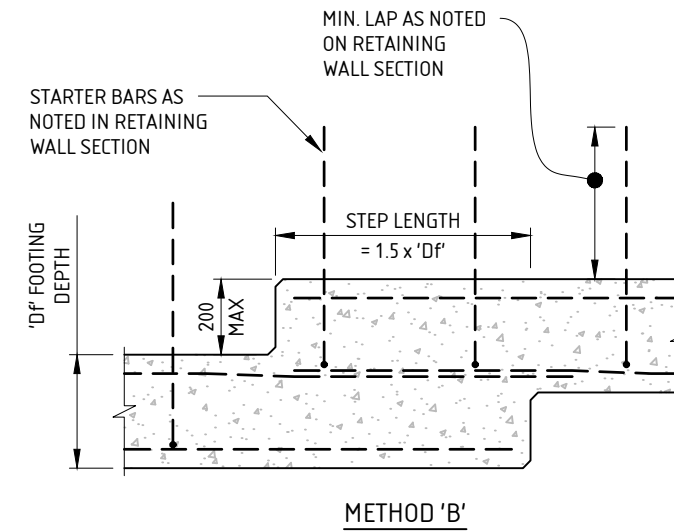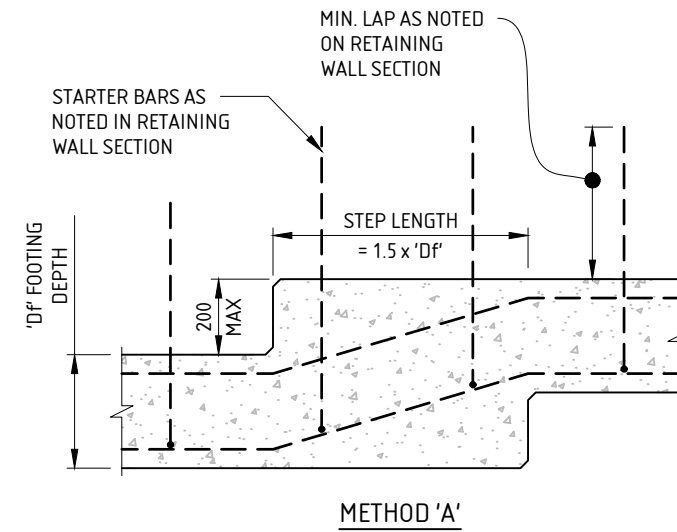

METHODS FOR STEPPING RETAINING WALL FOOTINGS (ELEVATION)

BEND REINFORCEMENT ON SITE TO MAINTAIN COVER
(FOR FOOTING REINFORCEMENT & DEPTH REFER TO RETAINING WALL DETAILS)