


DEVELOPMENT APPLICATION

ALTERATIONS AND ADDITIONS

323 McCARRS CREEK ROAD, TERRY HILLS


SHEET LIST		
SHEET NUMBER	SHEET NAME	Current Revision
A020	NOTES & SCHEDULES	G
A021	BASIC COMMITMENTS	G
A022	APPROVAL KEY PLAN	G
A030	LOT PLAN	G
A050	SITE PLAN & SITE ANALYSIS	G
A051	SHADOW STUDY	G
A052	AREA PLANS	G
A053	GROSS FLOOR AREA	G
A150	FLOOR PLAN_ GF	G
A151	FLOOR PLAN_ FF	G
A450	NEW EXTERIOR ELEVATIONS	G
A500	GENERAL SECTIONS	G
A800	DOORS & WINDOWS SCHEDULE	G
A901	PERSPECTIVES	G

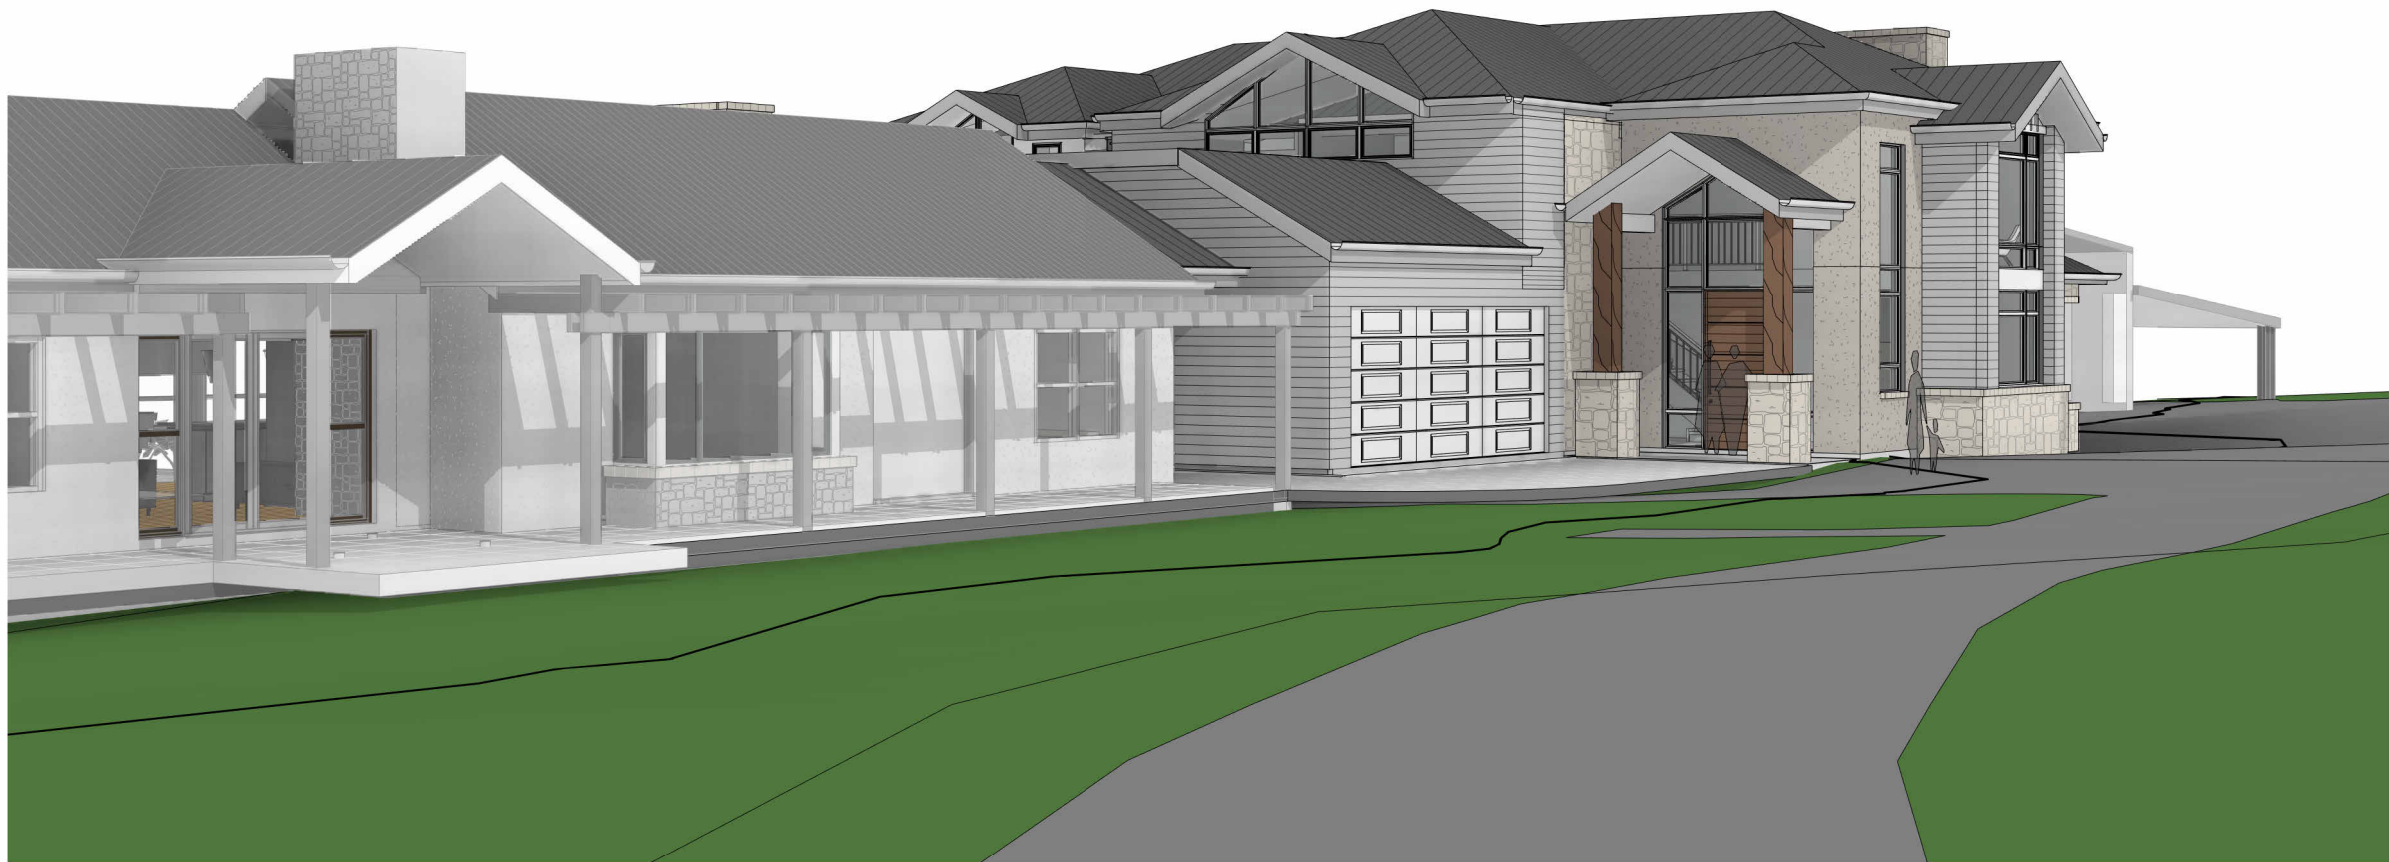


REFER TO APPROVED DA2021/2228
MODIFIED CC2023/0875

BUSHFIRE ATTACK LEVEL (BAL-FZ)
AS3959-2018 CONSTRUCTION OF BUILDINGS IN BUSHFIRE PRONE AREAS IS TO APPLY TO THIS DEVELOPMENT

EXTERNAL WALLS

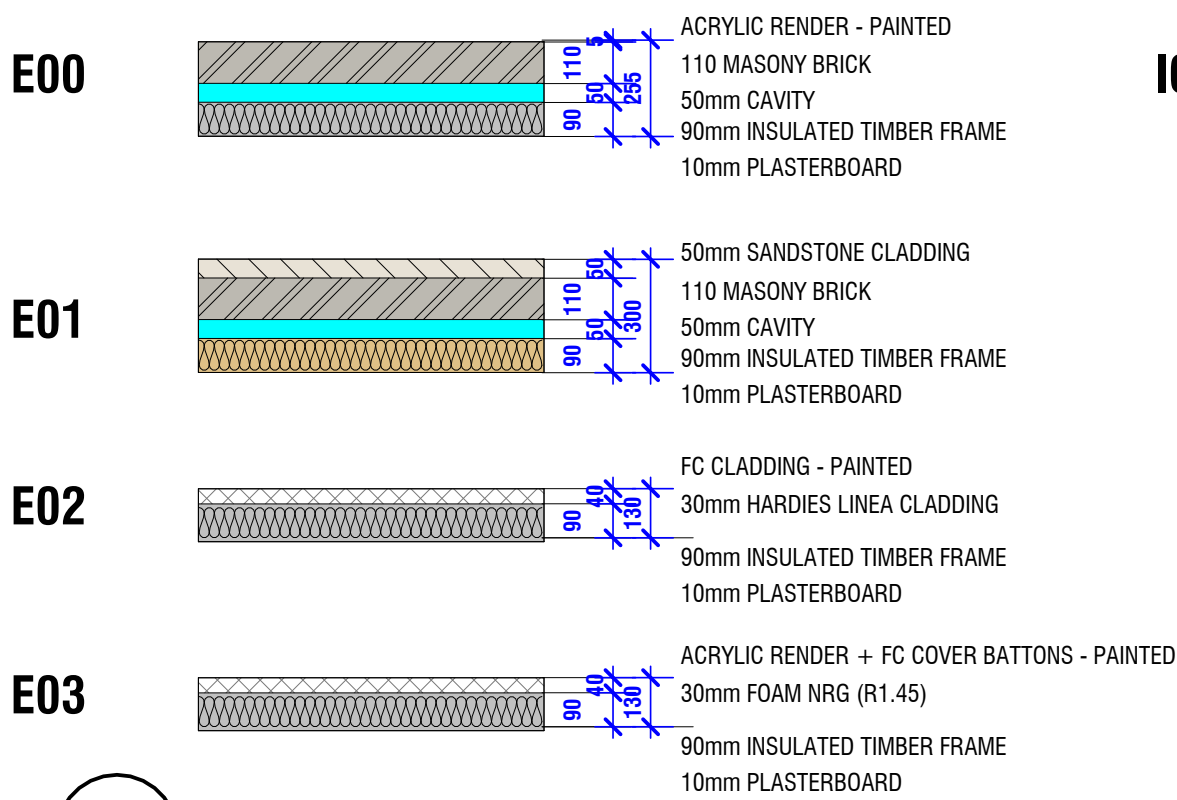


WALL TYPES
1 : 20

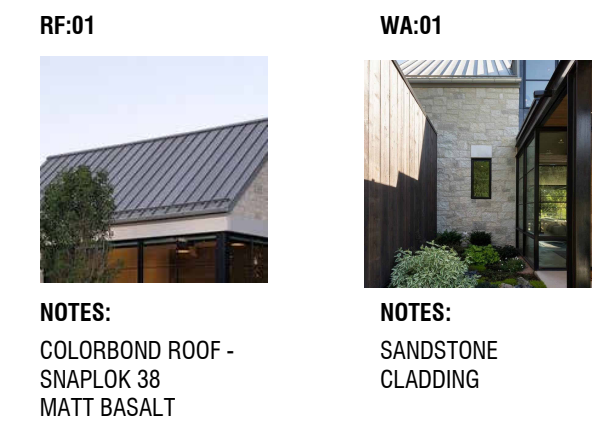



PROPOSED MATERIALS
1 : 20

INTERNAL WALLS

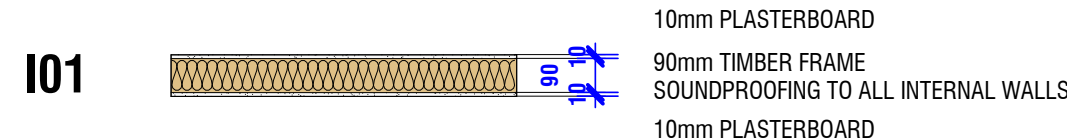


FLOOR / ROOF TYPES
1 : 20

FLOORS

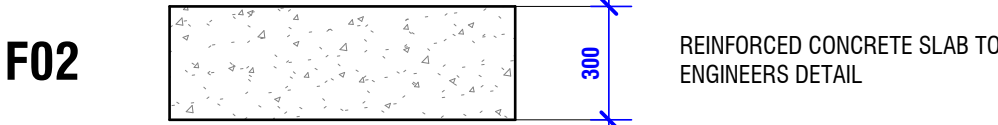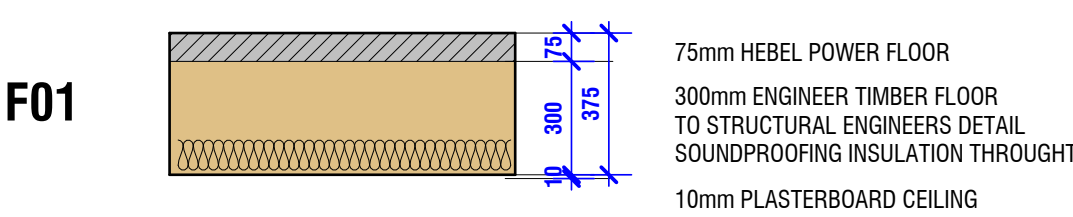

ROOF

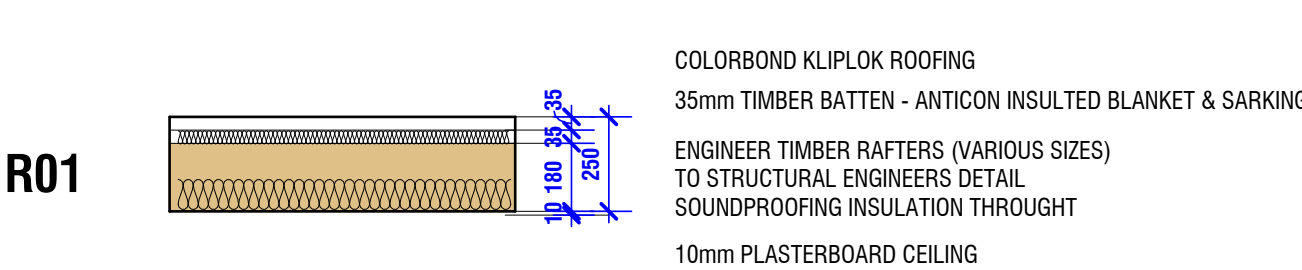

FLOOR / ROOF TYPES
1 : 20

DESIGNERS WORK HEALTH AND SAFETY STATEMENT

- FALLS, SLIPS, TRIPS & WORKING AT HEIGHT DURING CONSTRUCTION**
Wherever possible, components for this building should be prefabricated off-site or at ground level to minimise the risk of workers falling more than two metres. However, construction of this building will require workers to be working at heights where a fall in excess of two metres is possible and injury is likely to result from such a fall. The builder should provide a suitable barrier wherever a person is required to work in a situation where falling more than two metres is a possibility.
DURING OPERATION OR MAINTENANCE
For houses or other low-rise buildings where scaffolding is appropriate.
Cleaning and maintenance of windows, walls, roof or other components of this building will require persons to be situated where a fall from height in excess of two metres is possible. Where the type of activity is required, scaffolding, fall barriers or Personal Protective Equipment (PPE) should be used in accordance with relevant codes of practice, regulations or legislation.
FLOOR FINISHES BY OWNER
As the designer has not been involved in the selection of surface finishes, the owner is responsible for the selection of surface finishes in the pedestrian trafficked areas of this building. Surfaces should be selected in accordance with AS HB 197:1999 and AS/NZS 4489:2004.
STEPS, LOOSE OBJECTS AND UNEVEN SURFACES
Due to design restrictions for this building, steps and/or ramps are included in the building which may be a hazard to workers carrying objects or otherwise occupied. Steps should be clearly marked with both visual and tactile warnings during construction, maintenance, demolition and at all times where the building operates as a workplace.
Building owners and occupiers should monitor the pedestrian access ways and in particular access to areas where maintenance is routinely carried out to ensure that surfaces have not moved or cracked so that they become uneven and present a trip hazard. Spills, loose material, stray objects or any other matter that may cause a slip or trip hazard should be cleaned or removed from access ways.
Contractors should be required to maintain a tidy work site during construction, maintenance or demolition to reduce the risk of trips and falls in the workplace. Materials for construction or maintenance should be stored in designated areas away from access ways and work.
- LOOSE MATERIAL AND SMALL OBJECTS**
Construction, maintenance or demolition work on or around this building is likely to involve persons working above ground level or above roof levels. Where this occurs one or more of the following measures should be taken to avoid objects falling from the area where the work is being carried out onto persons below:
 - Prevent or restrict access to areas below where the work is being carried out.
 - Provide toeboards to scaffolding or work platforms.
 - Provide protective structure below the work area.
 - Ensure that all persons below the work area have protective equipment PPE.
- BUILDING COMPONENTS**
During construction renovations or demolition of this building, parts of the structure including fabricated steel work, heavy panels and many other components will remain standing prior to or after supporting parts are in place. Contractors should ensure that temporary bracing or other required support is in place at all times where collapse, which may injure persons in the area, is a possibility.
Mechanical lifting of materials and components during construction, maintenance or demolition presents a risk of falling objects. Contractors should ensure that appropriate lifting devices are used, that loads are properly secured and the capacity to resist below the load is maintained or exceeded.
- TRAFFIC MANAGEMENT**
For building on major road, narrow road or already sloping road.
Parking of vehicles or loading/unloading of vehicles on this roadway may cause a traffic hazard. During construction, maintenance or demolition of this building designated parking for workers and loading areas should be provided. Trained traffic management personnel should be responsible for the supervision of these areas.
For building where roads loading/unloading is restricted.
Construction of this building will require loading and unloading of materials on the roadway. Deliveries should be well planned to avoid congestion of loading areas and trained traffic management personnel should be used to supervise loading/unloading areas.
For all buildings.
Base construction and demolition sites present a risk of collision where other traffic is moving within the site. A traffic management plan supervised by trained traffic management personnel should be adopted for the work site.
- SERVICES**
GENERAL
Reroute of services during excavation or other activity creates a variety of risks including release of hazardous material. Existing services are located on or around this site. Where known, these are identified on the plans but the exact location and extent of services may vary from that indicated. Services should be located using appropriate services (such as Dial Before You Dig), appropriate excavation practice should be used and, where necessary, specialist contractors should be used.
Locations and underground power lines MAY be located on or around this site. All underground power lines must be deconstructed or carefully located and adequate warning signs used prior to any construction, maintenance or demolition commencing.
Underground power lines MAY be located on or around this site. All underground power lines must be deconstructed or carefully located and adequate warning signs used prior to any construction, maintenance or demolition commencing.
Overhead power lines MAY be near or on this site. These pose a risk of electrocution if struck or approached by lifting devices or other plant and persons working above ground level. Where there is a danger of this occurring, power lines should be, where practical, deconstructed or relocated. Where this is not practical adequate warning in the form of bright coloured tape or signage should be used or a protection barrier provided.
- MANUAL TASKS**
Components within this design with a mass in excess of 25 kilograms should be lifted by two or more workers or mechanical lifting device. Where this is not practical, suppliers or fabricators should be required to limit the component mass.
Any material packaging, building and maintenance components should clearly show the total mass of packages and where practical all items should be stored on site in a way which minimises bending before lifting. Advice should be provided on safe lifting methods in an area where lifting may occur. Construction, maintenance and demolition of this building will require the use of portable tools and equipment. This should be fully maintained in accordance with manufacturers specifications and not used without fully or in the case of electrical equipment not carrying and electrical safety lay. All safety guards should be regularly checked and Personal Protective Equipment should be used in accordance with manufacturers specifications.

1 HEALTH & SAFETY
1 : 100

CONST. CERTIFICATE SPEC. + NCC COMPLIANCE

- Earthwork is to comply with NCC 2019 Table 3.1.1.1 as referenced in Figure 3.1.2.1 & Clause 3.1.1.200 for determination of a normal site as referenced by Clause 3.2.1.
- Design/Details is to comply with AS/NZS 3000:2015 or Section of AS/NZS 3000:2012.
- Termite Management is to comply with NCC 2019 Part 3.1.3 and AS 3600.1:2000 and/or AS 3600.1:2014. A durable notice is to be installed in accordance with NCC 2019 Part 3.1.3.20. Where a chemical termite management system is used, the chemical must be included on the appropriate authority's product register.
- Finings and safe use to comply with AS 3070:2011.
- Masonry & masonry components are to comply with AS 3700:2011 Amendment 1 or AS 3700:2011 Amendment 1 & AS Part 47.2.2010.
- Weatherproofing of masonry is to comply with AS 3700:2011 or AS 4773:2010 Amendment 1 & AS Part 4773:2010.
- Steel framing to comply with:
Steel Structures AS 4100:1999 Amendment 1.
Cold Formed steel structures AS/NZS 4600:2004 Amendment 1, 4 or Residential & service steel framing AS/NZS Standard Residential & Low-Rise Steel Framing Part 1-2009 Amendment A, B & C Part 2-2014 Amendment A.
- Timber framing to comply with AS 1684.2:2015 Amendment 1 or AS 1684.4:2010 Amendment 1.
- Nail plated timber trusses AS 1720:2015.
- Structural steel members are to comply with:
Steel Structures AS 4100:1999 Amendment 1.
Cold Formed steel structures AS/NZS 4600:2004 Amendment 1.
- Roof cladding is to comply with:
Roofing steel AS 2049:2009 Amendment 1 and AS 2050:2002 Amendment 1 & 2.
- Metal roof AS 1562.
- Gutters and downpipes to comply with AS/NZS 3000:2015 or Section of AS/NZS 3000:2015.
- Wall cladding to comply with AS/NZS 2008.2:2000.
- Allowable encumbrances are to comply with NCC 2019 Part 3.7.1.7.
- Sorting type materials used in a roof must have flammability index of not greater than 5.
- Combustible cladding, daylight of the roof installed in a roof or part of a roof required to have a non-combustible covering must comply with NCC 2019 Part 3.7.1.10.
- Smoke alarms are to comply with NCC 2019 Part 3.7.2 and AS 3786:1989 Amendment 1, 2, 3, & 4 and/or AS 3786:2014 Amendment 1.
- Building elements in wet areas must be waterproof or water resistant in accordance with NCC Table 3.8.1.1 & comply with AS 3740:2010 Amendment 1.
- Room heights are to comply with NCC 2019 Part 3.8.2.
- Construction of sanitary compartments to comply with NCC 2019 Part 3.8.3.3.
- Natural lighting is to comply with NCC 2019 Part 3.8.2.
- Artificial lighting is to comply with AS/NZS 1560.0:2006.
- Mechanical ventilation is to comply with AS 1668.2:2012.
- An exhaust fan from a sanitary compartment, laundry or bathroom must comply with NCC 2019 Part 3.8.3.20.
- Natural ventilation is to comply with NCC 2019 Part 3.8.2.
- Location of sanitary compartments is to comply with NCC 2019 Part 3.8.3.3.
- Sound insulation must comply with NCC 2019 Part 3.8.4.
- Stair construction is to comply with NCC 2019 Part 3.9.1.
- Barriers and handrails are to comply with NCC 2019 Part 3.9.2.
- Swimming Pools: Safety barriers installed in accordance with AS 1601.1 and AS 1926.2.
- Building fabric insulation is to comply with NCC 2019 Part 3.12.1.1 and AS/NZS 4869.1-2002 Amendment 1.
- Building sealing is to comply with NCC 2019 NSW Part 3.12.3 as follows:
Rooflight: Part 3.12.3.2.
External windows and doors: Part 3.12.3.3.
Exhaust fans are to be fitted with a sealing device such as a self-closing damper, filter or the like as required by NCC 2019 Part 3.12.3.4.
Construction of roofs, walls & floors (building sealing) is to comply with NCC 2019 Part 3.12.3.5.
- A sealed hot water supply system is to comply with Part B2 of NCC 2019 Volume Three - Plumbing Code Australia.
- Heating or air conditioning NCC 2019 Part 3.12.2.1 & AS/NZS 4889.1-2002 Amendment 1.
- Central heating water piping NCC 2019 Part 3.12.2.2.
- Heating & cooling ductwork NCC 2019 Part 3.12.3.

2 NCC
1 : 100

APPROVAL KEY:

EXISTING DWELLING


ELEMENTS APPROVAED - WILL NOT BE BUILT UNDER DA2021/2228

ELEMENTS APPROVED - YET TO BE BUILT UNDER DA2121/2228


ELEMENTS BUILD - AS APPROVED UNDER DA2021/2228

PROPOSED NEW WORK UNDER THIS APPLICATION



2 APPROVAL KEY PLAN
1 : 100

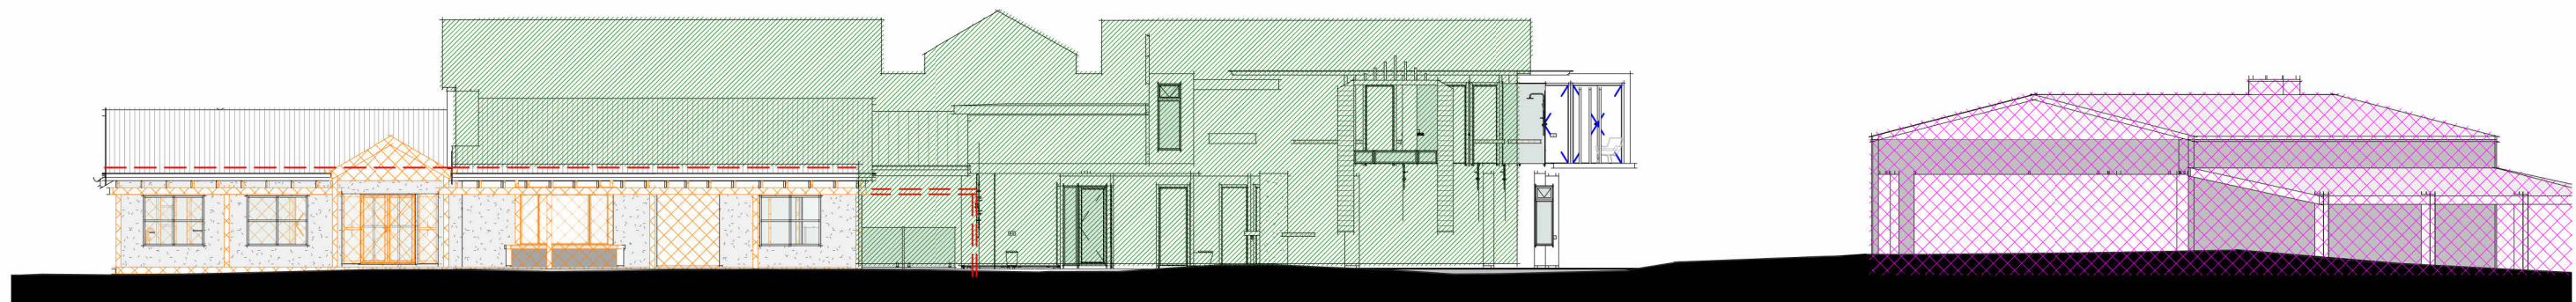

3 WEST ELEVATION - PREVIOUS DA
1 : 200

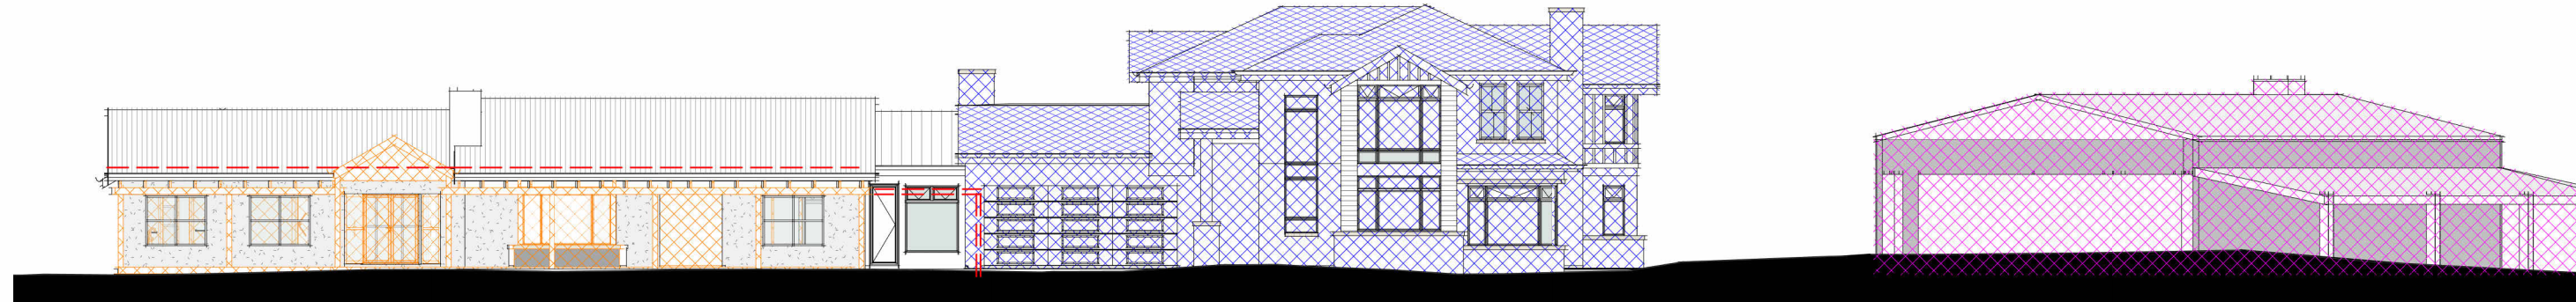

4 WEST ELEVATION - PROPOSED DA
1 : 200

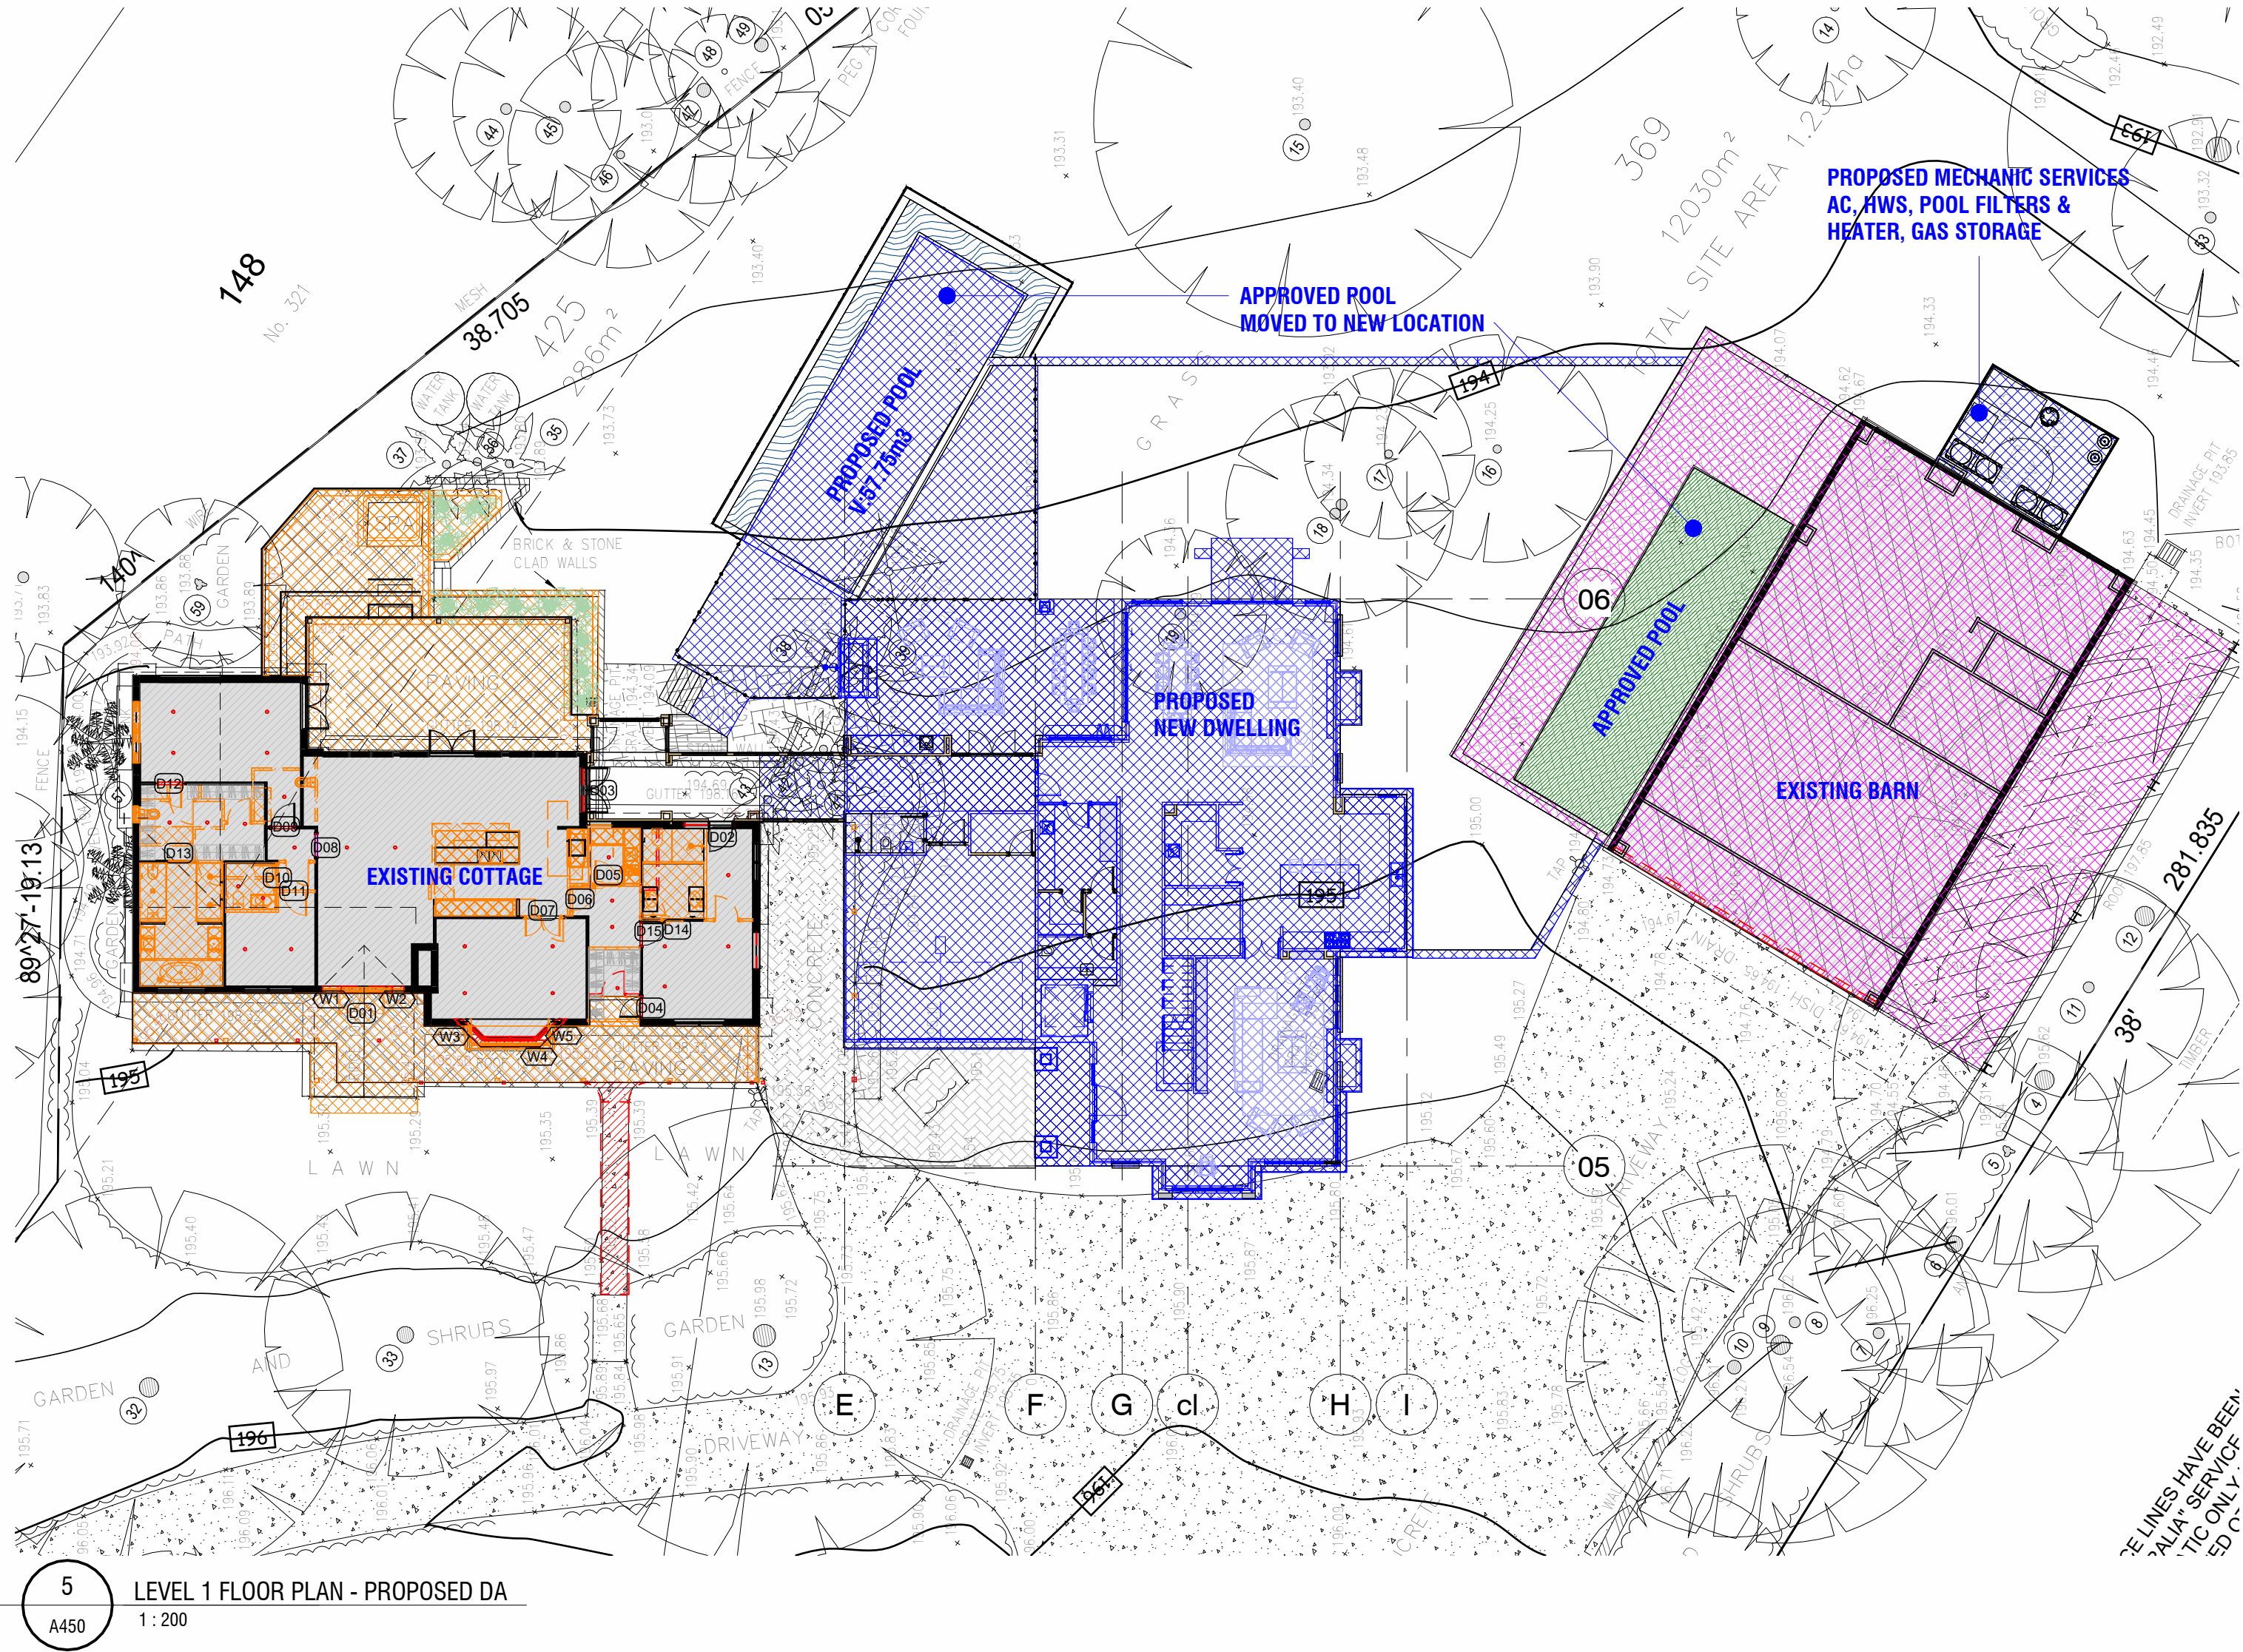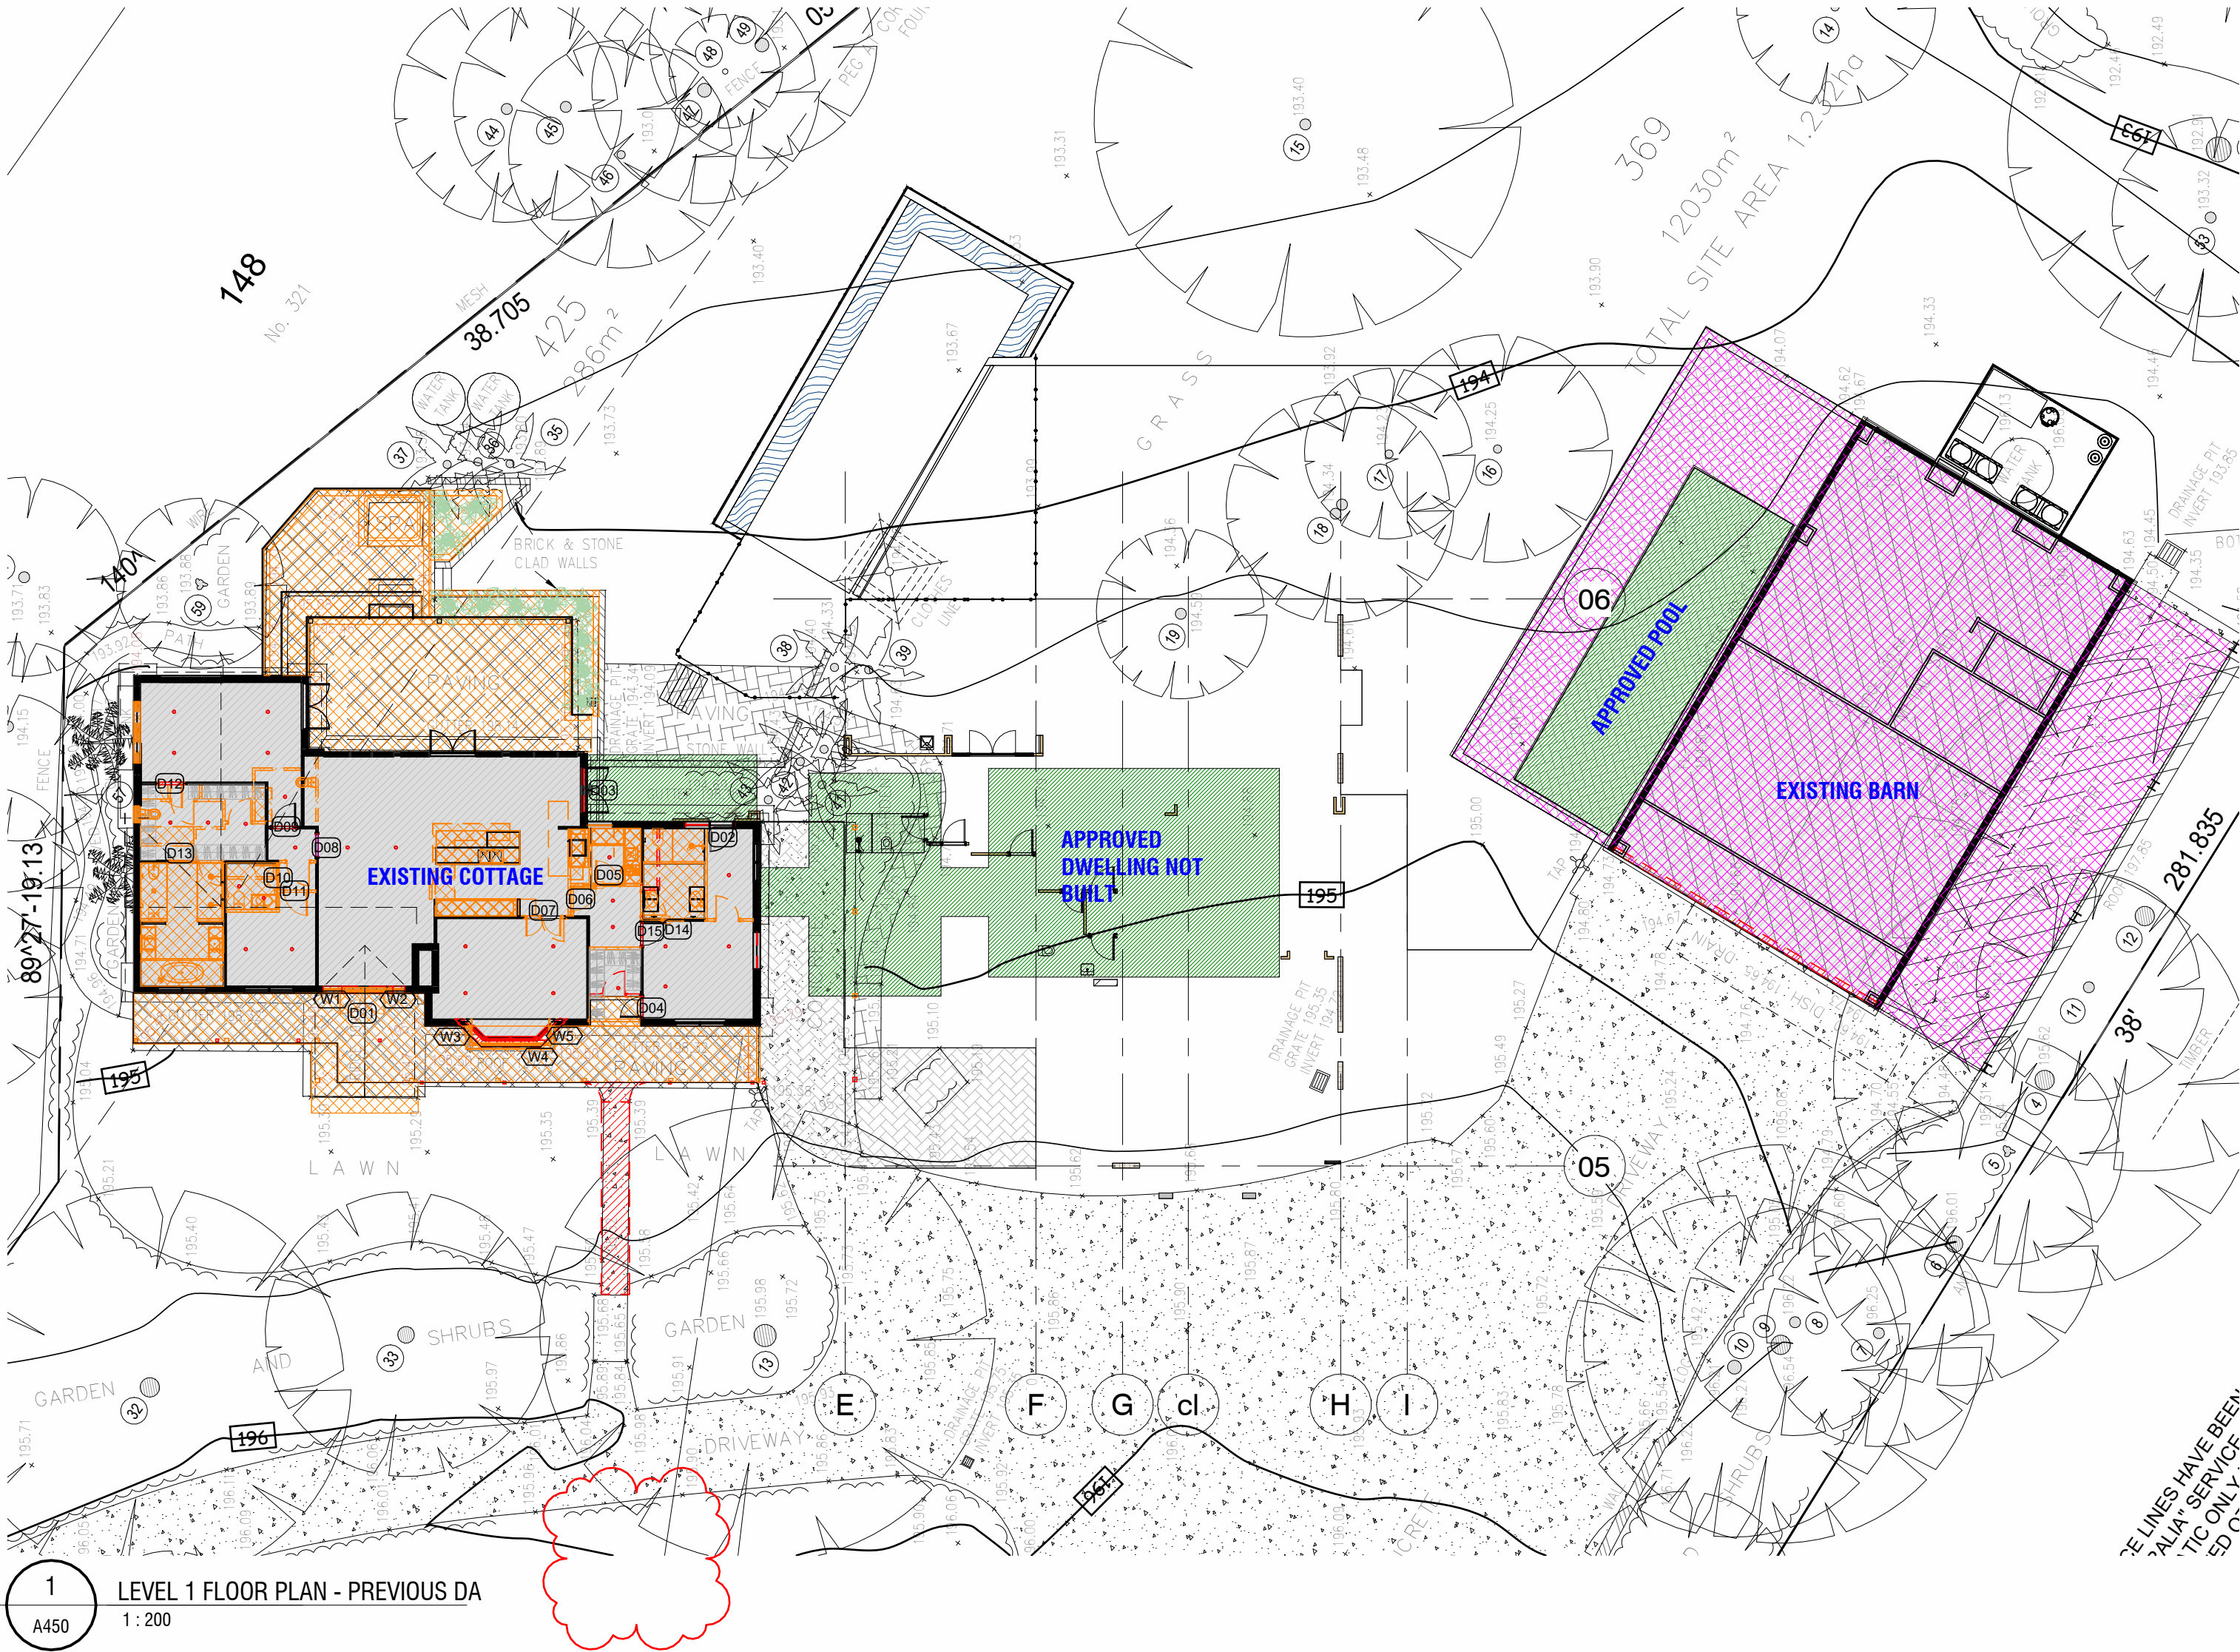




2 LOCATION PLAN
1:50



1 LOT PLAN
1:500

3 LOT PLAN
A450
1:1000

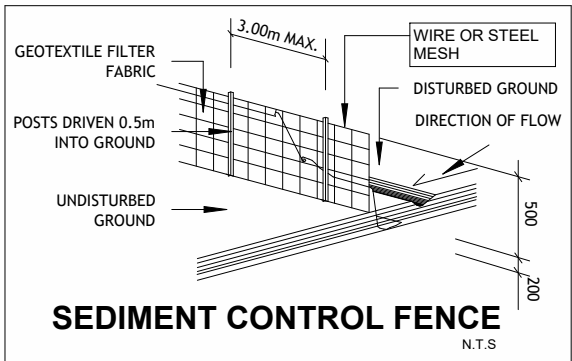

AREA FOR RECYCLING AND BUILDERS RUBBISH AS PER LOCAL AUTHORITIES REQUIREMENTS

BUILDER'S ALL-WEATHER ACCESS TO PREVENT TRACKING OF SEDIMENT

PORTABLE TOILET

AREA FOR MATERIAL STORAGE AND DELIVERIES


TEMPORARY CONSTRUCTION FENCE

SEDIMENT CONTROL FENCE

No	TREE TYPE	DIAMETER	HEIGHT	SPREAD	No	TREE TYPE	DIAMETER	HEIGHT	SPREAD	No	TREE TYPE	DIAMETER	HEIGHT	SPREAD
1	TREE	20.40	10	5	21	FERN	0.30	10	6	41	PALM	0.30	10	6
2	PALM	20.40	10	5	22	TREE	0.30	10	6	42	PALM	0.30	10	6
3	PALM	20.40	10	5	23	TREE	0.30	10	6	43	PALM	0.30	10	6
4	EUCALYPT	0.30	10	5	24	EUCALYPT	0.30	10	6	44	PALM	0.30	10	6
5	TREE	0.40	10	5	25	MELALEUCA	0.30	10	6	45	PALM	0.30	10	6
6	EUCALYPT	0.70	10	5	26	EUCALYPT	0.30	10	6	46	PALM	0.30	10	6
7	MELALEUCA	0.40	10	5	27	TREE	0.30	10	6	47	PALM	0.30	10	6
8	EUCALYPT	0.40	10	5	28	TREE	0.30	10	6	48	PALM	0.30	10	6
9	TREE	0.40	10	5	29	TREE	0.30	10	6	49	PALM	0.30	10	6
10	EUCALYPT	0.40	10	5	30	TREE	0.30	10	6	50	PALM	0.30	10	6
11	EUCALYPT	0.40	10	5	31	TREE	0.30	10	6	51	PALM	0.30	10	6
12	TREE	0.40	10	5	32	TREE	0.30	10	6	52	PALM	0.30	10	6
13	EUCALYPT	0.40	10	5	33	TREE	0.30	10	6	53	PALM	0.30	10	6
14	EUCALYPT	0.40	10	5	34	TREE	0.30	10	6	54	PALM	0.30	10	6
15	JACARANDA	0.40	10	5	35	TREE	0.30	10	6	55	PALM	0.30	10	6
16	TREE	0.40	10	5	36	TREE	0.30	10	6	56	PALM	0.30	10	6
17	TREE	0.40	10	5	37	TREE	0.30	10	6	57	PALM	0.30	10	6
18	TREE	0.40	10	5	38	TREE	0.30	10	6	58	PALM	0.30	10	6
19	TREE	0.40	10	5	39	TREE	0.30	10	6	59	PALM	0.30	10	6
20	TREE	0.40	10	5	40	TREE	0.30	10	6	60	PALM	0.30	10	6


1 SITE PLAN 1:200

- NOTES:
- 1) A BOUNDARY IDENTIFICATION HAS BEEN UNDERTAKEN.
 - 2) OFFSET DIMENSIONS TO BOUNDARIES HEREON MUST NOT BE USED FOR CONSTRUCTION.
 - 3) CAUTION: SHOULD ANY DEVELOPMENT OR CONSTRUCTION BE PLANNED ON OR NEAR THE BOUNDARIES, THE BOUNDARIES SHOULD BE CLEARLY MARKED ON SITE.
 - 4) ORIGIN OF LEVELS ON A.H.I.D. IS TAKEN FROM S.S.M. 36450 RL 201.465 A.H.I.D.
 - 5) TREE SPREADS ARE DIAGRAMMATIC ONLY AND ARE NOT SYMMETRICAL.
 - 6) UNDERGROUND (NOT VISIBLE) SERVICE LINES HAVE BEEN SHOWN FROM "BEFORE YOU DIG AUSTRALIA" SERVICE AUTHORITY RECORDS & ARE DIAGRAMMATIC ONLY IN REGARD TO THEIR POSITION & WIDTH UNLESS STATED OTHERWISE.
 - 7) BEARINGS SHOWN ARE ON TRUE NORTH.
 - 8) CONTOUR INTERVAL 0.5 METRE.
 - 9) CONTOURS ARE INDICATIVE OF GROUND FORM ONLY. ONLY SPOT LEVELS SHOULD BE USED FOR CALCULATIONS OF QUANTITIES WITH CAUTION.

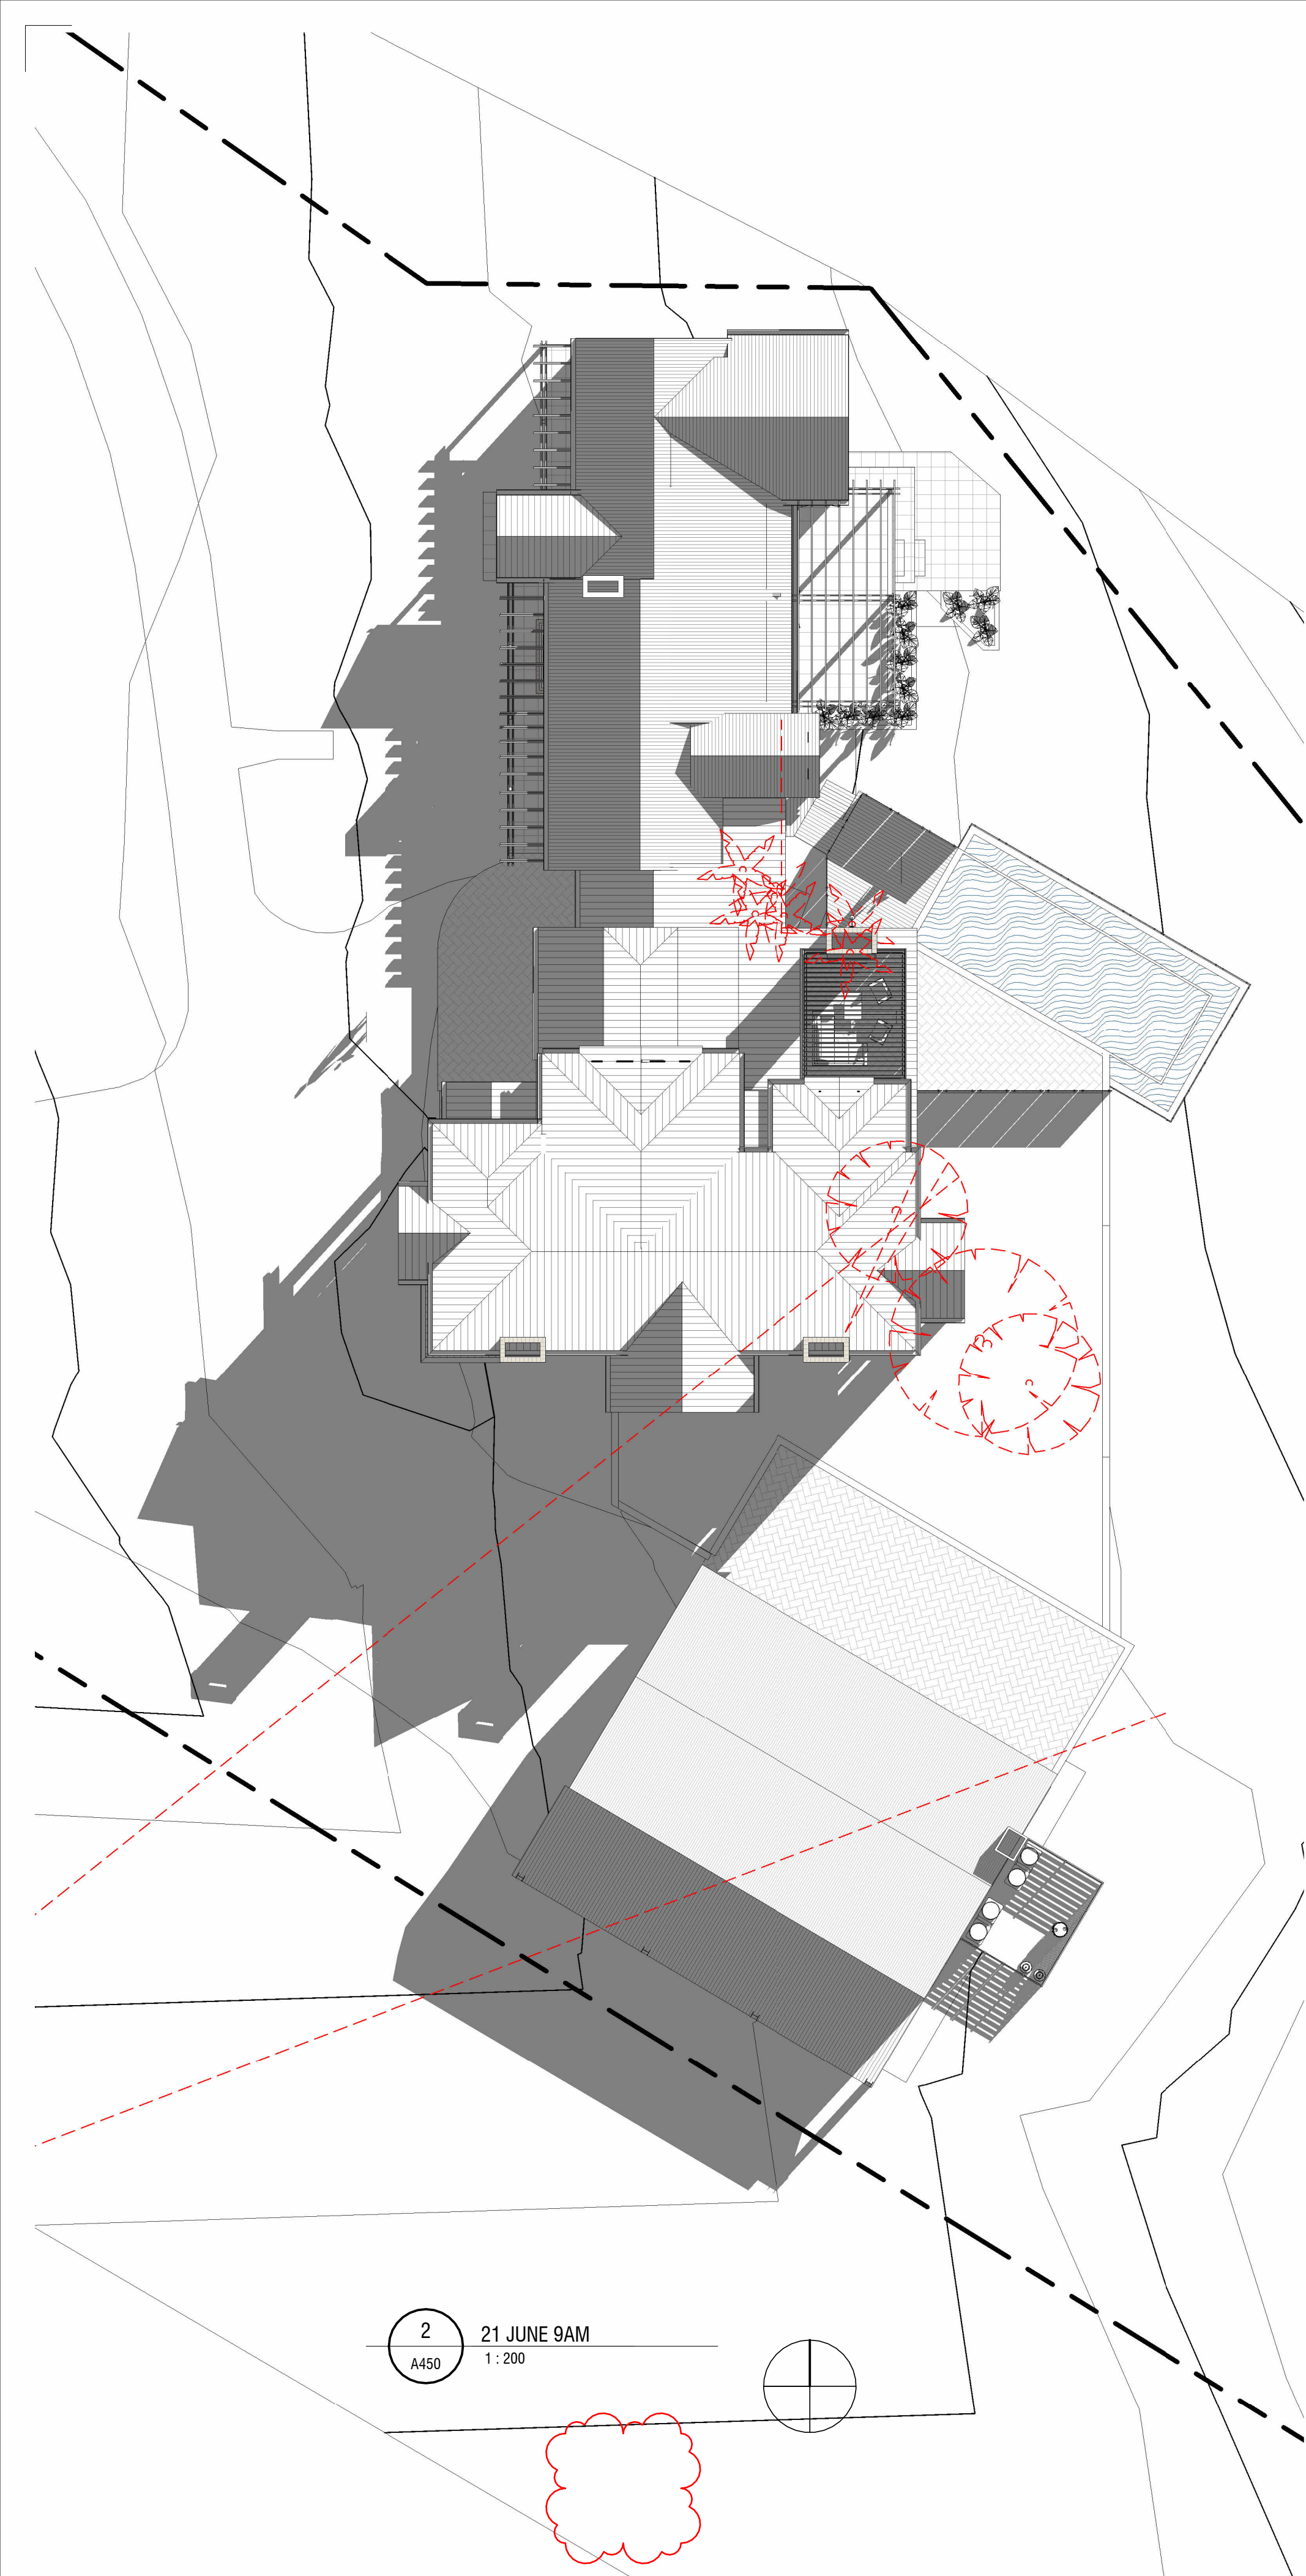


2 21 JUNE 9AM
A450 1 : 200

PROPOSED AREAS:


 GFA CALCULATED AREA

SITE AREA = 12030 m2

PROPOSED GROUND FLOOR = 240.50m2
PROPOSED FRIST FLOOR = 197.10m2
PROPOSED TOTAL = 437.60m2

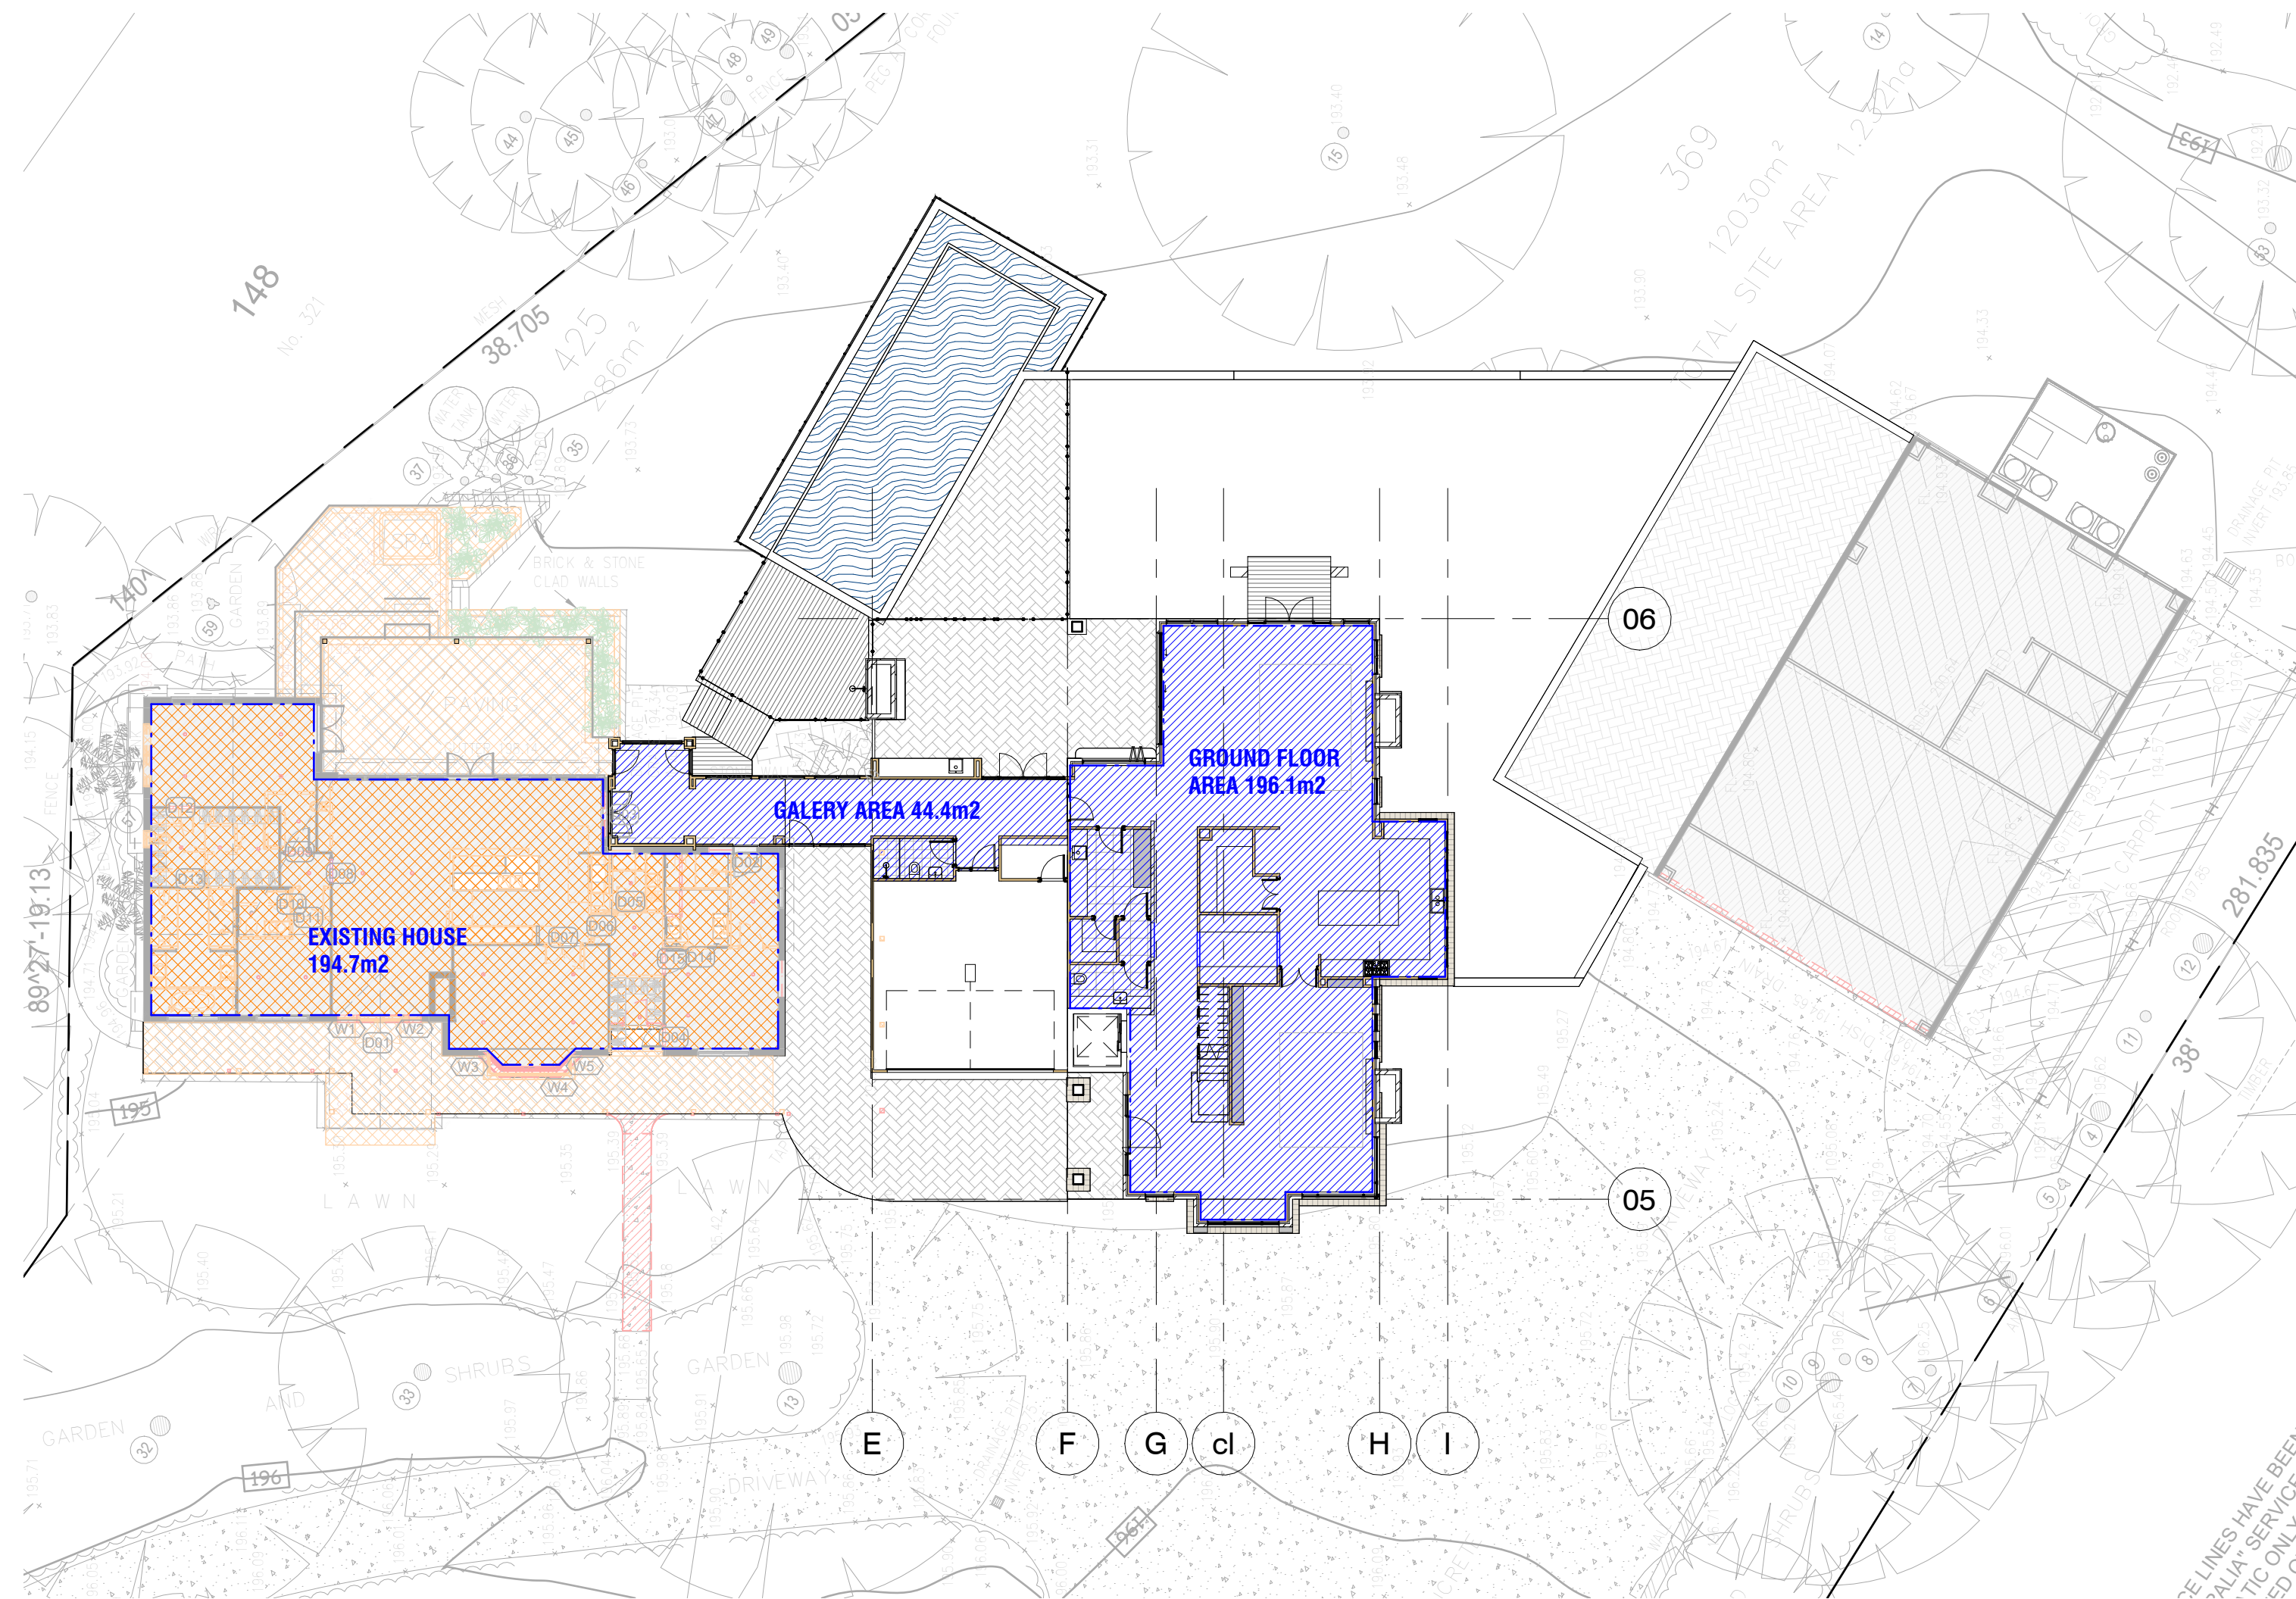


1 LEVEL 1 FLOOR PLAN - PROPOSED DA
A450 1:200

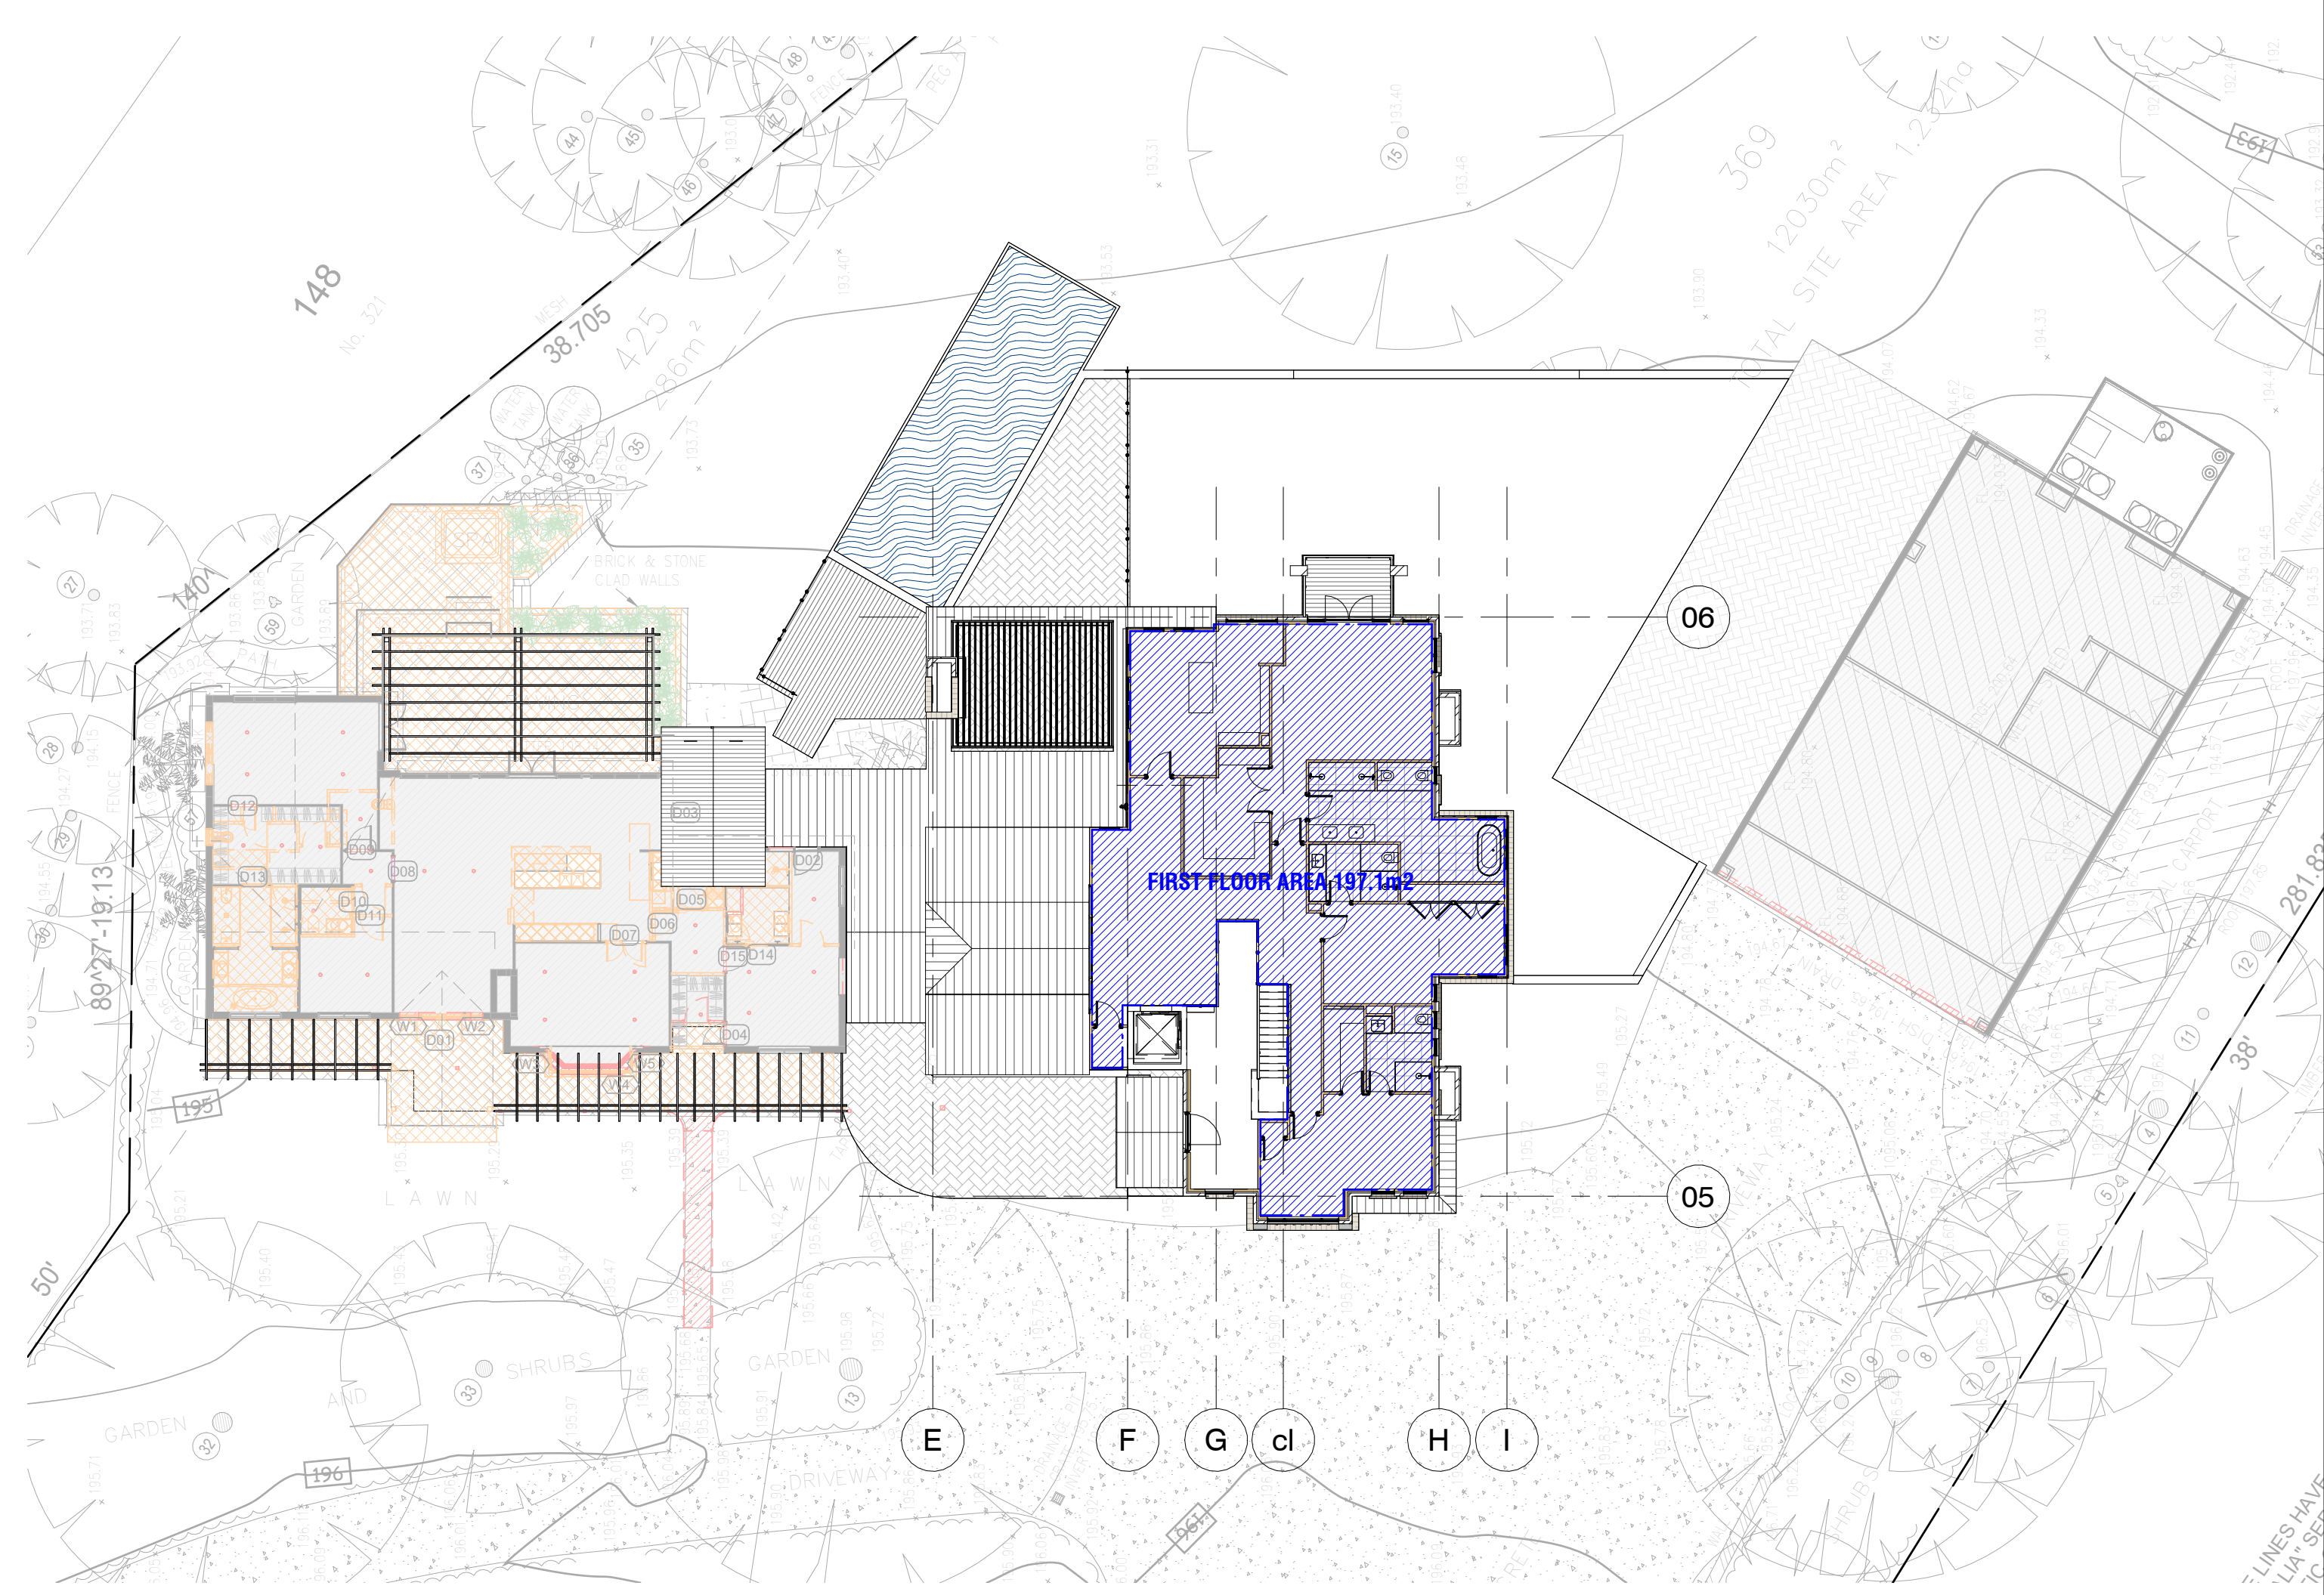

2 LEVEL 2 FLOOR PLAN
A450 1:200

Area Schedule (Gross Building)				
Level	Name	Area	Area Type	Comments
LEVEL 1	ALFRESCO	52.8 m²	Gross Building Area	
LEVEL 1	GARAGE	54.6 m²	Gross Building Area	
LEVEL 1	GF BALC	7.0 m²	Gross Building Area	
LEVEL 1	PORCH	7.6 m²	Gross Building Area	
LEVEL 2	FF BALC	6.3 m²	Gross Building Area	
: 5		128.3 m²		
LEVEL 1	GF LIVING	216.1 m²	Gross Building Area	BASIX
LEVEL 2	FF LIVING	204.8 m²	Gross Building Area	BASIX
LEVEL 1	GALLERY	40.3 m²	Gross Building Area	BASIX
BASIX: 3		461.3 m²		
LEVEL 1	EXISTING	210.9 m²	Gross Building Area	BASIX EX
BASIX EX: 1		210.9 m²		
		800.4 m²		

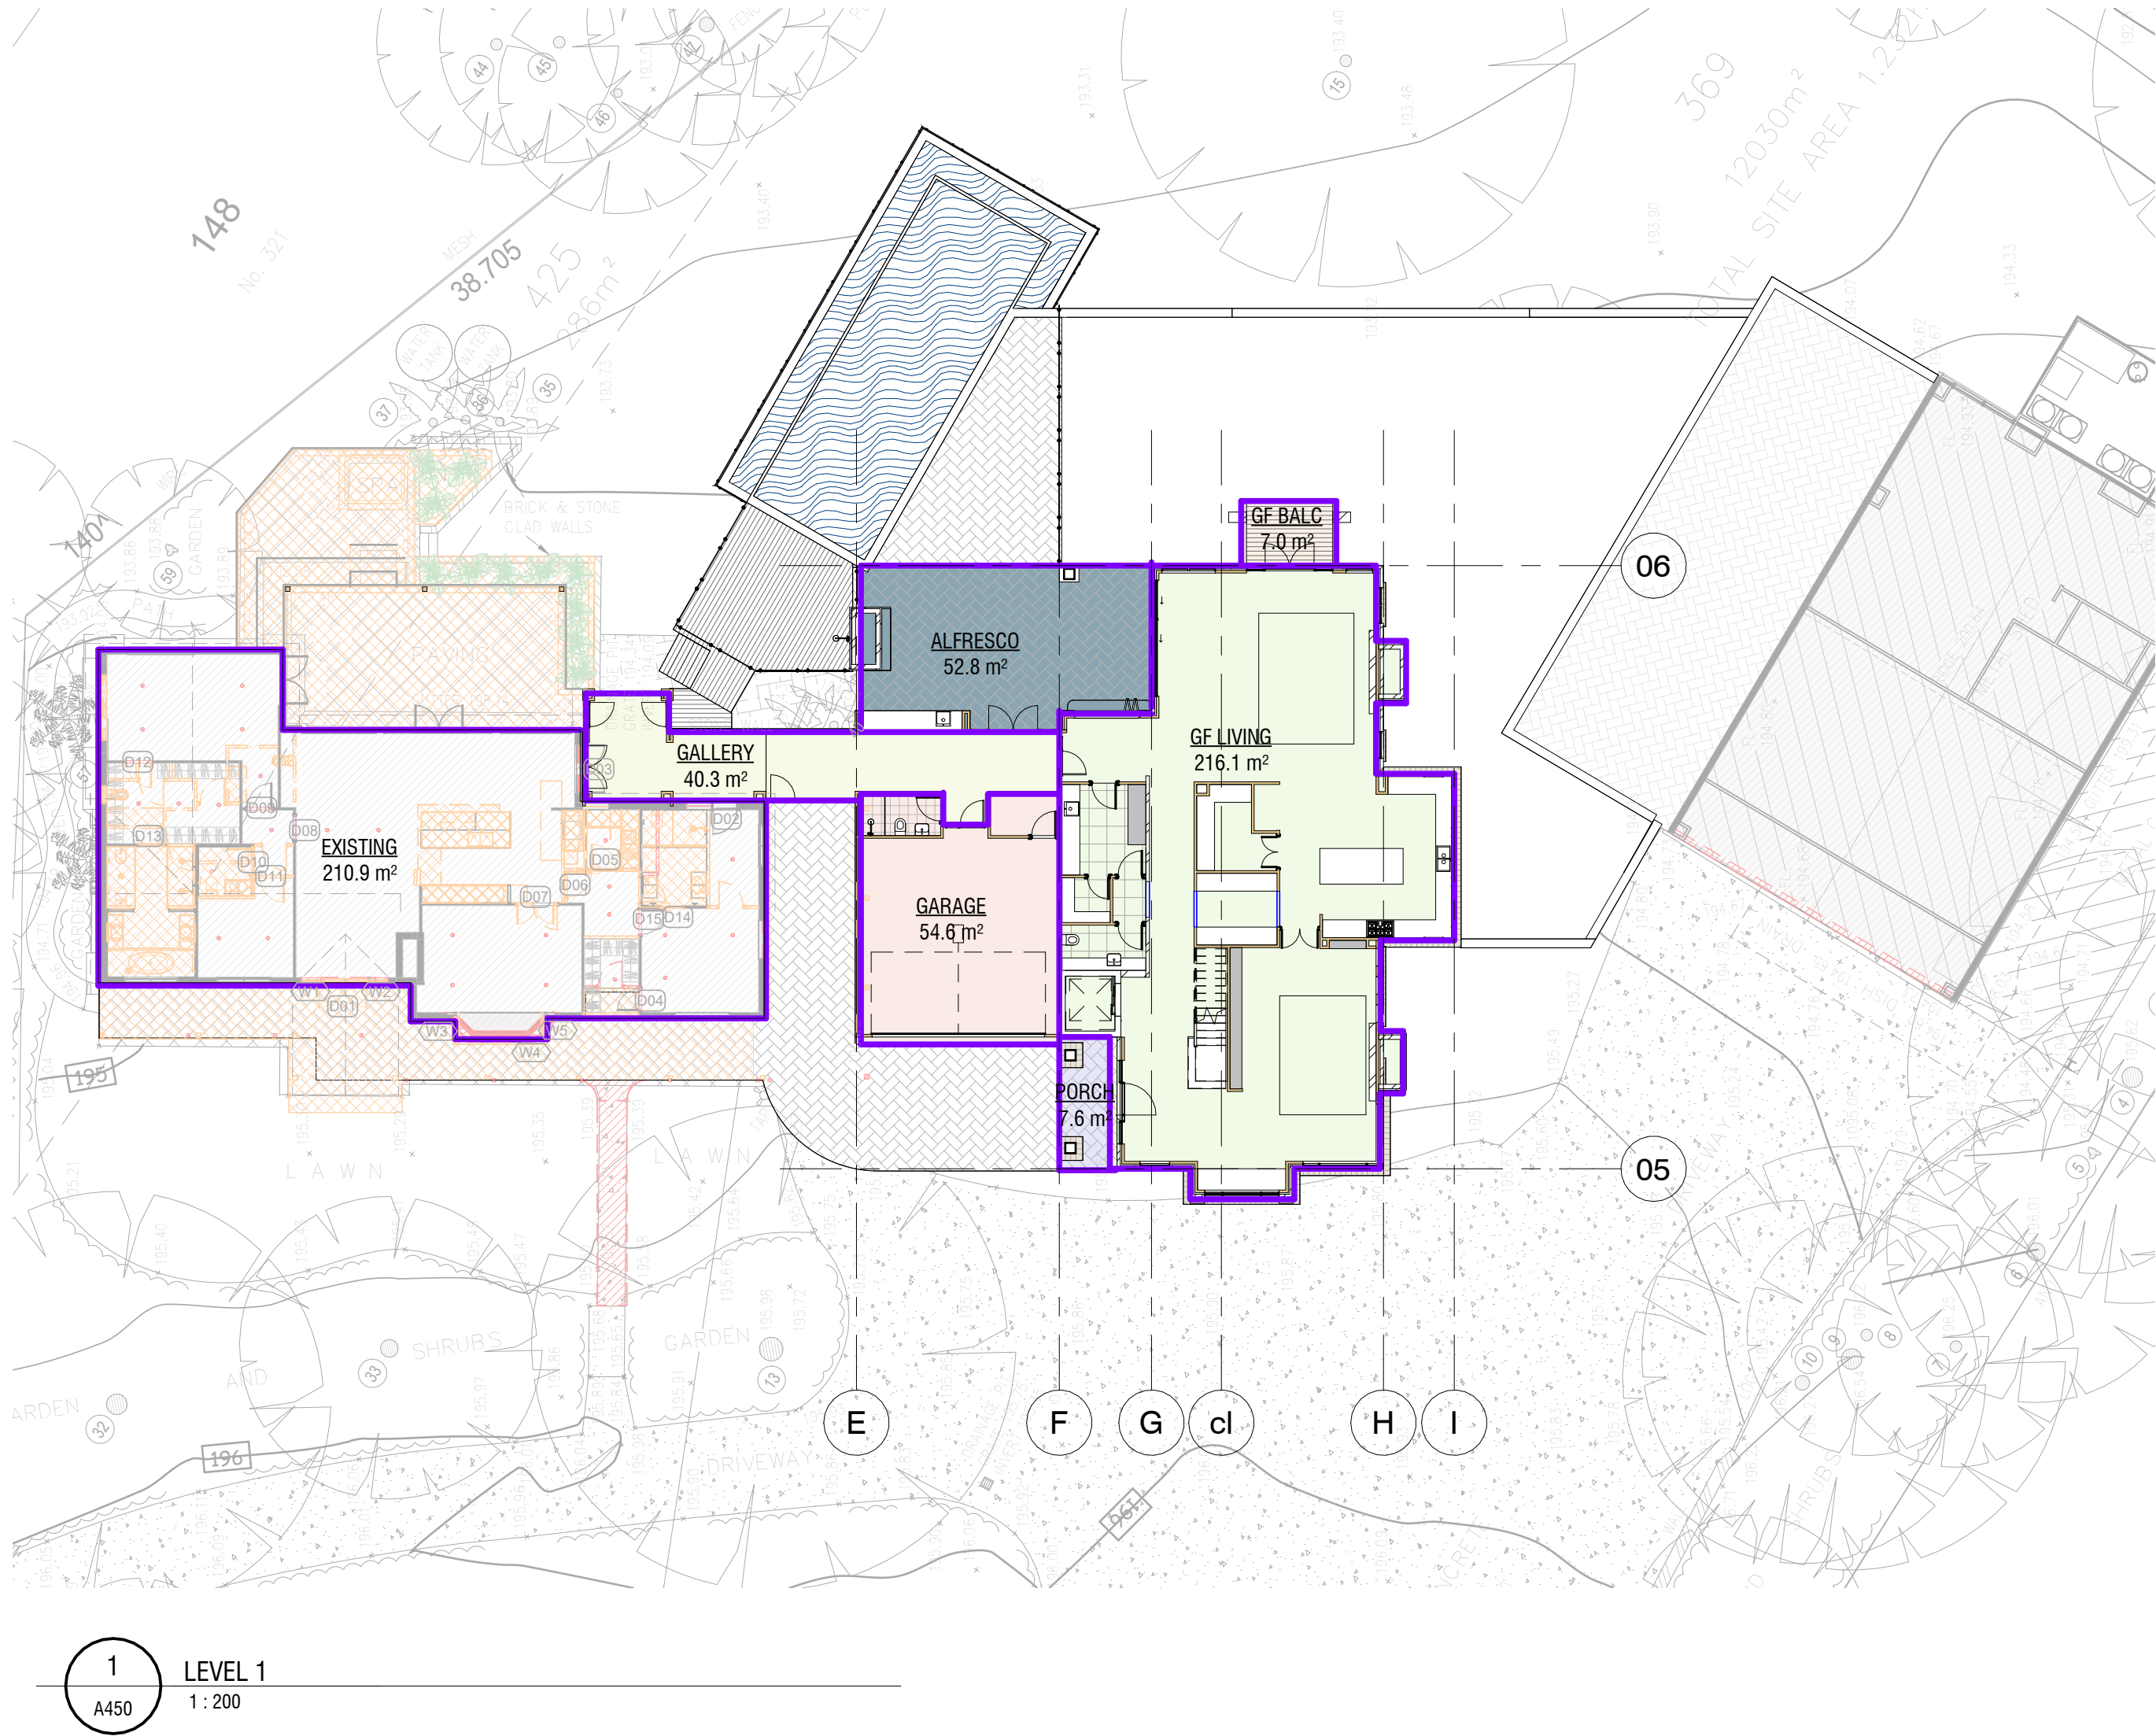


Building Area Legend

- ALFRESCO
- EXISTING
- GALLERY
- GARAGE
- GF BALC
- GF LIVING
- PORCH


Building Area Legend

- FF BALC
- FF LIVING

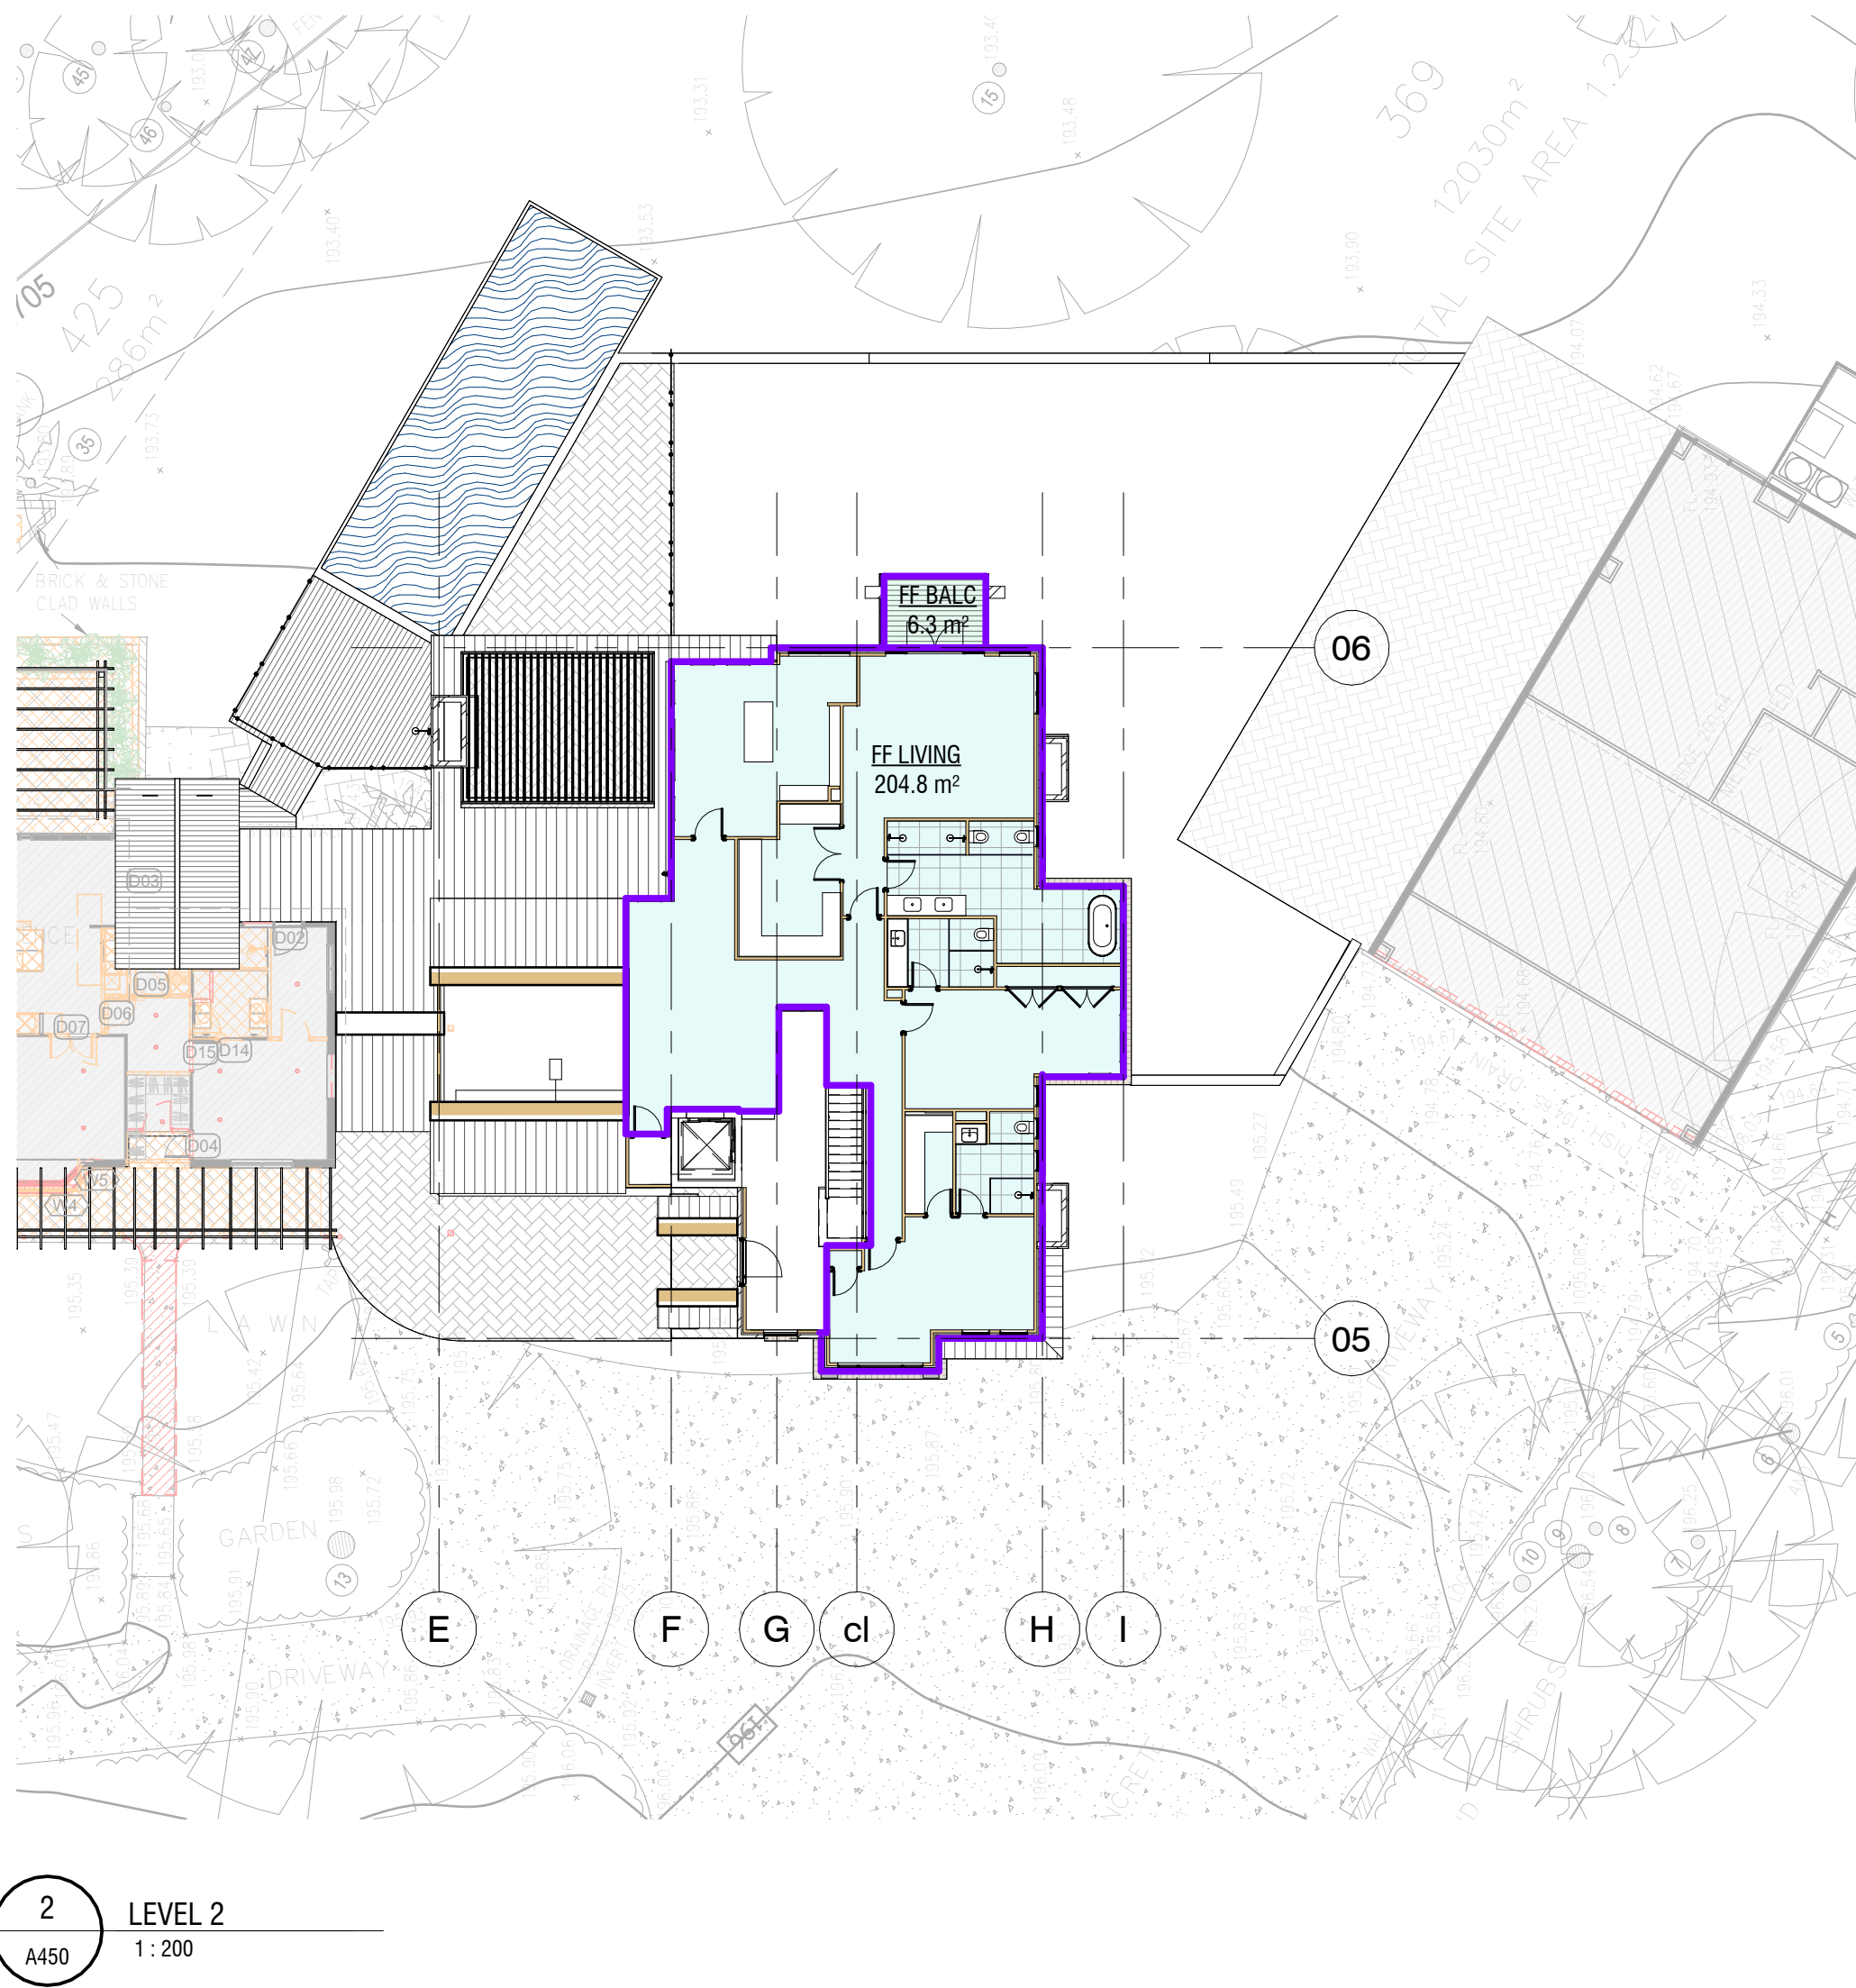

2 LEVEL 2
A450 1:200

ELEMENTS BUILT UNDER DA2021/2228	
NO.	DESCRIPTION
1	BAY WINDOW REPLACED WITH FZ COMPLIANT BOX WINDOWS
2	DECKS CONSTRUCTED TO FZ COMPLIANCE
3	ENSUITE AS PER APPROVAL
4	POWDER ROOM AS PER APPROVAL
5	KITCHEN AS PER APPROVAL
6	LAUNDRY AS PER APPROVAL
7	BATHROOM AS PER APPROVAL
8	NEW DOORS AND GABLE ROOF AS PER APPROVAL
9	EXISTING VERANDAH REMOVED AND REPLACED WITH ALU. PERGOLA

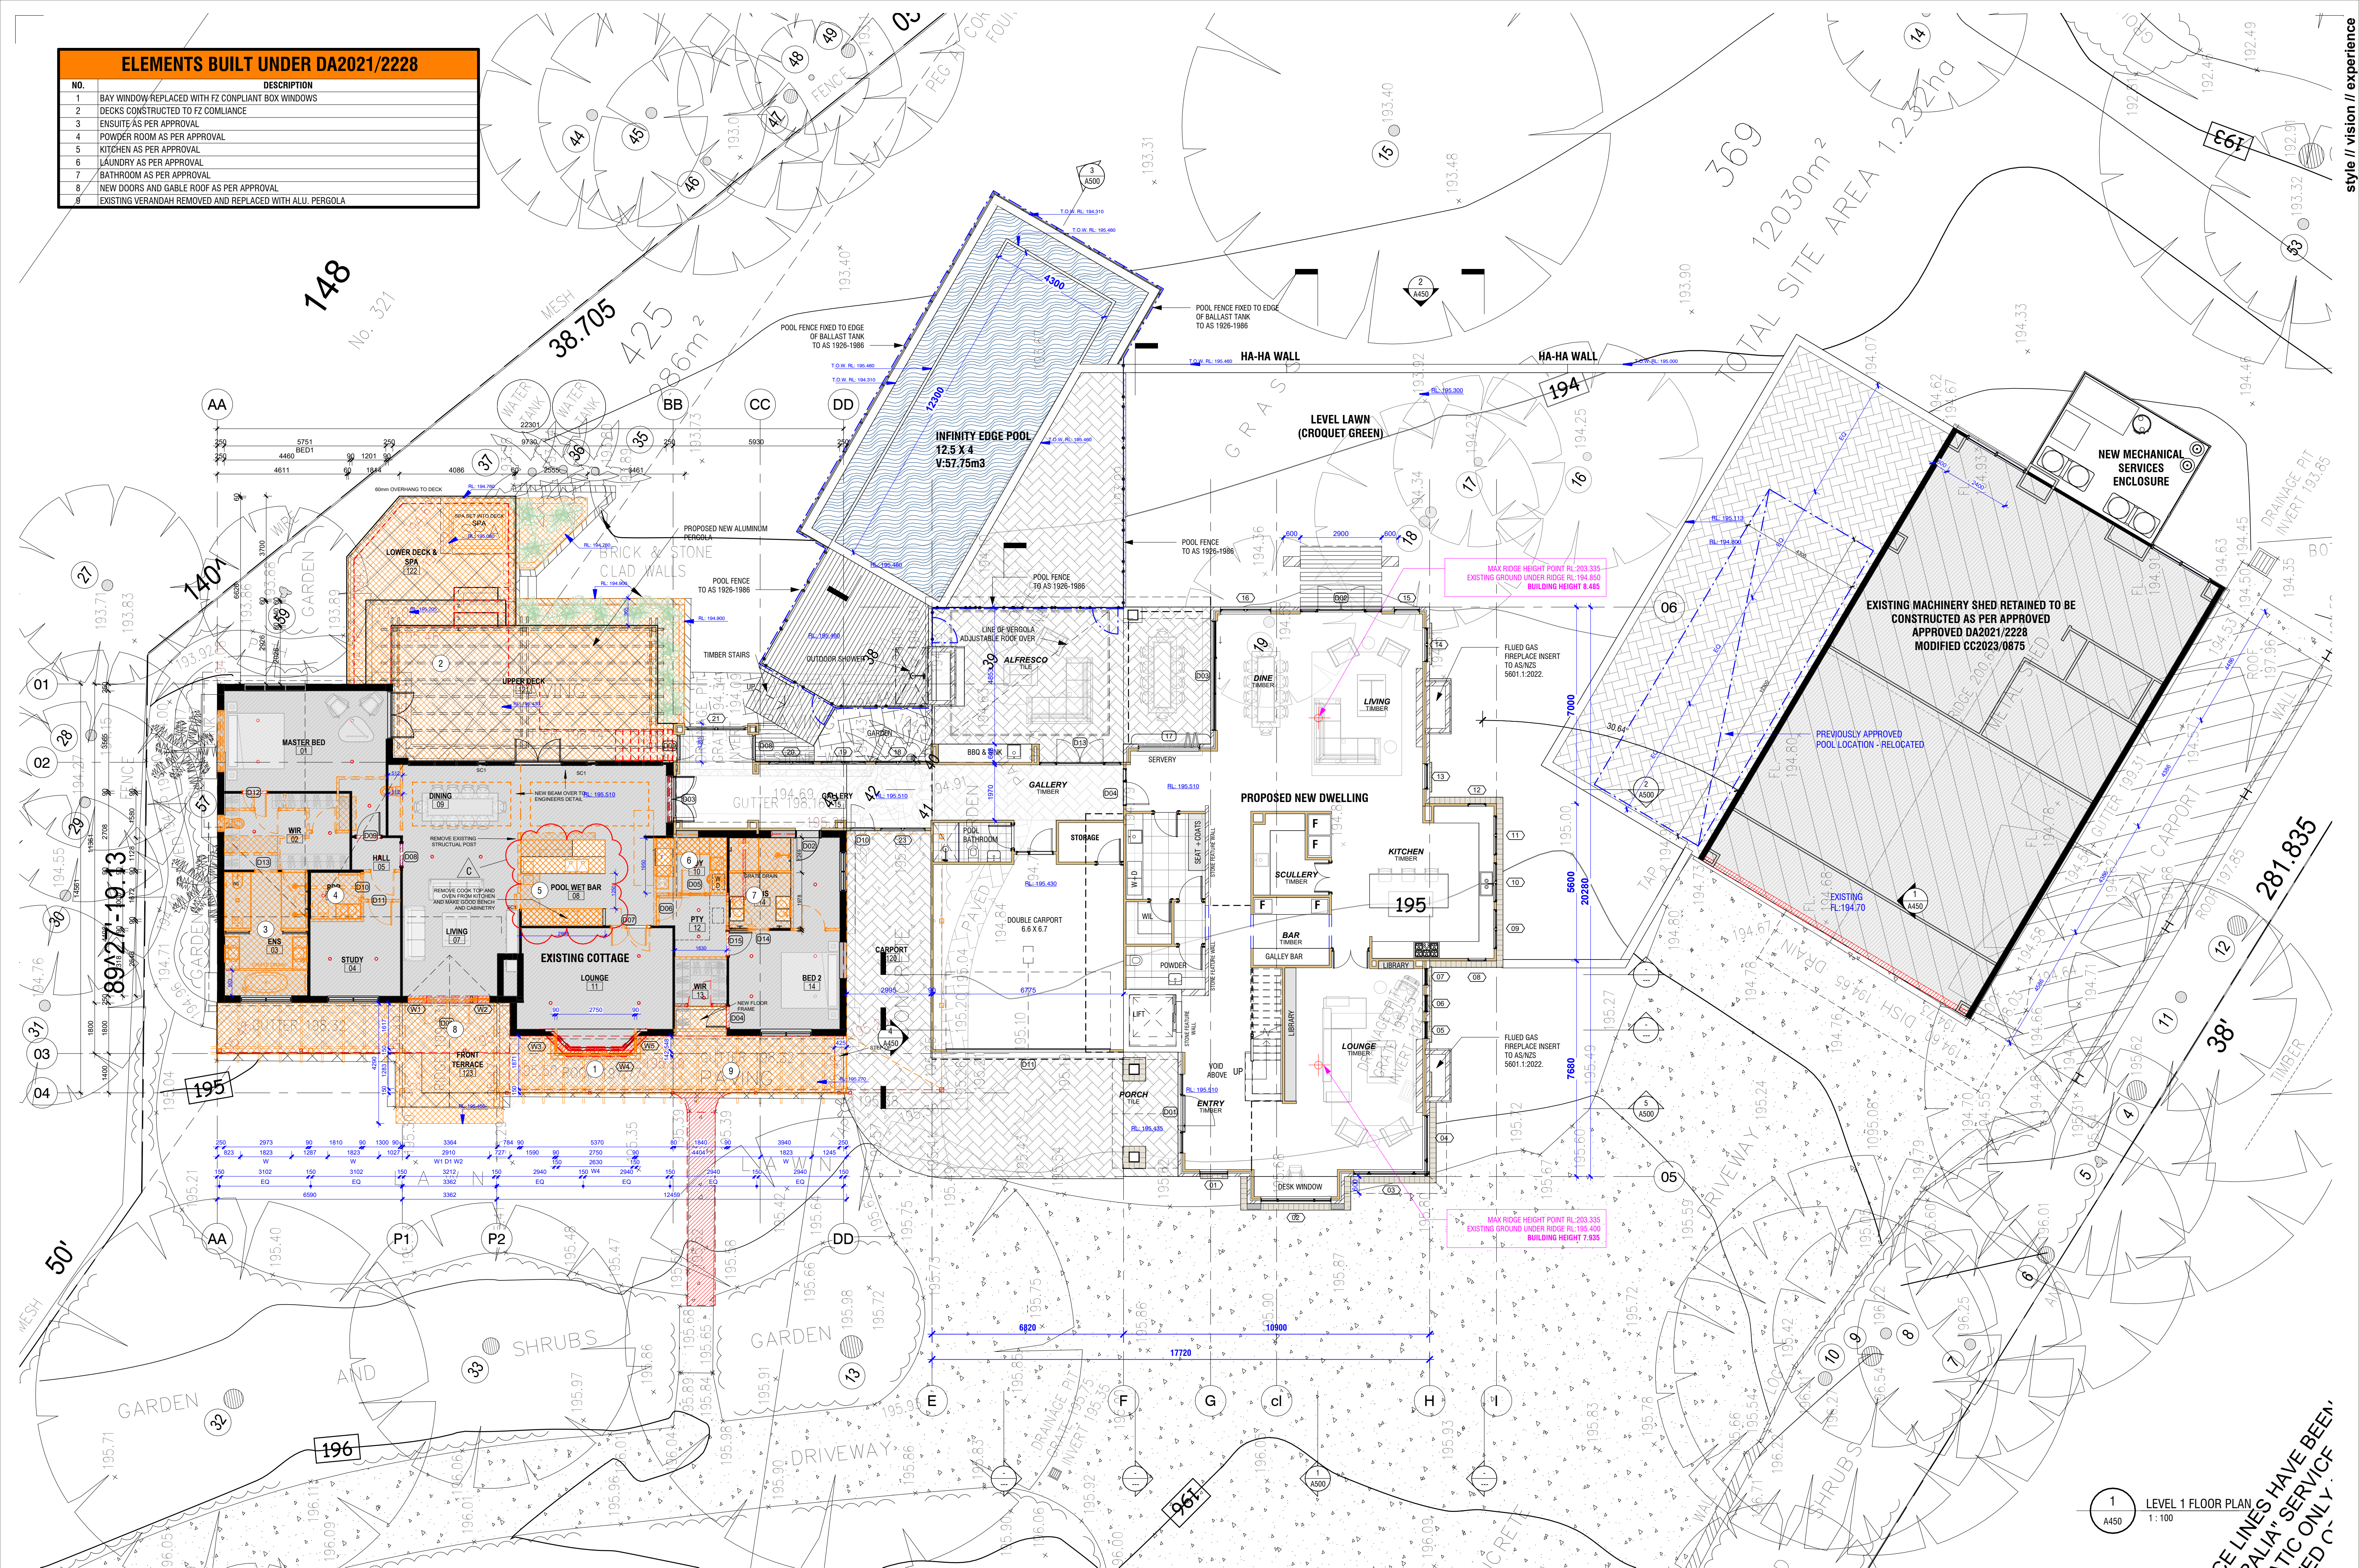





1
A450
LEVEL 2 FLOOR PLAN
1 : 100

1


ELEMENTS BUILT UNDER DA2021/2228	
NO.	DESCRIPTION
1	BAY WINDOW REPLACED WITH FZ COMPLIANT BOX WINDOWS
2	DECKS CONSTRUCTED TO FZ COMPLIANCE
3	ENSUITE AS PER APPROVAL
4	POWDER ROOM AS PER APPROVAL
5	KITCHEN AS PER APPROVAL
6	LAUNDRY AS PER APPROVAL
7	BATHROOM AS PER APPROVAL
8	NEW DOORS AND GABLE ROOF AS PER APPROVAL
9	EXISTING VERANDAH REMOVED AND REPLACED WITH ALU. PERGOLA

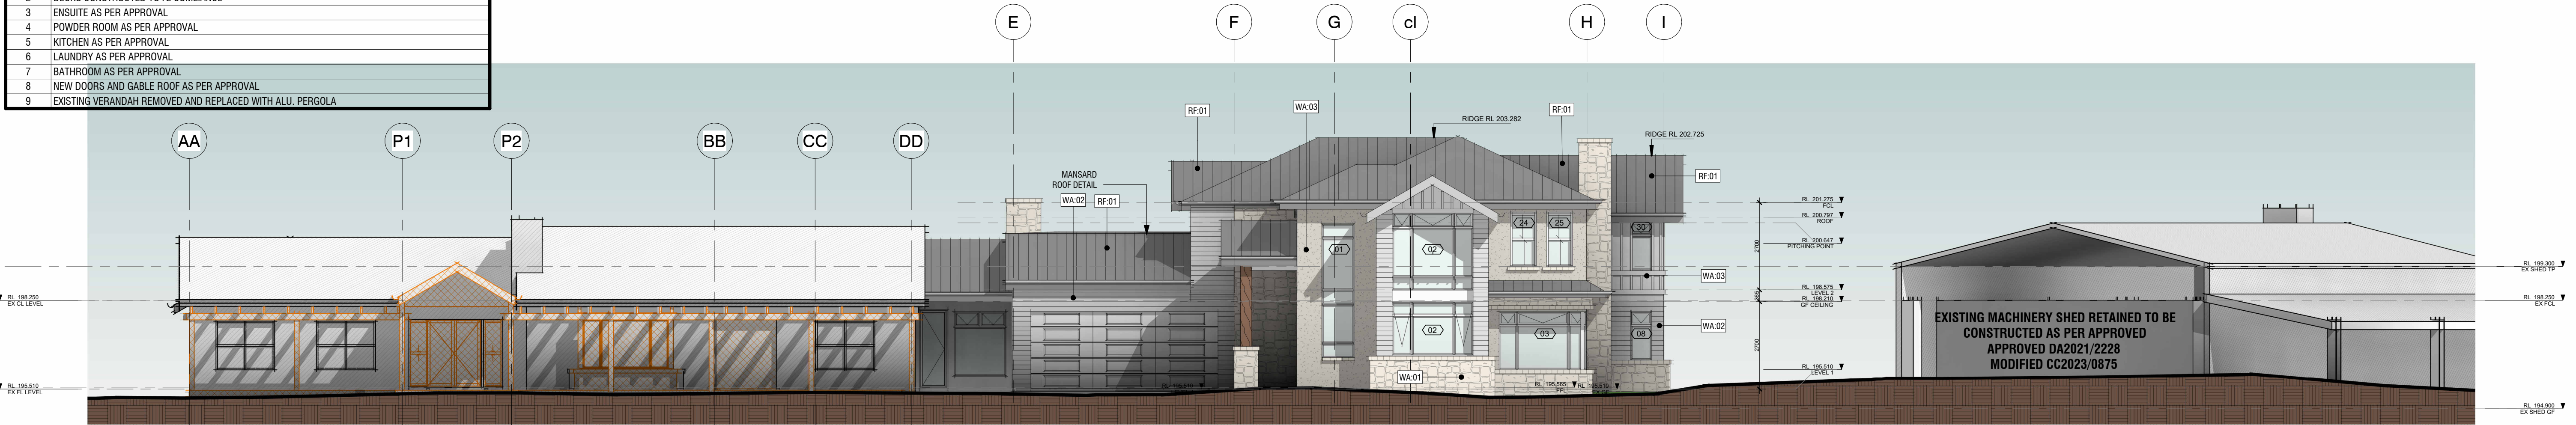


3 NEW WEST ELEVATION
A150 1:100

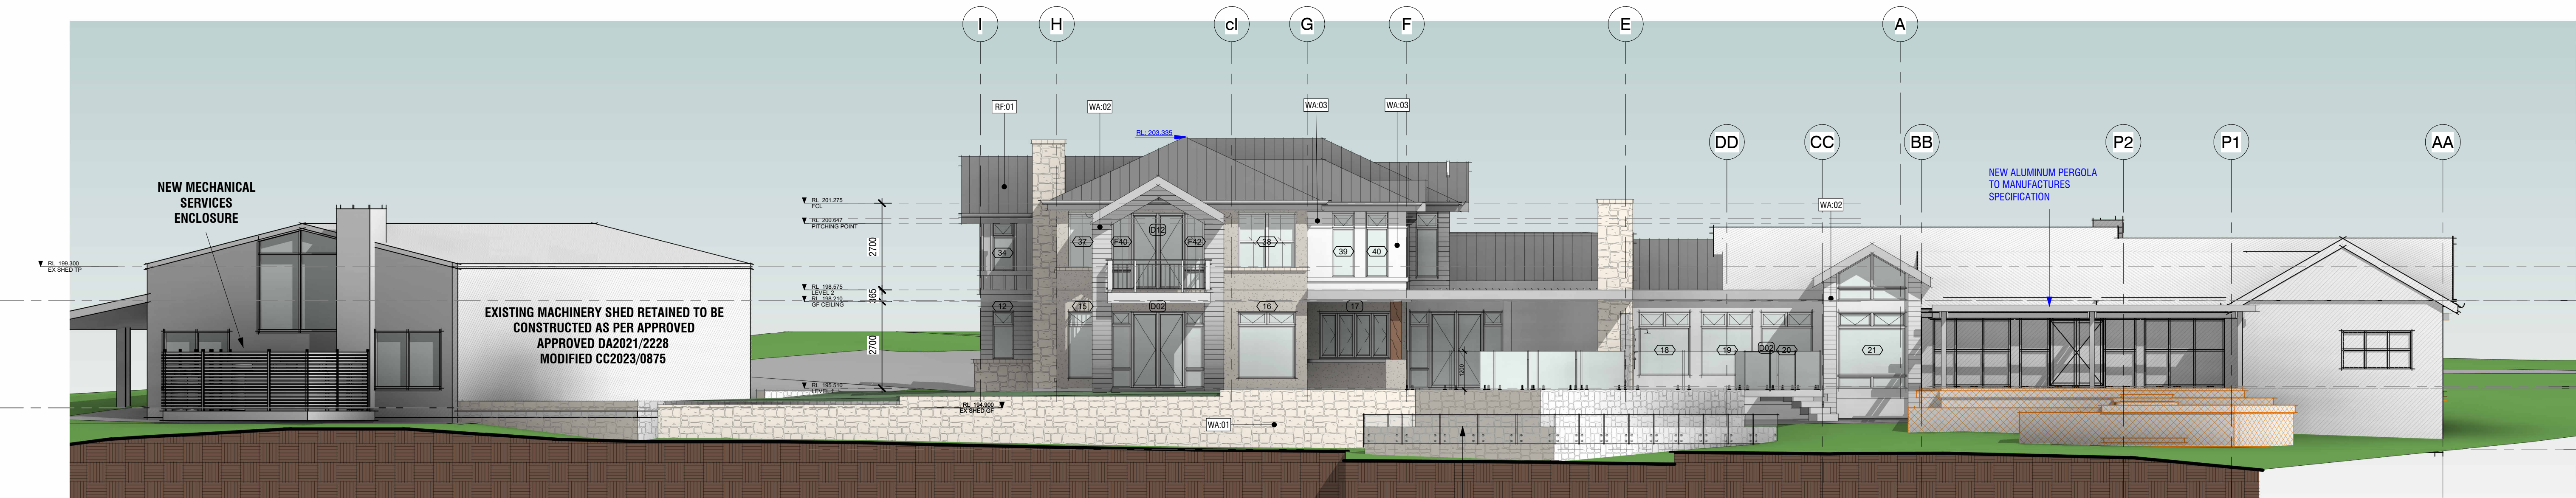


2 NEW EAST ELEVATION
A150 1:100

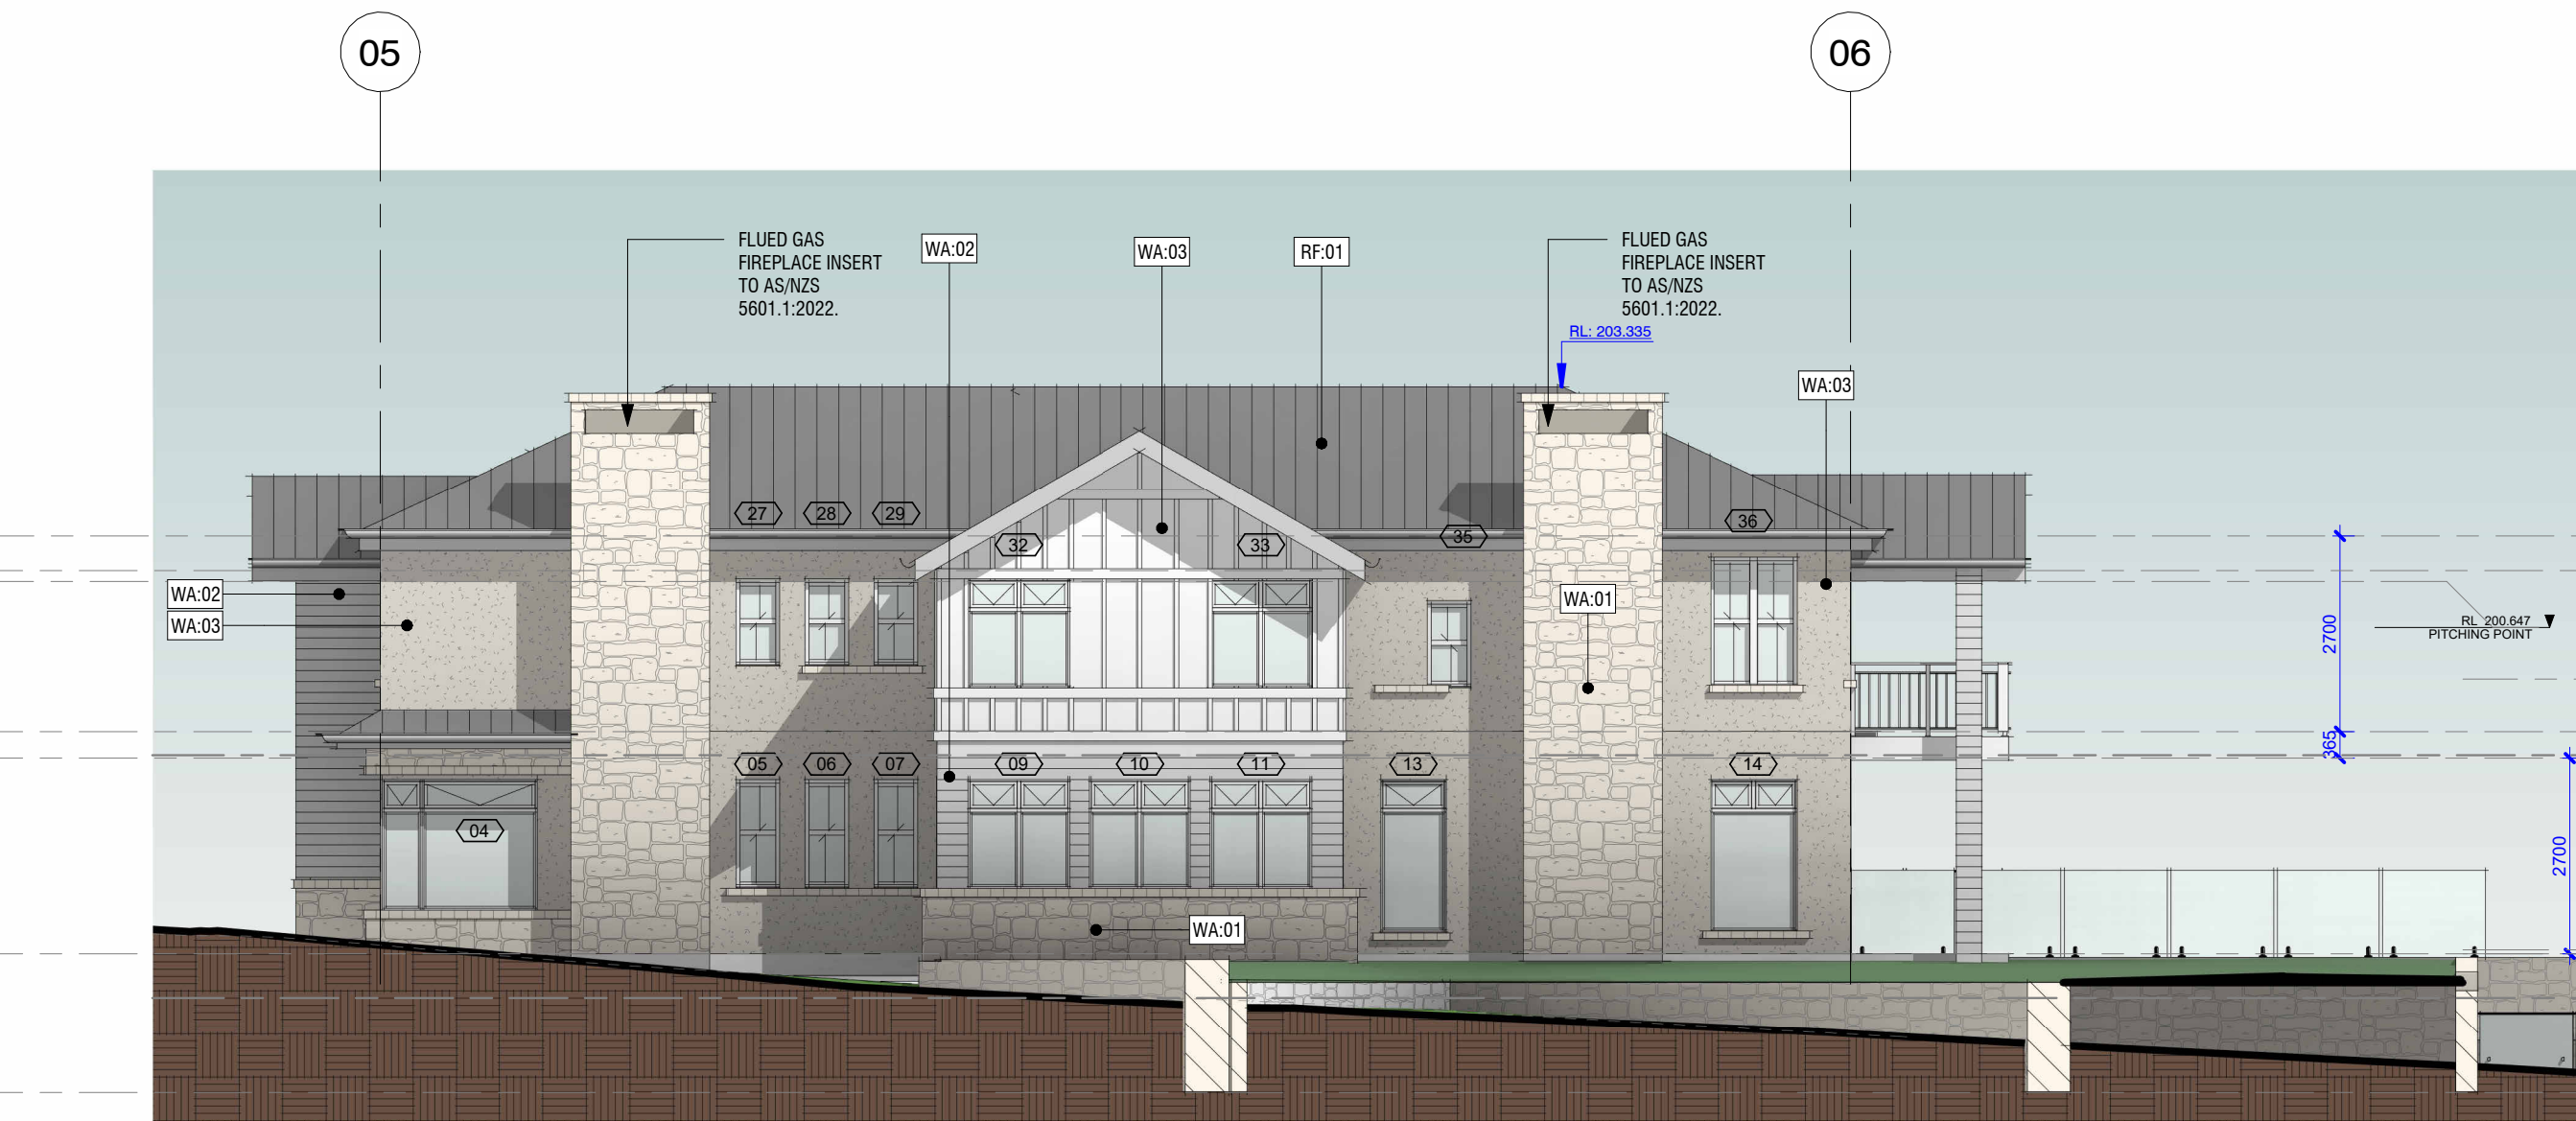


1 NEW SOUTH ELEVATION
A150 1:100

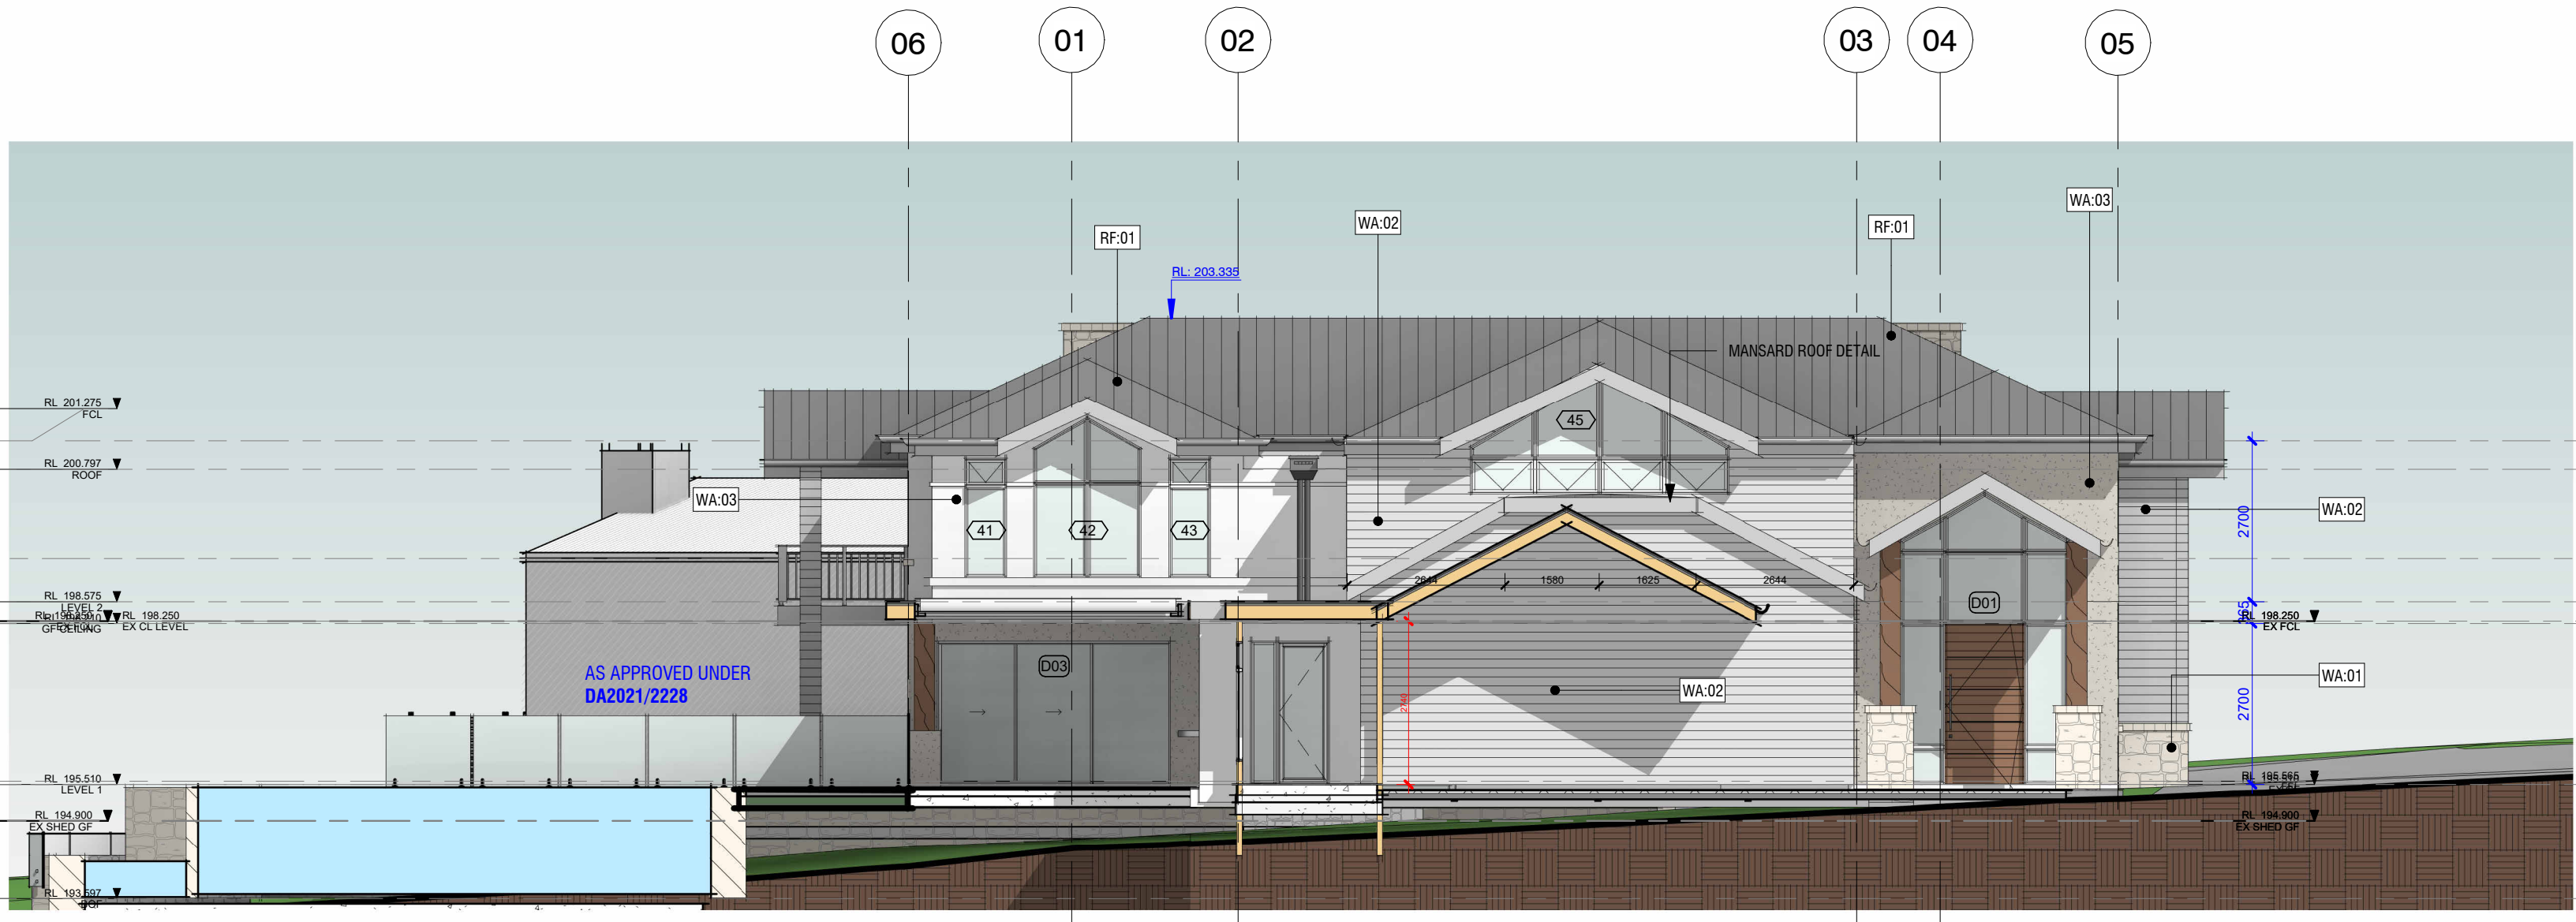


4 NEW NORTH ELEVATION
A150 1:100

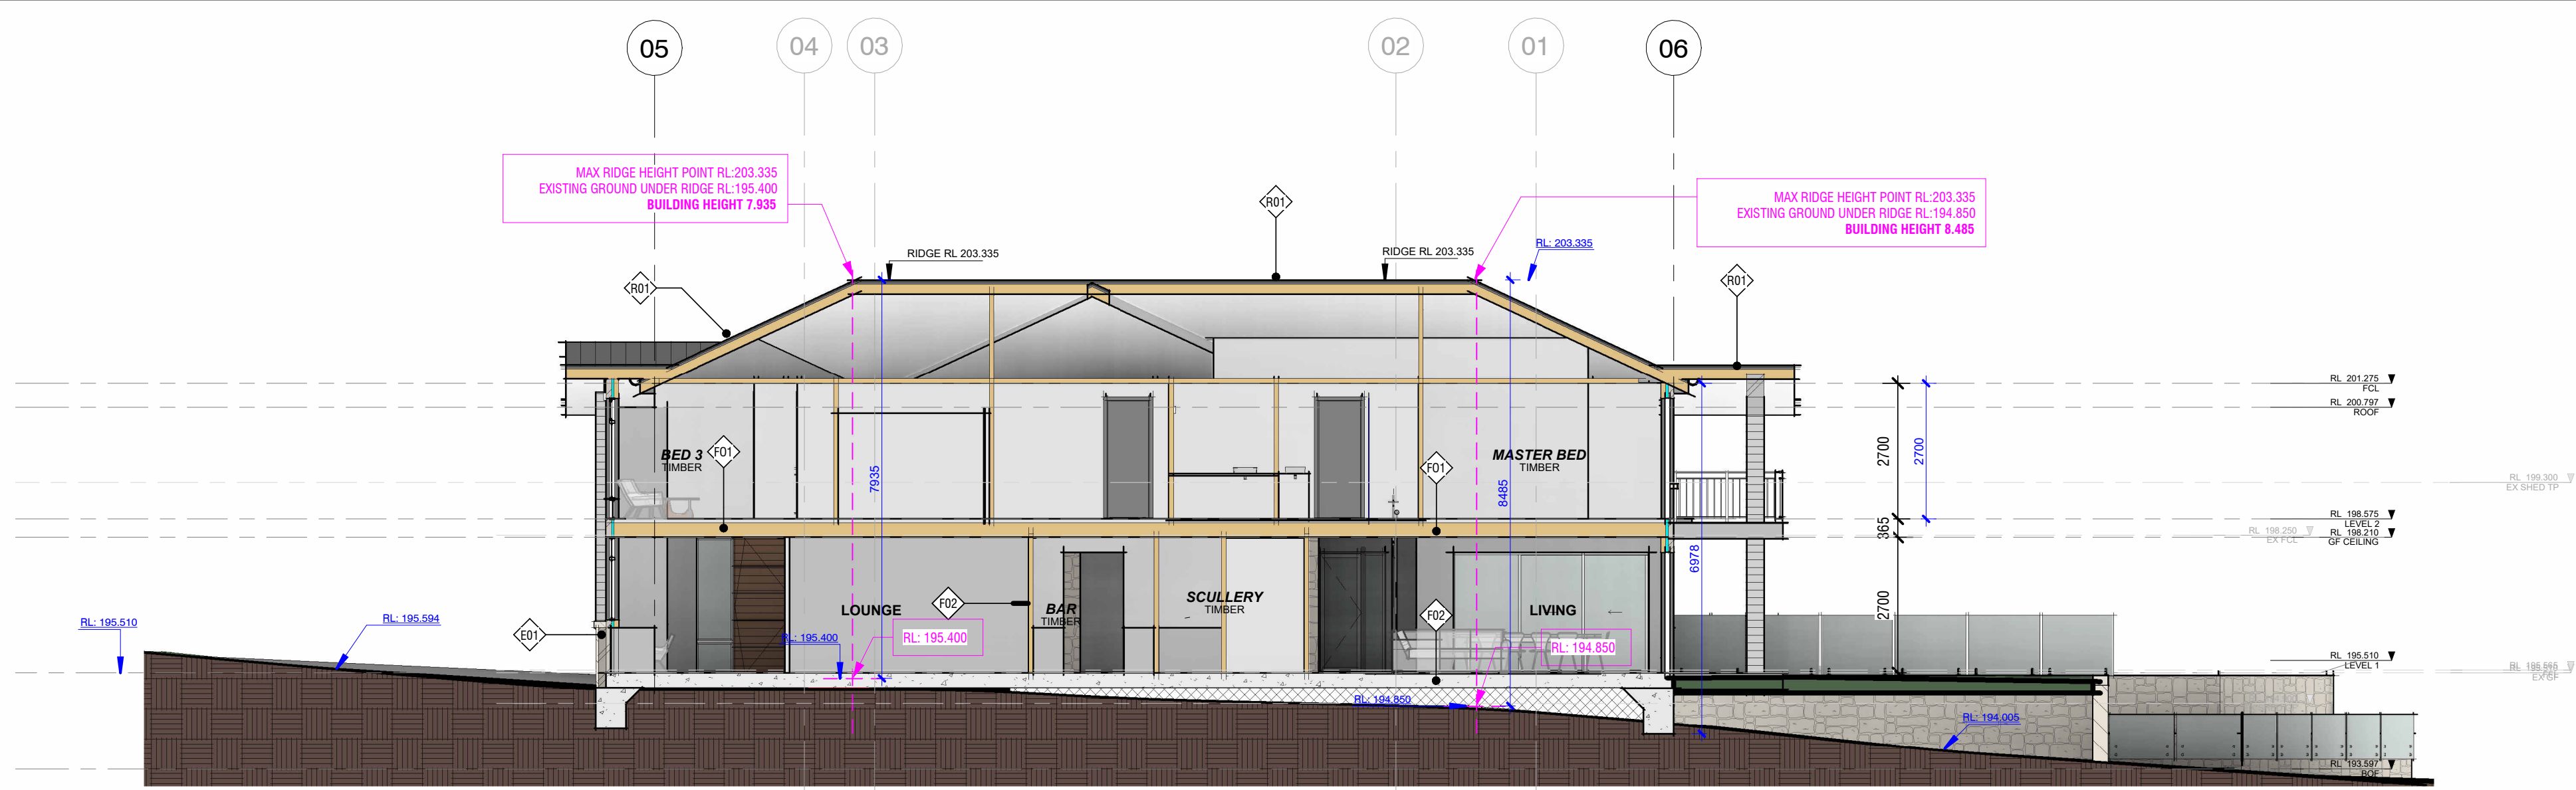


1 Section 1
1 : 100

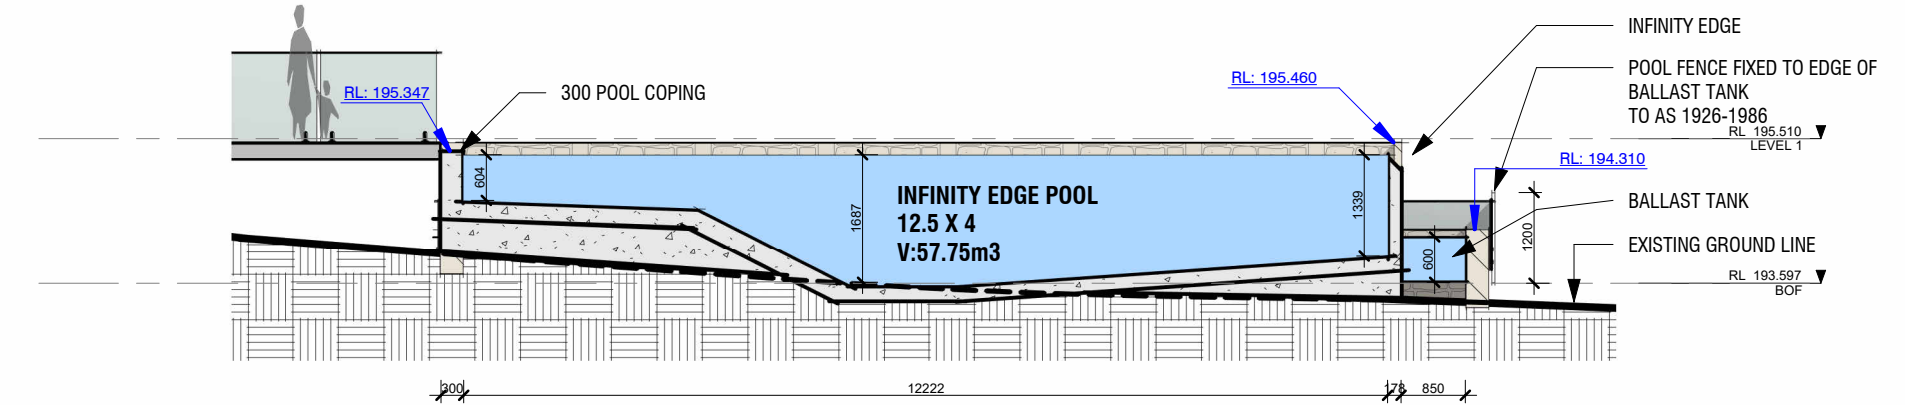

3 POOL LONG SECTION
1 : 100

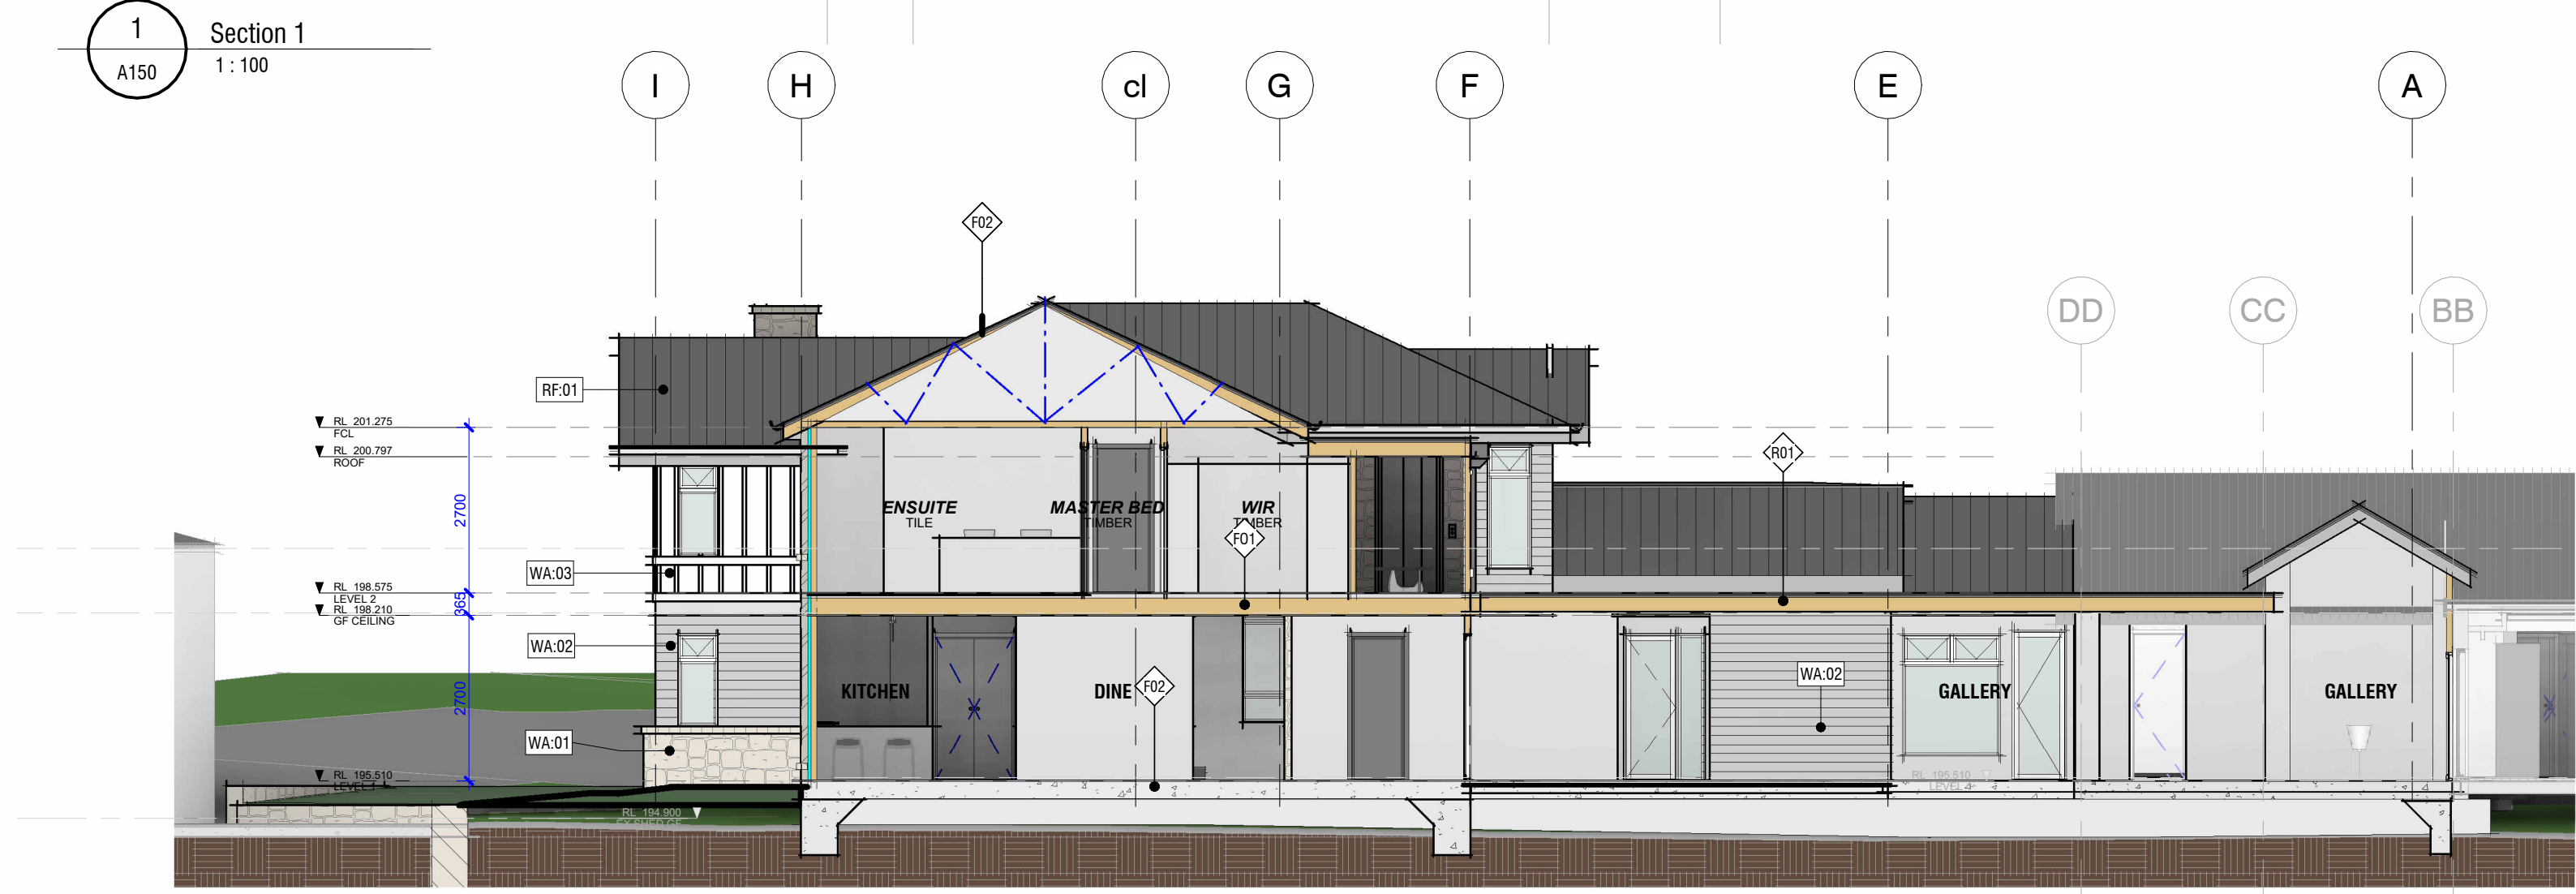

2 Section 7
1 : 100

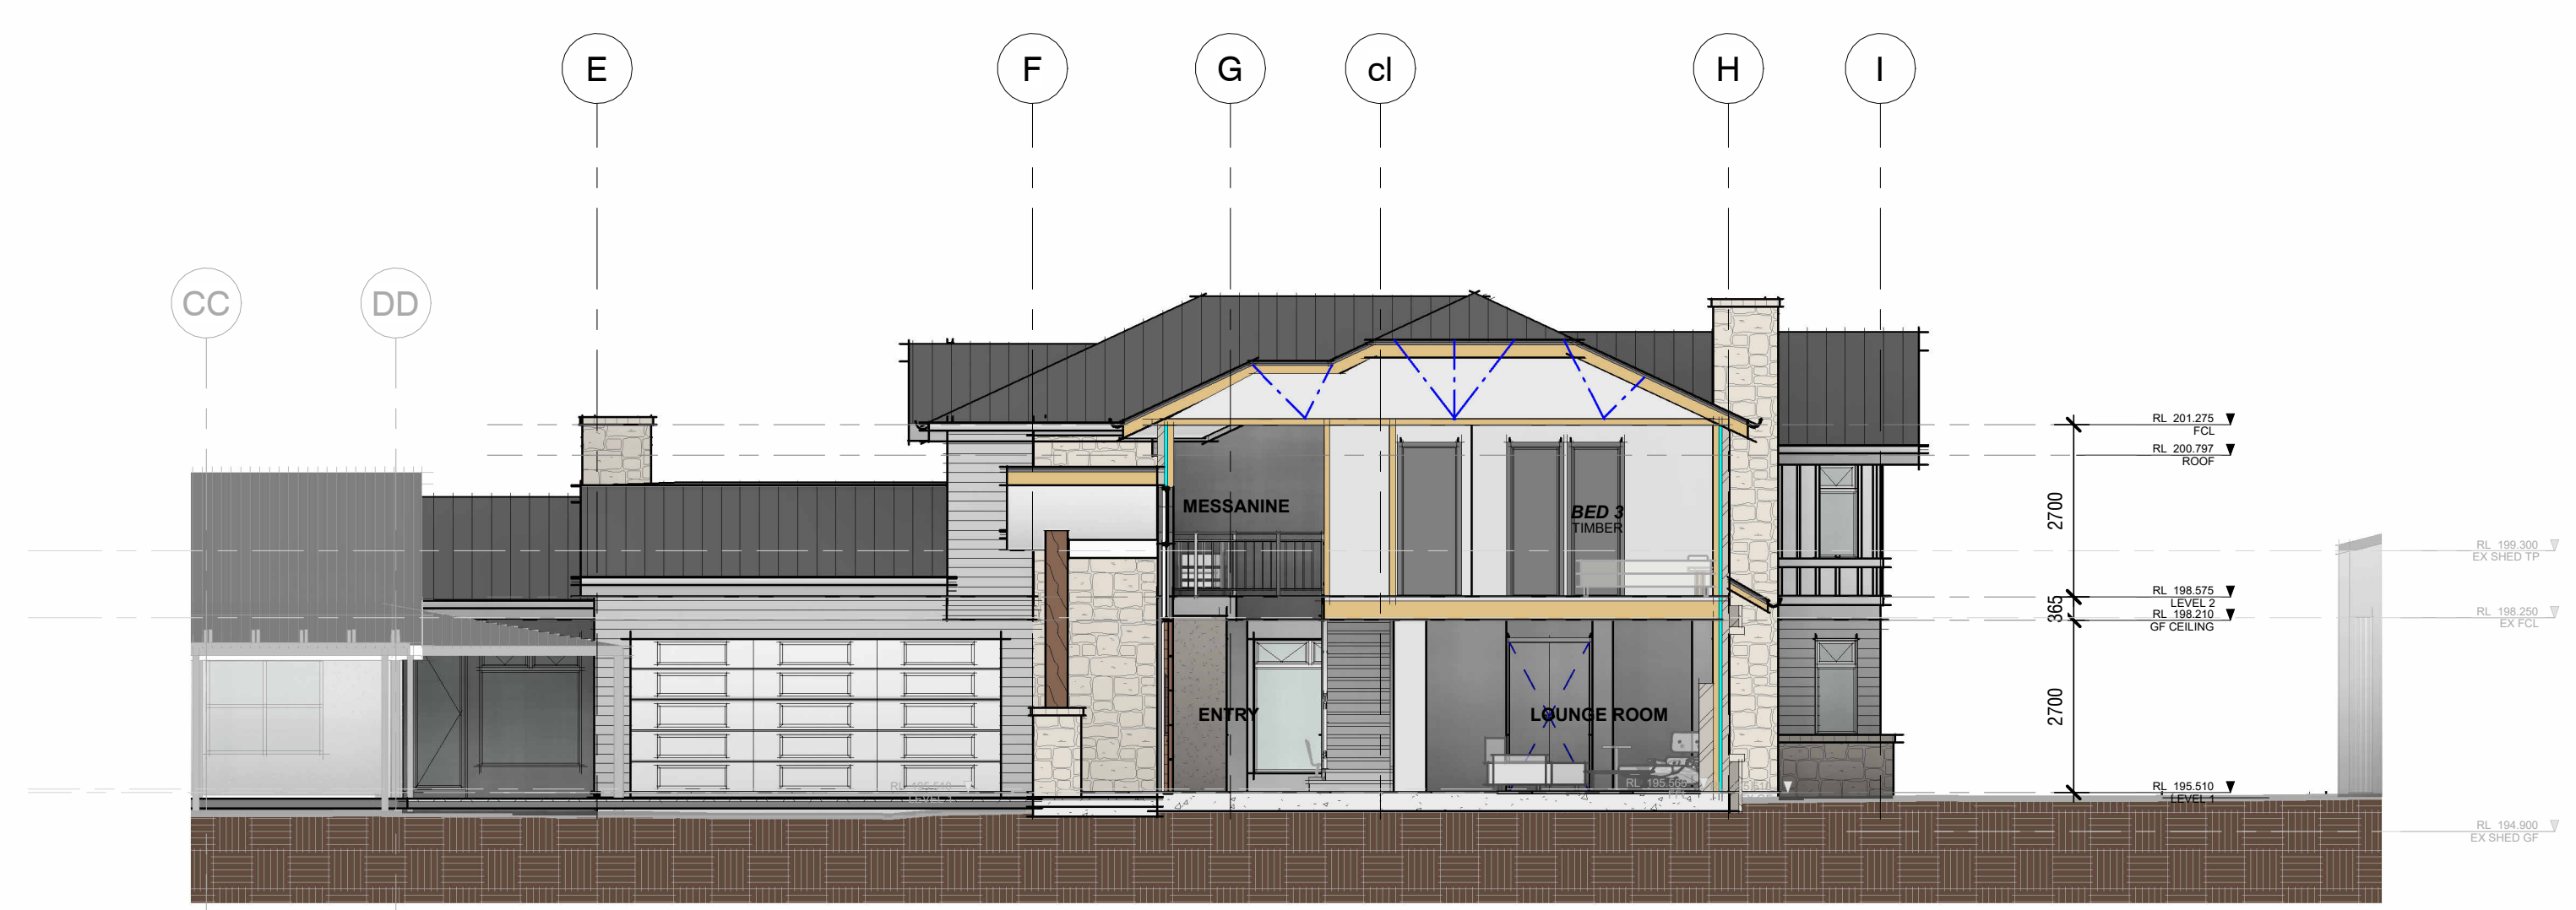

5 Section 3
1 : 100

Area Schedule (Gross Building)				
Level	Name	Area	Area Type	Comments
LEVEL 1	ALFRESCO	52.8 m ²	Gross Building Area	
LEVEL 1	GARAGE	54.6 m ²	Gross Building Area	
LEVEL 1	GF BALC	7.0 m ²	Gross Building Area	
LEVEL 1	PORCH	7.6 m ²	Gross Building Area	
LEVEL 2	FF BALC	6.3 m ²	Gross Building Area	
: 5		128.3 m ²		
LEVEL 1	GF LIVING	216.1 m ²	Gross Building Area	BASIX
LEVEL 2	FF LIVING	204.8 m ²	Gross Building Area	BASIX
LEVEL 1	GALLERY	40.3 m ²	Gross Building Area	BASIX
BASIX: 3		461.3 m ²		
LEVEL 1	EXISTING	210.9 m ²	Gross Building Area	BASIX EX
BASIX EX: 1		210.9 m ²		
		800.4 m ²		

Architectural drawing of a building facade showing floor levels, window types, and dimensions.

Floor Levels:

- FCL:201.162 (First Floor Ceiling Level)
- FIRST FLOOR FFL:198.462 (First Floor Finished Floor Level)
- FCL:198.097 (First Floor Ceiling Level)
- GROUND FLOOR FFL:195.397 (Ground Floor Finished Floor Level)

Window Types and Dimensions:

- D01:** Large window with a gabled top and a central wooden door. Dimensions: 2700 (height), 2810 (width), 740 (side panels), 2500 (main panel), 600 (side panels).
- 01:** Vertical window unit. Dimensions: 1200 (width), 450 (height), 1600 (height), 1200 (height), 1415 (height), 905 (height).
- 02:** Large window unit. Dimensions: 2500 (width), 600 (side panels), 1300 (main panel), 600 (side panels), 450 (height), 2100 (height), 1600 (height), 1200 (height), 1415 (height), 1415 (height), 6165 (height).
- 03:** Window unit. Dimensions: 2800 (width), 600 (side panels), 1650 (main panel), 550 (side panels), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 04:** Window unit. Dimensions: 2200 (width), 1650 (main panel), 550 (side panels), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 05:** Window unit. Dimensions: 650 (width), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 06:** Window unit. Dimensions: 650 (width), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 08:** Window unit. Dimensions: 650 (width), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 09:** Window unit. Dimensions: 1400 (width), 675 (side panels), 50 (main panel), 675 (side panels), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 10:** Window unit. Dimensions: 1400 (width), 675 (side panels), 50 (main panel), 675 (side panels), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 11:** Window unit. Dimensions: 1400 (width), 675 (side panels), 50 (main panel), 675 (side panels), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 13:** Window unit. Dimensions: 900 (width), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 15:** Window unit. Dimensions: 900 (width), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 14:** Window unit. Dimensions: 1200 (width), 575 (side panels), 50 (main panel), 575 (side panels), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- D02:** Large window unit. Dimensions: 2900 (width), 600 (side panels), 1700 (main panel), 600 (side panels), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 16:** Window unit. Dimensions: 1800 (width), 875 (side panels), 50 (main panel), 875 (side panels), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- D03:** Large window unit. Dimensions: 3890 (width), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).
- 17:** Window unit. Dimensions: 2200 (width), 569 (side panels), 528 (main panel), 540 (side panels), 563 (side panels), 2400 (height), 1350 (height), 900 (height), 50 (height), 400 (height).

Notes:

- NOTE: BUILDER TO CONFIRM IF WINDOW CAN BE MANUFACTURED AS A SINGLE BAY WINDOW
- NOTE: BUILDER TO CONFIRM IF WINDOW CAN BE MANUFACTURED AS A SINGLE BAY WINDOW

Architectural drawing of the ground floor windows and doors. The drawing shows a series of openings labeled D04, D05, D06, D07, D08, D09, D10, 18, 19, 20, 23, 21, and D11. Dimensions are provided for each opening, including width, height, and depth. The drawing is oriented with the ground floor at the bottom and the first floor at the top. The ground floor level is marked as FFL:195.397 and the first floor level as FFL:198.462. The drawing is titled 'WINDOWS & DOORS GROUND FLOOR' and has a scale of 1:50.

