

PRELIMINARY GEOTECHNICAL ASSESSMENT:

61 Wyadra Avenue, North Manly

1.0	LANDSLIP RISK CLASS (<i>Highlight indicates Landslip Risk Class of property</i>)
<input checked="" type="checkbox"/>	<i>A - Geotechnical Report not normally required</i>
<input checked="" type="checkbox"/>	<i>B - Geotechnical Engineer (Under Council Guidelines) to decide if Geotechnical Report is required</i>
<input type="checkbox"/>	<i>C - Geotechnical Report is required</i>
<input type="checkbox"/>	<i>D - Geotechnical Engineer (Under Council Guidelines) to decide if Geotechnical Report is required</i>
<input type="checkbox"/>	<i>E - Geotechnical Report required</i>

2.0 Proposed Development

- 2.1 Construct a new carport on the uphill side of the property.
- 2.2 Various other minor external alterations.
- 2.3 Apart from those for footings, no excavations are required. No fills are shown on the plans.
- 2.4 Details of the proposed development are shown on 6 drawings prepared by Nikki Mote Architect, Project number 2002, drawings numbered AR DA 1-00 to AR DA 1-02, AR DA 3-00, AR DA 5-00, and AR DA 5-01, dated 24/5/22.

3.0 Site Location

- 3.1 The site was inspected on the 15th June, 2022, and previously on the 9th July, 2021.
- 3.2 This residential property is on the low side of the road and has a N aspect. It is located on the gentle to moderately graded upper middle reaches of a hillslope. Medium Strength Hawkesbury Sandstone bedrock outcrops on the downhill side of

the property. Where sandstone is not exposed, it is expected to underlie the surface at relatively shallow depths. The natural surface of the block has been altered with an excavation for the lower ground floor of the house and with filling used for landscaping on the downhill side of the property. The proposed development will not alter the surface further for the proposed works.

3.3 The site shows no indications of historical movement in the natural surface that could have occurred since the property was developed. We are aware of no history of instability on the property.

4.0 Site Description

The natural slope falls across the site at an average angle of $\sim 11^\circ$. At the road frontage, a concrete driveway runs to a parking area on the uphill side of the house. The fill for the road is battered to stable angles and is supported by a low stable concrete block retaining wall that lines the road frontage. Between this wall and the house is a gently sloping lawn area. The part three-storey brick and timber framed and clad house is supported on brick walls and brick piers. No significant signs of movement were observed in the supporting walls of the house and the supporting brick piers stand vertical. Some of the supporting walls were observed to be supported directly onto outcropping sandstone bedrock on the downhill side of the house. A gently sloping lawn-covered fill extends off the downhill side of the house. Competent Medium Strength Sandstone outcrops through the W side of this lawn. The fill is supported by a stable battered slope lined with rocks reaching $\sim 1.2\text{m}$ high. The area surrounding the house and driveway is mostly lawn-covered with some paved areas. No signs of movement associated with slope instability were observed on the grounds. The adjoining neighbouring properties were observed to be in good order as seen from the road and the subject property.

5.0 Recommendations

The proposed development and site conditions were considered and applied to the Council Flow Chart.


Provided good engineering and building practice are followed, no further Geotechnical assessment is recommended for the proposed development.

White Geotechnical Group Pty Ltd.



Ben White M.Sc. Geol.,
AusIMM., CP GEOL.
No. 222757
Engineering Geologist.

Preliminary Assessment Flow Chart – Norther Beaches Council (Warringah)

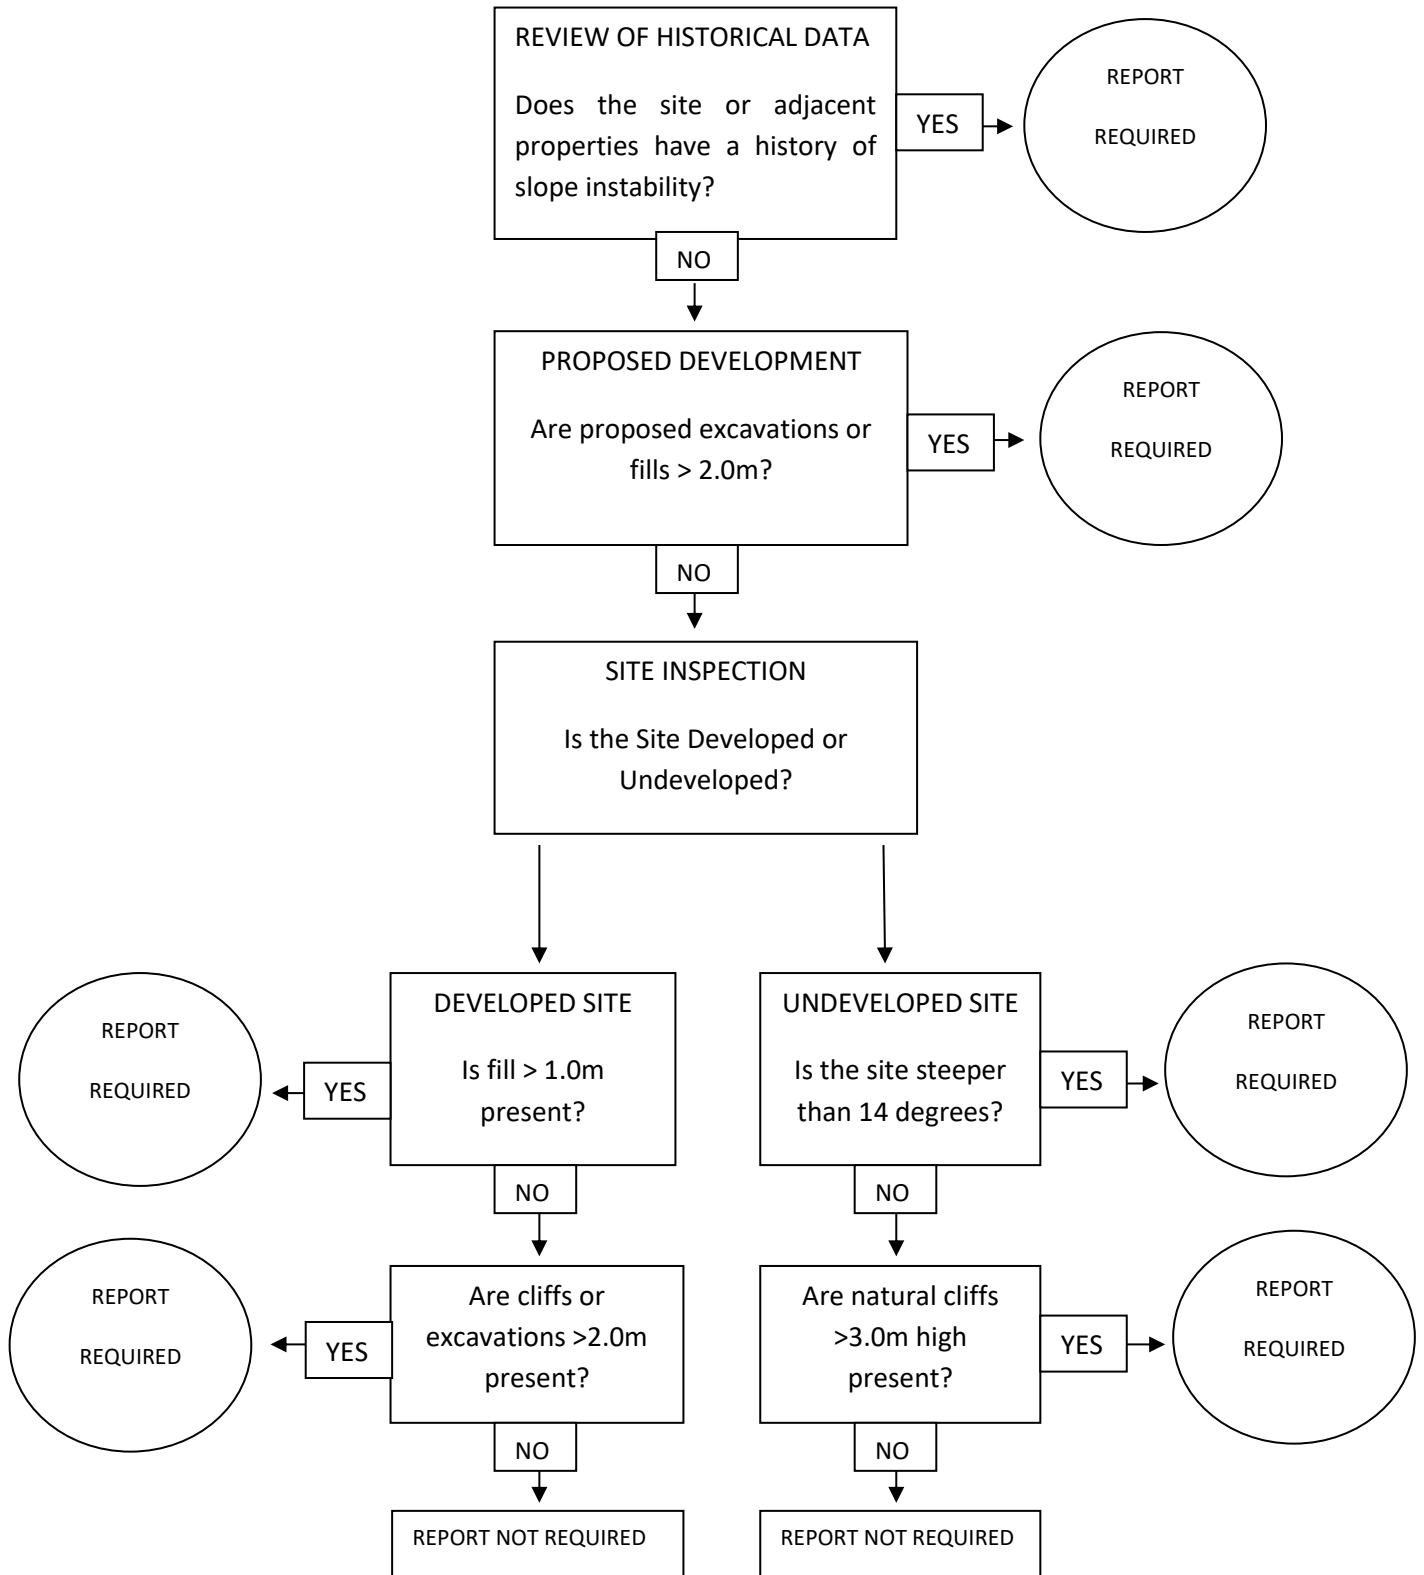

Information about your Preliminary Assessment

This Preliminary Assessment relies on visual observations of the surface features observed during the site inspection. Where reference is made to subsurface features (e.g. the depth to rock) these are interpretations based on the surface features present and previous experience in the area. No ground testing was conducted as part of this assessment and it is possible subsurface conditions will vary from those interpreted in the assessment.

In some cases, we will recommend no further geotechnical assessment is necessary despite the presence of existing fill or a rock face on the property that exceed the heights that would normally trigger a full geotechnical report, according to the Preliminary Assessment Flow Chart. Where this is the case, if it is an existing fill, it is either supported by a retaining wall that we consider stable, or is battered at a stable angle and situated in a suitable position on the slope. If it is a rock face that exceeds the flow chart limit height, the face has been deemed to be competent rock that is considered stable. These judgements are backed by the inspection of over 5000 properties on Geotechnical related matters.

The proposed excavation heights referred to in section 2.0 of this assessment are estimated by review of the plans we have been given for the job. Although we make every reasonable effort to provide accurate information excavation heights should be checked by the owner or person lodging the DA. If the excavation heights referred to in in section 2.0 of this assessment are incorrect, we are to be informed immediately and before this assessment is lodged with the DA.