



www.bushconaustralia.com.au - Email-matt@bushconaustralia.com.au - Phone-0403 161 732

40 Ruskin Rowe, Avalon NSW, 2107

Bushfire Risk Assessment

In relation to a proposed development at:

No 4 Allen Avenue, Bilgola, NSW


This assessment has been prepared and certified by: Matthew Toghil. BPAD certified practitioner FPAA Accreditation NO: BPAD31642 Report No: 4All-01 Date: 20/12/2015	
Can this proposal comply with AS3959-2009 & addendum to Appendix 3 of PBP?	<u>YES</u>
What is the recommended level of compliance with AS3959, 2009?	<u>BAL-12.5</u>
Does this development comply with the requirements of PBP?	<u>YES</u>
Does this development comply with the Aims and Objectives of PBP?	<u>YES</u>
Is referral to the NSW RFS required?	<u>NO</u>
Architectural plans provided by: Jason Youssef Blue Sky Developments Pty Ltd	BH Design DWG: 1509/DA 1-10 Dated: December 2015

Table of Contents

Executive Summary	3
1. Description of the subject property.....	4
2. Development Proposal and Building Classification	5
3. Classification of the Vegetation on and surrounding the site	6
4. Assessment of effective slope	7
5. Access and Egress	7
6. Adequacy of water supply.....	7
7. Features that may mitigate the impact of a high intensity bushfire.....	8
8. Environmental impact of any proposed bushfire protection measures.....	8
9. Bushfire Risk Assessment.....	8
11. The extent to which the construction conforms or deviates from Chapter 4 of ‘Planning for Bushfire Protection 2006’	9
12.Recommendations.....	10
13. Summary	11
14. References.....	12

Executive Summary

The purpose of the report is to determine the category of bushfire attack and subsequent construction standard for the proposed alterations and additions to the existing class 1a dwelling at No 4 Allen Avenue, Bilgola Beach, NSW.

The site had been identified as 'bush fire prone land' for the purpose of Section 146 of the *Environmental Planning and Assessment Act 1979* and the Legislative requirements for building on bush fire prone lands are applicable.

The proposed development is in infill development as defined within Chapter 4.3.5 of *Planning for Bushfire Protection 2006* and this report has been prepared in accordance with the requirements of Section 79BA of the Environment Planning and Assessment Act.

This assessment includes an analysis of the hazard, threat and subsequent risk of the development proposal and provides recommendations that satisfy the Objective and Performance requirements of the Building Code of Australia, Planning for Bushfire Protection 2006 [PBP] and Australian Standard AS3959, 2009.

Following a site assessment it was determined the distance of the development from the closest hazard would keep the Bushfire Attack Level (BAL) to BAL-12.5, in accordance with the methodology described in PBP. The development also meets performance criteria as set out in chapter 4 of PBP in relation to APZ's, siting and design, construction standards, access and egress requirements, water and utility services and landscaping.

Site was inspected 18/12/15

1. Description of the subject property

Property address: Lot No 20 DP 11978 (Lot A DP 379490)

No 4 Allen Avenue, Bilgola Beach

Local Government Area: Pittwater

The development site is a residential block that faces northwest off Allen Avenue. The following sections 4-8 describe in detail the vegetation, slope, access and egress, availability of water supplies and environmental considerations for the site.

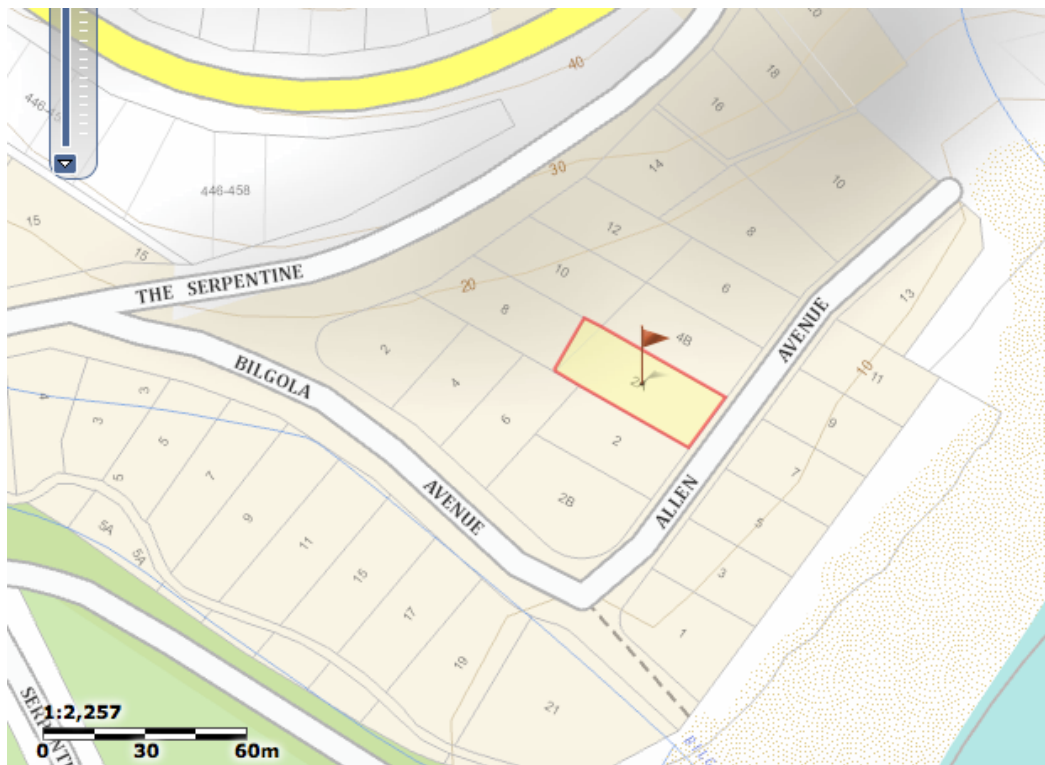


Figure 1: Location of the subject site

2. Development Proposal and Building Classification

The development proposal is for the alteration and additions to the existing class 1a dwelling.

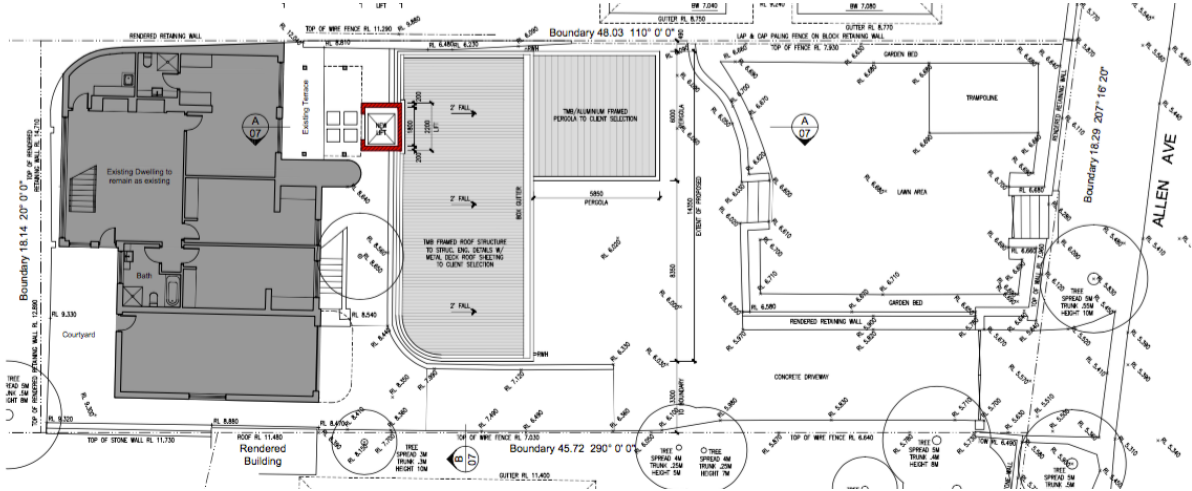


Figure 2: Proposed ground floor plan.

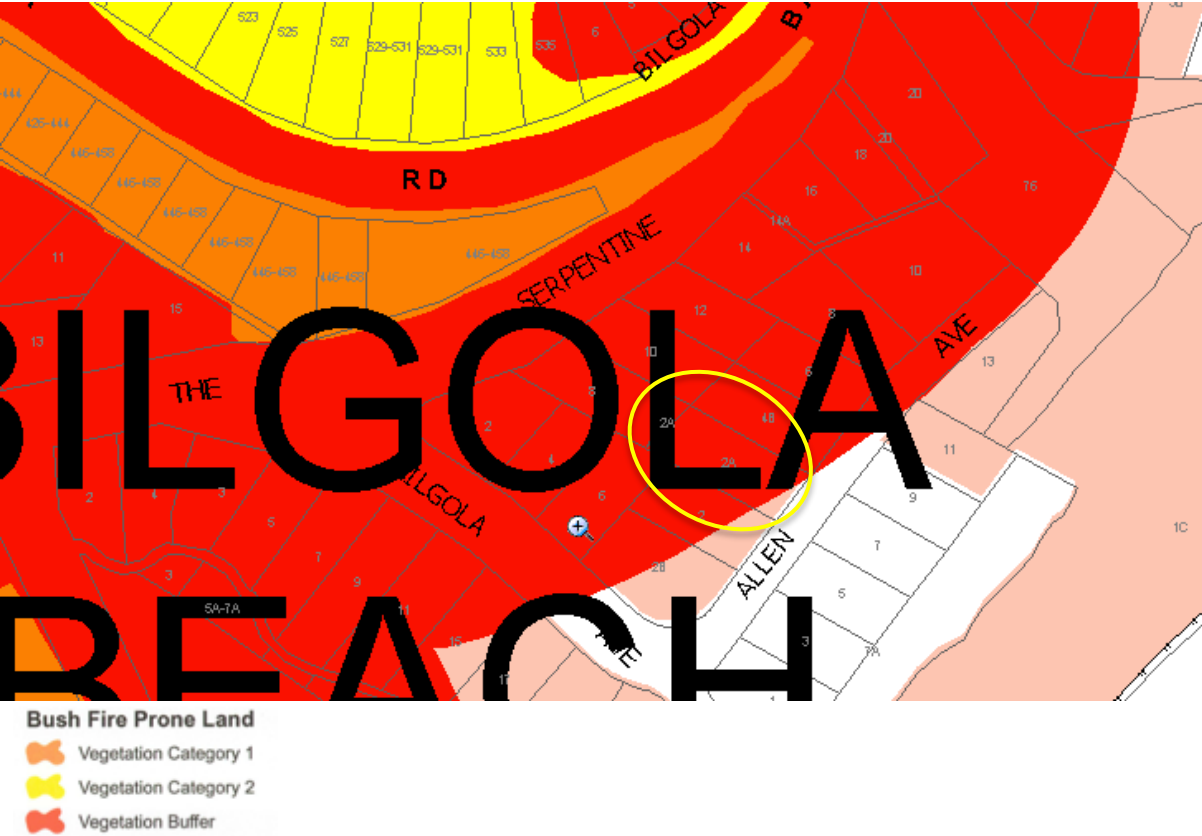


Figure 3: Pittwater Council’s bushfire prone land map showing the location of the subject site (map not to scale).

3. Classification of the Vegetation on and surrounding the site

The site is located within an existing residential subdivision. The site has been cleared and there is no threat from bushfire attack on the site. For the purpose of assessing the bushfire hazard to the subject site, there is an area of vegetation to the northwest of the site, which is of significance.



Figure 4: Aerial photo showing the location of the site and surrounding vegetation.

North (northwest): 76m to the north of the proposed new dwelling there is an area of vegetation that is considered a threat for bushfire attack to the site. With reference to PBP and the bushfire prone land map for the area the classification of vegetation for this hazard Category 1, Tall Shrub (Mallee/Mulga).


East: Properties to the east of the site are developed and maintained and there is no threat of bushfire attack from this direction for more than 100m.

South: Properties to the south of the site are developed and maintained and there is no threat of bushfire attack from this direction for more than 100m.

West: Properties to the west of the site are developed and maintained and there is no threat of bushfire attack from this direction for more than 100m.

4. Assessment of effective slope

Direction	Hazard type	Effective Slope
North (northwest)	Forest	Upslope
East	No hazard >100m	N/A
South	No hazard >100m	N/A
West	No hazard >100m	N/A

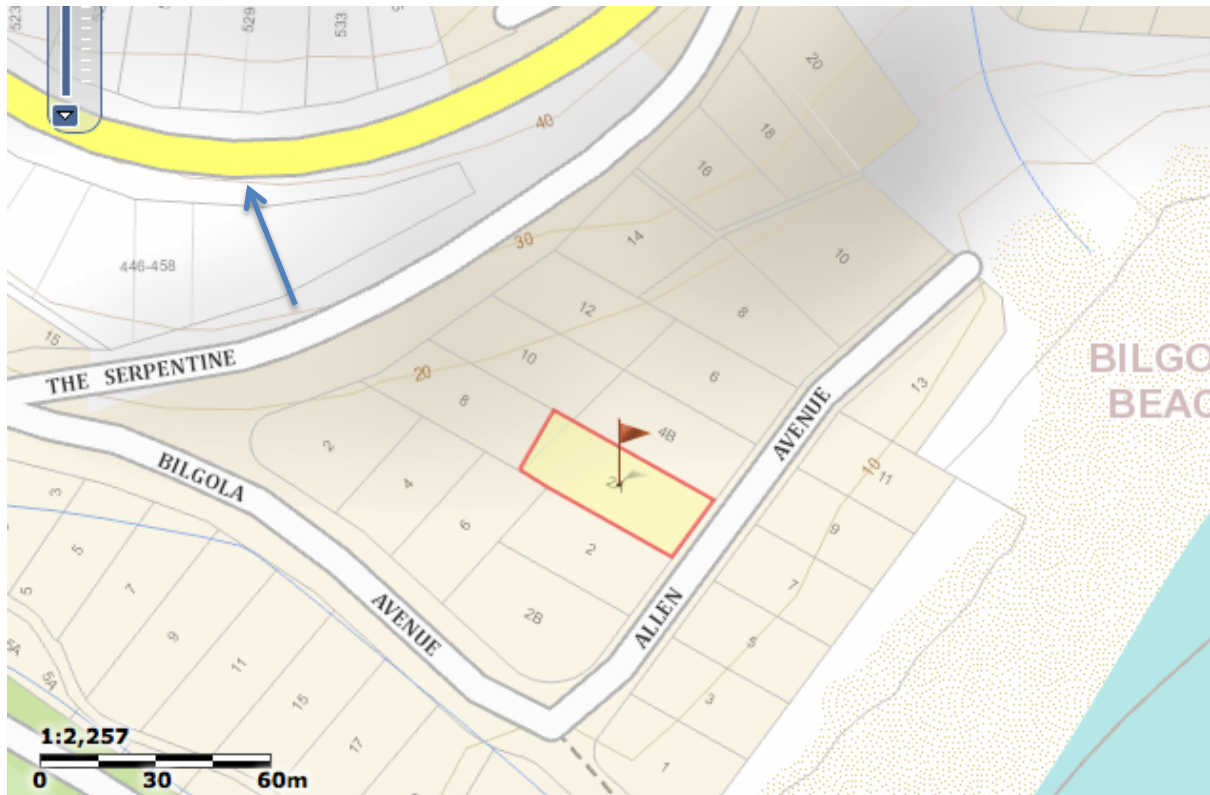

Legend:  Direction of effective slope

Figure 6: Contour map showing direction of effective slope.

5. Access and Egress

The site has direct access to Allen Avenue, which is a public road, access and egress for emergency vehicles appears adequate.

6. Adequacy of water supply

The area has reticulated water supply and hydrants are spaced at a regular distance along Allen Avenue.

7. Features that may mitigate the impact of a high intensity bushfire

There are no significant features on or adjoining the site that may mitigate the impact of a high intensity bushfire on the proposed development.

8. Environmental impact of any proposed bushfire protection measures.

The scope of this assessment has not been to provide an environmental assessment, however, the bushfire protection measures that are proposed will have no adverse environmental effects. All protection measures are either within the boundaries of the allotment or part of the constructed building.

9. Bushfire Risk Assessment

Table 1; reference AS 3959, 2009 table 2.4.2

Determination of the category of bushfire attack for the site, and subsequent required building standards.

Direction	Distance to classified vegetation	Vegetation Classification	Assessment of effective slope	FDI	Bushfire Attack Level
North	76m	Tall Shrub (Mallee/Mulga)	Upslope	100	BAL-12.5
East	>100m	N/A	N/A	N/A	BAL-12.5
South	>100m	N/A	N/A	N/A	BAL-12.5
West	>100m	N/A	N/A	N/A	BAL-12.5

Summary: Based upon the relevant provisions of PBP the anticipated radiant heat attack for the site is <12.5kW/m² and the subsequent minimum construction standard is BAL-12.5 AS 3959- 2009.

11. The extent to which the construction conforms or deviates from Chapter 4 of 'Planning for Bushfire Protection 2006'

Performance Criteria	How this development meets acceptable solutions
The intent may be achieved where:	
<u>In relation to APZ's:</u> -Defendable space is provided onsite. -An APZ is provided and maintained for the life of the building.	Defendable space is provided on all sides of the building. Asset protection zones are provided for on site and by adjoining development and public roads.
<u>In relation to siting and design:</u> - Building are sited and designed to minimise the risk of bushfire attack.	The siting of the building has been previously determined in accordance with local council requirements, no advantage could be gained by recommending a re-siting of the building.
<u>In relation to construction standards:</u> It is demonstrated that the proposed building can withstand bushfire attack in the form of wind, smoke, embers, radiant heat and flame contact.	Construction standards have been recommended in accordance with the requirements of <i>Planning for Bushfire Protection 2006</i> and <i>AS 3959-2009 Construction of buildings in bushfire prone areas</i> .
<u>In relation to access requirements:</u> Safe operational access is provided [and maintained] for emergency service personnel in suppressing a bushfire while residents are seeking to relocate, in advance of a bushfire.	This site has direct access to public roads, and the access and egress for emergency vehicles and evacuation appears to be adequate.
<u>In relation to water and utility services:</u> -Adequate water and electrical services are provided for fire fighting operations. -Gas and electricity services are located so as to not contribute to the risk of the building.	The area has reticulated water supply and the nearest street hydrant is within the minimum required distance from the most distant point of the subject site in accordance with the requirements of PBP and AS2419.1 2005. This report shall recommend compliance with PBP 4.1.3 for services including electricity and gas.
<u>In relation to landscaping:</u> It is designed and managed to minimise flame contact and radiant heat to buildings, and the potential for wind driven embers to cause ignition.	The development application should include recommendations that the site is managed in accordance with Inner Protection Area requirements of PBP
<u>In relation to emergency and evacuation planning</u>	It is advised the residents should complete a <i>Bushfire Survival Plan</i> as formulated by the NSW Rural Fire Service and Fire and Rescue NSW.

12.Recommendations

The following recommendations are made for the bushfire protection measures for the proposed alterations and additions to the existing class 1a dwelling at No 4 Allen Avenue, Bilgola Beach, NSW and are based upon the relevant provisions of the NSW RFS guideline entitled *Planning for Bushfire Protection 2006*.

1) <u>Construction standard.</u>	New construction shall comply with a minimum standard of section 3 [construction general] and section 5 (BAL-12.5), AS3959-2009 and Addendum to Appendix 3 of <i>Planning for Bushfire Protection 2006</i> .
2) <u>Electricity and gas supply</u>	As far as practical, new electricity and gas supplies shall be installed in accordance with the requirements of 4.1.3 of PBP. Note: 4.1.3 of PBP requires the <i>'where practical, electrical transmission lines should be underground'</i> and <i>'the location of gas services will not lead to ignition of surrounding bushland of the fabric of the building'</i> .
3) <u>Landscaping</u>	At the commencement of building works and in the perpetuity, the entire property shall be managed in accordance with Appendix 5 of <i>Planning for Bushfire Protection 2006</i>
4) <u>Emergency Risk Management</u>	It is advised the residents should complete a <i>Bushfire Survival Plan</i> as formulated by the NSW Rural Fire Service and Fire and Rescue NSW. An emergency evacuation is not recommended as a condition of consent.
5) <u>Adjacent Structures [class 10b]</u>	At the planning stage, class 10b buildings in bushfire prone areas should be non-combustible. [Class 10b buildings include a fence, retaining wall or free standing wall, swimming pool or the like].
6) <u>Water supplies</u>	Reticulated water supply is located on the adjoining road at regular intervals and id easily accessible. No additional water supplies have been recommended.

13. Summary

This report consists of a bushfire risk assessment for proposed alterations and additions to the existing class 1a dwelling at No 4 Allen Avenue, Bilgola Beach, NSW.

The report concludes that the proposed development is on designated bushfire prone land and the legislative requirements for development of bushfire prone areas are applicable. The proposed development will be constructed to the minimum standard required in accordance with the guidelines of *Planning for Bushfire Protection 2006* and *AS 3959-2009 Construction of buildings in bushfire prone areas*.

This report has considered all of the elements of bushfire attack and provided the proposed development is constructed in accordance with the recommendations of section 12 of this report, it is my considered opinion that the development satisfies the Objectives and Performance requirements of the *Building Code of Australia, Planning for bushfire Protection 2006* and *Australian Standard AS3959, 2009*.

*Note: Notwithstanding the precautions adopted, it should always be remembered that bushfires burn under a wide range of conditions and an element of risk, no matter how small always remains, and although the standard is designed to improve the performance of such buildings, there can be no guarantee, because of the variable nature of bushfires, that any one building will withstand a bushfire attack on every occasion. This report is a Bushfire Hazard Assessment that provides the required information to assist Local Councils and the Rural fire Service in determining compliance in accordance with *Planning for Bushfire Protection 2006* and *AS3959, 2009*. The local Council is the final consenting authority and the construction of the building must comply with the recommendations included in the council's conditions of consent.*



Matthew Toghil- Bushfire Consultant
Accreditation No. BPAD31642
Grad Cert Bushfire Protection, UWS 2012
Certificate IV Building & Construction
Certificate II in Public Safety (Firefighting and Emergency Operations)
Member- Fire Protection Association Australia



14. References

Australian Building Codes Board

Building Code of Australia

Volume 1 & 2

Canprint

Australian Building Codes Board [2001]

Fire Safety Engineering Guidelines

Edition 2001

ABCB Canberra

D. Drysdale D. [1998]

Introduction to Fire Dynamics 2nd Edition

John Wiley & Sons Ltd

NSW Government Environmental Planning and Assessment Act [1979]

Part 79BA-Consultation and development consent- Certain bushfire prone land

NSW Government Printer

Planning NSW [2006]

Planning for Bushfire Protection 2006

A guide for Councils, Planners, Fire Authorities, Developers and Home Owners

This document provides the necessary planning considerations when developing areas for residential use in residential, rural residential, rural and urban areas when development sites are in close proximity to areas likely to be affected by bushfire events and replaces Planning for Bushfire Protection 2001.

[This document is essential reading. Download a copy from the RFS website or purchase a copy through the NSW Government online shop or phone 9228 6333.](#)

Ramsay C & Rudolph L [2003]

Landscape and building design for bushfire prone areas

CSIRO Publishing

Standards Australia [2009]

Australian Standards 3959

Australian Building Code Board