Consulting Engineers

STRUCTURAL - CIVIL - STORMWATER - REMEDIAL

STORMWATER NOTES

- 1. ALL PIPES TO BE 100mm ϕ UNLESS NOTED OTHERWISE.
- 2. ALL PIPES TO BE UPVC TO AS 1254-2002 UNLESS NOTED OTHERWISE.
 3. ALL PIPES TO BE LAYED AT 1 % MINIMUM GRADE UNLESS NOTED OTHERWISE.
- 4. ALL PIPES SHALL BE LAID ON A 75mm SAND BED, COMPACTED TO 100% S.M.D.D. BELOW PAVEMENTS.

 (NO COMPACTION REQUIRED BELOW LANDSCAPING)

 COVER TO SURFACE FROM TOP OF PIPE TO BE 300mm MINIMUM.
- COVER TO SURFACE FROM TOP OF PIPE TO BE 300mm MINIMUM.

 BACKFILL TO BE ADEQUATELY CONSOLIDATED AROUND PIPES BY

 METHOD OF RAMMING AND WATERING IN. TRENCHES TO BE FILLED

 WITH GRANULAR MATERIAL AS SPECIFIED.
- 5. ALL DOWN PIPES TO BE 100mm & UNLESS NOTED OTHERWISE.
- 6. DOWN PIPE LOCATIONS ARE INDICATIVE ONLY. LOCATIONS TO BE CONFIRMED WITH ARCHITECT PRIOR TO COMMENCEMENT OF WORK
- 7. PROVIDE CLEANING EYES AT ALL DOWNPIPES
- 8. ALL PITS TO BE CAST INSITU OR, IF PRECAST, APPROVED BY ENGINEER. CAST INSITU PITS TO HAVE 150mm THICK CONCRETE WALLS AND BASE. WALLS TO BE REINFORCED WITH I NI2 TOP TIE UNLESS NOTED OTHERWISE. CAST INSITU PITS GREATER THAN 900 DEEP TO BE MINIMUM 900x600 AND TO HAVE 150mm THICK CONCRETE WALLS AND BASE. WALLS TO BE REINFORCED WITH NI2 AT 300 EACH WAY UNLESS NOTED OTHERWISE.
- 9. ALL PITS GREATER THAN 1000mm DEEP SHALL HAVE STEP IRONS AS PER COUNCIL STANDARDS.
- 10. THE BOUNDARY OR SILT ARRESTOR PIT SHOULD ALWAYS INCORPORATE A SUMP AND MAXI-MESH SCREEN AS PER LOCAL COUNCIL REQUIREMENTS. HOWEVER, UNLESS SPECIFICALLY REQUIRED BY COUNCILS POLICY OR IF THE SITE CONSISTS OF A CLAY OR ROCK SUBGRADE, ALL OTHER DRAINAGE PITS WILL NOT REQUIRE A SUMP.
- 11. ALL WORK TO BE IN ACCORDANCE WITH LOCAL COUNCIL STANDARDS AND SPECIFICATIONS.
- 12. PRIOR TO COMMENCING ANY SITE WORKS THE CONTRACTOR SHALL IMPLEMENT EROSION CONTROL MEASURES TO APPROVED SEDIMENT AND EROSION CONTROL PLAN, EPA GUIDELINES AND COUNCIL SPECIFICATIONS. ALL MEASURES TO REMAIN IN PLACE UNTIL COMPLETION AND STABILIZATION OF THE SITE TO COUNCIL SATISFACTION.
- 13. ALL LEVELS SHOWN ARE TO AHD

UPDATED FOR DA

Description:

Issue:

ISSUED FOR DA SUBMISSION

20-11-2020

- 14. ENSURE THAT ALL PITS AND STORMWATER PIPES ARE LOCATED CLEAR FROM TREE ROOT SYSTEMS.
- 15. ALL EXISTING EARTHENWARE PIPES TO BE UPGRADED TO UPVC.
- 16. ALL WORKS TO BE IN ACCORDANCE WITH AS 3500-2003 NATIONAL PLUMBING DRAINAGE CODE PART 3 STORMWATER DRAINAGE.
- 17. UNLESS NOTED OTHERWISE, SUB-SOIL DRAINS ARE TO BE INSTALLED IN ACCORDANCE WITH AS3500.3 ALONGSIDE WALLS THAT IMPEDE THE NATURAL FLOW OF GROUNDWATER. THIS MAY ALSO INVOLVE TRENCHING INTO THE CLAY OR ROCK SUBGRADE TO DIRECT GROUNDWATER AWAY FROM STRUCTURES.
- 18. IF NOT INDICATED ON PLANS, PROVIDE LEAF CATCHERS TO ALL DOWNPIPES OR GUTTER GUARD TO ALL EAVES GUTTERS.

RAINWATER RE-USE TANKS:

- 1. CONSIDERING THE ROOF CATCHMENT AREA, LOCATION OF PROPERTY, INTENDED USE OF RAINWATER AND GARDEN SIZE WE RECOMMEND PROVIDING A RAINWATER TANK FOR USE AS PER BASIX REQUIREMENTS.
- 2. THE TANKS PROVIDED WILL REDUCE PRESSURE ON COUNCIL'S STORMWATER INFRASTRUCTURE.
- REFERENCES:
 COOMBES P.J. \$ KUCZERA G. (2001), "RAINWATER TANK DESIGN FOR WATER SUPPLY \$
 STORMWATER MANAGEMENT." STORMWATER INDUSTRY ASSOCIATION REGIONAL CONFERENCE
 PATRICK DUPONT \$ STEVE SHACKEL, "RAINWATER"
- AUSTRALIAN GOVERNMENT (2004), "GUIDANCE ON USE OF RAINWATER TANKS"

 4. ALL CONNECTIONS TO PLUMBING AND RAINWATER TANKS TO BE IN ACCORDANCE WITH SYDNEY WATERS' GUIDE "INSTALLING A RAINWATER TANK"
- AVAILABLE AT www.sydneywater.com.au

 5. PROVIDE A DUAL SUPPLY SYSTEM AND BACKFLOW PREVENTION SYSTEM IN ACCORDANCE WITH 'BASIX-DESIGN GUIDE FOR SINGLE DWELLINGS' BY NSW DEPARTMENT OF INFRASTRUCTURE, PLANING AND NATURAL RESOURCES.
- 6. IF NOT SPECIFIED ON PLANS, THE FIRST FLUSH SYSTEM IS TO HAVE A MINIMUM SIZE OF 20L PER 100m2 OF ROOF CATCHMENT AREA PRIOR TO ENTERING THE RAINWATER TANK. INDIVIDUAL SITE ANALYSIS IS REQUIRED IN HEAVILY POLLUTED AREAS TO DETERMINE IF LARGER VOLUMES OF FIRST FLUSH RAINWATER ARE TO BE DIVERTED. IF IN DOUBT, CHECK WITH LOCAL HEALTH AUTHORITIES.
- 7. SCREENED DOWNPIPE RAINWATER HEAD OR OTHER SUITABLE LEAF AND DEBRIS DEVICE TO BE INSTALLED ON EACH DOWNPIPE. SCREEN MESH TO BE 4-6mm AND DESIGNED TO BE SELF-CLEANING.
- 8. FIRST FLUSH DEVICES, OR APPROVED ALTERATIVE, TO BE INSTALLED WITH AN AUTOMATED DIVERSION AND DRAINAGE SYSTEM, THAT IS, NO MANUAL DIVERSION AND DRAINAGE VALVES. REFER TYPICAL FLUSH OUT PIT FOR DETAILS.
- 9. BEFORE PURCHASING MATERIALS OR PAINT TO BE USED ON ROOF CATCHMENT AREAS, THE MANUFACTURER'S RECOMMENDATIONS ON LABELS AND BROCHURES FOR RAINWATER TANK SUITABILITY TO BE READ AND ADHERED TO.
- 10. PRE-STORAGE PITS FOR UNDERGROUND RAINWATER STORAGE TANKS AND FLUSH OUT PITS MAY ASSIST IN LIMITING SILT, AND PREVENT VERMIN, INSECTS (INCLUDING MOSQUITOES) AND DEBRIS FROM ENTERING THE RAINWATER STORAGE AREA.
- 11. BUILDER/PLUMBER TO ENSURE THE INSTALLATION OF THE RAINWATER TANK SYSTEM IS IN ACCORDANCE WITH THE RELEVANT AUSTRALIAN STANDARDS AND THE RAINWATER TANK DESIGN AND INSTALLATION HANDBOOK HB 230-2008. IF IN DOUBT CONTACT ENGINEER.
- 12. RAINWATER TANK TO BE WATER PROOFED IN ACCORDANCE WITH HB 230-200B

DRAWING SCHEDULE:

STORMWATER DRAWINGS

DIOI - GENERAL NOTES & DRAWING SCHEDULE
DIO2 - STORMWATER MANAGEMENT DRAINAGE PLAN

DIO3 - STORMWATER MANAGEMENT DRAINAGE PLAN

DIO4 - STORMWATER MANAGEMENT DRAINAGE PLANS AND DETAILS

ONSITE DETENTION CALCULATIONS ACCORDING TO NORTHERN BEACHES COUNCIL (PITTWATER)

TOTAL SITE AREA 1415 m²

PRE DEVELOPMENT IMPERVIOUS AREA 297 m² (54%)

POST DEVELOPMENT IMPERVIOUS AREA 383 m² (65%)

ANALYSIS OF AREA IMPACTED BY NEW DEVELOPMENT ONLY

DESIGN SITE AREA

DESIGN METHOD USED

224 m² (DEVELOPMENT AREA)

DRAINS (REFER TO DISK)

PRE DEVELOPMENT IMPERVIOUS AREA 133 m²
POST DEVELOPMENT IMPERVIOUS AREA 224 m²

PRE DEVELOPMENT SITE DISCHARGE

5 YR 7 1/s 20 YR 11 1/s 100 YR 16 1/s

POST DEVELOPMENT SITE DISCHARGE

5 YR

20 YR

10 1/s (7 1/s from OSD)

100 YR

13 1/s (12 1/s from OSD)

PORTION OF SITE THROUGH OSD 214 m^2 (95%)
ORIFICE SIZE 90 mm ϕ

TYPE OF CONTROL

ABOVE GROUND POLY TANKS

2 m³ (100% OFFSET)

NOTE

AS PER CLAUSE 9.3.1 OF NORTHERN BEACHES WATER MANAGEMENT FOR DEVELOPMENT POLICY, OSD REQUIRMENT IS OFFSET BY 2500L (25%) OF THE 10,000L OF RAINWATER PROVIDED.

VOLUME OF RAINWATER PROVIDED

MAXIMUM CONCETRATED DISCHARGE TO NATURAL WATERWAY 24 1/s

DIAL 1100 BEFORE YOU

NOTE:

NO INVESTIGATION OF UNDERGROUND
SERVICES HAS BEEN MADE.
ALL RELEVANT AUTHORITIES SHOULD
BE NOTIFIED PRIOR TO ANY EXCAVATION
ON OR NEAR THE SITE

DEVELOPERS & EXCAVATORS MAY BE HELD FINANCIALLY RESPONSIBLE BY THE ASSET OWNER SHOULD THEY DAMAGE UNDERGROUND NETWORKS.

CARELESS DIGGING CAN: - CAUSE DEATH OR SERIOUS INJURY TO

- CAUSE DEATH OR SERIOUS INJURY TO WORKERS AND THE GENERAL PUBLIC
 INCONVENIENCE USERS OF ELECTRICITY, GAS. WATER AND COMMUNICATIONS
- LEAD TO CRIMINAL PROSECUTION AND DAMAGES CLAIMS
 CAUSE EXPENSIVE FINANCIAL LOSSES TO BUSINESS
- TO BUSINESS

 CUT OFF EMERGENCY SERVICES

 DELAY PROJECT COMPLETION TIMES
 WHILE THE DAMAGE IS REPAIRED

MINIMISE YOUR RISK AND DIAL BEFORE YOU DIG. - TEL. 1100

ISSUED FOR D.A.
SUBMISSION ONLY
NOT FOR
CONSTRUCTION

IF IN DOUBT ASK

71			
			DOCUMENT CERTIFICATION
			BOOGHERT GERTH TOATHOR
			Date: 24/11/2020


	DOCUMENT CENTIFICATION					
	Date: 24/11/2020	.				
5	Michael Wachjo	Syd				
CJ	B.E.(Civil), MIEAust.	Suite Gold				
	(Director NB Consulting Engineers)	Unit				
leview:	The copyright of this drawing remains with Northern Beaches Consulting Engineers Ptv Ltd. Trading as NB Consulting Engineers					

MC

	Consulting Engineers STRUCTURAL - CIVIL - STORMWATER - REMEDIAL A.C.N. 076 121 616 A.B.N. 24 076 121 616	
	Sydney : Ph: (02) 9984 7000 Suite 207, 30 Fisher Road Dee Why N.S.W. 2099	
ı	Gold Coast: Ph: (07) 5631 4744	
-	Unit 8, 1726 Gold Coast Highway Burleigh Heads QLD 4220	
,	E: nb@nbconsulting.com.au W: www.nbconsulting.com.au	

H & C DESIGN	Project: ALTERATIONS AND 287 HUDSON PARADE,
JILL MORRISON	Drawing Title: STORMWATER MAN GENERAL NOTES AND DRA

IONS AND ADDITIONS	Date:	Design:	Drawn:		
N PARADE, CLAREVILLE	DEC. 2020	CMcL		MC	Issue:
ATED MANACEMENT	Job No:		Draw	ving No:	Issue:
TES AND DRAWING SCHEDULE	MANAGEMENT D DRAWING SCHEDULE 130101			2101	А

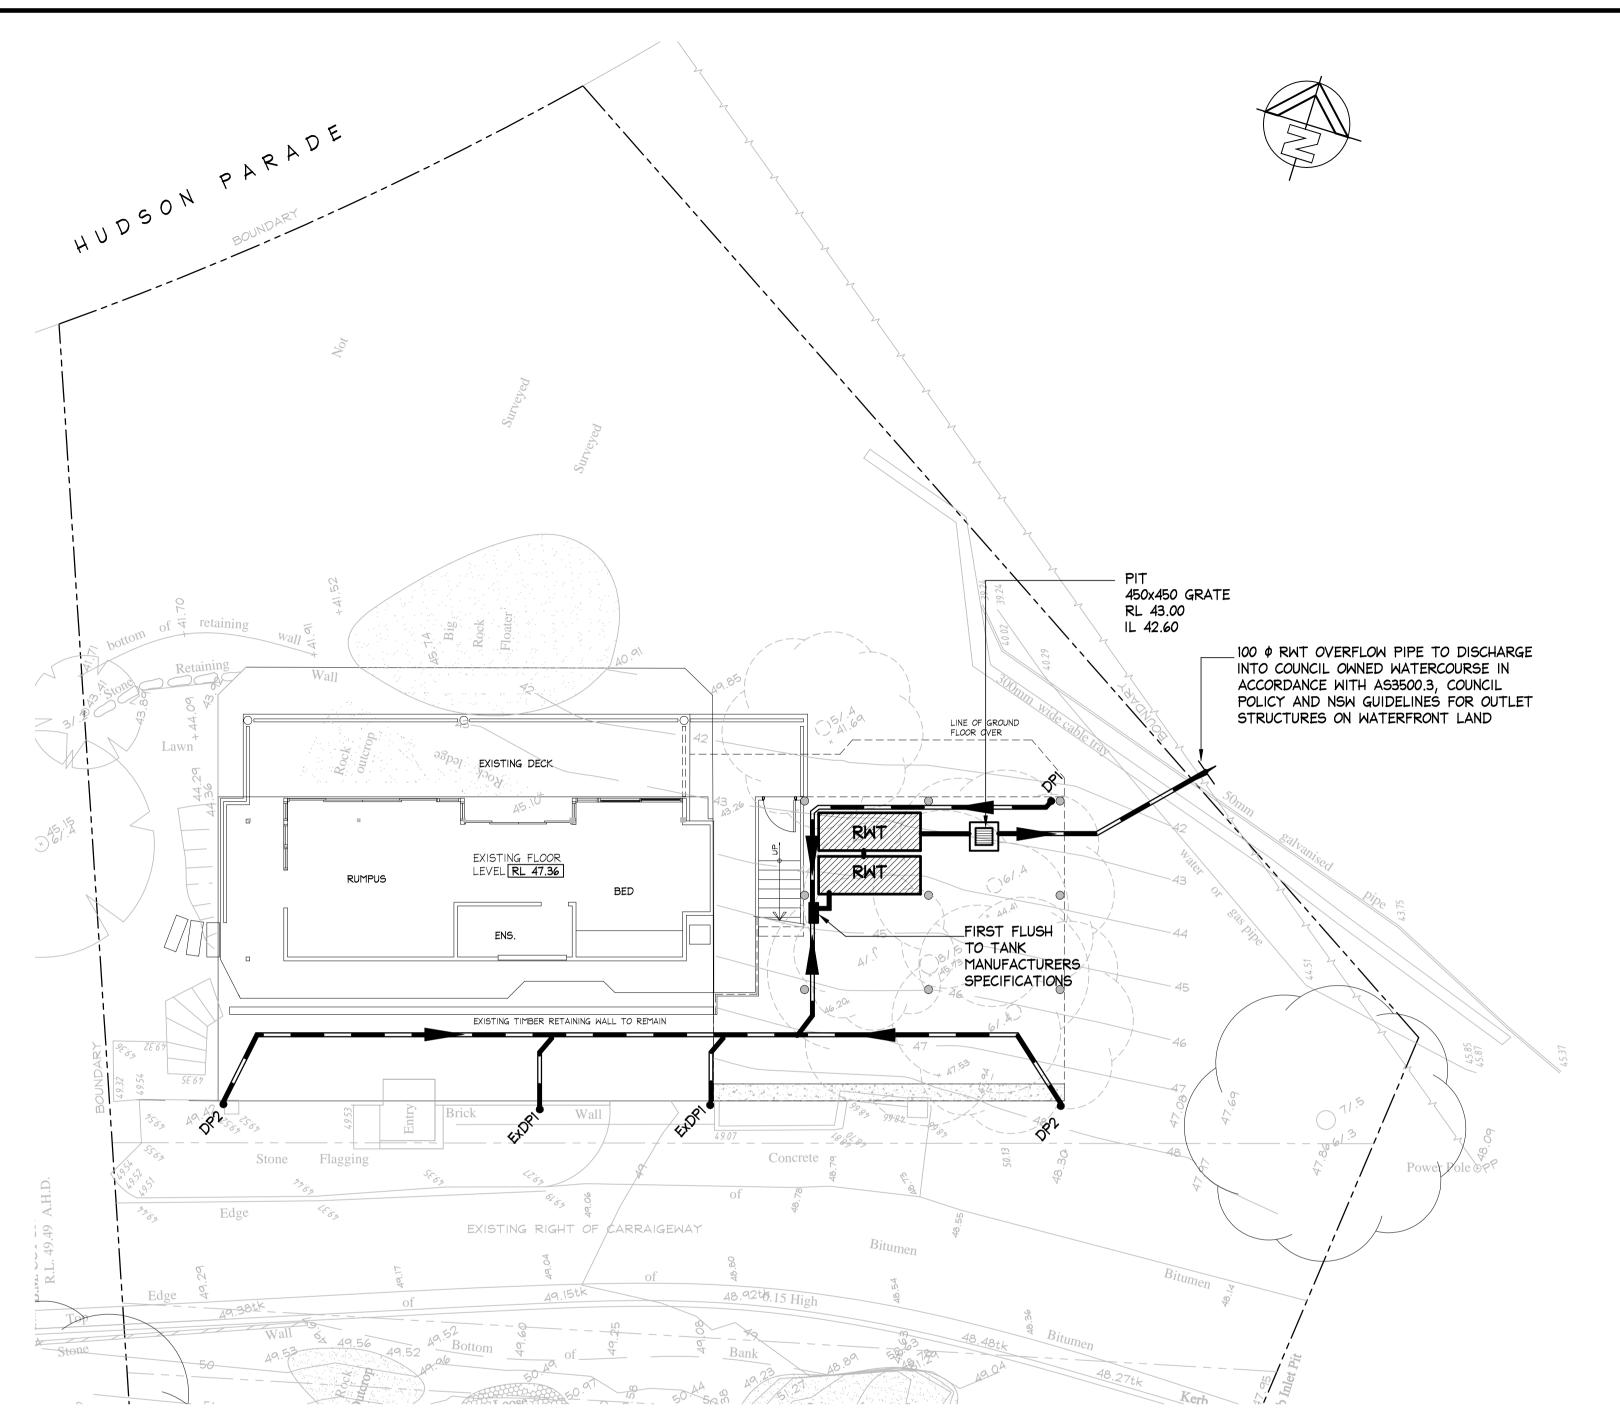

LOWER GROUND LEVEL - DRAINAGE PLAN SCALE = 1 : 100

LEGEND 100mm & DOWNPIPE TO DISCHARGE TO RWT 150mm & DOWNPIPE TO DISCHARGE TO RWT EXISTING 150 \$\phi\$ DOWNPIPE DISCHARGE TO RWT EXISTING 2x100x100 DOWNPIPES (REFER NOTE) EXISTING 100mm & DOWNPIPE TO DISCHARGE TO RWT NEW STORMWATER PIPE STORMWATER PIPE FLOW DIRECTION STORMWATER PIT RAINWATER TANK - REFER DETAIL NOTE: ALL DRAINAGE LINES ARE INDICATIVE ONLY.

NOTE: SUBSOIL DRAINAGE

STORMWATER DRAWINGS DO NOT INCLUDE SUBSOIL AGRICULTURAL DRAINAGE DETAILS FOR D.A. SUBMISSION. NORTHERN BEACHES CONSULTING ENGINEERS PTY LTD MUST BE COMMISSIONED TO INCLUDE THESE DETAILS ONLY WHEN CONSTRUCTION CERTIFICATE AND/OR CONSTRUCTION DOCUMENTATION IS COMPLETE AND PROVIDED

LOCATION MAY VARY DUE TO CONSTRAINTS.

NOTE: LOCATION OF DRAINAGE ELEMENTS

THE LOCATION OF DETAILED DRAINAGE ELEMENTS ARE INDICATIVE ONLY AND MAY NEED TO MOVE BASED ON SITE CONSTRAINTS AND OTHER FACTORS. THE BUILDER IS TO NOTIFY THE ENGINEER PRIOR CONSTRUCTION IF ANY DRAINAGE ELEMENTS NEED TO BE REMOVED OR IF SITE CONSTRAINTS REQUIRE A CHANGE OF THE DRAINAGE REGIME.

NOTE: EXISTING STORMWATER SYSTEM EXISTING STORMWATER DRAINAGE SYSTEM

TO BE UTILISED WHERE ADEQUATE. BUILDER TO INSPECT PRIOR TO CONSTRUCTION AND UPGRADE IF REQUIRED IN ACCORDANCE WITH AS 3500.3

NOTE: EXCAVATION AROUND TREES

CARE SHOULD BE TAKEN WHEN UNDERTAKING WORKS IN THE VICINITY OF SELECTED TREES NOT TO DISTURB THE TREE ROOT SYSTEM. HAND DIGGING OF TRENCHES ETC MAY BE NECESSARY. REFER ARBORISTS REPORT.

NOTES:

- 1. THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION IF THE ISSUE DATE PRECEDES THE ISSUE DATE ON THE ARCHITECTURAL DRAWINGS.
- 2. DO NOT SCALE FROM THIS DRAWING.
- 3. ALL DIMENSIONS ARE TO BE VERIFIED ON SITE BY THE BUILDER BEFORE COMMENCING WITH ASSOCIATED WORK.
- 4. FOR GENERAL NOTES REFER TO DRAWING NUMBER: SOI.



NOTE: NO INVESTIGATION OF UNDERGROUND SERVICES HAS BEEN MADE.
ALL RELEVANT AUTHORITIES SHOULD BE NOTIFIED PRIOR TO ANY EXCAVATION ON OR NEAR THE SITE

DEVELOPERS & EXCAVATORS MAY BE HELD FINANCIALLY RESPONSIBLE BY THE ASSET OWNER SHOULD THEY DAMAGE UNDERGROUND NETWORKS.

- CARELESS DIGGING CAN:
 CAUSE DEATH OR SERIOUS INJURY TO WORKERS AND THE GENERAL PUBLIC - INCONVENIENCE USERS OF ELECTRICITY, GAS, WATER AND COMMUNICATIONS - LEAD TO CRIMINAL PROSECUTION AND DAMAGES CLAIMS
 - CAUSE EXPENSIVE FINANCIAL LOSSES
- TO BUSINESS - CUT OFF EMERGENCY SERVICES - DELAY PROJECT COMPLETION TIMES WHILE THE DAMAGE IS REPAIRED

MINIMISE YOUR RISK AND DIAL BEFORE YOU DIG. - TEL. 1100

ISSUED FOR D.A. SUBMISSION ONLY NOT FOR CONSTRUCTION

IF IN DOUBT ASK

- 1					
					DOCUMENT CERTIFICATION
					DOCUMENT CENTIFICATION
					Date: 24/11/2020
4-12-2020	В	UPDATED FOR DA	M	Γ	Michael Wachjo /
20-11-2020	А	ISSUED FOR DA SUBMISSION	MC	Γ	B.E.(Civil), MIEAust.
	•				(Director NB Consulting Engineers)

Issue: Description:

Consulting Engineers Designer: STRUCTURAL - CIVIL - STORMWATER - REMEDIAL A.C.N. 076 121 616 A.B.N. 24 076 121 616 **Sydney**: Ph: (02) 9984 7000 Suite 207, 30 Fisher Road Dee Why N.S.W. 2099 Gold Coast: Ph: (07) 5631 4744

E: nb@nbconsulting.com.au W: www.nbconsulting.com.au

The copyright of this drawing remains with Northern Beaches


Client: Unit 8, 1726 Gold Coast Highway Burleigh Heads QLD 4220


Project: ALTERATIONS AND ADDITIONS H & C DESIGN 287 HUDSON PARADE, CLAREVILLE Drawing Title: STORMWATER MANAGEMENT JILL MORRISON DRAINAGE PLAN

DEC. 2020

MC

Drawing No:

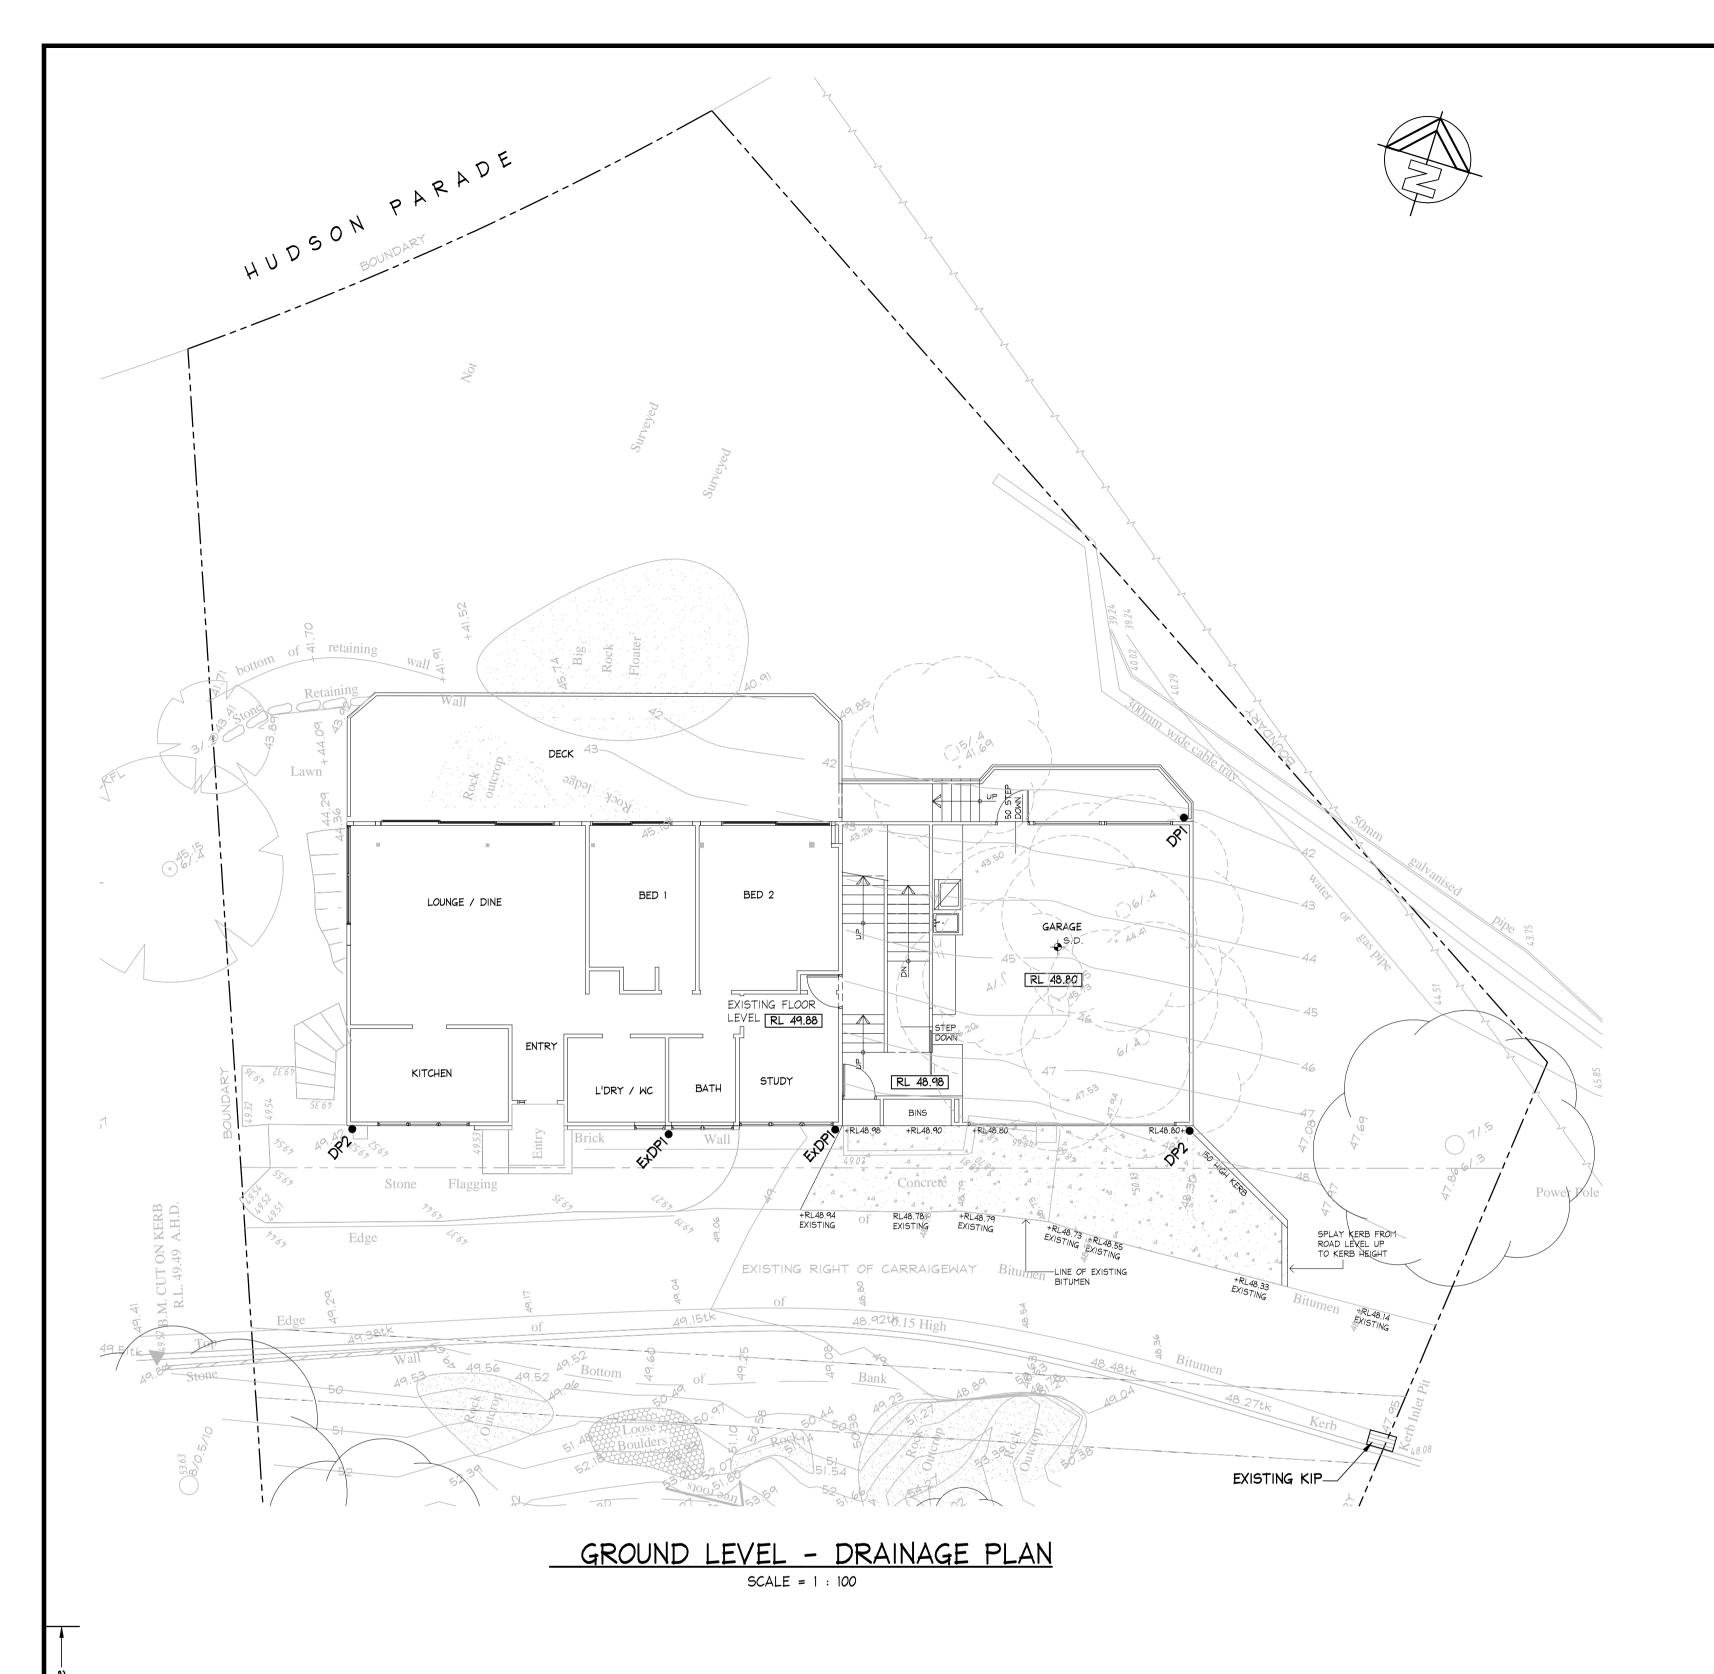

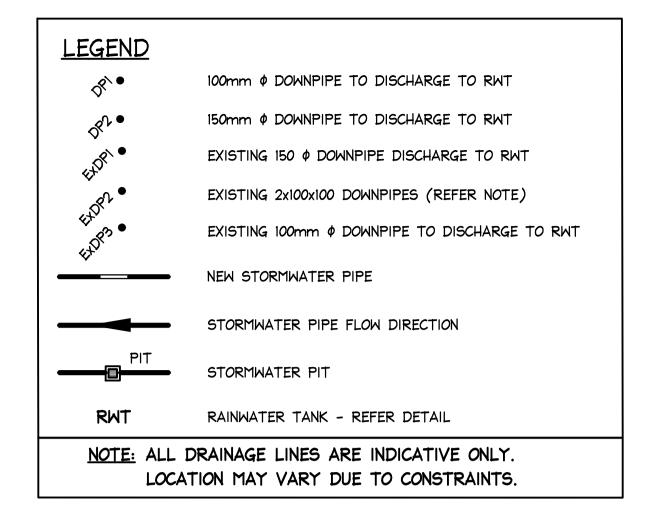

NOTE: SUBSOIL DRAINAGE

STORMWATER DRAWINGS DO NOT INCLUDE SUBSOIL AGRICULTURAL DRAINAGE DETAILS FOR D.A. SUBMISSION. NORTHERN BEACHES CONSULTING ENGINEERS PTY LTD MUST BE COMMISSIONED TO INCLUDE THESE DETAILS ONLY WHEN CONSTRUCTION CERTIFICATE AND/OR CONSTRUCTION DOCUMENTATION IS COMPLETE AND PROVIDED

NOTE: LOCATION OF DRAINAGE ELEMENTS

THE LOCATION OF DETAILED DRAINAGE ELEMENTS ARE INDICATIVE ONLY AND MAY NEED TO MOVE BASED ON SITE CONSTRAINTS AND OTHER FACTORS. THE BUILDER IS TO NOTIFY THE ENGINEER PRIOR CONSTRUCTION IF ANY DRAINAGE ELEMENTS NEED TO BE REMOVED OR IF SITE CONSTRAINTS REQUIRE A CHANGE OF THE DRAINAGE REGIME.

NOTE: EXISTING STORMWATER SYSTEM EXISTING STORMWATER DRAINAGE SYSTEM TO BE UTILISED WHERE ADEQUATE. BUILDER TO INSPECT PRIOR TO CONSTRUCTION AND UPGRADE IF REQUIRED IN ACCORDANCE WITH AS 3500.3

NOTE: EXCAVATION AROUND TREES CARE SHOULD BE TAKEN WHEN UNDERTAKING WORKS IN THE VICINITY OF SELECTED TREES NOT TO DISTURB THE TREE ROOT SYSTEM. HAND DIGGING OF TRENCHES ETC MAY BE NECESSARY. REFER ARBORISTS REPORT.

NOTES:

- 1. THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION IF THE ISSUE DATE PRECEDES THE ISSUE DATE ON THE ARCHITECTURAL DRAWINGS.
- 2. DO NOT SCALE FROM THIS DRAWING.
- 3. ALL DIMENSIONS ARE TO BE VERIFIED ON SITE BY THE BUILDER BEFORE COMMENCING WITH ASSOCIATED WORK.
- 4. FOR GENERAL NOTES REFER TO DRAWING NUMBER: SOI.



NOTE: NO INVESTIGATION OF UNDERGROUND SERVICES HAS BEEN MADE. ALL RELEVANT AUTHORITIES SHOULD BE NOTIFIED PRIOR TO ANY EXCAVATION

ON OR NEAR THE SITE DEVELOPERS & EXCAVATORS MAY BE HELD FINANCIALLY RESPONSIBLE BY THE ASSET OWNER SHOULD THEY DAMAGE UNDERGROUND NETWORKS.

- CARELESS DIGGING CAN:

 CAUSE DEATH OR SERIOUS INJURY TO WORKERS AND THE GENERAL PUBLIC - INCONVENIENCE USERS OF ELECTRICITY, GAS, WATER AND COMMUNICATIONS - LEAD TO CRIMINAL PROSECUTION AND
- DAMAGES CLAIMS - CAUSE EXPENSIVE FINANCIAL LOSSES TO BUSINESS
- CUT OFF EMERGENCY SERVICES - DELAY PROJECT COMPLETION TIMES WHILE THE DAMAGE IS REPAIRED

MINIMISE YOUR RISK AND DIAL BEFORE YOU DIG. - TEL. 1100

ISSUED FOR D.A. SUBMISSION ONLY NOT FOR CONSTRUCTION

IF IN DOUBT ASK

41					
					DOCUMENT CERTIFICATION
					Date: 24/11/2020
4-12-2020	В	UPDATED FOR DA	MC	Σ	Michael Wachjo
20-11-2020	А	ISSUED FOR DA SUBMISSION	MC	7	B.E.(Civil), MIEAust.
Date:	Issue:	Description:	Ву:	Review:	(Director NB Consulting Engineers) The copyright of this drawing remains with Northern Beaches Consulting Engineers Pty Ltd. Trading as NB Consulting Engineers

Consulting Engineers Designer: STRUCTURAL - CIVIL - STORMWATER - REMEDIAL A.C.N. 076 121 616 A.B.N. 24 076 121 616 **Sydney**: Ph: (02) 9984 7000 Suite 207, 30 Fisher Road Dee Why N.S.W. 2099 Gold Coast: Ph: (07) 5631 4744

E: nb@nbconsulting.com.au W: www.nbconsulting.com.au


Unit 8, 1726 Gold Coast Highway Burleigh Heads QLD 4220

Project: ALTERATIONS AND ADDITIONS H & C DESIGN 287 HUDSON PARADE, CLAREVILLE Drawing Title: STORMWATER MANAGEMENT JILL MORRISON DRAINAGE PLAN

Drawn: DEC. 2020 CMcL MC Drawing No: D103 B

NOTES:

- 1. THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION IF THE ISSUE DATE PRECEDES THE ISSUE DATE ON THE ARCHITECTURAL DRAWINGS.
- 2. DO NOT SCALE FROM THIS DRAWING.
- 3. ALL DIMENSIONS ARE TO BE VERIFIED ON SITE BY THE BUILDER BEFORE COMMENCING WITH ASSOCIATED WORK.
- 4. FOR GENERAL NOTES REFER TO DRAWING NUMBER: SOI.

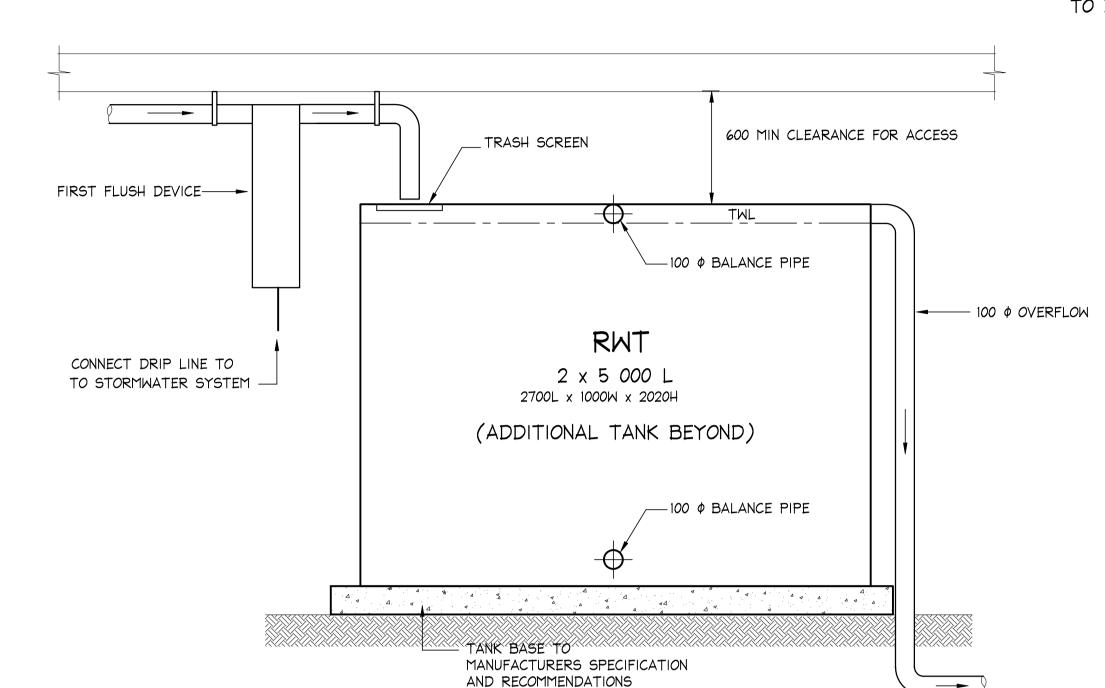

TYPICAL RAINWATER RE-USE TANK DETAIL NOT TO SCALE

450×450 GRATE MAXI MESH SCREEN RH3030 \$ HANDLE OUTLET PIPE GEOFABRIC ---\$20mm WEEP BLUE METAL HOLES AT 200 CTS PRECAST OR CAST INSITU PIT REFER STORMWATER NOTES ALTERNATIVE POLYPROPYLENE PIT BY MANUFACTURER

TYPICAL PIT DETAIL

SCALE = 1 : 20

NOTE: BOX GUTTERS ALL BOX GUTTER SYSTEMS SHOWN ON THESE PLANS ARE TO BE INSTALLED STRICTLY IN

ACCORDANCE WITH THE ASSOCIATED DETAILS. IF ANY CHANGE TO THE BOX GUTTER CONFIGURATION IS PROPOSED, NOTIFY THE ENGINEER FOR RE-DESIGN. IF THE INSTALLED BOX GUTTER DOES NOT STRICTLY COMPLY WITH OUR DESIGN, CERTIFICATION OF THE HYDRAULIC SYSTEM MAY BE REFUSED.

EXISTING BOX GUTTER WIDTH 110 MIN -OVERFLOW RAINHEAD DEPTH RAINHEAD WIDTH RAINHEAD LENGTH

EXISTING BOX GUTTER EXBGI \$ NEW RAINHEAD RHD DETAIL

SCALE = NTS

EXISTING BOX GUTTER IS GENERALLY NON COMPLIANT WITH AS3500.3. HOWEVER, THERE ARE NO PROPOSED CHANGES TO THIS BOX GUTTER. THE PROPOSED RAINHEAD WILL REDUCE THE RISK OF WATER INGRESS INTO HABITABLE AREAS OF THE PROPERTY.



ISSUED FOR D.A. SUBMISSION ONLY NOT FOR CONSTRUCTION

IF IN DOUBT ASK

INVERT OF NEW EAVES GUTTER. DP IS NOT A FULL HEIGHT DOWNPIPE. FIRST FLOOR AND LOWER ROOF - DRAINAGE PLAN LINE OF BUILDING UNDER EXISTING LOWER ROOF -----NEW ROOF

VOID TO GROUND FLOOR

FLOOR LEVEL RL 51.86

CONNECT NEW DOWNPIPE

TO EXDPI 250mm BELOW

UPPER ROOF - DRAINAGE PLAN SCALE = 1 : 100

LEGEND 100mm \$\phi\$ DOWNPIPE TO DISCHARGE TO RWT 100mm & DOWNPIPE (UNDER ROOF) 150mm \$\phi\$ DOWNPIPE TO DISCHARGE TO RWT EXISTING 150 \$\phi\$ DOWNPIPE EXISTING 100mm & DOWNPIPE TO DISCHARGE TO RWT DOWNPIPE AND SPREADER **ExBGI** EXISTING BOX GUTTER - 200 wide x 110 deep RAINHEAD REFER DETAIL DENOTES EXISTING ROOF

NOTE: ALL DRAINAGE LINES ARE INDICATIVE ONLY.

Description:

Issue:

LOCATION MAY VARY DUE TO CONSTRAINTS.

EXISTING ROOF TO REMAIN

ExBGI

NOTE: LOCATION OF DRAINAGE ELEMENTS

THE LOCATION OF DETAILED DRAINAGE ELEMENTS ARE INDICATIVE ONLY AND MAY NEED TO MOVE BASED ON SITE CONSTRAINTS AND OTHER FACTORS. THE BUILDER IS TO NOTIFY THE ENGINEER PRIOR CONSTRUCTION IF ANY DRAINAGE ELEMENTS NEED TO BE REMOVED OR IF SITE CONSTRAINTS REQUIRE A CHANGE OF THE DRAINAGE REGIME.

(Director NB Consulting Engineers)

The copyright of this drawing remains with Northern Beaches Consulting Engineers Pty Ltd. Trading as NB Consulting Engineer

NOTE: EXISTING ROOF DRAINAGE EXISTING ROOF DRAINAGE TO BE RETAINED AND OR UPGRADED AS REQUIRED IN ACCORDANCE

WITH AS3500.3

DOCUMENT CERTIFICATION 24/11/2020 Michael Wachjo // 4-12-2020 MC UPDATED FOR DA CJB.E.(Civil), MIEAust. 20-11-2020 ISSUED FOR DA SUBMISSION

Consulting Engineers Designer:

STRUCTURAL - CIVIL - STORMWATER - REMEDIAL
A.C.N. 076 121 616 A.B.N. 24 076 121 616
Sydney: Ph: (02) 9984 7000
Suite 207, 30 Fisher Road Dee Why N.S.W. 2099
Gold Coast: Ph: (07) 5631 4744
Unit 8, 1726 Gold Coast Highway Burleigh Heads QLD 4220
E: nb@nbconsulting.com.au W: www.nbconsulting.com.au

H & C DESIGN	287 HUDSON PARADE, CLAREVILLE
Client: JILL MORRISON	STORMWATER MANAGEMENT DRAINAGE PLANS AND DETAILS

Project: ALTERATIONS AND ADDITIONS 287 HUDSON PARADE, CLAREVILLE	Date: DEC. 2020	Design: CMcL	Drawn:	
Drawing Title: STORMWATER MANAGEMENT DRAINAGE PLANS AND DETAILS	Job No: 130101		Drawing No: D104	Issue: