



**REPORT TO
MR CRAIG ROBERTS**

**ON
GEOTECHNICAL INVESTIGATION**

**FOR
PROPOSED ALTERATIONS AND ADDITIONS**

**AT
45 SMITH AVENUE, ALLAMBIE HEIGHTS,
NSW**

Date: 21 March 2019

Ref: 32230Rpt

JKGeotechnics
www.jkgeotechnics.com.au

T: +612 9888 5000

Jeffery and Katauskas Pty Ltd trading as JK Geotechnics

ABN 17 003 550 801





Date: 21 March 2019
Report No: 32230Rrpt
Revision No: 0

Report prepared by:

Paul Roberts
Principal Associate | Engineering Geologist

For and on behalf of
JK GEOTECHNICS
PO BOX 976
NORTH RYDE BC NSW 1670

© Document copyright of JK Geotechnics

This report (which includes all attachments and annexures) has been prepared by JK Geotechnics (JKG) for its Client, and is intended for the use only by that Client.

This Report has been prepared pursuant to a contract between JKG and its Client and is therefore subject to:

- a) JKG's proposal in respect of the work covered by the Report;
- b) The limitations defined in the Client's brief to JKG;
- c) The terms of contract between JK and the Client, including terms limiting the liability of JKG.

If the Client, or any person, provides a copy of this Report to any third party, such third party must not rely on this Report, except with the express written consent of JKG which, if given, will be deemed to be upon the same terms, conditions, restrictions and limitations as apply by virtue of (a), (b), and (c) above.

Any third party who seeks to rely on this Report without the express written consent of JKG does so entirely at their own risk and to the fullest extent permitted by law, JKG accepts no liability whatsoever, in respect of any loss or damage suffered by any such third party.

At the Company's discretion, JKG may send a paper copy of this report for confirmation. In the event of any discrepancy between paper and electronic versions, the paper version is to take precedence. The USER shall ascertain the accuracy and the suitability of this information for the purpose intended; reasonable effort is made at the time of assembling this information to ensure its integrity. The recipient is not authorised to modify the content of the information supplied without the prior written consent of JKG.



Table of Contents

1	INTRODUCTION	1
2	INVESTIGATION AND ASSESSMENT PROCEDURE	1
2.1	Subsurface Investigation	1
2.2	Walkover Survey	2
3	RESULTS OF INVESTIGATION	3
3.1	Site Description	3
3.2	Subsurface Conditions	4
4	COMMENTS AND RECOMMENDATIONS	5
4.1	Overview	5
4.2	Potential Landslide Hazards	5
4.3	Risk Analysis	5
5	COMMENTS AND RECOMMENDATIONS	6
5.1	Landslide Risk Management	6
5.2	Dilapidation Surveys	6
5.3	Site Preparation	7
5.4	Footing Design	7
5.5	Retention Design Parameters	7
5.6	Additional Geotechnical Advice	8
5.7	Further Geotechnical Input	8
6	GENERAL COMMENTS	9

ATTACHMENTS

Table A: Summary of Risk Assessment to Property

Borehole Logs 1 and 2

Dynamic Cone Penetration Test Results (1 To 5)

Figure 1: Site Location Plan

Figure 2: Test Location Plan

Figure 3: Geotechnical Mapping Symbols

Appendix A: Landslide Risk Management Terminology

Appendix B: Some Guidelines For Hillside Construction

Report Explanation Notes

1 INTRODUCTION

This report presents the results of a limited scope geotechnical investigation for the proposed alterations and additions at 45 Smith Avenue, Allambie Heights, NSW. A site location plan is presented as Figure 1. The investigation was commissioned by Mr Craig Roberts by signed 'Acceptance of Proposal' form attached to an email dated 18 February 2019. The commission was on the basis of our fee proposal (Ref: P48884R) dated 6 February 2019.

We have been provided with the following information:

- Architectural drawings (Project No.1722, Drawings 1 to 9 Rev. a, dated 15 October 2018) prepared by Smith and Sons.
- A site survey plan (Ref. 185.17, dated 1 May 2017) prepared by Rennie Golledge Pty Ltd.

Based on a review of the provided information we understand that following partial demolition, the proposed alterations and additions will comprise a new two storey extension (with external deck areas) to the eastern side of the existing house. The extension will be suspended over the existing slope and new stepped walkways will be formed along the northern and southern sides of the extension.

Structural loads have not been provided and typical loadings for this type of development have been assumed.

Based on a review of the Warringah Development Control Plan (last amendment commenced 20 October 2018) the site lies within an Area B on the Council "Landslip Risk Map" as defined in the Warringah Local Environment Plan 2011, i.e. slope angles between 5° and 25° and based on a review of the provided survey plan, which indicated relatively steep slopes within the site, JK Geotechnics determined that a geotechnical assessment was required.

The purpose of the investigation was to obtain geotechnical information on the subsurface conditions as a basis for comments and recommendations on site stability, site preparation, footing design and landslide risk management measures.

2 INVESTIGATION AND ASSESSMENT PROCEDURE

2.1 Subsurface Investigation

The fieldwork for the investigation was carried out on 22 February 2019 and was limited by access constraints to the use of portable hand-held equipment. The fieldwork comprised:

- Two boreholes (BH1 and BH2) hand auger drilled to respective refusal depths of 0.3m and 1.0m.
- Five Dynamic Cone Penetration (DCP) tests (DCP1 to DCP5) carried out adjacent to each borehole and at three additional locations. The DCP tests were extended to refusal depths between about 0.2m (DCP3), and 1.4m (DCP5).

Prior to the commencement of the fieldwork, the test locations were scanned for the presence of buried services by a specialist sub-contractor.

The test locations, as shown on the attached Figure 2, were set out by taped measurements from existing surface features. Figure 2 is based on the provided survey plan with the proposed alterations and additions superimposed. The approximate surface RL's at the test locations were interpolated between spot levels and contours shown on the provided survey plan. The survey datum is the Australian Height Datum (AHD).

The compaction of the fill and the strength of the residual clayey soils were assessed from the DCP blow counts augmented with hand penetrometer readings on the cohesive soil samples recovered from the hand auger. The refusal depth of DCP test can also provide an indicative depth to bedrock, though we note that refusal can also occur on obstruction in fill, 'floaters' and other hard layers.

Groundwater observations were made in the boreholes during, and on completion of, hand auger drilling. No longer-term groundwater monitoring has been carried out.

Further details of the methods and procedures employed in the investigation are presented in the attached Report Explanation Notes.

The fieldwork for the investigation was carried out under the direction of our geotechnical engineer (Warren Smith), who was present full-time on site and set out the test locations, directed the buried services scan, logged the encountered subsurface profile, and nominated in-situ testing and sampling. The borehole logs (which include hand penetrometer readings and groundwater observations) and the DCP test results sheet are attached, together with a glossary of logging terms and symbols used.

Geotechnical laboratory testing was not carried out as it was deemed unnecessary. A contamination screen of site soils and groundwater was outside the agreed scope of this investigation.

2.2 Walkover Survey

The stability assessment is based upon a detailed inspection of the topographic, surface drainage and geological conditions of the site and its immediate environs. These features were compared to those of other similar lots in neighbouring locations to provide a comparative basis for assessing the risk of instability affecting the proposed development. The attached Appendix A defines the terminology adopted for the risk assessment together with a flow chart illustrating the Risk Management Process based on the guidelines given in AGS 2007c (Reference 1).

A summary of our observations is presented in Section 3.1 below. Our specific recommendations regarding the proposed development are discussed in Section 5 following our geotechnical assessment.

The attached Figure 2 indicates the principle geotechnical features present at the site. Additional features on Figure 2 have been measured by hand held inclinometer and tape measure techniques and hence are only

approximate. Should any of the features be critical to the proposed development, we recommend they be located more accurately using instrument survey techniques. Figure 3 presents an explanation of the geotechnical mapping symbols used.

3 RESULTS OF INVESTIGATION

3.1 Site Description

The site is located within undulating topography on a hillside that slopes down to the east at a maximum of about 26°. The site has a western frontage onto Smith Avenue.

At the time of the fieldwork, the western (upper) portion of the site was occupied by a two storey rendered house with grass and concrete covered surrounds; the concrete surfaces were cracked in places. The eastern section of the house was suspended over an upper sandstone bedrock outcrop face (maximum height about 3.5m). A stacked brick and sandstone cobble and boulder retaining wall (maximum 1.5m height) formed the western site boundary and supported the street frontage. A concrete surfaced stepped walkway extended down the southern side of the house to the crest of a lower partially overgrown sandstone bedrock outcrop (maximum 3.5m height) situated downslope (to the east) of the house. The relatively flat rear yard to the west of the lower bedrock outcrop crest was grass covered.

The central portion of the eastern margin of the grass covered rear yard area was supported in places by short lengths of concrete block and brick retaining walls (maximum 1.0m height) founded on the crest of the sandstone bedrock outcrop face. The retaining wall faces were slightly bulging.

Downslope of the lower sandstone bedrock outcrop, the remainder of the site was overgrown. A relatively flat bench extended eastwards approximately 5.5m from the toe of the lower sandstone bedrock outcrop face to the crest of an overgrown retaining wall (maximum height about 1.5m). Downslope of the overgrown retaining wall, occasional sandstone boulders and the trace of a low height brick retaining wall were evident through the vegetation. The overgrown lower area of the site sloped down to the east at a maximum of about 15°. The type and condition of the retaining wall could not be assessed due to the thick vegetation and access restrictions.

A neighbouring single storey timber clad house was set-back about 10m from the eastern site boundary. Surface levels stepped down about 1.8m across the eastern site boundary but access restrictions prevented an assessment of the wall type or it's condition.

A neighbouring two storey timber clad house was set-back at least about 1.5m from the western portion of the northern site boundary and the eastern section of the house was suspended between brick piers founded on a sandstone bedrock outcrop.

A neighbouring two storey brick house was set-back about 1.0m from the western portion of the southern site boundary. Sandstone outcrops on a similar alignment to those observed in the site were evident within the neighbouring site to the south.

Where observations were possible and unless otherwise described above, surface levels appeared to be similar across the site boundaries.

Based on a cursory inspection from within the site, unless otherwise described above, the buildings and structures within and neighbouring the site appeared to be in good condition.

3.2 Subsurface Conditions

The 1:100,000 geological map of Sydney indicates that the site is underlain by Hawkesbury Sandstone. The investigation disclosed a subsurface profile comprising a variable thickness of fill overlying residual soils, with sandstone bedrock observed at surface level or inferred at shallow to moderate depth. Groundwater was not encountered over the depth of the investigation. Reference should be made to the attached borehole logs and DCP test results sheet for specific details at each location. A summary of the pertinent subsurface characteristics is presented below:

Fill

Silty sandy clay fill assessed to be of medium plasticity was encountered from the surface in each borehole. BH1 met refusal at 0.3m depth in the fill; refusal has been inferred to be due to a large inclusion within the fill. The fill in BH2 was 0.8m thick. Based on the DCP test results, the fill was assessed to be poorly compacted. From below the refusal depth of BH1 the DCP test has been interpreted to indicate similar poorly compacted fill. The results of DCP3 to DCP5 have also been interpreted to represent similar poorly compacted fill from the surface.

Residual Silty Sandy Clays

Residual silty sandy clay assessed to be of medium plasticity and soft to firm strength was encountered below the fill in BH2. BH2 met refusal in the residual clays at 1.0m depth. The results of DCP1, DCP4 and DCP5 have been interpreted to indicate similar residual clays of soft to firm and stiff strength below the fill

Inferred Sandstone Bedrock

Based on the presence of sandstone bedrock outcrops at the site, the refusal of the DCP tests at between about 0.2m and 1.4m depth have been interpreted to indicate the bedrock surface. The bedrock surface below the current site surface levels steps down to the east from about RL26.6m (DCP1) and RL28.1m (DCP3) to RL 24.4m (DCP4), RL23.7m (DCP2) and RL23.2m (DCP5).

The sandstone bedrock exposed at the site was assessed to be moderately weathered and of medium strength.

Groundwater

The boreholes were 'dry' during, and on completion of hand augur drilling. We note that groundwater levels may not have stabilised over the relatively short observation period. In addition, no obvious signs of seepage over the bedrock outcrop surfaces were recorded. No longer term groundwater monitoring has been carried out.

4 COMMENTS AND RECOMMENDATIONS

4.1 Overview

The stepped hillside profile has been essentially controlled by north-south orientated sub-vertical planar joint planes which have formed the sandstone bedrock outcrop faces within and neighbouring the site. Where not outcropping, sandstone bedrock was assessed to be at shallow to moderate depth. Retaining walls also supported sections of the site and were in variable condition. The site appeared to be well drained.

Our observations did not reveal any obvious signs of mass soil and/or rock face instability or retaining wall collapse, although slight bulging of selected retaining walls was evident.

4.2 Potential Landslide Hazards

Based on the above, we consider that the potential landslide hazards associated with the site to be the following:

- A Instability of existing retaining walls
- B Instability of sandstone outcrop faces.
- C Instability of soil slopes.
- D Instability of sandstone boulders ('floaters').

4.3 Risk Analysis

The attached Table A summarises our qualitative assessment of each potential landslide hazard and of the consequences to property should the landslide hazard occur. Based on the above, the qualitative risks to property have been determined.

Table A indicates that the assessed risk to property is "Very Low" under existing conditions which would be considered 'acceptable' in accordance with the criteria given in Reference 1.

Following implementation of the recommendations in Section 5 below, the assessed risk to property would remain at 'acceptable' levels, in accordance with the criteria given in Reference 1.

We have not completed an assessment of risk to life. However, based on the indicative probabilities associated with the assessed likelihood of instability and assuming typical temporal, vulnerability, evacuation and spatial factors for this type of development we consider that the levels of risk to life to be 'acceptable'

in relation to the criteria given in Reference 1, i.e. less than 1×10^{-6} . We note that this assumes the recommendations outlined in Section 5 are adopted.

5 COMMENTS AND RECOMMENDATIONS

We consider that the proposed development may proceed provided the following specific construction and maintenance recommendations are adopted to maintain and further reduce the present risk of instability at the site and to control future risk.

5.1 Landslide Risk Management

The proposed extension will be suspended over the lower sandstone bedrock outcrop face and the overgrown slope below which contains a retaining wall of unknown condition and possibly potentially unstable sandstone boulders ('floaters').

Whilst risk levels have been assessed to be at 'acceptable' levels, we recommend that the following measures be taken to maintain and improve the overall stability of the site:

- Clear vegetation from the lower cliff face and the slope below in order to expose the existing retaining wall, the outcrop face and any potentially unstable 'floaters' on the lower slope.
- Following vegetation clearance, the structural and geotechnical engineers to then inspect the exposed existing retaining wall, other retaining walls within the site that are to remain, the outcrop faces and any potentially unstable 'floaters'. At this stage localised test pits around 'floaters' and/or along the toe of retaining walls to expose the footings may be required under the direction of the structural and geotechnical engineers.
- Based on the results of the geotechnical inspections the need and extent of stabilisation measures to support potentially unstable wedges, blocks or weak seams on the outcrop face and/or potentially unstable 'floaters' can then be detailed and may include rock bolts, underpins and/or reinforced shotcrete. The underpins would need to extend to bedrock.
- Based on the results of the structural inspections, the need for retaining wall strengthening measures, reconstruction and/or removal can then be assessed.

5.2 Dilapidation Surveys

Prior to site works commencing, consideration should be given to completing detailed dilapidation reports on the neighbouring properties to the north and south and possibly downslope to the east. In addition, Council may also require that dilapidation survey reports be completed on their assets lining the street frontages, i.e. the paved footpaths, roadways and kerbs and gutters. The property owners should be asked to confirm that the reports present a fair record of existing conditions as the reports may assist the client in defending themselves from unfair damage claims

5.3 Site Preparation

If any retaining walls need to be replaced and/or any localised excavations to reprofile existing surface levels to achieve design surface levels are required, excavation of the soil profile will be required. Due to access constraints hand held equipment is likely to be required unless a small tracked excavator can access the steep site.

Over any areas where external paved surfaces are proposed, it will be difficult to complete high quality earthworks on a small, steep site such as this, as it would require removing and re-compacting the existing fill. Also, on-grade external paved surface would be in contact with a mix of existing fill, residual clays and possibly a sub-vertical bedrock face. This mix of subgrade conditions would result in differential deflections, and potential cracking of the external paved areas. Over soil subgrade areas our recommendation is to suspend any external paved areas between footings founded in bedrock.

5.4 Footing Design

Sandstone is exposed across portions of the footprint of the proposed alterations and additions and is expected at shallow to moderate depth at other locations. We therefore recommend that the proposed footings be uniformly founded in sandstone bedrock.

Pad and strip footings founded on low or higher strength sandstone may be designed for an allowable bearing pressure of 600kPa, subject to geotechnical inspection. Where footings are founded close to the crest of outcrop faces the bedrock must be inspected by a geotechnical engineer to check for the presence of any adversely orientated defects, weak seams etc and appropriate rock face stabilisation measures completed as outlined in Section 5.1 above.

Where bedrock is expected at depths in excess of about 1.0m bored piles may be used and installed using an auger attachment to a tracked excavator (if access is feasible) or hand operated equipment such as hand augers. Temporary liners may be required to support any potentially collapsible fill.

All footings should be clean of any loose or water softened material and free of any standing water prior to pouring. All footings should be excavated, cleaned, inspected and poured with minimal delay. If a delay in pouring high level footings is anticipated, consideration should be given to protecting the base of the footing with a layer of blinding concrete.

5.5 Retention Design Parameters

If any retaining walls require strengthening and/or replacement, then the following earth pressure coefficients and subsoil parameters may be adopted for their design:

- We expect some minor movements of retaining walls may be tolerated and they may therefore be designed using a triangular lateral earth pressure distribution and a coefficient of 'active' earth pressure, (k_a), of 0.35 for the soil profile, assuming a horizontal backfill surface.
- A bulk unit weight of 20kN/m³ should be adopted for the retained profile.

- Any surcharge affecting the walls (e.g. nearby footings, compaction stresses, sloping retained surfaces, construction loads etc) should be allowed for in the design using the appropriate earth pressure coefficient from above.
- Conventional retaining walls should be designed as drained and provision made for permanent and effective drainage of the ground behind the walls. Subsurface drains should incorporate a non-woven geotextile fabric, such as Bidim A34, to act as a filter against subsoil erosion. The subsoil drains should discharge into the stormwater system.
- Lateral restraint of the retaining walls founded in the soil profile below adjacent surface levels may be provided by the passive pressure of the soil below these levels. A 'passive' earth pressure coefficient, K_p , of 3 may be adopted, using a triangular pressure distribution and provided a Factor of Safety of at least 2 is used in order to reduce the high deflections that are associated with achieving a full passive case. Localised excavations in front of the walls e.g. for buried services etc must also be taken into account in the design. Where these footings are on bedrock, the lateral resistance may be calculated using a friction angle of 35° for the footing/bedrock interface.

Any permanent rock bolts for rock face stabilisation measures should be designed for an allowable bond strength of 200kPa assuming they are installed into sandstone bedrock of at least low strength. Permanent rock bolts will need to be designed with due regard for long term corrosion protection, i.e. fully grouted, hot dipped galvanised and provided with a sacrificial thickness or using stainless steel bars. Rock bolts extending across the site boundaries will require permission from the neighbouring property owners.

Any reinforced shotcrete that is required to support weak extremely and or clay seams should be designed using the above 'active' earth pressure coefficient and the shotcrete provided with strip drains.

5.6 Additional Geotechnical Advice

We also provide the following additional geotechnical advice:

- The existing stormwater system, sewer and water mains and new water must be checked for leaks by using static head and pressure tests under the direction of a licensed plumber and repaired if found to be leaking.
- The guidelines for Hillside Construction given in Appendix B should also be adopted.

5.7 Further Geotechnical Input

The following summarises the scope of further geotechnical work recommended within this report. For specific details reference should be made to the relevant sections of this report:

- Dilapidation reports of adjoining buildings and structures.
- Excavation of test pits to expose existing retaining wall footings
- Inspection of rock cut faces and 'floaters' following vegetation clearance and directing stabilisation measures, if required.
- Inspection of representative footing bases.

6 GENERAL COMMENTS

The recommendations presented in this report include specific issues to be addressed during the construction phase of the project. In the event that any of the construction phase recommendations presented in this report are not implemented, the general recommendations may become inapplicable and JK Geotechnics accept no responsibility whatsoever for the performance of the structure where recommendations are not implemented in full and properly tested, inspected and documented.

Occasionally, the subsurface conditions between and below the completed boreholes and DCP tests may be found to be different (or may be interpreted to be different) from those expected. Variation can also occur with groundwater conditions, especially after climatic changes. If such differences appear to exist, we recommend that you immediately contact this office.

This report provides advice on geotechnical aspects for the proposed civil and structural design. As part of the documentation stage of this project, Contract Documents and Specifications may be prepared based on our report. However, there may be design features we are not aware of or have not commented on for a variety of reasons. The designers should satisfy themselves that all the necessary advice has been obtained. If required, we could be commissioned to review the geotechnical aspects of contract documents to confirm the intent of our recommendations has been correctly implemented.

A waste classification will need to be assigned to any soil excavated from the site prior to offsite disposal. Subject to the appropriate testing, material can be classified as Virgin Excavated Natural Material (VENM), General Solid, Restricted Solid or Hazardous Waste. Analysis takes seven to 10 working days to complete, therefore, an adequate allowance should be included in the construction program unless testing is completed prior to construction. If contamination is encountered, then substantial further testing (and associated delays) should be expected. We strongly recommend that this issue is addressed prior to the commencement of excavation on site.

This report has been prepared for the particular project described and no responsibility is accepted for the use of any part of this report in any other context or for any other purpose. If there is any change in the proposed development described in this report then all recommendations should be reviewed. Copyright in this report is the property of JK Geotechnics. We have used a degree of care, skill and diligence normally exercised by consulting engineers in similar circumstances and locality. No other warranty expressed or implied is made or intended. Subject to payment of all fees due for the investigation, the client alone shall have a licence to use this report. The report shall not be reproduced except in full.



TABLE A
SUMMARY OF RISK ASSESSMENT TO PROPERTY

POTENTIAL LANDSLIDE HAZARD	Existing Conditions				After Completion Of Proposed development and Implementation of Recommendations outlined in Section 5			
	A	B	C	D	A	B	C	D
	Instability of existing retaining walls	Instability of sandstone outcrop faces	Instability of soil slopes	Instability of sandstone boulders ('floaters')	Instability of existing retaining walls	Instability of sandstone outcrop faces	Instability of soil slopes	Instability of sandstone boulders ('floaters')
Assessed Likelihood	Possible	Possible	Unlikely	Possible	Unlikely	Unlikely	Unlikely	Unlikely
Assessed Consequence	Insignificant	Insignificant	Insignificant	Insignificant	Insignificant	Insignificant	Insignificant	Insignificant
Risk	Very Low	Very Low	Very Low	Very Low	Very Low	Very Low	Very Low	Very Low
Comments	A to D: Assumes localised failure. D Assumes 'floater' does not travel far downslope.				A to D: Assumes localised failure. A: Assumes walls assessed and strengthened as necessary in accordance with advice from the structural engineer. B and D: Assumes stabilisation measures installed in accordance with geotechnical advice. D Assumes 'floater' does not travel far downslope.			



BOREHOLE LOG

Borehole No.
1
1/1

<div><div>Client: CRAIG ROBERTS</div><div>Project: PROPOSED ALTERATIONS AND ADDITIONS</div><div>Location: 45 SMITH AVENUE, ALLAMBIE HEIGHTS, NSW</div></div>												
<div><div>Job No. 32230R</div><div>Method: HAND AUGER</div><div>R.L. Surface: ≈ 27.9</div><div>Date: 25/2/19</div><div>Datum: AHD</div><div>Logged/Checked by: W.S./P.R.</div></div>												
Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB									
DRY ON COMPLET- ION				REFER TO DCP TEST RESULTS	0			FILL: Silty sandy clay, medium plasticity, dark brown and light brown, fine to medium grained sand, trace of fine to coarse grained igneous and sandstone gravel, root fibres and slag, END OF BOREHOLE AT 0.3m	w>PL	50		APPEARS POORLY COMPACTED
					0.5							REFUSAL ON OBSTRUCTION IN FILL
					1							
					1.5							
					2							
					2.5							
					3							
					3.5							



BOREHOLE LOG


Borehole No.
2
1/1

<div>Client: CRAIG ROBERTS</div> <div>Project: PROPOSED ALTERATIONS AND ADDITIONS</div> <div>Location: 45 SMITH AVENUE, ALLAMBIE HEIGHTS, NSW</div>												
<div>Job No. 32230R Method: HAND AUGER R.L. Surface: ≈ 24.7</div> <div>Date: 25/2/19 Datum: AHD</div> <div>Logged/Checked by: W.S./P.R.</div>												
Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB									
DRY ON COMPLET- ION				REFER TO DCP TEST RESULTS	0		-	FILL: Silty sandy clay, medium plasticity, dark grey, fine to medium grained sand, trace of fine to medium grained sandstone gravel, root fibres and slag.	w>PL			GRASS COVER APPEARS POORLY COMPACTED
					0.5		20					
						1					CI	
								END OF BOREHOLE AT 1.0m				REFUSAL ON INFERRED BEDROCK
					1.5							
					2							
					2.5							
					3							
					3.5							




DYNAMIC CONE PENETRATION TEST RESULTS

Client:	CRAIG ROBERTS						
Project:	PROPOSED ALTERATIONS AND ADDITIONS						
Location:	45 SMITH AVENUE, ALLAMBIE HEIGHTS, NSW						
Job No.	32230R	Hammer Weight & Drop: 9kg/510mm					
Date:	22-2-19	Rod Diameter: 16mm					
Tested By:	W.S.	Point Diameter: 20mm					
Test Location	1	2	3	4	5		
Surface RL	≈27.9m	≈24.7m	≈28.3m	≈24.9m	≈24.6m		
Depth (mm)	Number of Blows per 100mm Penetration						
0 - 100	1	SUNK	SUNK	1	3		
100 - 200	3	↓	2/80mm	3	1		
200 - 300	3	1	REFUSAL	2	1		
300 - 400	4	2		2	1		
400 - 500	2	6		10/90mm	2		
500 - 600	2	7		REFUSAL	3		
600 - 700	12	1			2		
700 - 800	7	2			2		
800 - 900	3	2			2		
900 - 1000	3	2			4		
1000 - 1100	4	REFUSAL			8		
1100 - 1200	5				5		
1200 - 1300	10/90mm				5		
1300 - 1400	REFUSAL				4/80mm		
1400 - 1500					REFUSAL		
1500 - 1600							
1600 - 1700							
1700 - 1800							
1800 - 1900							
1900 - 2000							
2000 - 2100							
2100 - 2200							
2200 - 2300							
2300 - 2400							
2400 - 2500							
2500 - 2600							
2600 - 2700							
2700 - 2800							
2800 - 2900							
2900 - 3000							
Remarks:	1. The procedure used for this test is described in AS1289.6.3.2-1997 (R2013) 2. Usually 8 blows per 20mm is taken as refusal 3. Datum of levels is AHD						

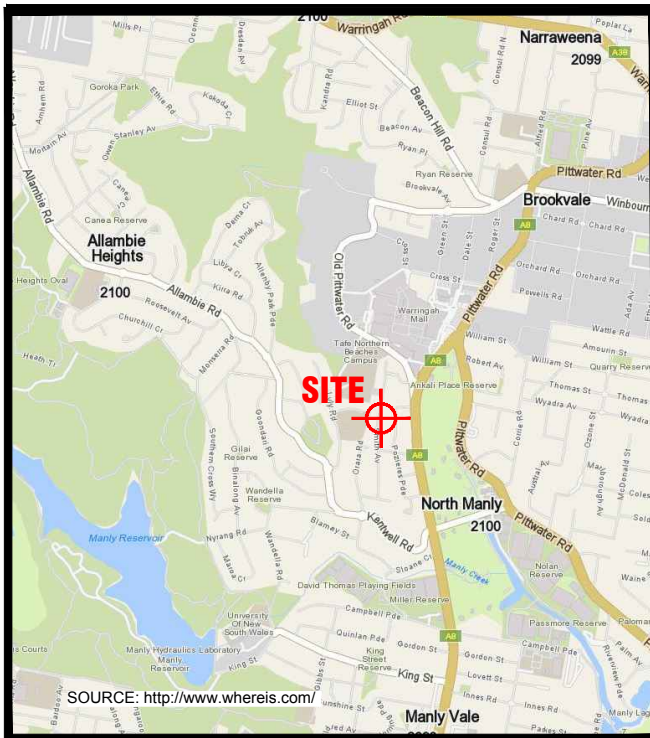


AERIAL IMAGE SOURCE: MAPS.AU.NEARMAP.COM, 27 DEC 2018.

Title:		SITE LOCATION PLAN	
Location:		45 SMITH AVENUE ALLAMBIE HEIGHTS, NSW	
Report No:	32230R	Figure No:	1
JKGeotechnics			



This plan should be read in conjunction with the JK Geotechnics report.


PLOT DATE: 21/03/2019 11:24:34 AM DWG FILE: S:\6 GEOTECHNICAL\Gf GEOTECHNICAL JOBS\32230 ALLAMBIE HEIGHTS\32230R.DWG

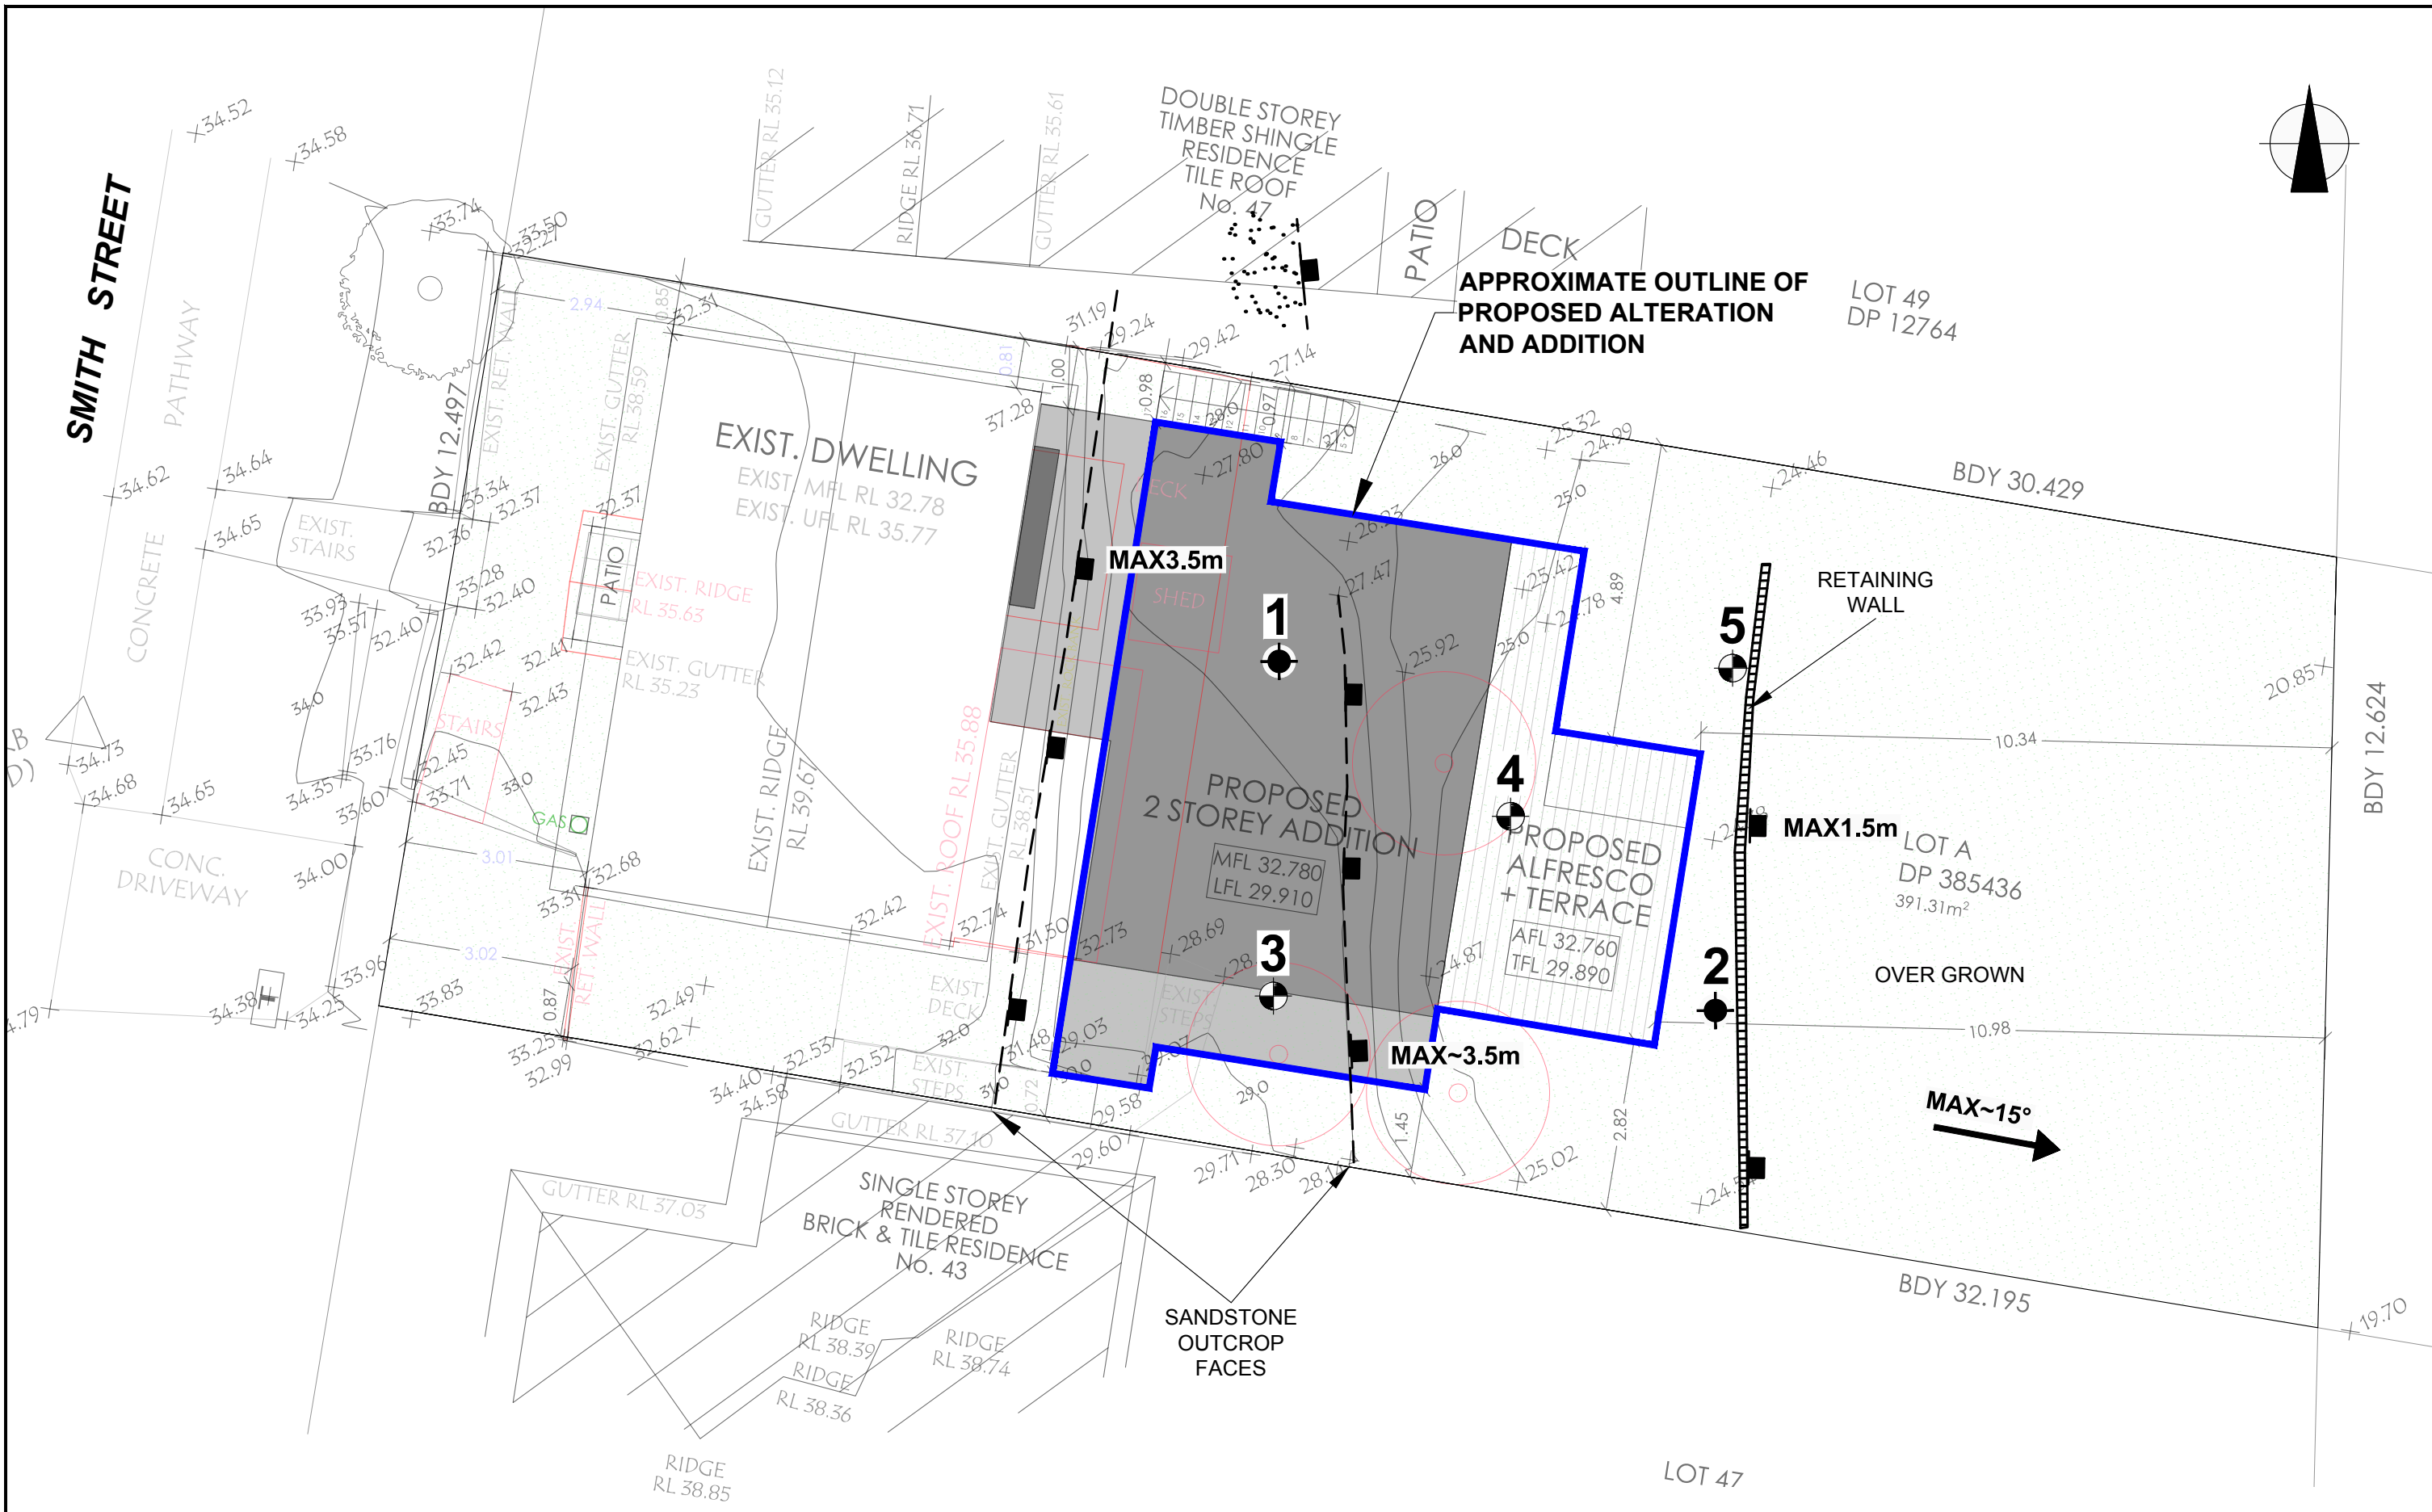

NOTE:
REFER TO FIGURE 3 FOR AN EXPLANATION OF
THE GEOTECHNICAL MAPPING SYMBOLS.

LEGEND

- BOREHOLE AND DCP TEST
- DCP TEST




This plan should be read in conjunction with the JK Geotechnics report.

Title: TEST LOCATION PLAN	
Location: 45 SMITH AVENUE ALLAMBIE HEIGHTS, NSW	
Report No: 32230R	Figure No: 2




TOPOGRAPHY

Symbol Ground Profile




convex
concave

well defined or angular
break of slope




convex
concave

poorly defined or
smooth change of slope




breaks of slope




changes of slope



convex and concave too close together
to allow the use of separate symbols



sharp




rounded




ridge crest




Cliff or escarpment or sharp break
40° or more (estimated height in metres)



Uniform Slope



Concave Slope



Convex Slope



Slope direction and angle (Degrees)



Top



Bottom



Cut or fill slope, arrows pointing down slope



Hummocky or irregular ground

OTHER FEATURES



Boulder



Seepage/spring




Swallow hole for runoff




Natural water course



Open drain, unlined



Open drain, lined



Fenceline




Property boundary




Dry Stone Wall



Major joint in rock face
(opening in millimetres)



Tension crack
(opening in millimetres)



Masonry or concrete wall




Ponding water




Boggy or swampy area

EXAMPLE OF USE OF TOPOGRAPHIC SYMBOLS:

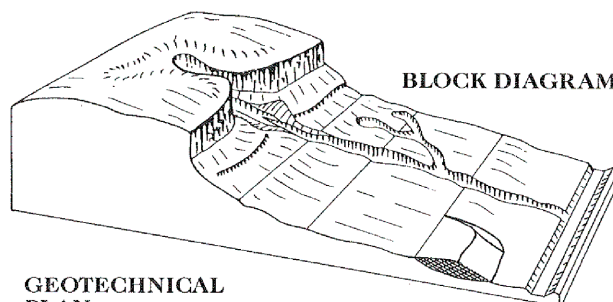

GEOTECHNICAL PLAN

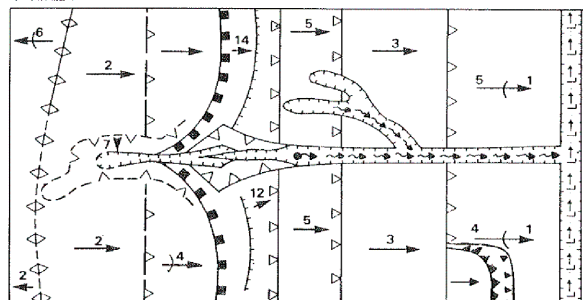

(After Gardiner, V & Dackombe, R. V.
(1983), Geomorphological Field Manual;
George Allen & Unwin).

Title:

GEOTECHNICAL MAPPING SYMBOLS

Location:

45 SMITH AVENUE
ALLAMBIE HEIGHTS, NSW


Report No:

32230R

Figure No:

3

JKGeotechnics



This plan should be read in conjunction with the JK Geotechnics report.



APPENDIX A

LANDSLIDE RISK MANAGEMENT TERMINOLOGY



APPENDIX A **LANDSLIDE RISK MANAGEMENT**

Definition of Terms and Landslide Risk

Risk Terminology	Description
Acceptable Risk	A risk for which, for the purposes of life or work, we are prepared to accept as it is with no regard to its management. Society does not generally consider expenditure in further reducing such risks justifiable.
Annual Exceedance Probability (AEP)	The estimated probability that an event of specified magnitude will be exceeded in any year.
Consequence	The outcomes or potential outcomes arising from the occurrence of a landslide expressed qualitatively or quantitatively, in terms of loss, disadvantage or gain, damage, injury or loss of life.
Elements at Risk	The population, buildings and engineering works, economic activities, public services utilities, infrastructure and environmental features in the area potentially affected by landslides.
Frequency	A measure of likelihood expressed as the number of occurrences of an event in a given time. See also 'Likelihood' and 'Probability'.
Hazard	A condition with the potential for causing an undesirable consequence (the landslide). The description of landslide hazard should include the location, volume (or area), classification and velocity of the potential landslides and any resultant detached material, and the likelihood of their occurrence within a given period of time.
Individual Risk to Life	The risk of fatality or injury to any identifiable (named) individual who lives within the zone impacted by the landslide; or who follows a particular pattern of life that might subject him or her to the consequences of the landslide.
Landslide Activity	The stage of development of a landslide; pre failure when the slope is strained throughout but is essentially intact; failure characterised by the formation of a continuous surface of rupture; post failure which includes movement from just after failure to when it essentially stops; and reactivation when the slope slides along one or several pre-existing surfaces of rupture. Reactivation may be occasional (eg. seasonal) or continuous (in which case the slide is 'active').
Landslide Intensity	A set of spatially distributed parameters related to the destructive power of a landslide. The parameters may be described quantitatively or qualitatively and may include maximum movement velocity, total displacement, differential displacement, depth of the moving mass, peak discharge per unit width, or kinetic energy per unit area.
Landslide Risk	The AGS Australian GeoGuide LR7 (AGS, 2007e) should be referred to for an explanation of Landslide Risk.
Landslide Susceptibility	The classification, and volume (or area) of landslides which exist or potentially may occur in an area or may travel or retrogress onto it. Susceptibility may also include a description of the velocity and intensity of the existing or potential landsliding.
Likelihood	Used as a qualitative description of probability or frequency.
Probability	<p>A measure of the degree of certainty. This measure has a value between zero (impossibility) and 1.0 (certainty). It is an estimate of the likelihood of the magnitude of the uncertain quantity, or the likelihood of the occurrence of the uncertain future event.</p> <p>These are two main interpretations:</p> <p>(i) Statistical – frequency or fraction – The outcome of a repetitive experiment of some kind like flipping coins. It includes also the idea of population variability. Such a number is called an 'objective' or relative frequentist probability because it exists in the real world and is in principle measurable by doing the experiment.</p>



Risk Terminology	Description
Probability <i>(continued)</i>	(ii) Subjective probability (degree of belief) – Quantified measure of belief, judgment, or confidence in the likelihood of an outcome, obtained by considering all available information honestly, fairly, and with a minimum of bias. Subjective probability is affected by the state of understanding of a process, judgment regarding an evaluation, or the quality and quantity of information. It may change over time as the state of knowledge changes.
Qualitative Risk Analysis	An analysis which uses word form, descriptive or numeric rating scales to describe the magnitude of potential consequences and the likelihood that those consequences will occur.
Quantitative Risk Analysis	An analysis based on numerical values of the probability, vulnerability and consequences and resulting in a numerical value of the risk.
Risk	A measure of the probability and severity of an adverse effect to health, property or the environment. Risk is often estimated by the product of probability x consequences. However, a more general interpretation of risk involves a comparison of the probability and consequences in a non-product form.
Risk Analysis	The use of available information to estimate the risk to individual, population, property, or the environment, from hazards. Risk analyses generally contain the following steps: scope definition, hazard identification and risk estimation.
Risk Assessment	The process of risk analysis and risk evaluation.
Risk Control or Risk Treatment	The process of decision-making for managing risk and the implementation or enforcement of risk mitigation measures and the re-evaluation of its effectiveness from time to time, using the results of risk assessment as one input.
Risk Estimation	The process used to produce a measure of the level of health, property or environmental risks being analysed. Risk estimation contains the following steps: frequency analysis, consequence analysis and their integration.
Risk Evaluation	The stage at which values and judgments enter the decision process, explicitly or implicitly, by including consideration of the importance of the estimated risks and the associated social, environmental and economic consequences, in order to identify a range of alternatives for managing the risks.
Risk Management	The complete process of risk assessment and risk control (or risk treatment).
Societal Risk	The risk of multiple fatalities or injuries in society as a whole: one where society would have to carry the burden of a landslide causing a number of deaths, injuries, financial, environmental and other losses.
Susceptibility	See 'Landslide Susceptibility'.
Temporal Spatial Probability	The probability that the element at risk is in the area affected by the landsliding, at the time of the landslide.
Tolerable Risk	A risk within a range that society can live with so as to secure certain net benefits. It is a range of risk regarded as non-negligible and needing to be kept under review and reduced further if possible.
Vulnerability	The degree of loss to a given element or set of elements within the area affected by the landslide hazard. It is expressed on a scale of 0 (no loss) to 1 (total loss). For property, the loss will be the value of the damage relative to the value of the property; for persons, it will be the probability that a particular life (the element at risk) will be lost, given the person(s) is affected by the landslide.

NOTE: Reference should be made to Figure A1 which shows the inter-relationship of many of these terms and the relevant portion of Landslide Risk Management.

Reference should also be made to the paper referenced below for Landslide Terminology and more detailed discussion of the above terminology.

This appendix is an extract from **PRACTICE NOTE GUIDELINES FOR LANDSLIDE RISK MANAGEMENT** as presented in **Australian Geomechanics, Vol 42, No 1, March 2007**, which discusses the matter more fully.

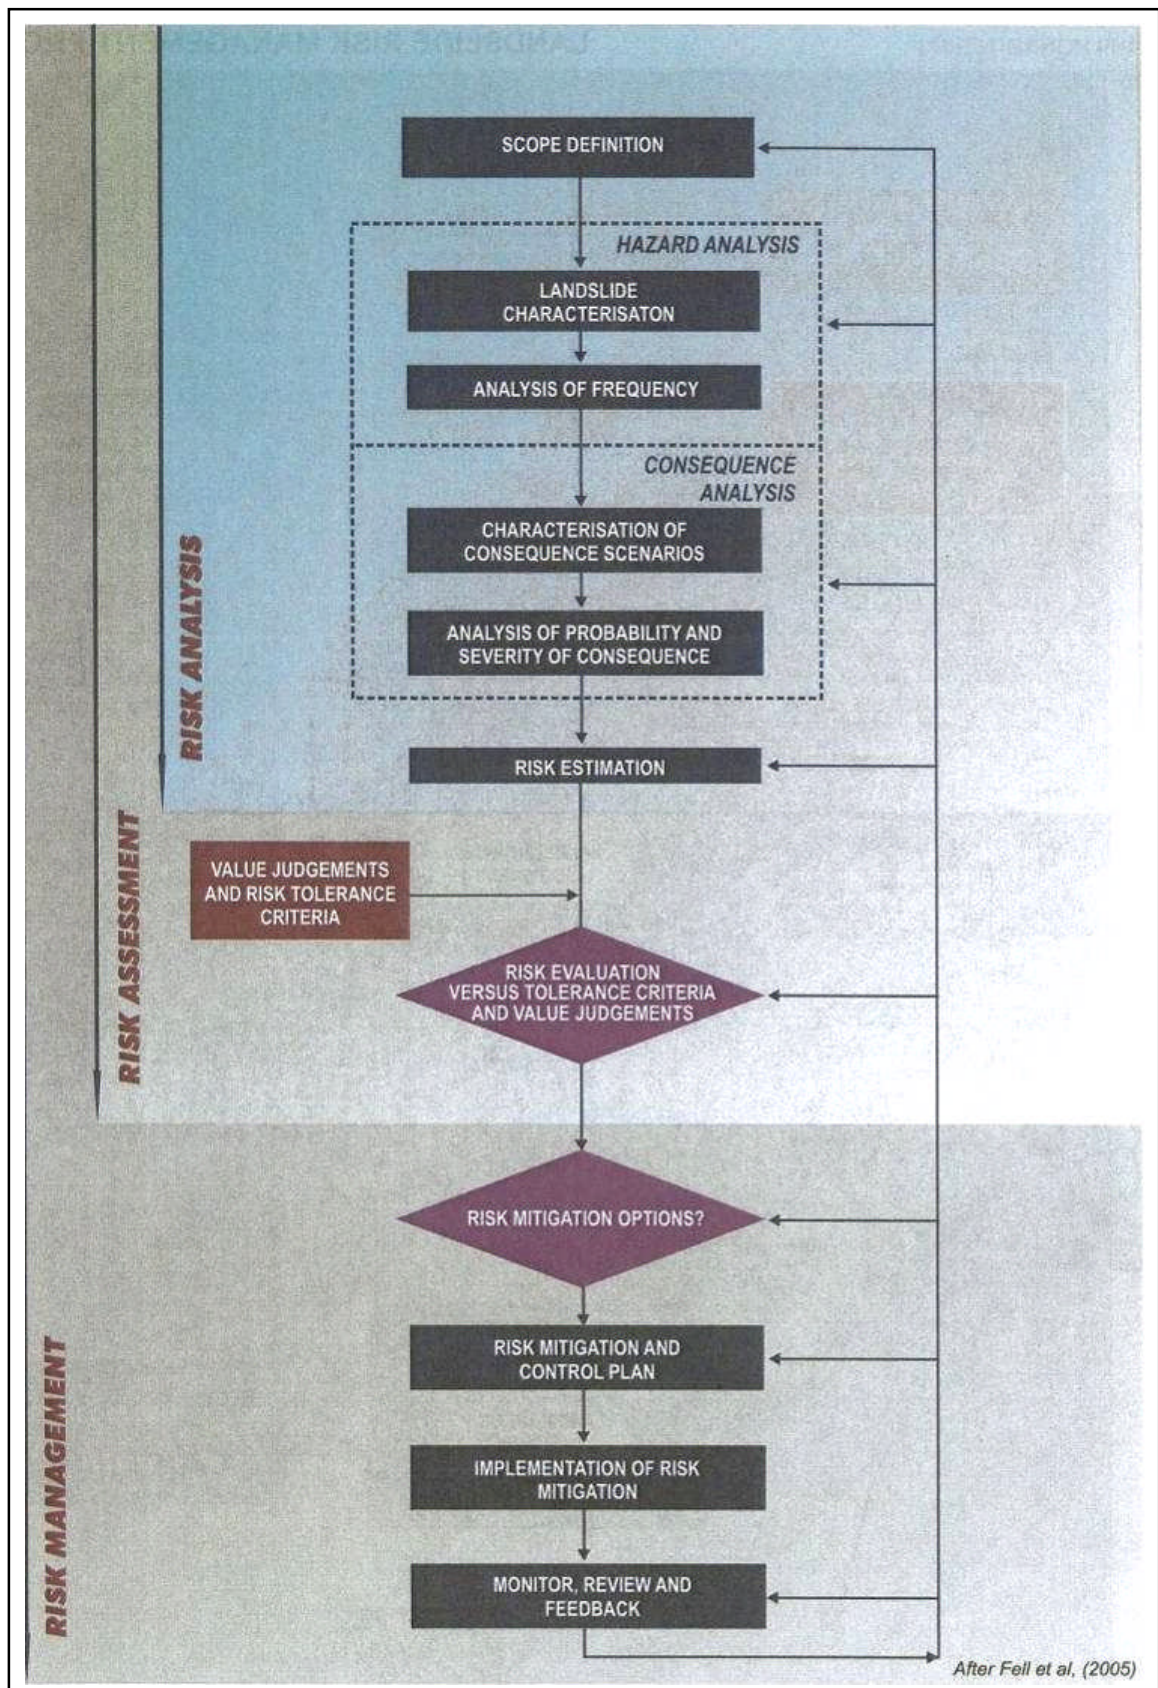


FIGURE A1: Flowchart for Landslide Risk Management.

This figure is an extract from GUIDELINE FOR LANDSLIDE SUSCEPTIBILITY, HAZARD AND RISK ZONING FOR LAND USE PLANNING, as presented in Australian Geomechanics Vol 42, No 1, March 2007, which discusses the matter more fully.



**TABLE A1: LANDSLIDE RISK ASSESSMENT
QUALITATIVE TERMINOLOGY FOR USE IN ASSESSING RISK TO PROPERTY**

QUALITATIVE MEASURES OF LIKELIHOOD

Approximate Annual Probability		Implied Indicative Landslide Recurrence Interval		Description	Descriptor	Level
Indicative Value	Notional Boundary					
10^{-1}	5×10^{-2}	10 years	20 years	The event is expected to occur over the design life.	ALMOST CERTAIN	A
10^{-2}		100 years		The event will probably occur under adverse conditions over the design life.	LIKELY	B
10^{-3}	5×10^{-3}	1000 years	200 years	The event could occur under adverse conditions over the design life.	POSSIBLE	C
10^{-4}	5×10^{-4}	10,000 years	2000 years	The event might occur under very adverse circumstances over the design life.	UNLIKELY	D
10^{-5}	5×10^{-5}	100,000 years	20,000 years	The event is conceivable but only under exceptional circumstances over the design life.	RARE	E
10^{-6}	5×10^{-6}	1,000,000 years	200,000 years	The event is inconceivable or fanciful over the design life.	BARELY CREDIBLE	F

Note: (1) The table should be used from left to right; use Approximate Annual Probability or Description to assign Descriptor, not *vice versa*.

QUALITATIVE MEASURES OF CONSEQUENCES TO PROPERTY

Approximate Cost of Damage		Description	Descriptor	Level
Indicative Value	Notional Boundary			
200%	100%	Structure(s) completely destroyed and/or large scale damage requiring major engineering works for stabilisation. Could cause at least one adjacent property major consequence damage.	CATASTROPHIC	1
60%		Extensive damage to most of structure, and/or extending beyond site boundaries requiring significant stabilisation works. Could cause at least one adjacent property medium consequence damage.	MAJOR	2
20%	40%	Moderate damage to some of structure, and/or significant part of site requiring large stabilisation works. Could cause at least one adjacent property minor consequence damage.	MEDIUM	3
5%	10%	Limited damage to part of structure, and/or part of site requiring some reinstatement stabilisation works.	MINOR	4
0.5%	1%	Little damage. (Note for high probability event (Almost Certain), this category may be subdivided at a notional boundary of 0.1%. See Risk Matrix.)	INSIGNIFICANT	5

Notes: (2) The Approximate Cost of Damage is expressed as a percentage of market value, being the cost of the improved value of the unaffected property which includes the land plus the unaffected structures.

- (3) The Approximate Cost is to be an estimate of the direct cost of the damage, such as the cost of reinstatement of the damaged portion of the property (land plus structures), stabilisation works required to render the site to tolerable risk level for the landslide which has occurred and professional design fees, and consequential costs such as legal fees, temporary accommodation. It does not include additional stabilisation works to address other landslides which may affect the property.
- (4) The table should be used from left to right; use Approximate Cost of Damage or Description to assign Descriptor, not *vice versa*.

Extract from PRACTICE NOTE GUIDELINES FOR LANDSLIDE RISK MANAGEMENT as presented in Australian Geomechanics, Vol 42, No 1, March 2007, which discusses the matter more fully.



TABLE A1: LANDSLIDE RISK ASSESSMENT
QUALITATIVE TERMINOLOGY FOR USE IN ASSESSING RISK TO PROPERTY (continued)

QUALITATIVE RISK ANALYSIS MATRIX – LEVEL OF RISK TO PROPERTY

LIKELIHOOD		CONSEQUENCES TO PROPERTY (With Indicative Approximate Cost of Damage)				
	Indicative Value of Approximate Annual Probability	1: CATASTROPHIC 200%	2: MAJOR 60%	3: MEDIUM 20%	4: MINOR 5%	5: INSIGNIFICANT 0.5%
A – ALMOST CERTAIN	10^{-1}	VH	VH	VH	H	M or L (5)
B – LIKELY	10^{-2}	VH	VH	H	M	L
C – POSSIBLE	10^{-3}	VH	H	M	M	VL
D – UNLIKELY	10^{-4}	H	M	L	L	VL
E – RARE	10^{-5}	M	L	L	VL	VL
F – BARELY CREDIBLE	10^{-6}	L	VL	VL	VL	VL

Notes: (5) Cell A5 may be subdivided such that a consequence of less than 0.1% is Low Risk.

(6) When considering a risk assessment it must be clearly stated whether it is for existing conditions or with risk control measures which may not be implemented at the current time.

RISK LEVEL IMPLICATIONS

Risk Level		Example Implications (7)
VH	VERY HIGH RISK	Unacceptable without treatment. Extensive detailed investigation and research, planning and implementation of treatment options essential to reduce risk to Low; may be too expensive and not practical. Work likely to cost more than value of the property.
H	HIGH RISK	Unacceptable without treatment. Detailed investigation, planning and implementation of treatment options required to reduce risk to Low. Work would cost a substantial sum in relation to the value of the property.
M	MODERATE RISK	May be tolerated in certain circumstances (subject to regulator's approval) but requires investigation, planning and implementation of treatment options to reduce the risk to Low. Treatment options to reduce to Low risk should be implemented as soon as practicable.
L	LOW RISK	Usually acceptable to regulators. Where treatment has been required to reduce the risk to this level, ongoing maintenance is required.
VL	VERY LOW RISK	Acceptable. Manage by normal slope maintenance procedures.

Note: (7) The implications for a particular situation are to be determined by all parties to the risk assessment and may depend on the nature of the property at risk; these are only given as a general guide.

Extract from PRACTICE NOTE GUIDELINES FOR LANDSLIDE RISK MANAGEMENT as presented in Australian Geomechanics, Vol 42, No 1, March 2007, which discusses the matter more fully.



AUSTRALIAN GEOGUIDE LR2 (LANDSLIDES)

What is a Landslide?

Any movement of a mass of rock, debris, or earth, down a slope, constitutes a "landslide". Landslides take many forms, some of which are illustrated. More information can be obtained from Geoscience Australia, or by visiting its Australian landslide Database at www.ga.gov.au/urban/factsheets/landslide.jsp. Aspects of the impact of landslides on buildings are dealt with in the book "Guideline Document Landslide Hazards" published by the Australian Building Codes Board and referenced in the Building Code of Australia. This document can be purchased over the internet at the Australian Building Codes Board's website www.abcb.gov.au.

Landslides vary in size. They can be small and localised or very large, sometimes extending for kilometres and involving millions of tonnes of soil or rock. It is important to realise that even a 1 cubic metre boulder of soil, or rock, weighs at least 2 tonnes. If it falls, or slides, it is large enough to kill a person, crush a car, or cause serious structural damage to a house. The material in a landslide may travel downhill well beyond the point where the failure first occurred, leaving destruction in its wake. It may also leave an unstable slope in the ground behind it, which has the potential to fall again, causing the landslide to extend (regress) uphill, or expand sideways. For all these reasons, both "potential" and "actual" landslides must be taken very seriously. The present a real threat to life and property and require proper management.

Identification of landslide risk is a complex task and must be undertaken by a geotechnical practitioner (GeoGuide LR1) with specialist experience in slope stability assessment and slope stabilisation.

What Causes a Landslide?

Landslides occur as a result of local geological and groundwater conditions, but can be exacerbated by inappropriate development (GeoGuide LR8), exceptional weather, earthquakes and other factors. Some slopes and cliffs never seem to change, but are actually on the verge of failing. Others, often moderate slopes (Table 1), move continuously, but so slowly that it is not apparent to a casual observer. In both cases, small changes in conditions can trigger a landslide with series consequences. Wetting up of the ground (which may involve a rise in groundwater table) is the single most important cause of landslides (GeoGuide LR5). This is why they often occur during, or soon after, heavy rain. Inappropriate development often results in small scale landslides which are very expensive in human terms because of the proximity of housing and people.

Does a Landslide Affect You?

Any slope, cliff, cutting, or fill embankment may be a hazard which has the potential to impact on people, property, roads and services. Some tell-tale signs that might indicate that a landslide is occurring are listed below:

- Open cracks, or steps, along contours
- Groundwater seepage, or springs
- Bulging in the lower part of the slope
- Hummocky ground
- trees leaning down slope, or with exposed roots
- debris/fallen rocks at the foot of a cliff
- tilted power poles, or fences
- cracked or distorted structures

These indications of instability may be seen on almost any slope and are not necessarily confined to the steeper ones (Table 1). Advice should be sought from a geotechnical practitioner if any of them are observed. Landslides do not respect property boundaries. As mentioned above they can "run-out" from above, "regress" from below, or expand sideways, so a landslide hazard affecting your property may actually exist on someone else's land.

Local councils are usually aware of slope instability problems within their jurisdiction and often have specific development and maintenance requirements. **Your local council is the first place to make enquiries if you are responsible for any sort of development or own or occupy property on or near sloping land or a cliff.**

TABLE 1 – Slope Descriptions

Appearance	Slope Angle	Maximum Gradient	Slope Characteristics
Gentle	0° - 10°	1 on 6	Easy walking.
Moderate	10° - 18°	1 on 3	Walkable. Can drive and manoeuvre a car on driveway.
Steep	18° - 27°	1 on 2	Walkable with effort. Possible to drive straight up or down roughened concrete driveway, but cannot practically manoeuvre a car.
Very Steep	27° - 45°	1 on 1	Can only climb slope by clutching at vegetation, rocks, etc.
Extreme	45° - 64°	1 on 0.5	Need rope access to climb slope.
Cliff	64° - 84°	1 on 0.1	Appears vertical. Can abseil down.
Vertical or Overhang	84° - 90±°	Infinite	Appears to overhang. Abseiler likely to lose contact with the face.



Some typical landslides which could affect residential housing are illustrated below:

Rotational or circular slip failures (Figure 1) - can occur on moderate to very steep soil and weathered rock slopes (Table 1). The sliding surface of the moving mass tends to be deep seated. Tension cracks may open at the top of the slope and bulging may occur at the toe. The ground may move in discrete "steps" separated by long periods without movement. More rapid movement may occur after heavy rain.

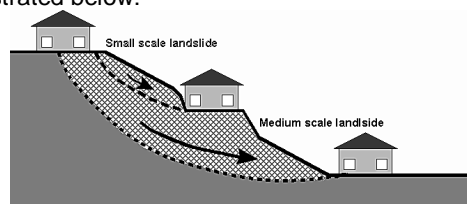


Figure 1

Translational slip failures (Figure 2) - tend to occur on moderate to very steep slopes (Table 1) where soil, or weak rock, overlies stronger strata. The sliding mass is often relatively shallow. It can move, or deform slowly (creep) over long periods of time. Extensive linear cracks and hummocks sometimes form along the contours. The sliding mass may accelerate after heavy rain.

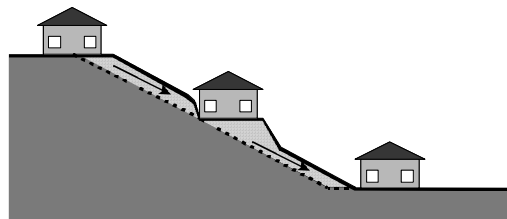


Figure 2

Wedge failures (Figure 3) - normally only occur on extreme slopes, or cliffs (Table 1), where discontinuities in the rock are inclined steeply downwards out of the face.

Rock falls (Figure 3) - tend to occur from cliffs and overhangs (Table 1).

Cliffs may remain, apparently unchanged, for hundreds of years. Collections of boulders at the foot of a cliff may indicate that rock falls are ongoing. Wedge failures and rock falls do not "creep". Familiarity with a particular local situation can instil a false sense of security since failure, when it occurs, is usually sudden and catastrophic.

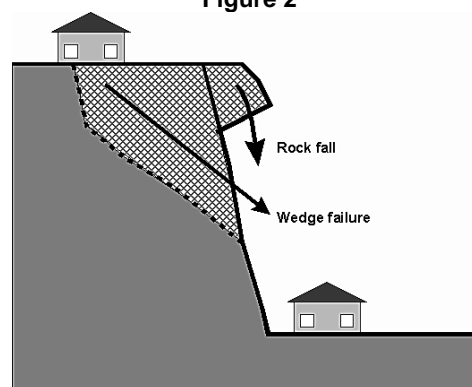


Figure 3

Debris flows and mud slides (Figure 4) - may occur in the foothills of ranges, where erosion has formed valleys which slope down to the plains below. The valley bottoms are often lined with loose eroded material (debris) which can "flow" if it becomes saturated during and after heavy rain. Debris flows are likely to occur with little warning; they travel a long way and often involve large volumes of soil. The consequences can be devastating.

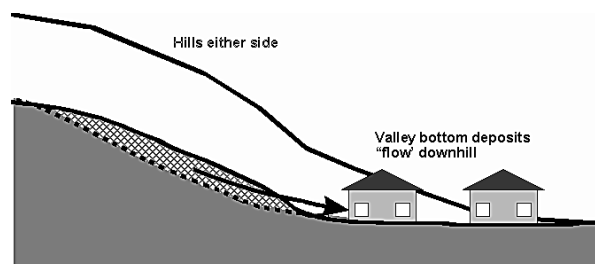


Figure 4

More information relevant to your particular situation may be found in other Australian GeoGuides:

- GeoGuide LR1 - Introduction
- GeoGuide LR3 - Soil Slopes
- GeoGuide LR4 - Rock Slopes
- GeoGuide LR5 - Water & Drainage
- GeoGuide LR6 - Retaining Walls
- GeoGuide LR7 - Landslide Risk
- GeoGuide LR8 - Hillside Construction
- GeoGuide LR9 - Effluent & Surface Water Disposal
- GeoGuide LR10 - Coastal Landslides
- GeoGuide LR11 - Record Keeping

The Australian GeoGuides (LR series) are a set of publications intended for property owners; local councils; planning authorities; developers; insurers; lawyers and, in fact, anyone who lives with, or has an interest in, a natural or engineered slope, a cutting, or an excavation. They are intended to help you understand why slopes and retaining structures can be a hazard and what can be done with appropriate professional advice and local council approval (if required) to remove, reduce, or minimise the risk they represent. The GeoGuides have been prepared by the Australian Geomechanics Society, a specialist technical society within Engineers Australia, the national peak body for all engineering disciplines in Australia, whose members are professional geotechnical engineers and engineering geologists with a particular interest in ground engineering. The GeoGuides have been funded under the Australian governments' National Disaster Mitigation Program.



AUSTRALIAN GEOGUIDE LR7 (LANDSLIDE RISK)

Concept of Risk

Risk is a familiar term, but what does it really mean? It can be defined as *"a measure of the probability and severity of an adverse effect to health, property, or the environment."* This definition may seem a bit complicated. In relation to landslides, geotechnical practitioners (see GeoGuide LR1) are required to assess risk in terms of the likelihood that a particular landslide will occur and the possible consequences. This is called landslide risk assessment. The consequences of a landslide are many and varied, but our concerns normally focus on loss of, or damage to, property and loss of life.

Landslide Risk Assessment

Some local councils in Australia are aware of the potential for landslides within their jurisdiction and have responded by designating specific **"landslide hazard zones"**. Development in these areas is normally covered by special regulations. If you are contemplating building, or buying an existing house, particularly in a hilly area, or near cliffs, then go first for information to your local council. If you have any concern that you could be dealing with a landslide hazard that your local council is not aware of you should seek advice from a geotechnical practitioner.

Landslide risk assessment must be undertaken by a geotechnical practitioner. It may involve visual inspection, geological mapping, geotechnical

investigation and monitoring to identify:

- potential landslides (there may be more than one that could impact on your site);
- the likelihood that they will occur;
- the damage that could result;
- the cost of disruption and repairs; and
- the extent to which lives could be lost.

Risk assessment is a predictive exercise, but since the ground and the processes involved are complex, prediction inevitably lacks precision. If you commission a landslide risk assessment for a particular site you should expect to receive a report prepared in accordance with current professional guidelines and in a form that is acceptable to your local council, or planning authority.

Risk to Property

Table 1 indicates the terms used to describe risk to property. Each risk level depends on an assessment of how likely a landslide is to occur and its consequences in dollar terms. Likelihood is the chance of it happening in any one year, as indicated in Table 2. Consequences are related to the cost of the repairs and perhaps temporary loss of use. These two factors are combined by the geotechnical practitioner to determine the Qualitative Risk.

TABLE 1 – RISK TO PROPERTY

Qualitative Risk		Significance - Geotechnical engineering requirements
Very high	VH	Unacceptable without treatment. Extensive detailed investigation and research, planning and implementation of treatment options essential to reduce risk to Low. May be too expensive and not practical. Work likely to cost more than the value of the property.
High	H	Unacceptable without treatment. Detailed investigation, planning and implementation of treatment options required to reduce risk to acceptable level. Work would cost a substantial sum in relation to the value of the property.
Moderate	M	May be tolerated in certain circumstances (subject to regulator's approval) but requires investigation, planning and implementation of treatment options to reduce the risk to Low. Treatment options to reduce to Low risk should be implemented as soon as possible.
Low	L	Usually acceptable to regulators. Where treatment has been needed to reduce the risk to this level, ongoing maintenance is required.
Very Low	VL	Acceptable. Manage by normal slope maintenance procedures.

TABLE 2 – LIKELIHOOD

Likelihood	Annual Probability
Almost Certain	1:10
Likely	1:100
Possible	1:1,000
Unlikely	1:10,000
Rare	1:100,000
Barely credible	1:1,000,000

The terms "unacceptable", "tolerable" etc. in Table 1 indicate how most people react to an assessed risk level. However, some people will always be more prepared, or better able, to tolerate a higher risk level than others. Some local councils and planning authorities stipulate a maximum tolerable risk level. This may be lower than you feel is reasonable for your block but it is, nonetheless, a pre-requisite for development. Reasons for this include the fact that a landslide on your block may pose a risk to neighbours and passers-by and that, should you sell, subsequent owners of the block may be more risk averse than you.



Risk to Life

Most of us have some difficulty grappling with the concept of risk and deciding whether, or not, we are prepared to accept it. However, without doing any sort of analysis, or commissioning a report from an "expert", we all take risks every day. One of them is the risk of being killed in an accident. This is worth thinking about, because it tells us a lot about ourselves and can help to put an assessed risk into a meaningful context. By identifying activities that we either are, or are not, prepared to engage in, we can get some indication of the maximum level of risk that we are prepared to take. This knowledge can help us to decide whether we really are able to accept a particular risk, or to tolerate a particular likelihood of loss, or damage, to our property (Table 2).

In Table 3, data from NSW for the years 1998 to 2002, and other sources, is presented. A risk of 1 in 100,000 means that, in any one year, 1 person is killed for every 100,000 people undertaking that particular activity. The NSW data assumes that the whole population undertakes the activity. That is, we are all at risk of being killed in a fire, or of choking on our food, but it is reasonable to assume that only people who go deep sea fishing run a risk of being killed while doing it.

It can be seen that the risks of dying as a result of falling, using a motor vehicle, or engaging in water-related activities (including bathing) are all greater than 1:100,000 and yet few people actively avoid situations where these risks are present. Some people are averse to flying and yet it represents a lower risk than choking to death on food. The data also indicate that, even when the risk of dying as a consequence of a particular event is very small, it could still happen to any one of us today. If this were not so, there would be no risk at all and clearly that is not the case.

In NSW, the planning authorities consider that 1:1,000,000 is the maximum tolerable risk for domestic housing built near an obvious hazard, such as a chemical factory. Although not specifically considered in the NSW guidelines there is little difference between the hazard presented by a neighbouring factory and a landslide: both have the capacity to destroy life and property and both are always present.

TABLE 3 – RISK TO LIFE

Risk (deaths per participant per year)	Activity/Event Leading to Death (NSW data unless noted)
1:1,000	Deep sea fishing (UK)
1:1,000 to 1:10,000	Motor cycling, horse riding , ultra-light flying (Canada)
1:23,000	Motor vehicle use
1:30,000	Fall
1:70,000	Drowning
1:180,000	Fire/burn
1:660,000	Choking on food
1:1,000,000	Scheduled airlines (Canada)
1:2,300,000	Train travel
1:32,000,000	Lightning strike

More information relevant to your particular situation may be found in other AUSTRALIAN GEOGUIDES:

- GeoGuide LR1 - Introduction
- GeoGuide LR2 - Landslides
- GeoGuide LR3 - Landslides in Soil
- GeoGuide LR4 - Landslides in Rock
- GeoGuide LR5 - Water & Drainage
- GeoGuide LR6 - Retaining Walls
- GeoGuide LR8 - Hillside Construction
- GeoGuide LR9 - Effluent & Surface Water Disposal
- GeoGuide LR10 - Coastal Landslides
- GeoGuide LR11 - Record Keeping

The Australian GeoGuides (LR series) are a set of publications intended for property owners; local councils; planning authorities; developers; insurers; lawyers and, in fact, anyone who lives with, or has an interest in, a natural or engineered slope, a cutting, or an excavation. They are intended to help you understand why slopes and retaining structures can be a hazard and what can be done with appropriate professional advice and local council approval (if required) to remove, reduce, or minimise the risk they represent. The GeoGuides have been prepared by the Australian Geomechanics Society, a specialist technical society within Engineers Australia, the national peak body for all engineering disciplines in Australia, whose members are professional geotechnical engineers and engineering geologists with a particular interest in ground engineering. The GeoGuides have been funded under the Australian governments' National Disaster Mitigation Program.



APPENDIX B

SOME GUIDELINES FOR HILLSIDE CONSTRUCTION



APPENDIX B – SOME GUIDELINES FOR HILLSIDE CONSTRUCTION


GOOD ENGINEERING PRACTICE		POOR ENGINEERING PRACTICE	
ADVICE			
GEOTECHNICAL ASSESSMENT	Obtain advice from a qualified, experienced geotechnical consultant at early stage of planning and before site works.	Prepare detailed plan and start site works before geotechnical advice.	
PLANNING			
SITE PLANNING	Having obtained geotechnical advice, plan the development with the risk arising from the identified hazards and consequences in mind.	Plan development without regard for the Risk.	
DESIGN AND CONSTRUCTION			
HOUSE DESIGN	Use flexible structures which incorporate properly designed brickwork, timber or steel frames, timber or panel cladding. Consider use of split levels. Use decks for recreational areas where appropriate.	Floor plans which require extensive cutting and filling. Movement intolerant structures.	
SITE CLEARING	Retain natural vegetation wherever practicable.	Indiscriminately clear the site.	
ACCESS & DRIVEWAYS	Satisfy requirements below for cuts, fills, retaining walls and drainage. Council specifications for grades may need to be modified. Driveways and parking areas may need to be fully supported on piers.	Excavate and fill for site access before geotechnical advice.	
EARTHWORKS	Retain natural contours wherever possible.	Indiscriminant bulk earthworks.	
	CUTS	Minimise depth. Support with engineered retaining walls or batter to appropriate slope. Provide drainage measures and erosion control.	Large scale cuts and benching. Unsupported cuts. Ignore drainage requirements.
	FILLS	Minimise height. Strip vegetation and topsoil and key into natural slopes prior to filling. Use clean fill materials and compact to engineering standards. Batter to appropriate slope or support with engineered retaining wall. Provide surface drainage and appropriate subsurface drainage.	Loose or poorly compacted fill, which if it fails, may flow a considerable distance (including onto properties below). Block natural drainage lines. Fill over existing vegetation and topsoil. Include stumps, trees, vegetation, topsoil, boulders, building rubble etc. in fill.
	ROCK OUTCROPS & BOULDERS	Remove or stabilise boulders which may have unacceptable risk. Support rock faces where necessary.	Disturb or undercut detached blocks or boulders.
RETAINING WALLS	Engineer design to resist applied soil and water forces. Found on bedrock where practicable. Provide subsurface drainage within wall backfill and surface drainage on slope above. Construct wall as soon as possible after cut/fill operation.	Construct a structurally inadequate wall such as sandstone flagging, brick or unreinforced blockwork. Lack of subsurface drains and weepholes.	
FOOTINGS	Found within bedrock where practicable. Use rows of piers or strip footings oriented up and down slope. Design for lateral creep pressures if necessary. Backfill footing excavations to exclude ingress of surface water.	Found on topsoil, loose fill, detached boulders or undercut cliffs.	
SWIMMING POOLS	Engineer designed. Support on piers to rock where practicable. Provide with under-drainage and gravity drain outlet where practicable. Design for high soil pressures which may develop on uphill side whilst there may be little or no lateral support on downhill side.		
DRAINAGE	SURFACE	Provide at tops of cut and fill slopes. Discharge to street drainage or natural water courses. Provide generous falls to prevent blockage by siltation and incorporate silt traps. Line to minimise infiltration and make flexible where possible. Special structures to dissipate energy at changes of slope and/or direction.	Discharge at top of fills and cuts. Allow water to pond bench areas.
	SUBSURFACE	Provide filter around subsurface drain. Provide drain behind retaining walls. Use flexible pipelines with access for maintenance. Prevent inflow of surface water.	Discharge of roof run-off into absorption trenches.
	SEPTIC & SULLAGE	Usually requires pump-out or mains sewer systems; absorption trenches may be possible in some areas if risk is acceptable. Storage tanks should be water-tight and adequately founded.	Discharge sullage directly onto and into slopes. Use of absorption trenches without consideration of landslide risk.
EROSION CONTROL & LANDSCAPING	Control erosion as this may lead to instability. Revegetate cleared area.	Failure to observe earthworks and drainage recommendations when landscaping.	
DRAWINGS AND SITE VISITS DURING CONSTRUCTION			
DRAWINGS	Building Application drawings should be viewed by a geotechnical consultant.		
SITE VISITS	Site visits by consultant may be appropriate during construction.		
INSPECTION AND MAINTENANCE BY OWNER			
OWNER'S RESPONSIBILITY	Clean drainage systems; repair broken joints in drains and leaks in supply pipes. Where structural distress is evident seek advice. If seepage observed, determine cause or seek advice on consequences.		

This table is an extract from PRACTICE NOTE GUIDELINES FOR LANDSLIDE RISK MANAGEMENT as presented in *Australian Geomechanics*, Vol 42, No 1, March 2007 which discusses the matter more fully.

HILLSIDE CONSTRUCTION PRACTICE

Sensible development practices are required when building on hillsides, particularly if the hillside has more than a low risk of instability (GeoGuide LR7). Only building techniques intended to maintain, or reduce, the overall level of landslide risk should be considered. Examples of good hillside construction practice are illustrated below.

EXAMPLES FOR **GOOD** HILLSIDE CONSTRUCTION PRACTICE

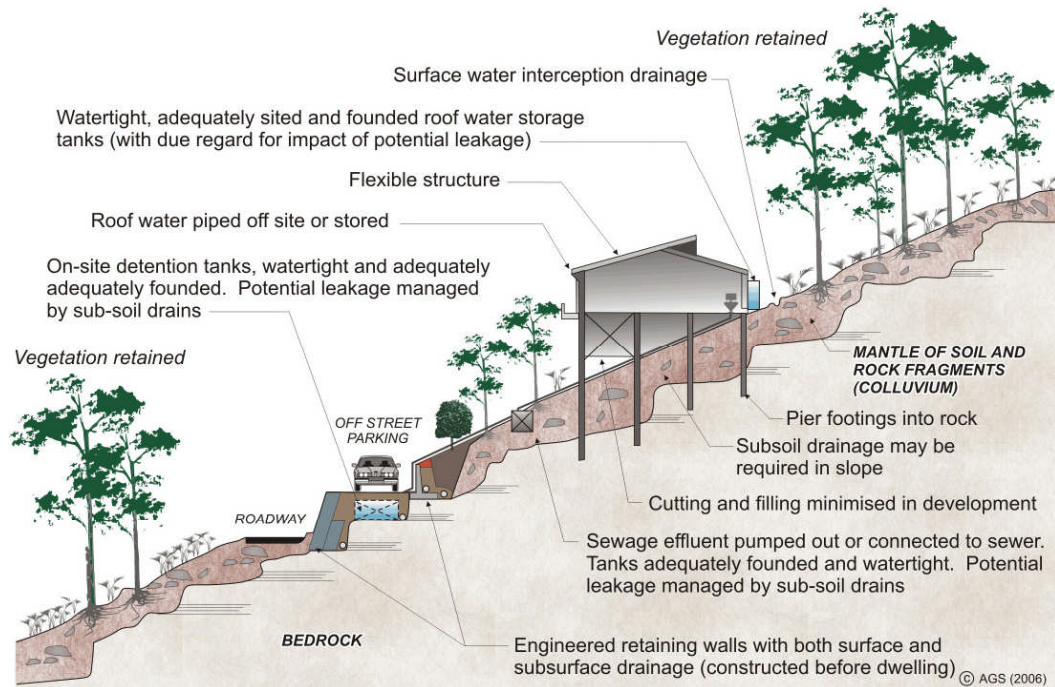

WHY ARE THESE PRACTICES GOOD?

Roadways and parking areas - are paved and incorporate kerbs which prevent water discharging straight into the hillside (GeoGuide LR5).

Cuttings - are supported by retaining walls (GeoGuide LR6).

Retaining walls - are engineer designed to withstand the lateral earth pressures and surcharges expected, and include drains to prevent water pressures developing in the backfill. Where the ground slopes steeply down towards the high side of a retaining wall, the disturbing force (see GeoGuide LR6) can be two or more times that due to level ground. Retaining walls must be designed taking these forces into account.

Sewage - whether treated or not is either taken away in pipes or contained in properly founded tanks so it cannot soak into the ground.

Surface water - from roofs and other hard surfaces is piped away to a suitable discharge point rather than being allowed to infiltrate into the ground. Preferably, the discharge point will be in a natural creek where ground water exits, rather than enters, the ground. Shallow, lined, drains on the surface can fulfill the same purpose (GeoGuide LR5).

Surface loads - are minimised. No fill embankments have been built. The house is a lightweight structure. Foundation loads have been taken down below the level at which a landslide is likely to occur and, preferably, to rock. This sort of construction is probably not applicable to soil slopes (GeoGuide LR3). If you are uncertain whether your site has rock near the surface, or is essentially a soil slope, you should engage a geotechnical practitioner to find out.

Flexible structures - have been used because they can tolerate a certain amount of movement with minimal signs of distress and maintain their functionality.


Vegetation clearance - on soil slopes has been kept to a reasonable minimum. Trees, and to a lesser extent smaller vegetation, take large quantities of water out of the ground every day. This lowers the ground water table, which in turn helps to maintain the stability of the slope. Large scale clearing can result in a rise in water table with a consequent increase in the likelihood of a landslide (GeoGuide LR5). An exception may have to be made to this rule on steep rock slopes where trees have little effect on the water table, but their roots pose a landslide hazard by dislodging boulders.

Possible effects of ignoring good construction practices are illustrated on page 2. Unfortunately, these poor construction practices are not as unusual as you might think and are often chosen because, on the face of it, they will save the developer, or owner, money. You should not lose sight of the fact that the cost and anguish associated with any one of the disasters illustrated, is likely to more than wipe out any apparent savings at the outset.

ADOPT GOOD PRACTICE ON HILLSIDE SITES
Extract from Geoguide LR8 – Hillside Construction Practice



EXAMPLES FOR **POOR** HILLSIDE CONSTRUCTION PRACTICE

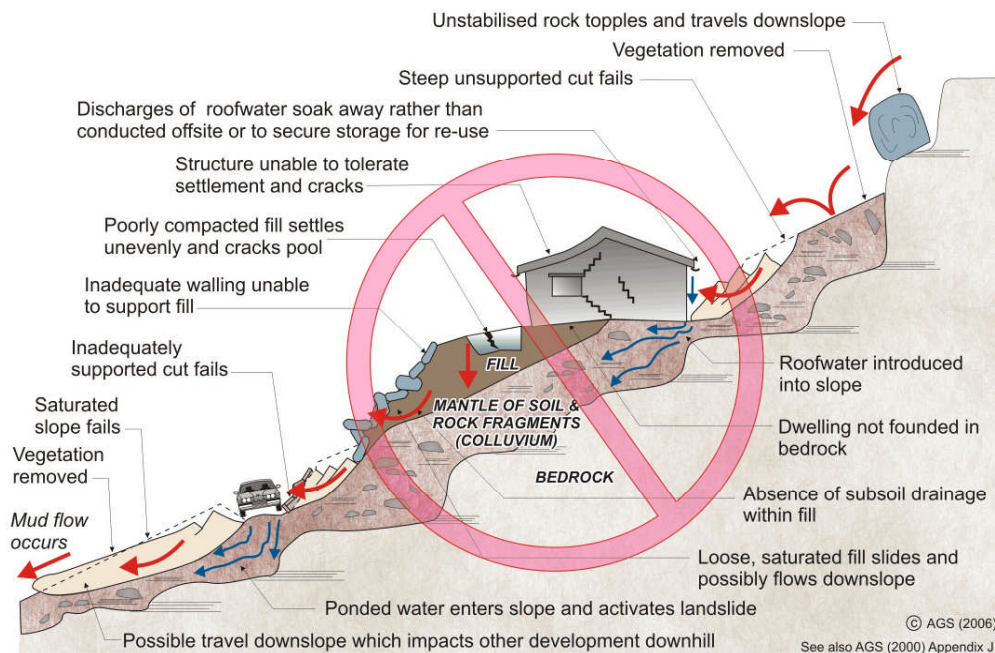

WHY ARE THESE PRACTICES POOR?

Roadways and parking areas - are unsurfaced and lack proper table drains (gutters) causing surface water to pond and soaks into the ground.

Cut and fill - has been used to balance earthworks quantities and level the site leaving unstable cut faces and added large surface loads to the ground. Failure to compact the fill properly has led to settlement, which will probably continue for several years after completion. The house and pool have been built on the fill and have settled with it and cracked. Leakage from the cracked pool and the applied surface loads from the fill have combined to cause landslides.

Retaining walls - have been avoided, to minimise cost, and hand placed rock walls used instead. Without applying engineering design principles, the walls have failed to provide the required support to the ground and have failed, creating a very dangerous situation.

A heavy, rigid, house - has been built on shallow, conventional, footings. Not only has the brickwork cracked because of the resulting ground movements, but it has also become involved in a man-made landslide.

Soak-away drainage - has been used for sewage and surface water run-off from roofs and pavements. This water soaks into the ground and raises the water table (GeoGuide LR5). Subsoil drains that run along the contours should be avoided for the same reason. If felt necessary, subsoil drains should run steeply downhill in a chevron, or herringbone, pattern. This may conflict with the requirements for effluent and surface water disposal (GeoGuide LR9) and if so, you will need to seek professional advice.

Rock debris - from landslides higher up on the slope seems likely to pass through the site. Such locations are often referred to by geotechnical practitioners as "debris flow paths". Rock is normally even denser than ordinary fill, so even quite modest boulders are likely to weigh many tonnes and do a lot of damage once they start to roll. Boulders have been known to travel hundreds of metres downhill leaving behind a trail of destruction.

Vegetation - has been completely cleared, leading to a possible rise in the water table and increased landslide risk (GeoGuide LR5).

DON'T CUT CORNERS ON HILLSIDE SITES - OBTAIN ADVICE FROM A GEOTECHNICAL PRACTITIONER

More information relevant to your particular situation may be found in other Australian GeoGuides:

- | | |
|-------------------------------------|--|
| • GeoGuide LR1 - Introduction | • GeoGuide LR6 - Retaining Walls |
| • GeoGuide LR2 - Landslides | • GeoGuide LR7 - Landslide Risk |
| • GeoGuide LR3 - Landslides in Soil | • GeoGuide LR9 - Effluent & Surface Water Disposal |
| • GeoGuide LR4 - Landslides in Rock | • GeoGuide LR10 - Coastal Landslides |
| • GeoGuide LR5 - Water & Drainage | • GeoGuide LR11 - Record Keeping |

The Australian GeoGuides (LR series) are a set of publications intended for property owners; local councils; planning authorities; developers; insurers; lawyers and, in fact, anyone who lives with, or has an interest in, a natural or engineered slope, a cutting, or an excavation. They are intended to help you understand why slopes and retaining structures can be a hazard and what can be done with appropriate professional advice and local council approval (if required) to remove, reduce, or minimise the risk they represent. The GeoGuides have been prepared by the Australian Geomechanics Society, a specialist technical society within Engineers Australia, the national peak body for all engineering disciplines in Australia, whose members are professional geotechnical engineers and engineering geologists with a particular interest in ground engineering. The GeoGuides have been funded under the Australian governments' National Disaster Mitigation Program.

Extract from Geoguide LR8 – Hillside Construction Practice.



REPORT EXPLANATION NOTES

INTRODUCTION

These notes have been provided to amplify the geotechnical report in regard to classification methods, field procedures and certain matters relating to the Comments and Recommendations section. Not all notes are necessarily relevant to all reports.

The ground is a product of continuing natural and man-made processes and therefore exhibits a variety of characteristics and properties which vary from place to place and can change with time. Geotechnical engineering involves gathering and assimilating limited facts about these characteristics and properties in order to understand or predict the behaviour of the ground on a particular site under certain conditions. This report may contain such facts obtained by inspection, excavation, probing, sampling, testing or other means of investigation. If so, they are directly relevant only to the ground at the place where and time when the investigation was carried out.

DESCRIPTION AND CLASSIFICATION METHODS

The methods of description and classification of soils and rocks used in this report are based on Australian Standard 1726:2017 'Geotechnical Site Investigations'. In general, descriptions cover the following properties – soil or rock type, colour, structure, strength or density, and inclusions. Identification and classification of soil and rock involves judgement and the Company infers accuracy only to the extent that is common in current geotechnical practice.

Soil types are described according to the predominating particle size and behaviour as set out in the attached soil classification table qualified by the grading of other particles present (eg. sandy clay) as set out below:

Soil Classification	Particle Size
Clay	< 0.002mm
Silt	0.002 to 0.075mm
Sand	0.075 to 2.36mm
Gravel	2.36 to 63mm
Cobbles	63 to 200mm
Boulders	> 200mm

Non-cohesive soils are classified on the basis of relative density, generally from the results of Standard Penetration Test (SPT) as below:

Relative Density	SPT 'N' Value (blows/300mm)
Very loose (VL)	< 4
Loose (L)	4 to 10
Medium dense (MD)	10 to 30
Dense (D)	30 to 50
Very Dense (VD)	> 50

Cohesive soils are classified on the basis of strength (consistency) either by use of a hand penetrometer, vane shear, laboratory testing and/or tactile engineering examination. The strength terms are defined as follows.

Classification	Unconfined Compressive Strength (kPa)	Indicative Undrained Shear Strength (kPa)
Very Soft (VS)	≤ 25	≤ 12
Soft (S)	> 25 and ≤ 50	> 12 and ≤ 25
Firm (F)	> 50 and ≤ 100	> 25 and ≤ 50
Stiff (St)	> 100 and ≤ 200	> 50 and ≤ 100
Very Stiff (VSt)	> 200 and ≤ 400	> 100 and ≤ 200
Hard (Hd)	> 400	> 200
Friable (Fr)	Strength not attainable – soil crumbles	

Rock types are classified by their geological names, together with descriptive terms regarding weathering, strength, defects, etc. Where relevant, further information regarding rock classification is given in the text of the report. In the Sydney Basin, 'shale' is used to describe fissile mudstone, with a weakness parallel to bedding. Rocks with alternating inter-laminations of different grain size (eg. siltstone/claystone and siltstone/fine grained sandstone) is referred to as 'laminite'.

SAMPLING

Sampling is carried out during drilling or from other excavations to allow engineering examination (and laboratory testing where required) of the soil or rock.

Disturbed samples taken during drilling provide information on plasticity, grain size, colour, moisture content, minor constituents and, depending upon the degree of disturbance, some information on strength and structure. Bulk samples are similar but of greater volume required for some test procedures.

Undisturbed samples are taken by pushing a thin-walled sample tube, usually 50mm diameter (known as a U50), into the soil and withdrawing it with a sample of the soil contained in a relatively undisturbed state. Such samples yield information on structure and strength, and are necessary for laboratory determination of shrink-swell behaviour, strength and compressibility. Undisturbed sampling is generally effective only in cohesive soils.

Details of the type and method of sampling used are given on the attached logs.



INVESTIGATION METHODS

The following is a brief summary of investigation methods currently adopted by the Company and some comments on their use and application. All methods except test pits, hand auger drilling and portable Dynamic Cone Penetrometers require the use of a mechanical rig which is commonly mounted on a truck chassis or track base.

Test Pits: These are normally excavated with a backhoe or a tracked excavator, allowing close examination of the insitu soils and 'weaker' bedrock if it is safe to descend into the pit. The depth of penetration is limited to about 3m for a backhoe and up to 6m for a large excavator. Limitations of test pits are the problems associated with disturbance and difficulty of reinstatement and the consequent effects on close-by structures. Care must be taken if construction is to be carried out near test pit locations to either properly recompact the backfill during construction or to design and construct the structure so as not to be adversely affected by poorly compacted backfill at the test pit location.

Hand Auger Drilling: A borehole of 50mm to 100mm diameter is advanced by manually operated equipment. Refusal of the hand auger can occur on a variety of materials such as obstructions within any fill, tree roots, hard clay, gravel or ironstone, cobbles and boulders, and does not necessarily indicate rock level.

Continuous Spiral Flight Augers: The borehole is advanced using 75mm to 115mm diameter continuous spiral flight augers, which are withdrawn at intervals to allow sampling and insitu testing. This is a relatively economical means of drilling in clays and in sands above the water table. Samples are returned to the surface by the flights or may be collected after withdrawal of the auger flights, but they can be very disturbed and layers may become mixed. Information from the auger sampling (as distinct from specific sampling by SPTs or undisturbed samples) is of limited reliability due to mixing or softening of samples by groundwater, or uncertainties as to the original depth of the samples. Augering below the groundwater table is of even lesser reliability than augering above the water table.

Rock Augering: Use can be made of a Tungsten Carbide (TC) bit for auger drilling into rock to indicate rock quality and continuity by variation in drilling resistance and from examination of recovered rock cuttings. This method of investigation is quick and relatively inexpensive but provides only an indication of the likely rock strength and predicted values may be in error by a strength order. Where rock strengths may have a significant impact on construction feasibility or costs, then further investigation by means of cored boreholes may be warranted.

Wash Boring: The borehole is usually advanced by a rotary bit, with water being pumped down the drill rods and returned up the annulus, carrying the drill cuttings. Only major changes in stratification can be assessed from the cuttings, together with some information from "feel" and rate of penetration.

Mud Stabilised Drilling: Either Wash Boring or Continuous Core Drilling can use drilling mud as a circulating fluid to stabilise the borehole. The term 'mud' encompasses a range of products ranging from bentonite to polymers. The mud tends to mask the cuttings and reliable identification is only possible from intermittent intact sampling (eg. from SPT and U50 samples) or from rock coring, etc.

Continuous Core Drilling: A continuous core sample is obtained using a diamond tipped core barrel. Provided full core recovery is achieved (which is not always possible in very low strength rocks and granular soils), this technique provides a very reliable (but relatively expensive) method of investigation. In rocks, NMLC or HQ triple tube core barrels, which give a core of about 50mm and 61mm diameter, respectively, is usually used with water flush. The length of core recovered is compared to the length drilled and any length not recovered is shown as NO CORE. The location of NO CORE recovery is determined on site by the supervising engineer; where the location is uncertain, the loss is placed at the bottom of the drill run.

Standard Penetration Tests: Standard Penetration Tests (SPT) are used mainly in non-cohesive soils, but can also be used in cohesive soils, as a means of indicating density or strength and also of obtaining a relatively undisturbed sample. The test procedure is described in Australian Standard 1289.6.3.1-2004 (R2016) *'Methods of Testing Soils for Engineering Purposes, Soil Strength and Consolidation Tests – Determination of the Penetration Resistance of a Soil – Standard Penetration Test (SPT)'*.

The test is carried out in a borehole by driving a 50mm diameter split sample tube with a tapered shoe, under the impact of a 63.5kg hammer with a free fall of 760mm. It is normal for the tube to be driven in three successive 150mm increments and the 'N' value is taken as the number of blows for the last 300mm. In dense sands, very hard clays or weak rock, the full 450mm penetration may not be practicable and the test is discontinued.

The test results are reported in the following form:

- In the case where full penetration is obtained with successive blow counts for each 150mm of, say, 4, 6 and 7 blows, as

$$N = 13 \\ 4, 6, 7$$

- In a case where the test is discontinued short of full penetration, say after 15 blows for the first 150mm and 30 blows for the next 40mm, as

$$N > 30 \\ 15, 30/40\text{mm}$$

The results of the test can be related empirically to the engineering properties of the soil.

A modification to the SPT is where the same driving system is used with a solid 60° tipped steel cone of the same diameter as the SPT hollow sampler. The solid cone can be continuously driven for some distance in soft clays or loose sands, or may be used where damage would otherwise occur to the SPT. The results of this Solid Cone Penetration Test (SCPT) are shown as 'N_c' on the borehole logs, together with the number of blows per 150mm penetration.



Cone Penetrometer Testing (CPT) and Interpretation:

The cone penetrometer is sometimes referred to as a Dutch Cone. The test is described in Australian Standard 1289.6.5.1–1999 (R2013) *'Methods of Testing Soils for Engineering Purposes, Soil Strength and Consolidation Tests – Determination of the Static Cone Penetration Resistance of a Soil – Field Test using a Mechanical and Electrical Cone or Friction-Cone Penetrometer'*.

In the tests, a 35mm or 44mm diameter rod with a conical tip is pushed continuously into the soil, the reaction being provided by a specially designed truck or rig which is fitted with a hydraulic ram system. Measurements are made of the end bearing resistance on the cone and the frictional resistance on a separate 134mm or 165mm long sleeve, immediately behind the cone. Transducers in the tip of the assembly are electrically connected by wires passing through the centre of the push rods to an amplifier and recorder unit mounted on the control truck. The CPT does not provide soil sample recovery.

As penetration occurs (at a rate of approximately 20mm per second), the information is output as incremental digital records every 10mm. The results given in this report have been plotted from the digital data.

The information provided on the charts comprise:

- Cone resistance – the actual end bearing force divided by the cross sectional area of the cone – expressed in MPa. There are two scales presented for the cone resistance. The lower scale has a range of 0 to 5MPa and the main scale has a range of 0 to 50MPa. For cone resistance values less than 5MPa, the plot will appear on both scales.
- Sleeve friction – the frictional force on the sleeve divided by the surface area – expressed in kPa.
- Friction ratio – the ratio of sleeve friction to cone resistance, expressed as a percentage.

The ratios of the sleeve resistance to cone resistance will vary with the type of soil encountered, with higher relative friction in clays than in sands. Friction ratios of 1% to 2% are commonly encountered in sands and occasionally very soft clays, rising to 4% to 10% in stiff clays and peats. Soil descriptions based on cone resistance and friction ratios are only inferred and must not be considered as exact.

Correlations between CPT and SPT values can be developed for both sands and clays but may be site specific.

Interpretation of CPT values can be made to empirically derive modulus or compressibility values to allow calculation of foundation settlements.

Stratification can be inferred from the cone and friction traces and from experience and information from nearby boreholes etc. Where shown, this information is presented for general guidance, but must be regarded as interpretive. The test method provides a continuous profile of engineering properties but, where precise information on soil classification is required, direct drilling and sampling may be preferable.

There are limitations when using the CPT in that it may not penetrate obstructions within any fill, thick layers of hard clay and very dense sand, gravel and weathered bedrock. Normally a 'dummy' cone is pushed through fill to protect the equipment. No information is recorded by the 'dummy' probe.

Flat Dilatometer Test: The flat dilatometer (DMT), also known as the Marchetti Dilometer comprises a stainless steel blade having a flat, circular steel membrane mounted flush on one side.

The blade is connected to a control unit at ground surface by a pneumatic-electrical tube running through the insertion rods. A gas tank, connected to the control unit by a pneumatic cable, supplies the gas pressure required to expand the membrane. The control unit is equipped with a pressure regulator, pressure gauges, an audio-visual signal and vent valves.

The blade is advanced into the ground using our CPT rig or one of our drilling rigs, and can be driven into the ground using an SPT hammer. As soon as the blade is in place, the membrane is inflated, and the pressure required to lift the membrane (approximately 0.1mm) is recorded. The pressure then required to lift the centre of the membrane by an additional 1mm is recorded. The membrane is then deflated before pushing to the next depth increment, usually 200mm down. The pressure readings are corrected for membrane stiffness.

The DMT is used to measure material index (I_b), horizontal stress index (K_b), and dilatometer modulus (E_b). Using established correlations, the DMT results can also be used to assess the 'at rest' earth pressure coefficient (K_0), over-consolidation ratio (OCR), undrained shear strength (C_u), friction angle (ϕ), coefficient of consolidation (C_h), coefficient of permeability (K_h), unit weight (γ), and vertical drained constrained modulus (M).

The seismic dilatometer (SDMT) is the combination of the DMT with an add-on seismic module for the measurement of shear wave velocity (V_s). Using established correlations, the SDMT results can also be used to assess the small strain modulus (G_0).

Portable Dynamic Cone Penetrometers: Portable Dynamic Cone Penetrometer (DCP) tests are carried out by driving a 16mm diameter rod with a 20mm diameter cone end with a 9kg hammer dropping 510mm. The test is described in Australian Standard 1289.6.3.2–1997 (R2013) *'Methods of Testing Soils for Engineering Purposes, Soil Strength and Consolidation Tests – Determination of the Penetration Resistance of a Soil – 9kg Dynamic Cone Penetrometer Test'*.

The results are used to assess the relative compaction of fill, the relative density of granular soils, and the strength of cohesive soils. Using established correlations, the DCP test results can also be used to assess California Bearing Ratio (CBR).

Refusal of the DCP can occur on a variety of materials such as obstructions within any fill, tree roots, hard clay, gravel or ironstone, cobbles and boulders, and does not necessarily indicate rock level.



Vane Shear Test: The vane shear test is used to measure the undrained shear strength (C_u) of typically very soft to firm fine grained cohesive soils. The vane shear is normally performed in the bottom of a borehole, but can be completed from surface level, the bottom and sides of test pits, and on recovered undisturbed tube samples (when using a hand vane).

The vane comprises four rectangular blades arranged in the form of a cross on the end of a thin rod, which is coupled to the bottom of a drill rod string when used in a borehole. The size of the vane is dependent on the strength of the fine grained cohesive soils; that is, larger vanes are normally used for very low strength soils. For borehole testing, the size of the vane can be limited by the size of the casing that is used.

For testing inside a borehole, a device is used at the top of the casing, which suspends the vane and rods so that they do not sink under self-weight into the 'soft' soils beyond the depth at which the test is to be carried out. A calibrated torque head is used to rotate the rods and vane and to measure the resistance of the vane to rotation.

With the vane in position, torque is applied to cause rotation of the vane at a constant rate. A rate of 6° per minute is the common rotation rate. Rotation is continued until the soil is sheared and the maximum torque has been recorded. This value is then used to calculate the undrained shear strength. The vane is then rotated rapidly a number of times and the operation repeated until a constant torque reading is obtained. This torque value is used to calculate the remoulded shear strength. Where appropriate, friction on the vane rods is measured and taken into account in the shear strength calculation.

LOGS

The borehole or test pit logs presented herein are an engineering and/or geological interpretation of the subsurface conditions, and their reliability will depend to some extent on the frequency of sampling and the method of drilling or excavation. Ideally, continuous undisturbed sampling or core drilling will enable the most reliable assessment, but is not always practicable or possible to justify on economic grounds. In any case, the boreholes or test pits represent only a very small sample of the total subsurface conditions.

The terms and symbols used in preparation of the logs are defined in the following pages.

Interpretation of the information shown on the logs, and its application to design and construction, should therefore take into account the spacing of boreholes or test pits, the method of drilling or excavation, the frequency of sampling and testing and the possibility of other than 'straight line' variations between the boreholes or test pits. Subsurface conditions between boreholes or test pits may vary significantly from conditions encountered at the borehole or test pit locations.

GROUNDWATER

Where groundwater levels are measured in boreholes, there are several potential problems:

- Although groundwater may be present, in low permeability soils it may enter the hole slowly or perhaps not at all during the time it is left open.
- A localised perched water table may lead to an erroneous indication of the true water table.
- Water table levels will vary from time to time with seasons or recent weather changes and may not be the same at the time of construction.
- The use of water or mud as a drilling fluid will mask any groundwater inflow. Water has to be blown out of the hole and drilling mud must be washed out of the hole or 'reverted' chemically if reliable water observations are to be made.

More reliable measurements can be made by installing standpipes which are read after the groundwater level has stabilised at intervals ranging from several days to perhaps weeks for low permeability soils. Piezometers, sealed in a particular stratum, may be advisable in low permeability soils or where there may be interference from perched water tables or surface water.

FILL

The presence of fill materials can often be determined only by the inclusion of foreign objects (eg. bricks, steel, etc) or by distinctly unusual colour, texture or fabric. Identification of the extent of fill materials will also depend on investigation methods and frequency. Where natural soils similar to those at the site are used for fill, it may be difficult with limited testing and sampling to reliably assess the extent of the fill.

The presence of fill materials is usually regarded with caution as the possible variation in density, strength and material type is much greater than with natural soil deposits. Consequently, there is an increased risk of adverse engineering characteristics or behaviour. If the volume and quality of fill is of importance to a project, then frequent test pit excavations are preferable to boreholes.

LABORATORY TESTING

Laboratory testing is normally carried out in accordance with Australian Standard 1289 '*Methods of Testing Soils for Engineering Purposes*' or appropriate NSW Government Roads & Maritime Services (RMS) test methods. Details of the test procedure used are given on the individual report forms.

ENGINEERING REPORTS

Engineering reports are prepared by qualified personnel and are based on the information obtained and on current engineering standards of interpretation and analysis. Where the report has been prepared for a specific design proposal (eg. a three storey building) the information and interpretation may not be relevant if the design proposal is changed (eg. to a twenty storey building). If this happens, the Company will be pleased to review the report and the sufficiency of the investigation work.



Reasonable care is taken with the report as it relates to interpretation of subsurface conditions, discussion of geotechnical aspects and recommendations or suggestions for design and construction. However, the Company cannot always anticipate or assume responsibility for:

- Unexpected variations in ground conditions – the potential for this will be partially dependent on borehole spacing and sampling frequency as well as investigation technique.
- Changes in policy or interpretation of policy by statutory authorities.
- The actions of persons or contractors responding to commercial pressures.
- Details of the development that the Company could not reasonably be expected to anticipate.

If these occur, the Company will be pleased to assist with investigation or advice to resolve any problems occurring.

SITE ANOMALIES

In the event that conditions encountered on site during construction appear to vary from those which were expected from the information contained in the report, the Company requests that it immediately be notified. Most problems are much more readily resolved when conditions are exposed rather than at some later stage, well after the event.

REPRODUCTION OF INFORMATION FOR CONTRACTUAL PURPOSES

Where information obtained from this investigation is provided for tendering purposes, it is recommended that all information, including the written report and discussion, be made available. In circumstances where the discussion or comments section is not relevant to the contractual situation, it may be appropriate to prepare a specially edited document. The Company would

be pleased to assist in this regard and/or to make additional report copies available for contract purposes at a nominal charge.

Copyright in all documents (such as drawings, borehole or test pit logs, reports and specifications) provided by the Company shall remain the property of Jeffery and Katauskas Pty Ltd. Subject to the payment of all fees due, the Client alone shall have a licence to use the documents provided for the sole purpose of completing the project to which they relate. Licence to use the documents may be revoked without notice if the Client is in breach of any obligation to make a payment to us.

REVIEW OF DESIGN

Where major civil or structural developments are proposed or where only a limited investigation has been completed or where the geotechnical conditions/constraints are quite complex, it is prudent to have a joint design review which involves an experienced geotechnical engineer/engineering geologist.

SITE INSPECTION

The Company will always be pleased to provide engineering inspection services for geotechnical aspects of work to which this report is related.

Requirements could range from:

- i) a site visit to confirm that conditions exposed are no worse than those interpreted, to
- ii) a visit to assist the contractor or other site personnel in identifying various soil/rock types and appropriate footing or pile founding depths, or
- iii) full time engineering presence on site.

















SYMBOL LEGENDS




SOIL

	FILL
	TOPSOIL
	CLAY (CL, CI, CH)
	SILT (ML, MH)
	SAND (SP, SW)
	GRAVEL (GP, GW)
	SANDY CLAY (CL, CI, CH)
	SILTY CLAY (CL, CI, CH)
	CLAYEY SAND (SC)
	SILTY SAND (SM)
	GRAVELLY CLAY (CL, CI, CH)
	CLAYEY GRAVEL (GC)
	SANDY SILT (ML, MH)
	PEAT AND HIGHLY ORGANIC SOILS (Pt)

ROCK

	CONGLOMERATE
	SANDSTONE
	SHALE/MUDSTONE
	SILTSTONE
	CLAYSTONE
	COAL
	LAMINITE
	LIMESTONE
	PHYLLITE, SCHIST
	TUFF
	GRANITE, GABBRO
	DOLERITE, DIORITE
	BASALT, ANDESITE
	QUARTZITE

OTHER MATERIALS

	BRICKS OR PAVERS
	CONCRETE
	ASPHALTIC CONCRETE

CLASSIFICATION OF COARSE AND FINE GRAINED SOILS

Major Divisions		Group Symbol	Typical Names	Field Classification of Sand and Gravel	Laboratory Classification	
Coarse grained soil (more than 65% of soil excluding oversize fraction is greater than 0.075mm)	GRAVEL (more than half of coarse fraction is larger than 2.36mm)	GW	Gravel and gravel-sand mixtures, little or no fines	Wide range in grain size and substantial amounts of all intermediate sizes, not enough fines to bind coarse grains, no dry strength	≤ 5% fines	$C_u > 4$ $1 < C_c < 3$
		GP	Gravel and gravel-sand mixtures, little or no fines, uniform gravels	Predominantly one size or range of sizes with some intermediate sizes missing, not enough fines to bind coarse grains, no dry strength	≤ 5% fines	Fails to comply with above
		GM	Gravel-silt mixtures and gravel-sand-silt mixtures	'Dirty' materials with excess of non-plastic fines, zero to medium dry strength	≥ 12% fines, fines are silty	Fines behave as silt
		GC	Gravel-clay mixtures and gravel-sand-clay mixtures	'Dirty' materials with excess of plastic fines, medium to high dry strength	≥ 12% fines, fines are clayey	Fines behave as clay
	SAND (more than half of coarse fraction is smaller than 2.36mm)	SW	Sand and gravel-sand mixtures, little or no fines	Wide range in grain size and substantial amounts of all intermediate sizes, not enough fines to bind coarse grains, no dry strength	≤ 5% fines	$C_u > 6$ $1 < C_c < 3$
		SP	Sand and gravel-sand mixtures, little or no fines	Predominantly one size or range of sizes with some intermediate sizes missing, not enough fines to bind coarse grains, no dry strength	≤ 5% fines	Fails to comply with above
		SM	Sand-silt mixtures	'Dirty' materials with excess of non-plastic fines, zero to medium dry strength	≥ 12% fines, fines are silty	N/A
		SC	Sand-clay mixtures	'Dirty' materials with excess of plastic fines, medium to high dry strength	≥ 12% fines, fines are clayey	

Laboratory Classification Criteria

A well graded coarse grained soil is one for which the coefficient of uniformity $C_u > 4$ and the coefficient of curvature $1 < C_c < 3$. Otherwise, the soil is poorly graded. These coefficients are given by:

$$C_u = \frac{D_{60}}{D_{10}} \quad \text{and} \quad C_c = \frac{(D_{30})^2}{D_{10} D_{60}}$$


Where D_{10} , D_{30} and D_{60} are those grain sizes for which 10%, 30% and 60% of the soil grains, respectively, are smaller.

NOTES:

- For a coarse grained soil with a fines content between 5% and 12%, the soil is given a dual classification comprising the two group symbols separated by a dash; for example, for a poorly graded gravel with between 5% and 12% silt fines, the classification is GP-GM.
- Where the grading is determined from laboratory tests, it is defined by coefficients of curvature (C_c) and uniformity (C_u) derived from the particle size distribution curve.
- Clay soils with liquid limits $> 35\%$ and $\leq 50\%$ may be classified as being of medium plasticity.
- The U line on the Modified Casagrande Chart is an approximate upper bound for most natural soils.

Major Divisions		Group Symbol	Typical Names	Field Classification of Silt and Clay			Laboratory Classification
				Dry Strength	Dilatancy	Toughness	
Fine grained soils (more than 35% of soil excluding oversize fraction is less than 0.075mm)	SILT and CLAY (low to medium plasticity)	ML	Inorganic silt and very fine sand, rock flour, silty or clayey fine sand or silt with low plasticity	None to low	Slow to rapid	Low	Below A line
		CL, CI	Inorganic clay of low to medium plasticity, gravelly clay, sandy clay	Medium to high	None to slow	Medium	Above A line
		OL	Organic silt	Low to medium	Slow	Low	Below A line
	SILT and CLAY (high plasticity)	MH	Inorganic silt	Low to medium	None to slow	Low to medium	Below A line
		CH	Inorganic clay of high plasticity	High to very high	None	High	Above A line
		OH	Organic clay of medium to high plasticity, organic silt	Medium to high	None to very slow	Low to medium	Below A line
	Highly organic soil	Pt	Peat, highly organic soil	—	—	—	—

Modified Casagrande Chart for Classifying Silts and Clays according to their Behaviour

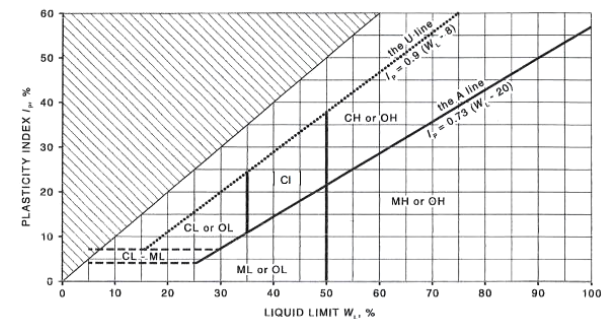



LOG SYMBOLS

Log Column	Symbol	Definition
Groundwater Record		Standing water level. Time delay following completion of drilling/excavation may be shown.
		Extent of borehole/test pit collapse shortly after drilling/excavation.
		Groundwater seepage into borehole or test pit noted during drilling or excavation.
Samples	ES	Sample taken over depth indicated, for environmental analysis.
	U50	Undisturbed 50mm diameter tube sample taken over depth indicated.
	DB	Bulk disturbed sample taken over depth indicated.
	DS	Small disturbed bag sample taken over depth indicated.
	ASB	Soil sample taken over depth indicated, for asbestos analysis.
	ASS	Soil sample taken over depth indicated, for acid sulfate soil analysis.
	SAL	Soil sample taken over depth indicated, for salinity analysis.
Field Tests	N = 17 4, 7, 10	Standard Penetration Test (SPT) performed between depths indicated by lines. Individual figures show blows per 150mm penetration. 'Refusal' refers to apparent hammer refusal within the corresponding 150mm depth increment.
	N _c =	5 7 3R
	VNS = 25 PID = 100	Vane shear reading in kPa of undrained shear strength. Photoionisation detector reading in ppm (soil sample headspace test).
Moisture Condition (Fine Grained Soils)	w > PL	Moisture content estimated to be greater than plastic limit.
	w ≈ PL	Moisture content estimated to be approximately equal to plastic limit.
	w < PL	Moisture content estimated to be less than plastic limit.
	w ≈ LL	Moisture content estimated to be near liquid limit.
	w > LL	Moisture content estimated to be wet of liquid limit.
(Coarse Grained Soils)	D	DRY – runs freely through fingers.
	M	MOIST – does not run freely but no free water visible on soil surface.
	W	WET – free water visible on soil surface.
Strength (Consistency) Cohesive Soils	VS	VERY SOFT – unconfined compressive strength ≤ 25kPa.
	S	SOFT – unconfined compressive strength > 25kPa and ≤ 50kPa.
	F	FIRM – unconfined compressive strength > 50kPa and ≤ 100kPa.
	St	STIFF – unconfined compressive strength > 100kPa and ≤ 200kPa.
	VSt	VERY STIFF – unconfined compressive strength > 200kPa and ≤ 400kPa.
	Hd	HARD – unconfined compressive strength > 400kPa.
	Fr	FRIABLE – strength not attainable, soil crumbles.
	()	Bracketed symbol indicates estimated consistency based on tactile examination or other assessment.
Density Index/ Relative Density (Cohesionless Soils)		Density Index (I_D) Range (%)
	VL	VERY LOOSE ≤ 15
	L	LOOSE > 15 and ≤ 35
	MD	MEDIUM DENSE > 35 and ≤ 65
	D	DENSE > 65 and ≤ 85
	VD	VERY DENSE > 85
	()	Bracketed symbol indicates estimated density based on ease of drilling or other assessment.
Hand Penetrometer Readings		SPT 'N' Value Range (Blows/300mm)
	300 250	0 – 4 4 – 10 10 – 30 30 – 50 > 50



Log Symbols continued

Log Column	Symbol	Definition
Remarks	'V' bit 'TC' bit T ₆₀ Soil Origin	Hardened steel 'V' shaped bit. Twin pronged tungsten carbide bit. Penetration of auger string in mm under static load of rig applied by drill head hydraulics without rotation of augers. The geological origin of the soil can generally be described as: RESIDUAL – soil formed directly from insitu weathering of the underlying rock. No visible structure or fabric of the parent rock. EXTREMELY WEATHERED – soil formed directly from insitu weathering of the underlying rock. Material is of soil strength but retains the structure and/or fabric of the parent rock. ALLUVIAL – soil deposited by creeks and rivers. ESTUARINE – soil deposited in coastal estuaries, including sediments caused by inflowing creeks and rivers, and tidal currents. MARINE – soil deposited in a marine environment. AEOLIAN – soil carried and deposited by wind. COLLUVIAL – soil and rock debris transported downslope by gravity, with or without the assistance of flowing water. Colluvium is usually a thick deposit formed from a landslide. The description 'slopewash' is used for thinner surficial deposits. LITTORAL – beach deposited soil.



Classification of Material Weathering

Term		Abbreviation		Definition
Residual Soil		RS		Material is weathered to such an extent that it has soil properties. Mass structure and material texture and fabric of original rock are no longer visible, but the soil has not been significantly transported.
Extremely Weathered		XW		Material is weathered to such an extent that it has soil properties. Mass structure and material texture and fabric of original rock are still visible.
Highly Weathered	Distinctly Weathered (Note 1)	HW	DW	The whole of the rock material is discoloured, usually by iron staining or bleaching to the extent that the colour of the original rock is not recognisable. Rock strength is significantly changed by weathering. Some primary minerals have weathered to clay minerals. Porosity may be increased by leaching, or may be decreased due to deposition of weathering products in pores.
Moderately Weathered		MW		The whole of the rock material is discoloured, usually by iron staining or bleaching to the extent that the colour of the original rock is not recognisable, but shows little or no change of strength from fresh rock.
Slightly Weathered		SW		Rock is partially discoloured with staining or bleaching along joints but shows little or no change of strength from fresh rock.
Fresh		FR		Rock shows no sign of decomposition of individual minerals or colour changes.

NOTE 1: The term 'Distinctly Weathered' is used where it is not practicable to distinguish between 'Highly Weathered' and 'Moderately Weathered' rock. 'Distinctly Weathered' is defined as follows: *'Rock strength usually changed by weathering. The rock may be highly discoloured, usually by iron staining. Porosity may be increased by leaching, or may be decreased due to deposition of weathering products in pores'*. There is some change in rock strength.

Rock Material Strength Classification

Term	Abbreviation	Uniaxial Compressive Strength (MPa)	Guide to Strength	
			Point Load Strength Index $IS_{(50)}$ (MPa)	Field Assessment
Very Low Strength	VL	0.6 to 2	0.03 to 0.1	Material crumbles under firm blows with sharp end of pick; can be peeled with knife; too hard to cut a triaxial sample by hand. Pieces up to 30mm thick can be broken by finger pressure.
Low Strength	L	2 to 6	0.1 to 0.3	Easily scored with a knife; indentations 1mm to 3mm show in the specimen with firm blows of the pick point; has dull sound under hammer. A piece of core 150mm long by 50mm diameter may be broken by hand. Sharp edges of core may be friable and break during handling.
Medium Strength	M	6 to 20	0.3 to 1	Scored with a knife; a piece of core 150mm long by 50mm diameter can be broken by hand with difficulty.
High Strength	H	20 to 60	1 to 3	A piece of core 150mm long by 50mm diameter cannot be broken by hand but can be broken by a pick with a single firm blow; rock rings under hammer.
Very High Strength	VH	60 to 200	3 to 10	Hand specimen breaks with pick after more than one blow; rock rings under hammer.
Extremely High Strength	EH	> 200	> 10	Specimen requires many blows with geological pick to break through intact material; rock rings under hammer.



Abbreviations Used in Defect Description

Cored Borehole Log Column	Symbol Abbreviation	Description
Point Load Strength Index	• 0.6	Axial point load strength index test result (MPa)
	x 0.6	Diametral point load strength index test result (MPa)
Defect Details – Type	Be	Parting – bedding or cleavage
	CS	Clay seam
	Cr	Crushed/sheared seam or zone
	J	Joint
	Jh	Healed joint
	Ji	Incipient joint
	XWS	Extremely weathered seam
	Degrees	Defect orientation is measured relative to normal to the core axis (ie. relative to the horizontal for a vertical borehole)
	P	Planar
	C	Curved
	Un	Undulating
	St	Stepped
	Ir	Irregular
	Vr	Very rough
	R	Rough
	S	Smooth
	Po	Polished
	Sl	Slickensided
	Ca	Calcite
	Cb	Carbonaceous
	Clay	Clay
	Fe	Iron
	Qz	Quartz
	Py	Pyrite
	Cn	Clean
	Sn	Stained – no visible coating, surface is discoloured
	Vn	Veneer – visible, too thin to measure, may be patchy
	Ct	Coating ≤ 1mm thick
	Filled	Coating > 1mm thick
	mm.t	Defect thickness measured in millimetres