



4 March 2013

FUJIFILM Australia Pty Ltd
PO Box 57
Brookvale NSW 2100

Attention: Mr R Blake

Dear Sir,

Re: Flammable Liquid Stores at 114 Old Pittwater Rd, Brookvale

Fujifilm Australia plan to install 2 off PR16D Storemasta Portable Flammable Liquid Stores at their premises at 114 Old Pittwater Rd, Brookvale. These stores are to be used for the storage of inks which are classified as Class 3 flammable liquids under the Australian Dangerous Goods Code. The stores are to be located and installed in accordance with the requirements of AS1940-2004 *The storage and handling of flammable of flammable and combustible liquids* as generally indicated in the attached sketch.

The purpose of this review is to consider the proposal against the document *Applying SEPP 33* published by the NSW Department of Planning in January 2011, to determine if the proposed facility is potentially hazardous.

Details of the stored products are summarised in the following table.

Class	Product	UN	PG	Max Qty
3	Ink	1210	II/III	4 t
3	Solvents, Thinners, Cleaners	1993	II/III	4 t
Total Class 3 Product		-	II/III	8 t

A site inspection has identified that the two site boundaries adjacent to the proposed store location are cliff faces rising vertically above the level of the installation with natural bushland at their brows. This is not considered a "sensitive" land use.

From Figure 9 of *Applying SEPP 33* (see attached), it can be seen that for 8 t of Class 3 PGII/III flammable liquid, the boundary distance threshold for the potentially hazardous region is 4 m.

As this installation is further than 4 m from its nearest boundaries, the proposal is not potentially hazardous.

Yours sincerely,

Richard Hall
Member – Australasian Institute of Dangerous Goods Consultants

RICHARD HALL & ASSOCIATES PTY LTD
CONSULTING ENGINEERS

ACN 003 998 909 ABN 91 145 055 930

Office 2 Level 1, 157A Victoria Road P.O. Box 186 Drummoyne NSW 1470

Phone: (02) 9719 1355 Fax: (02) 9719 8360 Mobile 0412 406 500 E-mail: rhall@richardhall.com.au

164.7

127.9

Inform
Title Det
Land Arc

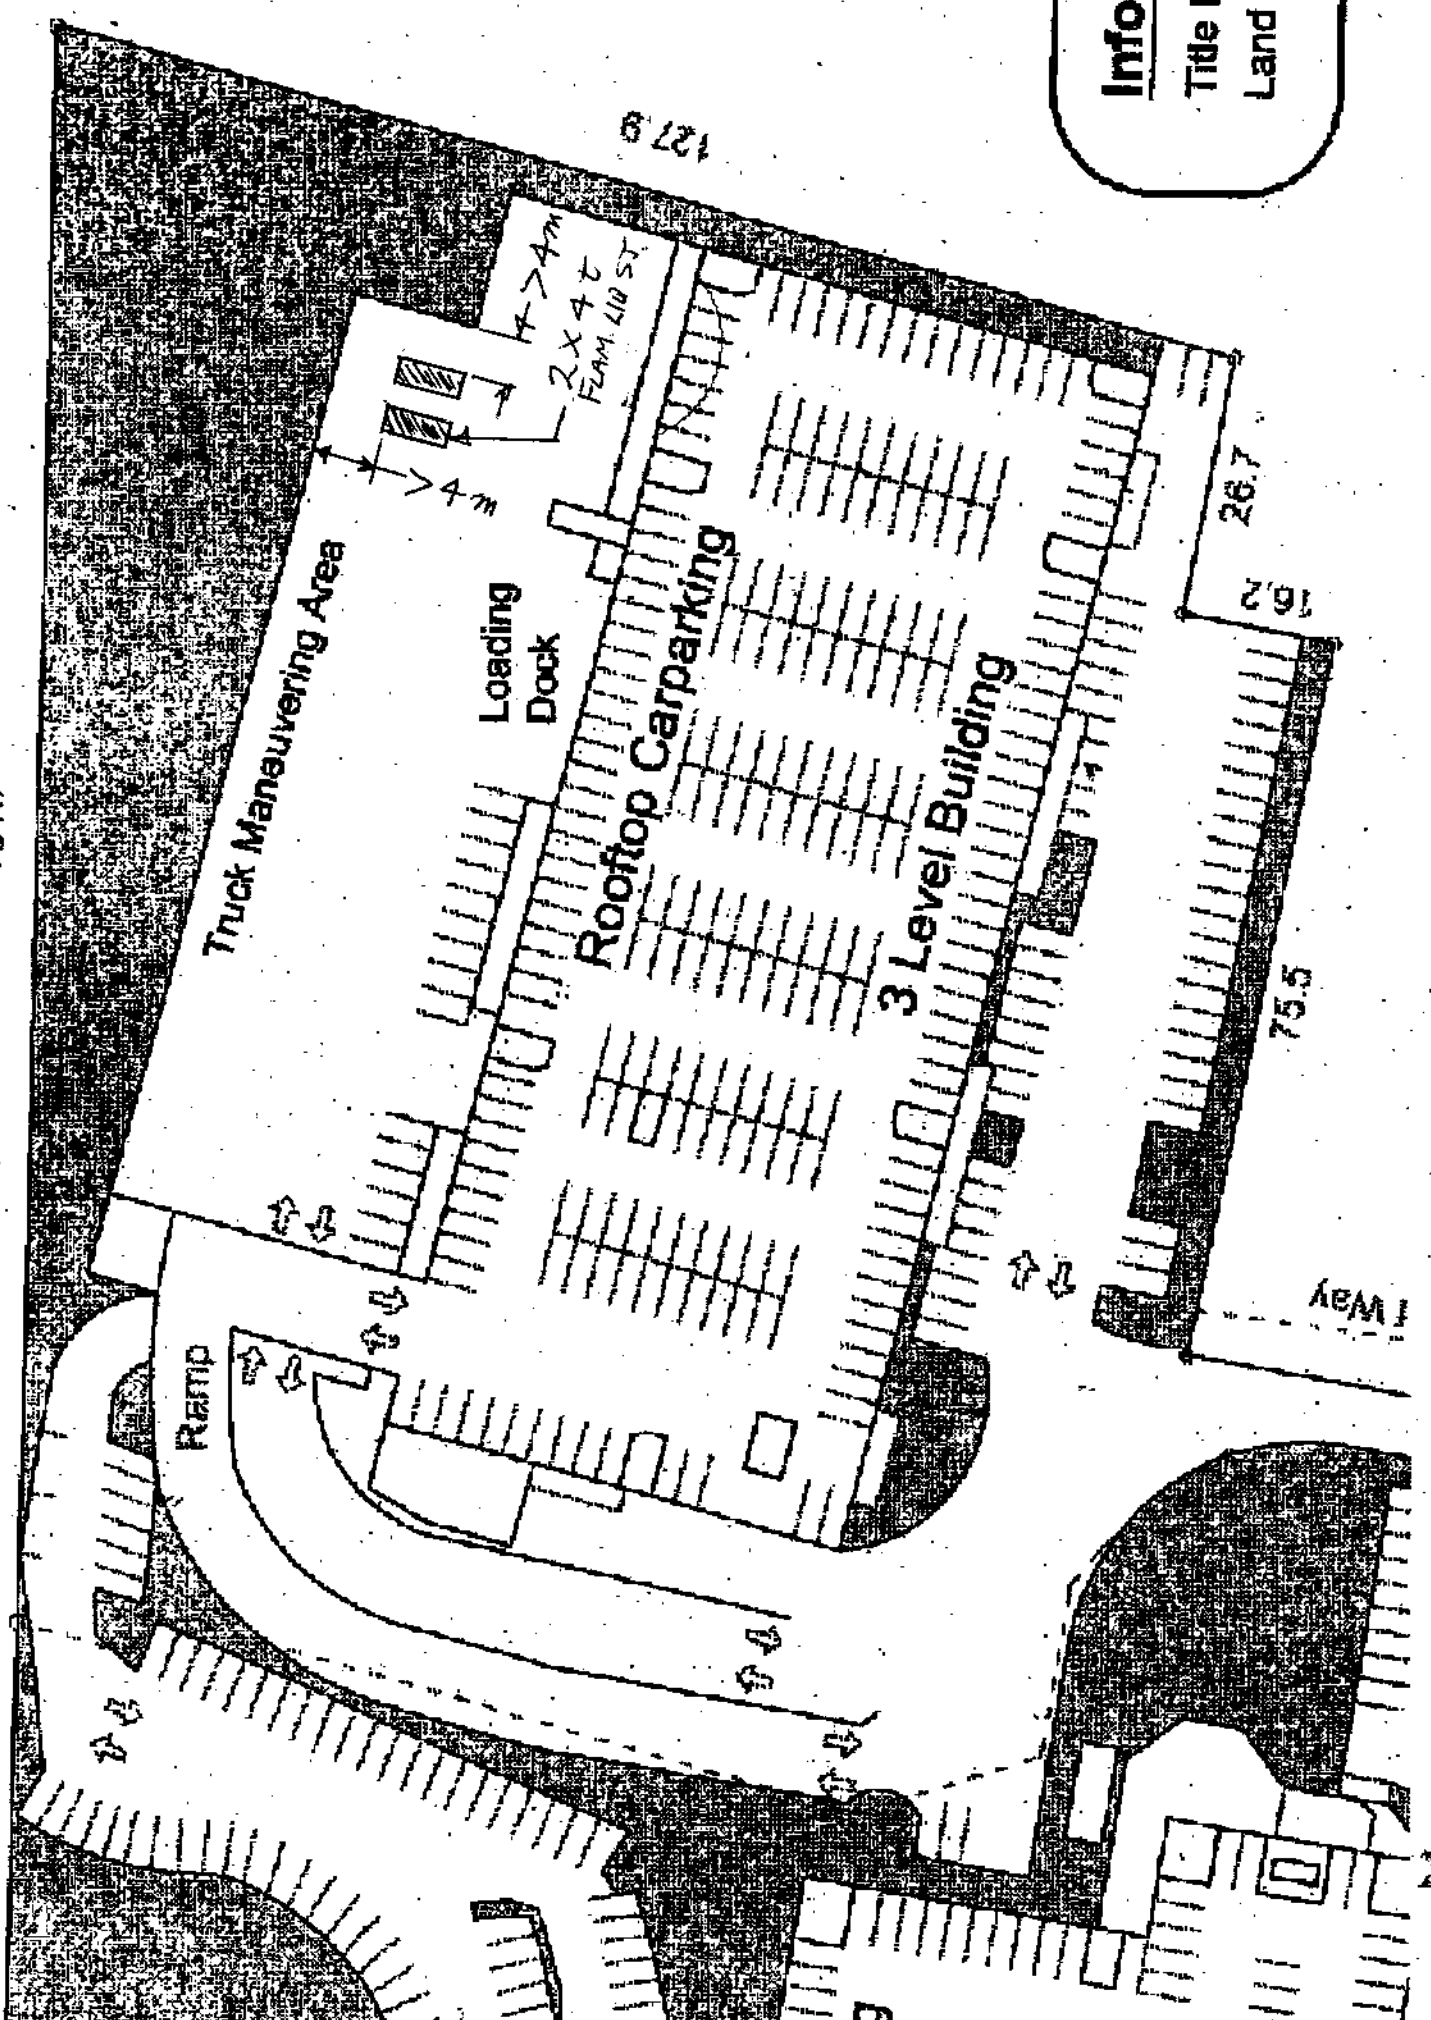


Figure 9: Class 3PGII and 3PGIII Flammable Liquids

