



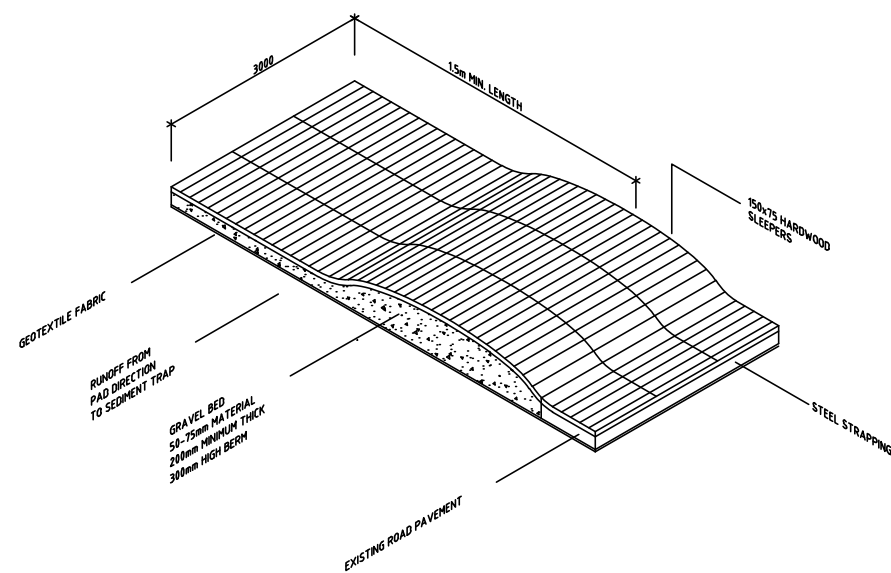

TEMPORARY CONSTRUCTION EXIT
N.T.S.

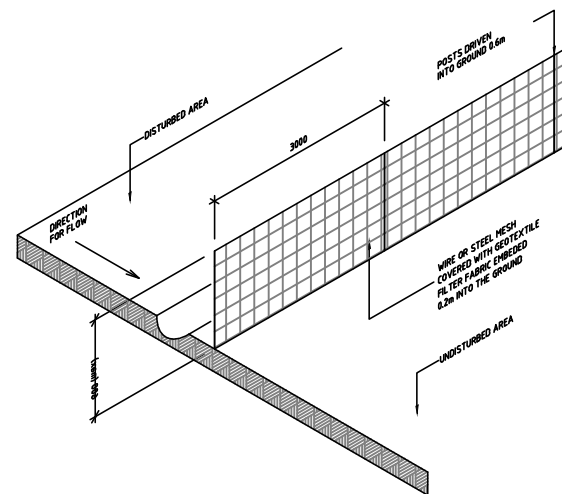

SEDIMENT FENCE DETAIL
N.T.S.

HYDRAULIC NOTES

- H.1 ALL SERVICES ARE TO BE LOCATED IN THE FIELD IN CONJUNCTION WITH A RESPONSIBLE OFFICER OF EACH RELEVANT AUTHORITY PRIOR TO COMMENCEMENT OF CONSTRUCTION.
- H.2 DRAINAGE PITS ARE TO BE 450 mm SQUARE OR LARGER AND FITTED WITH A GALVANISED GRATE.
- H.3 DRAINAGE PIPE SIZES ARE Ø100 mm UNLESS NOTED.
- H.4 DRAINAGE PIPES SHALL BE SEWER GRADE PVC UNLESS NOTED.
- H.5 ALL BARE SOIL AREAS ARE TO BE PROTECTED FROM EROSION BY TEMPORARY MEASURES AND RE-VEGETATED AT CESSATION OF CONSTRUCTION.
- H.6 A SEDIMENT CATCHMENT POND IS TO BE PROVIDED AT THE RATE OF 120 m³ CAPACITY PER HECTARE DRAINED. THE DETENTION TANKS MAY BE USED FOR THIS PURPOSE, PROVIDED SUFFICIENT WATER IS RETAINED AS A POOL DURING CONSTRUCTION & ADEQUATE SAFETY FENCING IS PROVIDED.
- H.7 THE DOWNHILL BOUNDARY OF THE SITE IS TO BE PROTECTED BY HAY BALE OR FILTER FABRIC FENCE DURING CONSTRUCTION AS SHOWN IN ATTACHED DETAIL.
- H.8 THE STREET DRAINAGE PIT LOCATED DOWNHILL OF THE SITE SHALL BE PROTECTED FROM SEDIMENT WITH HAY BALES.
- H.9 A SINGLE CONSTRUCTION ENTRANCE SHALL BE ESTABLISHED IN THE MANNER SHOWN IN ATTACHED DETAIL.
- H.10 ALL EROSION PROTECTION MEASURES TO MEET THE REQUIREMENTS OF THE DEPT. OF CONSERVATION AND LAND MANAGEMENT AS OUTLINED IN 'URBAN EROSION & SEDIMENT CONTROL', SCS TECH. HANDBOOK NO.2 1978 UNLESS SPECIFIED BY COUNCIL.

PIPE MAXIMUM FLOW TABLE (BASED ON Q = 0.065ETA & MANNINGS n = 0.012)

FRACTION SLOPE [%]	100 mm PVC		150 mm PVC		225 mm PVC	
	Q (l/s)	EIA (m2)	Q (l/s)	EIA (m2)	Q (l/s)	EIA (m2)
1.	5.6	85	16.5	260	48.6	750
2.	7.9	120	23.3	360	68.7	1060
3.	9.7	150	28.6	440	84.2	1300
4.	11.2	175	33.8	510	97.2	1500
5.	12.5	190	36.9	570	109	1680
10.	17.7	240	52.2	810	154	2380

EIA = EQUIVALENT IMPERVIOUS AREA

SPECIAL NOTES

1. ALL PIPES TO BE LAID ON 75mm SAND BEDDING WITH THE BARRELS FULLY SUPPORTED "BT" (CLASS BEDDING) PROVIDED "CLEANING ENDS" AT BOTH ENDS PIPES NOT DIRECTLY CONNECTED TO PITS.
2. "HEAVY DUTY" GRATES AND COVERS ARE TO BE PROVIDED IN TRAFFICABLE AREAS.
3. THE SUMP IN THE DETENTION TANK SHALL BE DELETED.
4. ORIGINAL PLATES USED TO REINFORCE THE DETENTION TANKS TO BE MACHINED TO THE EXACT DIMENSION AS CALCULATED, FROM MINIMUM 3 mm THICK STAINLESS STEEL OR 3 mm THICK GALVANIZED STEEL AFTER MACHINING. THEY MUST BE CAST IN THE PIT WALLS OR PERMANENTLY FIXED IN THE PIT BY SOME APPROVED METHOD SO THEY CANNOT BE EASILY REMOVED.
5. A PLATE MEASURING NO LESS THAN 400 mm x 200 mm SHALL BE IN SOME WAY PERMANENTLY ATTACHED AND PROMINENTLY DISPLAYED WITHIN THE IMMEDIATE VICINITY OF THE OSD DEVICE.
6. THE CONTRACTOR SHALL ADVISE THE AUTHORITY OF THE PROPERTY OF THE OSD DEVICE, AND ALSO THAT THE DEVICE IS NOT IN ANY WAY TO BE TEMPERED WITH OR CHANGED WITHOUT PRIOR WRITTEN CONSENT OF COUNCIL.
7. THE CONSTRUCTED OSD INSTALLATION MUST BE APPROPRIATELY CERTIFIED BY A SUITABLY QUALIFIED AND EXPERIENCED CONSULTING ENGINEER (GENERALLY OF CPE QUALIFICATION) WHO MUST STATE THAT IT COMES WITHIN CODE OF PRACTICE, STANDARDS AND SPECIFICATIONS, RULES AND REGULATIONS AND IS GENERALLY IN ACCORDANCE WITH APPROVED PLANS.
8. UPON COMPLETION OF THE OSD WORKS, WORK-AS-EXECUTED (WAE) PLANS SHALL BE SUBMITTED TO THE COUNCIL BY THE CONSULTING ENGINEER/REGISTERED SURVEYOR TO VERIFY THAT THE VOLUME OF STORAGE HAS BEEN ATTAINED AND THAT CRITICAL WATER AND FLOOR LEVELS ARE IN ACCORDANCE WITH DESIGN REQUIREMENTS. ANY CHANGES OR VARIATIONS TO THE APPROVED PLANS SHALL BE HIGHLIGHTED IN RED.
9. CERTIFICATION ON THE STANDARD FORM FOR ON-SITE DETENTION RECORD OF INSTALLATION ISSUED BY COUNCIL AND WAE PLANS SHALL BE SUBMITTED TOGETHER WITH THE COMPLIANCE CERTIFICATE.

GENERAL NOTES

- G.1 THESE NOTES SHALL BE READ IN CONJUNCTION WITH ALL ARCHITECTURAL AND OTHER CONSULTANTS DRAWINGS AND SPECIFICATIONS AND WITH SUCH OTHER WRITTEN INSTRUCTION AS ISSUED DURING THE COURSE OF THE CONTRACT. ALL DISCREPANCIES SHALL BE REFERRED TO THE ARCHITECT OR ENGINEER BEFORE PROCEEDING WITH THE WORK.
- G.2 DIMENSIONS SHALL NOT BE OBTAINED BY SCALING THE STRUCTURAL DRAWINGS.
- G.3 SETTING OUT DIMENSIONS SHOWN ON THE DRAWINGS SHALL BE VERIFIED BY ON-SITE MEASUREMENT.
- G.4 DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED.
- G.5 ALL WORKMANSHIP AND MATERIALS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CURRENT EDITIONS OF THE SAA CODE AND THE BY-LAWS AND ORDINANCES OF THE RELATIVE BUILDING AUTHORITY.
- G.6 EXCAVATIONS SHALL NOT BE PERMITTED WITHIN 2 METRES OF AN EXISTING STRUCTURE WITHOUT PRIOR APPROVAL OR RECOMMENDATIONS FOR SHORING OR UNDERPINNING PROVIDED BY ENGINEER.

FOUNDATIONS AND FOOTINGS

- F.1 FOOTINGS HAVE BEEN DESIGNED FOR AN ALLOWABLE INTENSITY OF BEARING PRESSURE OF kPa.
THE BUILDER SHALL OBTAIN APPROVAL OF THE FOUNDATION MATERIAL BEFORE PLACING CONCRETE.

F.2 FOOTINGS SHALL BE

SUB-GRADE

- SG.1 UNDER ALL SLABS ON GRADE, WHETHER ON CUT OR FILL, REMOVE SOFT SPOTS AND REFILL BY COMPACTING CUT SURFACES OR FILL SURFACES IN LAYERS NOT EXCEEDING 200 mm TO 95% DRY DENSITY, ENSURING MINIMUM SETTLEMENT TO SLABS.

CONCRETE WORK

- C.1 ALL WORKMANSHIP AND MATERIALS SHALL BE IN ACCORDANCE WITH AS 3600.

- C.2 CONCRETE QUALITY SHALL BE AS TABULATED AND SHALL BE VERIFIED BY TESTS.


ELEMENT	SLUMP	MAX. SIZE AGG.	CEMENT TYPE	ADMIXTURE	mPa CONCRETE GRADE
ALL	80	20	A	NIL	32

- C.3 CLEAR CONCRETE COVERS TO REINFORCEMENT SHALL BE AS FOLLOWS UNLESS OTHERWISE SHOWN.

CAST IN FORMS COMPLYING WITH AS 5699			
ELEMENT	CONDITION 1 NOT TO BE EXPOSED TO WEATHER GROUND WATER OR FRESH WATER	CONDITION 2 TO BE EXPOSED TO WEATHER GROUND WATER OR FRESH WATER	CONDITION 3 CAST AGAINST OTHER FORMWORK OR THE GROUND
PAD FOOTINGS & PILE CAPS	-	65	75
STRIP FOOTINGS	-	50	65
SORE OR CAST PIERS	-	50	75
COLUMNS	40	50	75
WALLS, INCLUDING RETAINING WALLS	20	30	65
BEAMS	25	40	65
SLABS, INCLUDING JOISTS & HOLLOW BLOCK CONSTRUCTION	20	30	65
REINFORCEMENT ADJACENT TO HOLLOW BLOCKS INTEGRAL WITH STRUCTURE	5	-	-

NOTE: 1. SLABS POURED OVER A MEMBRANE ON THE GROUND ARE INCLUDED AS CONDITION 2.
2. SLABS EXPOSED TO CORROSIVE VAPOURS, CORROSIVE GROUND WATER, SEA WATER OR SPRAY ARE TO HAVE REINFORCEMENT COVER AS NOTED OR NOT LESS THAN AS REQUIRED FOR CONDITION 3.

4. SIZES OF ELEMENTS DO NOT INCLUDE THICKNESS OF APPLIED FINISHES.
5. CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE TO THE APPROVAL OF THE ENGINEER.
6. BEAM DEPTHS ARE WRITTEN FIRST AND INCLUDE SLAB THICKNESS, IF ANY, UNO.
7. NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE ELEMENTS WITHOUT PRIOR APPROVAL OF THE ENGINEER.
8. REINFORCEMENT IS REPRESENTED DIAGRAMMATICALLY. IT IS NOT NECESSARILY SHOWN IN TRUE PROJECTION.
9. SPLICES IN REINFORCEMENT MADE IN POSITIONS OTHER THAN SHOWN SHALL BE TO THE APPROVAL OF THE ENGINEER, WHERE THE LAP LENGTH IS NOT SHOWN IT SHALL BE SUFFICIENT TO DEVELOP THE FULL STRENGTH OF THE REINFORCEMENT.
10. WELDING OF REINFORCEMENT SHALL NOT BE PERMITTED UNLESS SHOWN ON THE STRUCTURAL DRAWINGS.
11. PIPES OR CONDUITS SHALL NOT BE PLACED WITHIN THE CONCRETE COVER TO REINFORCEMENT WITHOUT THE APPROVAL OF THE ENGINEER.
12. ALL REINFORCING BARS SHALL COMPLY WITH AS 1302, ALL FABRIC SHALL COMPLY WITH AS 1303 AND AS 1304, AND SHALL BE SUPPLIED IN FLAT SHEETS.
13. REINFORCING SYMBOLS
- | | |
|--------------|--------------------------|
| S GRADE 2305 | DEFORMED BAR |
| C GRADE 410C | COLD WORKED DEFORMED BAR |
| Y GRADE 410R | DEFORMED BAR |
| R GRADE 230R | PLAIN BAR |
| F GRADE 450 | WELDED WIRE FABRIC |
| N GRADE 500 | DEFORMED BAR |
- THE NUMBER IMMEDIATELY FOLLOWING THESE SYMBOLS IS THE BAR DIAMETER IN MILLIMETRES
14. FABRIC REINFORCEMENT TO BE LAPPED 300 MINIMUM AT ENDS AND SIDES UNO. LAPS IN POSITION OF MAXIMUM MOMENT ARE NOT PERMITTED.
15. ALL REINFORCEMENT SHALL BE FULLY SUPPORTED ON INSULATED STEEL, PLASTIC OR CONCRETE CHAIRS SPACED AT 900 AND 750 CENTRES BOTH WAYS UNDER ROD AND FABRIC REINFORCEMENT RESPECTIVELY. RODS SHALL BE TIED AT ALTERNATE INTERSECTIONS.
16. MINIMUM STRIPPING TIMES FOR FORMWORK SHALL BE AS RECOMMENDED IN AS 1509 OR AS DIRECTED BY ENGINEER.

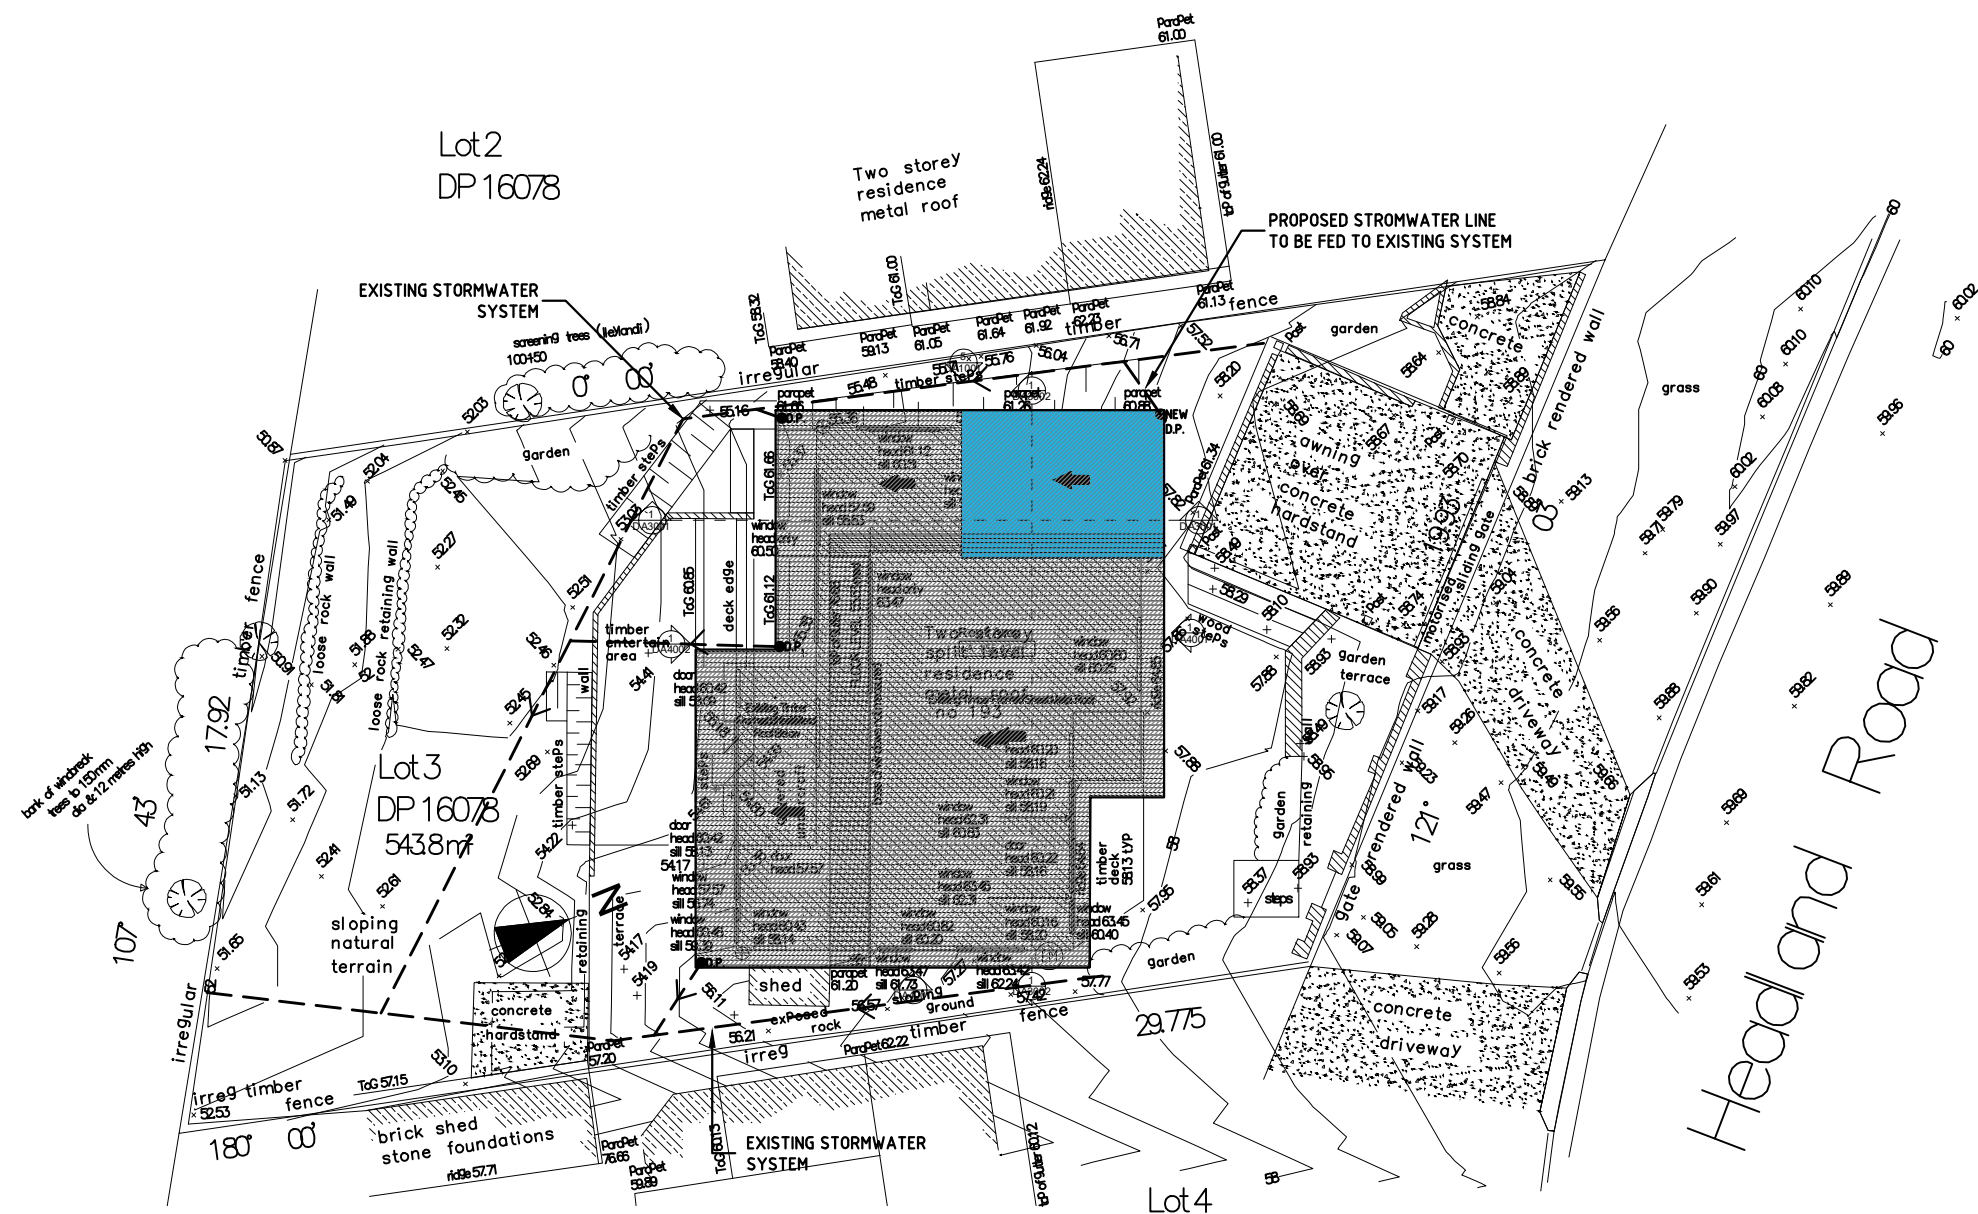

SITE PLAN

1:200

COPYRIGHT

THIS DESIGN AND PRINT IS THE PROPERTY OF TED BENNETT AND MUST NOT BE USED, REPRODUCED OR COPIED WITHOUT WRITTEN PERMISSION FROM TED BENNETT.

Registered Professional Engineer 198230

Mr Edward A. Bennett
MIEAust CPEng

Signature..........Date 10/09/2018

Register on the NPBR in the Category of
Civil/Environmental/Structural/Geotechnical
National Professional Engineers Register

CIVIL & STRUCTURAL ENGINEERING
DESIGN SERVICES PTY. LTD. ACN. 051 307 852

CONSULTING STRUCTURAL, CIVIL, GEOTECHNICAL & ENVIRONMENTAL ENGINEERS

3 Wanniti Road BELROSE 2085 PHONE 61-02 9975 3899

FAX 61-02 9975 1943

MOBILE 0407 753 899
EMAIL hited@bigpond.net.au

CLIENT: ROB WARREN
PROJECT: STORMWATER MANAGEMENT PLAN FOR
ALTERATION & ADDITION
193 HEADLAND ROAD
NORTH CURL CURL, NSW, 2099

Drawn By:	Scale:
BG	AS SHOWN

Checked By:	Drawing No.:
E. A. BENNETT MIE Aug 1	W-11-266518

Date:	10/09/2018	Amendmen
-------	------------	----------
