

## Bushfire Planning & Design

Central Coast, Newcastle, Hunter & Sydney  
0406077222  
E: bpad.matthew.noone@gmail.com



# Bushfire Hazard Assessment

100 Hilltop Road Avalon Beach 2107 (Lot 2/-/DP260241).



Project Details			
Assessed as:	Residential Infill		
Assessed by	Matthew Noone		
Highest BAL on any facade	BAL-FZ		
Planning for Bushfire Protection (2019) Compliance	The development does not conform to the relevant specification and requirements of Planning for Bushfire Protection in accordance with Section 4.14 of the Environmental Planning and Assessment Act 1979.		
Project Description	Sole Occupancy Dwelling.		
Report Number	BR-532222-A		
Date of Issue	19/08/2022	Report Validity:	1 year from date of issue

It is a breach of copyright for this document to be used to support a development application or any other purpose for any persons other than those for whom this document was prepared. Subject to the conditions prescribed under the Copyright Act no part of this document may in any form nor by any means be reproduced or transmitted without the prior written permission of the company Bushfire Planning & Design.

100 Hilltop Road Avalon Beach 2107

19/08/2022



# BUSHFIRE RISK ASSESSMENT CERTIFICATION

Development Address	100 Hilltop Road Avalon Beach 2107.
Parcel number	(Lot 2/-/DP260241).
Development description	Sole Occupancy Dwelling.
Architectural Drawings Reviewed.	Attached to report BR-532222.
Assessed Bushfire Attack Level	BAL-FZ
Does the assessment rely on alternate solutions?	Yes.
Assessed by Matthew Noone BPAD Accreditation Scheme No.	FPAA No. BPAD-PD 25584
Certificate Number:	BR-532222-A

I hereby certify, in accordance with s.4.14 of the Environmental Planning and Assessment Act 1979 that;

1	I am a person recognised by the NSW Rural Fire Service as a qualified consultant in bushfire risk assessment; and
2	Subject to the recommendations contained in the attached Bushfire Risk Assessment Report the proposed development conforms to the relevant specifications and requirements*

\* The relevant specifications and requirements being; specifications and requirements of the document entitled Planning for Bush Fire Protection prepared by the NSW Rural Fire Service in co-operation with the Department of Planning and any other document as prescribed by s.4.14 of the Environmental Planning and Assessment Act 1979.

I am aware that the Bushfire Assessment Report, prepared for the above mentioned site is to be submitted in support of a development application for this site and will be relied upon by Council as the basis for ensuring that the bushfire risk management aspects of the proposed development have been addressed in accordance with Planning for Bushfire Protection (2019).

The following have been provided and or included in our assessment.

- Bushfire Risk Assessment Report.
- Recommendations.
- Statement of vegetation impact in relation to APZ.

DATE	ISSUED TO	REV.	Comments
19/08/2022	Oliver Keaveney	A	Issued to support Development Application

## **DISCLAIMER and TERMS OF USE**

Bushfire Planning & Design cannot be held liable for the loss of life or property caused by a bushfire event. This report has considered the relevant planning instruments, bushfire constructions codes and practices applicable at the time of writing. Should additional information be provided after this report has been issued, we reserve the right to review and if necessary modify our report. Bushfire Planning and Design has no control over workmanship, buildings degrade over time and vegetation if not managed will regrow. In addition legislation and construction standards are subject to change. Due to significant variance of bushfire behaviour, we do not guarantee that the dwelling will withstand the passage of bushfire even if this development is constructed to the prescribed standards.

AS3959 (2018) states *“It should be borne in mind that the measures contained in this Standard cannot guarantee that a building will survive a bushfire event on every occasion. This is substantially due to the degree of vegetation management, the unpredictable nature of behaviour of fire, and extreme weather conditions.”*

The information and material contained herein is general in nature and is intended for your use and information. This report relates only to the specific development described within and cannot be used to support any other future development. Bushfire Planning and Design disclaims, to the extent permitted by law, all warranties, representations or endorsements, express or implied, with regard to the material contained herein. Bushfire Planning and Design does not warrant or represent that the material contained herein is free from errors or omissions, or that it is exhaustive.

Bushfire Planning and Design disclaims any liability (including but not limited to liability by reason of negligence) to the users of the material for any loss, damage, cost or expense whether direct, indirect, consequential or special, incurred by, or arising by reason of, any person using or relying on the material and whether caused by reason of, any error, omission or misrepresentation in the material or otherwise.

This report has been prepared by Matthew Noone trading as Bushfire Planning and Design. Matthew Noone holds a BPAD Level 2 accreditation with the Fire Protection Association of Australia. Under the BPAD accreditation scheme a BPAD Level 2 consultant can provide advice and undertake all types assessments with the exception of alternate solutions. In the event that alternate solution is proposed it will be undertaken outside of our accreditation. Alternate solutions are considered a deviation from the prescribed standards and as per s.4.14 of the Environmental Planning and Assessment Act (1979) are required to be required to be referred to the New South Wales Rural Fire Service (RFS) for review.

This report has been based on our interpretation of Planning for Bushfire Protection (2019), AS3959 (2018) and the methodology for site specific bushfire assessment. As a consultant, our view can be subjective. Our opinions may differ from the opinions provided by you the Client (or Client Representative), the Council, the RFS or another bushfire consultant. The Rural Fire Service (RFS) has a higher authority and can upon their review, increase a nominated BAL-rating or entirely reject a development proposal. Any such recommendations made by the RFS take precedence. Our role is intermediary between our Client (or Client Representative) and the consenting authority. We apply our knowledge of the relevant bushfire protection standards to provide the best possible outcome for our Client (or Client Representative), both from a bushfire safety and financial perspective. Should the RFS modify our recommendations or reject the proposal to which this report relates to we will not be held liable for any financial losses as a result. By using this document, you the Client (or Client Representative) agree to and acknowledge the above statements.

Bushfire Planning and Design accepts no liability or responsibility for any use or reliance upon this report and its supporting material by any unauthorized third party. The validity of this report is nullified if used for any other purpose than for which it was commissioned. Unauthorized use of this report in any form is deemed an infringement of our intellectual property. By using this document to support your development you the Client (or Client representative) agree to these terms.


Page No.

05	<b>SECTION 01 - BACKGROUND AND BRIEFING NOTES</b>
05	1.1 BUSHFIRE PRONE LAND
06	1.2 DEVELOPMENT PROPOSAL
06	1.3 REGULATORY FRAMEWORK
07	1.4 SITE LOCATION AND DESCRIPTION
08	1.5 LAND USE, ZONING AND PERMISSIBILITY
08	1.6 SIGNIFICANT ENVIRONMENTAL FEATURES
08	1.7 DETAILS OF ANY THREATENED SPECIES, POPULATIONS, ECOLOGICAL COMMUNITIES OR CRITICAL HABITATS
08	1.8 DETAILS OF ABORIGINAL HERITAGE
09	<b>SECTION 02 - BUSHFIRE ATTACK LEVEL (BAL) ASSESSMENT</b>
09	2.0 INTRODUCTION
09	2.1 SLOPE DETERMINATION
09	2.2 PREDOMINANT VEGETATION CLASS
10	2.2.1 VEGETATION PHOTOS
11	2.3 BUSHFIRE ATTACK LEVEL (BAL) ASSESSMENT.
11	2.4 RECOMMENDED ASSET PROTECTION ZONES (APZs).
11	2.4 RECOMMENDED ASSET PROTECTION ZONES (APZs).
13	<b>SECTION 03 - ASSET PROTECTION ZONES (APZs)</b>
13	3.0 APZ PERFORMANCE CRITERIA (PBP 2019)
14	3.1 - INNER APZ (IPA) GUIDELINES
14	3.2 - OUTER APZ (OPA) GUIDELINES
15	<b>SECTION 04 - CONSTRUCTION</b>
17	<b>SECTION 05 - ACCESS</b>
18	<b>SECTION 06 - WATER</b>
19	<b>SECTION 07 - ELECTRICITY &amp; GAS</b>
20	<b>SECTION 08 - RECOMMENDATIONS</b>
21	<b>SECTION 09 - SUMMARY</b>
22	<b>SECTION 10 - REFERENCES</b>
22	<b>SECTION 11 - APPENDICES</b>

# SECTION 01 - BACKGROUND AND BRIEFING NOTES

## 1.1 BUSHFIRE PRONE LAND

The subject site whether in whole or part is recorded as bushfire affected on a relevant map certified under Section 10.3 (2) of the Environmental Planning and Assessment Act 1979 (Refer figure 1.1). The development relates to the development of bushfire prone land and therefore must address the legislative requirements stipulated in Section 4.14 of the Environmental Planning and Assessment Act 1979. The development is required to comply with the New South Wales Rural Fire Service document Planning for Bushfire Protection (2019).

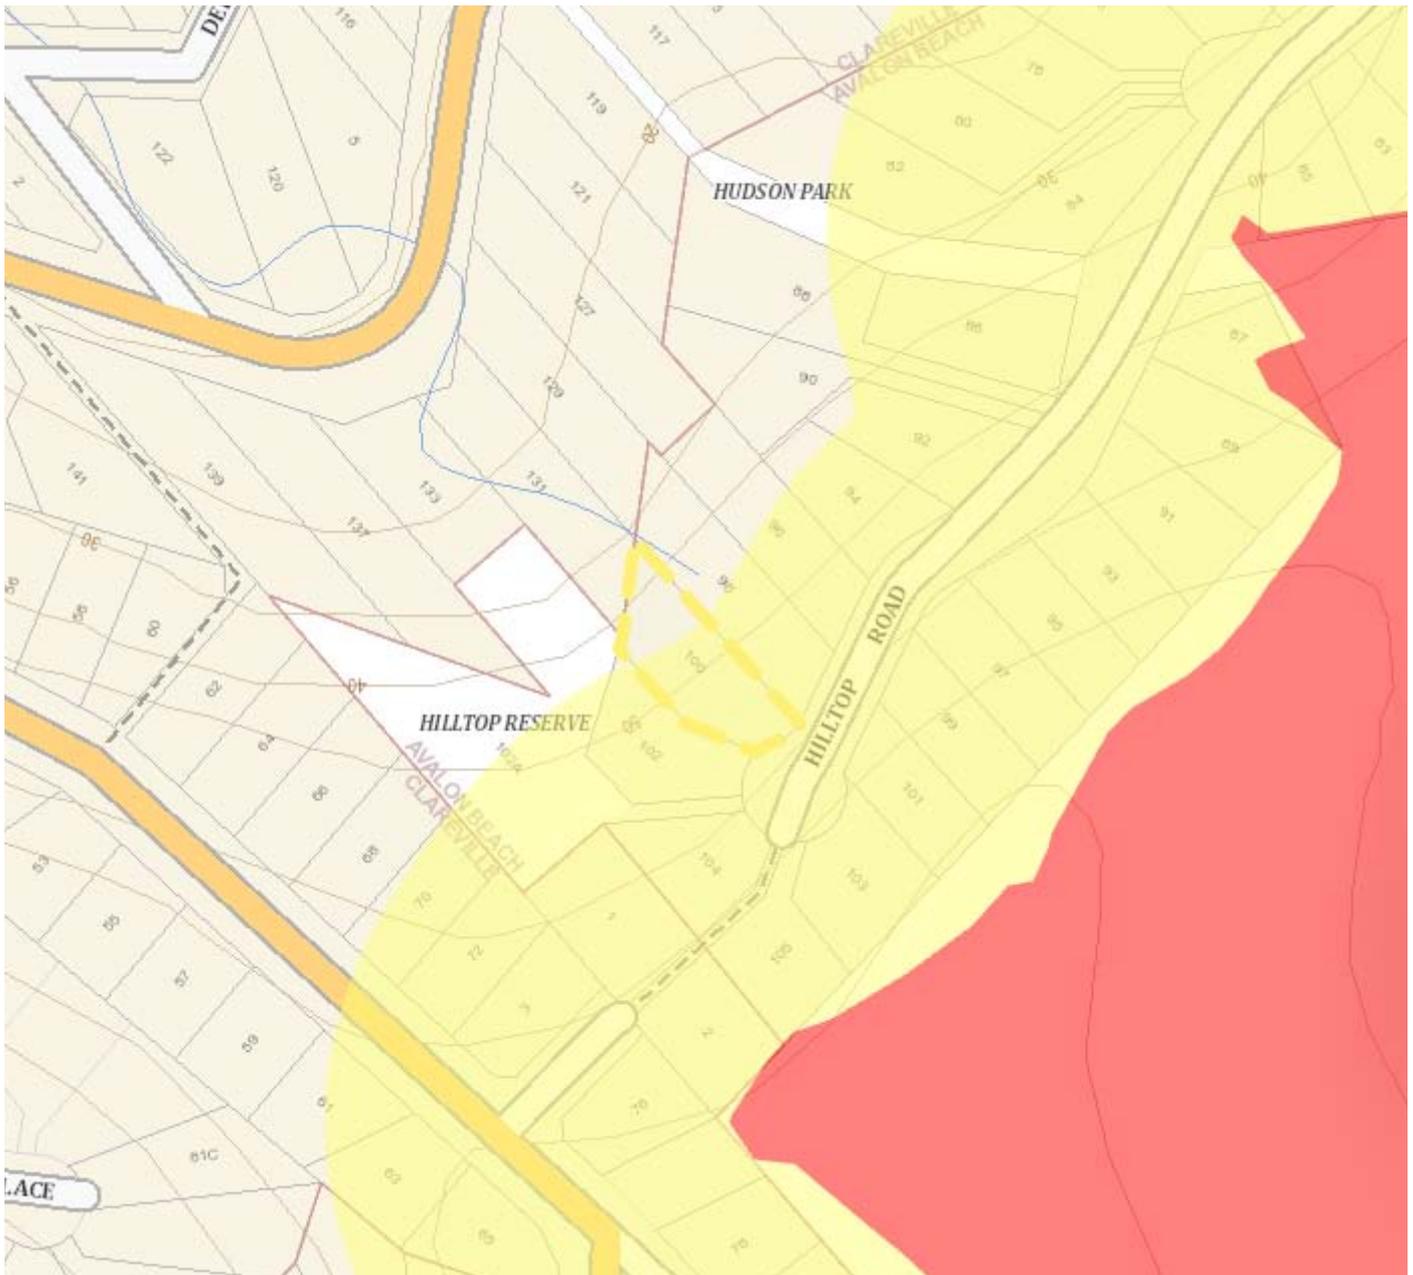

<b>BUSHFIRE PRONE LAND MAP</b>		PLOT DATE: 19/08/2022	PROJECT CRS: 28356	FIGURE
<ul style="list-style-type: none"> <li><span style="border-bottom: 2px dashed yellow; width: 20px; display: inline-block;"></span> Subject Site</li> <li><span style="background-color: yellow; width: 20px; height: 10px; display: inline-block;"></span> Vegetation Buffer</li> <li><span style="background-color: red; width: 20px; height: 10px; display: inline-block;"></span> Category 1</li> <li><span style="background-color: #c8e6c9; width: 20px; height: 10px; display: inline-block;"></span> Category 3</li> </ul>	<p><b>BUSHFIRE PLANNING AND DESIGN</b>                  bpad.matthew.noone@gmail.com / 0406077222</p>		<h1>1</h1>	

## 1.2 DEVELOPMENT PROPOSAL

The development relates to the construction of a sole occupancy dwelling on a vacant allotment.

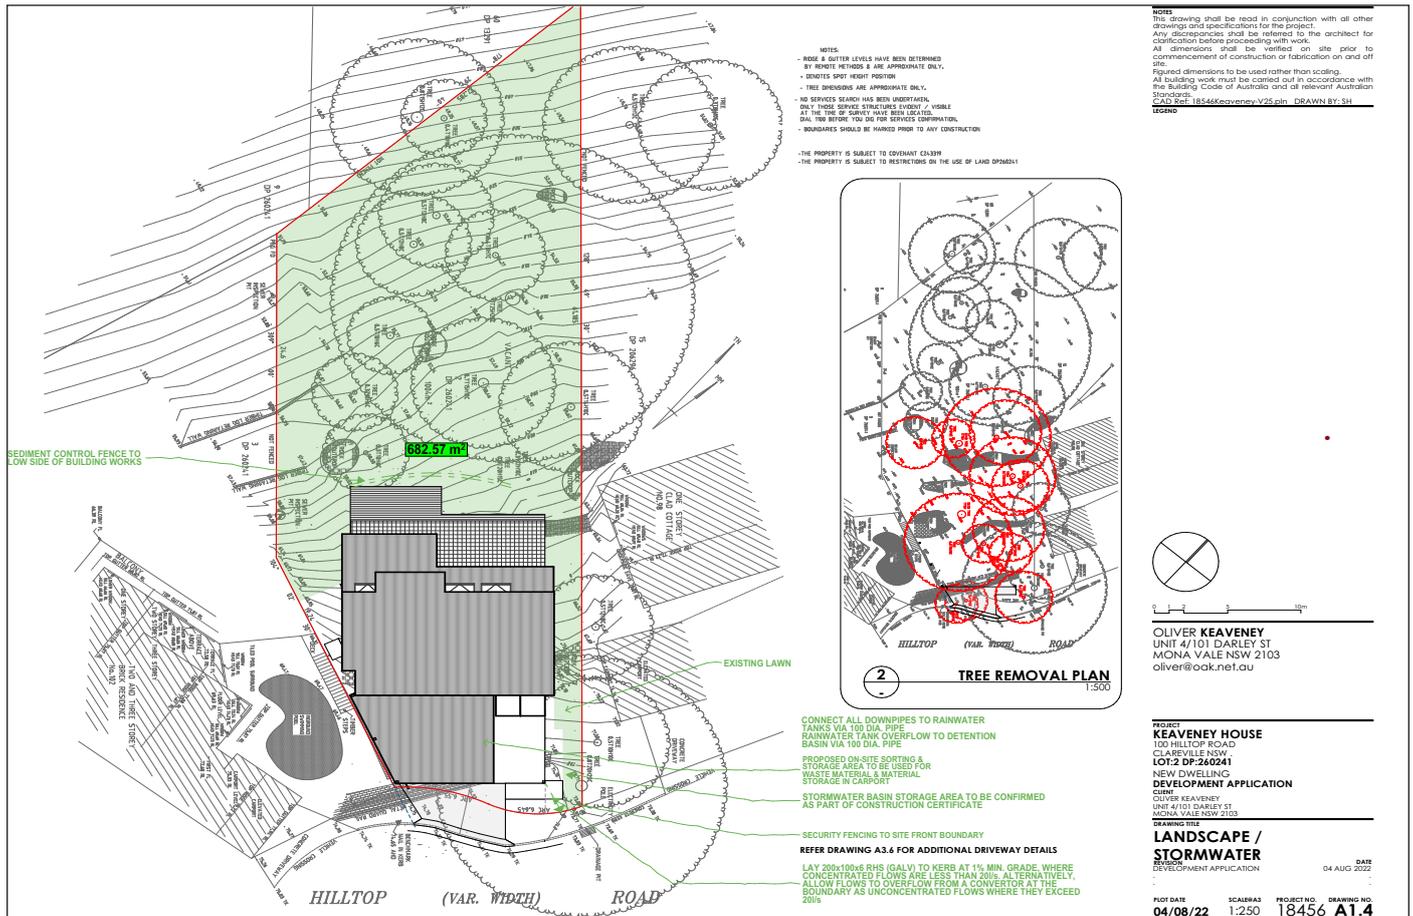


Figure 1.2: Concept Drawing

## 1.3 REGULATORY FRAMEWORK

The main legislation, planning instruments, development controls and guidelines that are related to this project are as follows;

### 4.14 Consultation and development consent— certain bush fire prone land

(1) Development consent cannot be granted for the carrying out of development for any purpose (other than a subdivision of land that could lawfully be used for residential or rural residential purposes or development for a special fire protection purpose) on bush fire prone land unless the consent authority:

(a) is satisfied that the development conforms to the specifications and requirements of the document entitled *Planning for Bush Fire Protection*, prepared by the NSW Rural Fire Service in co-operation with the Department of Planning (or, if another document is prescribed by the regulations for the purposes of this paragraph, that document) that are relevant to the development (“the relevant specifications and requirements”), or

(b) has been provided with a certificate by a person who is recognised by the NSW Rural Fire Service as a qualified consultant in bush fire risk assessment stating that the development conforms to the relevant specifications and requirements. (EPA & A, 1979).

## 1.4 SITE LOCATION AND DESCRIPTION

The subject site is located in Avalon Beach which is within the Northern Beaches Local Government Area (LGA). The site is currently vacant. The allotment is surrounded by managed residential curtilage to the south and east. Remnant vegetation is located to the north, north west and north east of the subject site. Forest vegetation is located to the south east of the subject site.



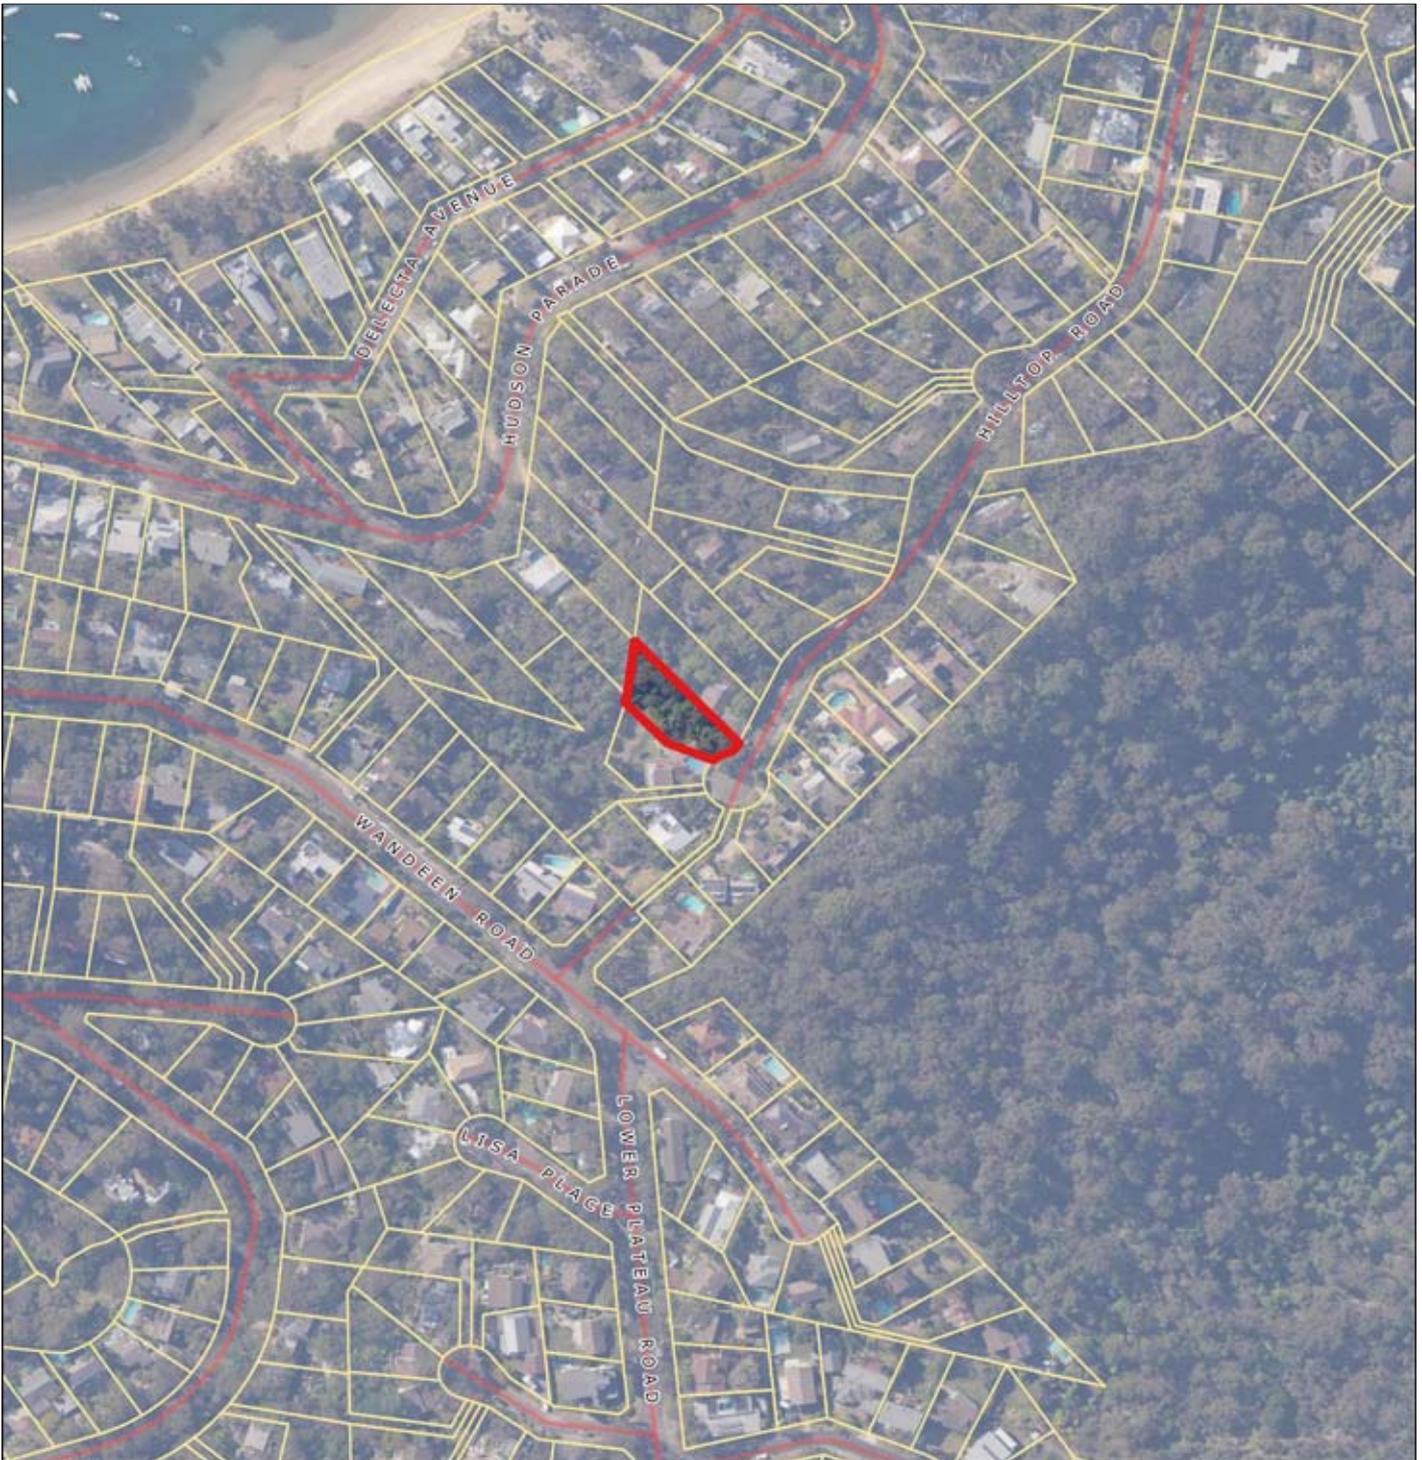


FIGURE 1.4 LOCATION DRAWING

 Subject Site	Plot date: 19/08/2022	Project CRS: EPSG:28356	
	 <p>Meters</p>		
BUSHFIRE PLANNING & DESIGN bpad.matthew.noone@gmail.com			V:1.1

## 1.5 LAND USE, ZONING AND PERMISSIBILITY

The subject site is zoned C4 Environmental Living.

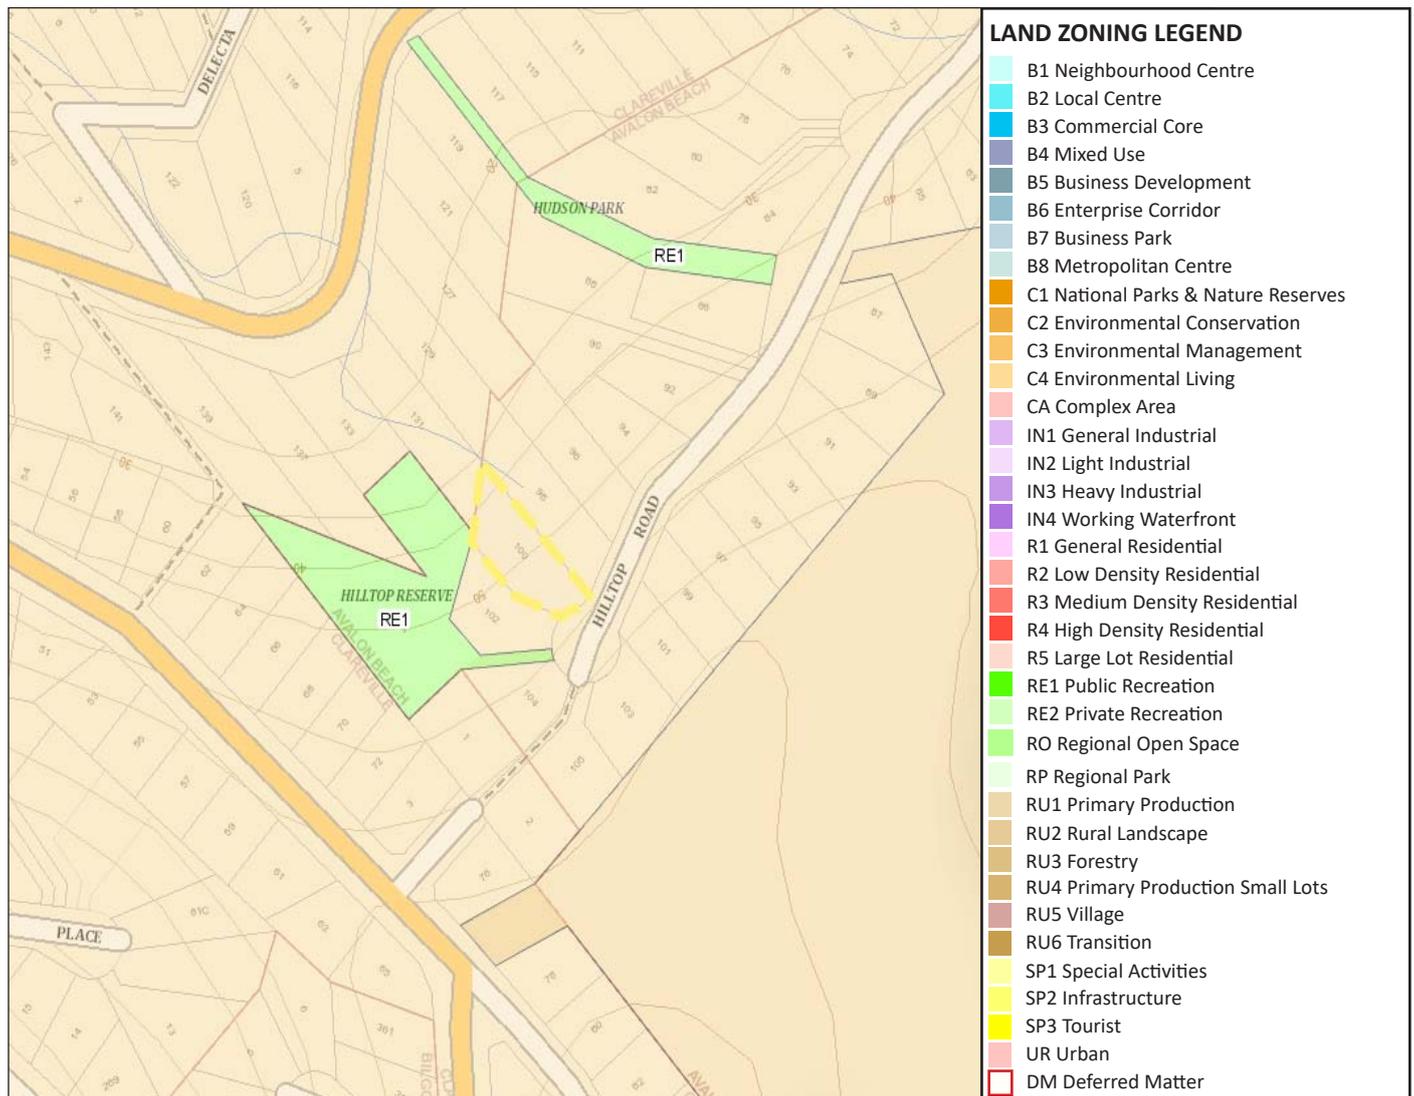

## 1.6 SIGNIFICANT ENVIRONMENTAL FEATURES

There are no significant environmental features within the subject site.

## 1.7 DETAILS OF ANY THREATENED SPECIES, POPULATIONS, ECOLOGICAL COMMUNITIES OR CRITICAL HABITATS

To our knowledge there are no threatened species, populations, ecological communities or critical habitat within the subject site.

## 1.8 DETAILS OF ABORIGINAL HERITAGE

To our knowledge the site is not associated with any items of Aboriginal heritage.

### 2.0 INTRODUCTION

For the purpose of this bushfire assessment, the vegetation is required to be described to a distance of 140m from the boundary and the slope to 100m from boundary. Vegetation type and slope under vegetation are the factors that will significantly affect bushfire behaviour.

'Research has shown that 85% of buildings are lost in the first 100m from bushland and that ember attack is a significant form of attack on properties' (RFS 2006).

### 2.1 SLOPE DETERMINATION

The effective slope has been assessed for a distance of at least 100m from the proposed development. The slope data has been calculated from a 1m LiDAR Digital Elevation Model (DEM). The source data sets have been captured to standards that are generally consistent with the Australian ICSM LiDAR Acquisition Specifications with require a fundamental vertical accuracy of at least 0.30m (95% confidence) and horizontal accuracy of at least 0.80m (95% confidence). The slope arrows indicated in figure A represent the slope calculated across the length of the arrow direct from the digital elevation model. The calculated slope as shown in Figure A has not been manipulated or modified in any way.

### 2.2 PREDOMINANT VEGETATION CLASS

This assessment includes vegetation both within and external to the site boundaries. Where mixes of vegetation formations are located together, the vegetation formation providing the greater hazard shall be used for the purpose of assessment. The combination of vegetation and slope that yields the worst case scenario shall be used (A1.2 PBP 2019).

Space left intentionally blank.

## 2.3 BUSHFIRE ATTACK LEVEL (BAL) ASSESSMENT.

To clarify the findings below, due to the proximity of the vegetation to the boundary, there is insufficient space within the site to mitigate potential radiant heat loads in excess of 40 kW/m<sup>2</sup> and flame contact in the event of a bushfire.

Based on the parameters identified in table 1 above and as depicted in Figure A, the proposed development is assessed as BAL-FZ as specified in AS3959 (2018).

<b>TABLE 1</b> (To be read in conjunction with Figure A).						
LGA = Northern Beaches Council				Forest Fire Danger Index = FDI 100		
ASPECT <sup>1</sup>	Vegetation Class <sup>2</sup>	Max Effective Slope <sup>3</sup>	Site slope <sup>3</sup>	Required APZ <sup>4</sup>	Proposed APZ / EML <sup>5</sup>	BAL-Rating
NW, NE	Remnant <sup>7</sup>	15-20° D-S	N/A	> 23m	> 19m	BAL-FZ
AOD	Managed residential land					

Abbreviations		
AOD All other directions	EML Extent of managed land	NVC Narrow vegetation corridor

<sup>1</sup>	<i>Cardinal direction from each proposed building facade based on grid north.</i>
<sup>2</sup>	<i>Vegetation Classifications are as described in PBP (2019) A1.2.</i>
<sup>3</sup>	<i>Site slope is calculated from 1m LiDAR contours.</i>
<sup>4</sup>	<i>Minimum APZ required stated as Acceptable Solutions within Table 1.12.2 and A1.12.5. PBP (2019).</i>
<sup>5</sup>	<i>Actual dimensional setback from the face of the building to the assessed vegetation. Achieved Asset Protection Zone (APZ) or extent of managed land (EML).</i>
<sup>6</sup>	<i>Where the direct line of sight between the proposed building and assessed vegetation is obstructed (by a wall or building) the assessed rating can be lowered by one BAL-rating (PBP 2019, s. A1.8).</i>
<sup>7</sup>	<i>Remnant bushland and narrow vegetation corridors (NVC) as stated in PBP (2019) s.A1.11 can be assessed as rainforest as a simplified approach or be assessed as Short Fire Run using method 2 (AS3959).</i>
<sup>8</sup>	<i>Deeming provisions for grassland s.7.9 PBP (2019).</i>
<sup>9</sup>	<i>BAL-rating determined via method 2 (AS3959)</i>

## 2.4 RECOMMENDED ASSET PROTECTION ZONES (APZs).

Due to the infill nature of the development, there is limited space within the site to provide an asset protection zone (APZ). Due to the slope to the north, an APZ greater than 23m is required to avoid potential flame contact and radiant heat loads in excess of 40 kW/m<sup>2</sup> in the event of a bushfire. An approximate 19m APZ is provided between the dwelling and the vegetation to the north. Defendable space is provided in the form of pedestrian access only. The site is to be managed as an inner APZ for perpetuity.

Refer to Section 3 for recommendations relating to APZ provision.

**FIGURE A**



**VEGETATION KEY (solid)**

Forest	Managed Land	Woodland	Low Threat Vegetation PBP (2019) A1.10
Grassland	Under Development	Rainforest	Remnant / Narrow Vegetation Corridor (NVC) PBP (2019) A1.11

**BUSHFIRE PLANNING & DESIGN**

bpad.matthew.noone@gmail.com  
0406077222

**DRAWING LEGEND**

Site Boundary	
Proposed / Subdivision APZ	
Hydrant	

**BAL KEY (dashed)**

BAL-FZ	BAL-19
BAL-40	BAL-12.5
BAL-29	BAL-LOW

## SECTION 03 - ASSET PROTECTION ZONES (APZs)

Intent of measures: to minimise the risk of bush fire attack and provide protection for emergency services personnel, residents and others assisting fire fighting activities.

### 3.0 APZ PERFORMANCE CRITERIA (PBP 2019)

- APZs are to be provided commensurate with the construction of the building.
- A defensible space is to be provided.
- APZs are to be managed and maintained to prevent the spread of a fire to the building.
- The APZ is to be provided in perpetuity.
- APZ maintenance is to be practical, soil stability is not compromised and the potential for crown fires is minimised.

The asset protection zones (APZ) requirements have been derived from the methodology of A1.12.2 or A1.12.3 in Appendix 1 of PBP (2019). Asset protection zones and in particular the Inner Asset Protection Zones are critical for providing defensible space and reducing flame length and rate of spread (PBP 2019). APZs are designed to provide sufficient open space for emergency workers to operate and for occupants to egress the site safely. They are divided into Inner and Outer Asset Protection Zones (IPAs and OPAs) and are required to be maintained for the life of the development. The IPA provides for defensible space and a reduction of radiant heat levels at the building line and the OPA provides for the reduction of the rate of spread and filtering of embers.

### GENERAL RECOMMENDATIONS

•	The APZ should be located completely within the boundary of the site. The required APZ extent will often be satisfied by surrounding managed land which is excluded under clause A1.10 PBP (2019).
•	Landscaping is designed and managed to minimise flame contact and radiant heat to buildings, and the potential for wind-driven embers to cause ignitions (refer to Section 3.1 and 3.2).
•	The APZ should not be located on slopes greater than 18° unless terracing is introduced.
•	A clear area of low-cut lawn or pavement is maintained adjacent to the asset requiring protection.

### 3.1 - INNER APZ (IPA) GUIDELINES

The Inner APZ (IPA) is the managed area closest to the asset (eg. dwelling). The IPA is managed to minimal fuel conditions and aims to mitigate the impact of direct flame contact and radiant heat on the development. The IPA also aims to provide defensible space.

#### TREES

- Canopy cover should be less than 15% (at maturity) within the Inner APZ.
- Trees (at maturity) should not touch or overhang the building.
- Lower limbs should be removed up to a height of 2m above ground.
- Canopies should be separated by 2 to 5m (horizontal and or vertical displacement).
- Preference should be given to smooth barked and evergreen trees.

#### SHRUBS

- Create large discontinuities or gaps in the vegetation to slow down or break the progress of fire towards buildings.
- Shrubs should not be located under trees shrubs should not form more than 10% ground cover.
- Clumps of shrubs should be separated from exposed windows and doors by a distance of at least twice the height of the vegetation.

#### GRASS

- Should be kept mown (as a guide grass should be kept to no more than 100mm in height).
- Leaves and vegetation debris should be removed.

### 3.2 - OUTER APZ (OPA) GUIDELINES

The Outer APZ (OPA) is the part of the APZ that is located between the IPA and the bushfire vegetation threat. The reduction in the available fuels and canopy connections in the OPA aims to mitigate the intensity of an approaching fire and restricts the pathways to crown fuels thus reducing the level of direct flame, radiant heat and ember attack on the IPA and asset (dwelling).

#### TREES

- Canopy cover should be less than 30% (at maturity) within the Outer APZ.
- Trees should have canopy separation canopies should be separated by 2 to 5m.

#### SHRUBS

- Shrubs should not form a continuous canopy.
- Shrubs should form no more than 20% of ground cover.

## SECTION 04 - CONSTRUCTION

### PERFORMANCE CRITERIA (PBP 2019)

It must be demonstrated that the proposed building can withstand bush fire attack in the form of wind, smoke, embers, radiant heat and flame contact. The BAL construction requirements have been determined in accordance with the appropriate table from A1.12.2 to A1.12.7 (PBP 2019) and in accordance with the NCC and as modified by section 7.5.

The proposed development is assessed as BAL-FZ as indicated in Figure A and as specified in AS3959 (2018). The proposed development could experience sustained flame contact and radiant heat loads in excess of 40 kW/m<sup>2</sup> during a bush fire. As per PBP (2019) s.A1.8, when any part of the development is assessed BAL-FZ, the BAL-FZ construction requirements apply to all proposed works regardless of shielding.

Although the RFS have not adopted Chapter 9 AS3959 and the NASH Standard as a Deemed to Satisfy solution, the construction methods for BAL-FZ (AS3959 and NASH) form the basis of a performance based solution and are accepted as being the appropriate construction methods for BAL-FZ construction.

The building requirements for the specified BAL-rating will mitigate bush fire attack in the form of wind, smoke, embers, radiant heat and flame contact.

It is the building contractor's responsibility to source a copy of the relevant AS3959 (2018) standard or the NASH standard to ensure the proposed development is constructed to the correct BAL-rating specifications.

- |  |  |
|--|--|
|  | • Where the fence is within 6m of a building or in areas of BAL-29 or greater, they should be made of non-combustible material only.   |
|  | • There are no bush fire protection requirements for Class 10a buildings located more than 6m from a dwelling in bush fire prone areas. Where a Class 10a building is located within 6m of a dwelling it must be constructed in accordance with the NCC. |

# BAL-FZ AS3959-2018 - CONSTRUCTION REQUIREMENTS

## CERTIFIED PROJECT: 100 Hilltop Road Avalon Beach 2107

The specification below is a summary from AS3959-2018. Note the specification includes the additional construction requirements of Planning for Bushfire Protection (2019). Bushfire Planning and Design provides this simplified specification as an aid however advises that this document is not a substitute for AS3959-2018 which provides more detail. To the best of our knowledge the information below is an accurate representation of AS3959 however we do not guarantee it is free from errors or omissions. We accept no liability for any misinterpretation of our abridged specification compared to AS3959. It is the building contractors responsibility to source their own version of AS3959 to avoid errors or misinterpretation. Construction specifications change over time therefore we can only endorse this specification if attached to a certified report or certificate that we prepared. **We will not support any development that has used this specification without our permission.**

	BAL FZ
SUB FLOOR SUPPORTS - POSTS, COLUMNS, PIERS, POLES FLOORS	- No requirement if enclosed with a compliant FZ rated wall. - Non combustible or, - FRL 30/-/- (sub floor supports) or, - AS1530.8.2 tested system.
	Floors to have an FRL of 30/30/30 or, Conform to AS1530.8.2 tested from the underside.
WALLS	90mm min thick masonry, masonry veneer, clay, concrete (insitu, aerated), calcium silicate, stone, earth wall, mud brick
	AS1530.8.2 Tested system or FRL 30/30/30 when tested from the outside.
WINDOWS	Bushfire shutter - system to comply with AS1530.8.2 (Use tested shutter <u>or</u> tested door/window system)
	Window system to comply with AS1530.8.2 or provide an FRL of -30/-.
	No screen required if using a compliant FZ rated shutter.
	Screen openable and fixed portion of window internally or externally.
DOORS	Bushfire shutter - system to comply with AS1530.8.2 (Use tested shutter <u>or</u> tested door/window system that complies with AS1530.8.2).
	Door system to comply with AS1530.8.2 or provide an FRL of -30/-.
	Weather strips to be provided at the base of side hung doors.
	Vehicle access doors to be non combustible and if attached to the building to be fire separated from the main building as per 3.2.2 AS3959. Alternatively the garage door is to comply with AS1530.8.2. Provide weather strips / brush seals.
	No ventilation slots permitted.
Roofs	Roof systems to comply with Appendix H AS3959 (2018) or comply with a AS1530.8.2 tested system.
	Roof lights and ventilators to comply with - AS1530.8.2.
	Roof penetrations to comply with - AS1530.8.2
	Verandah, carport or awning roof separated from the main roof space with a compliant wall is to be non-combustible. The roof can be framed in timber if protected with 6mm FC.
	Fascias, bargeboards, eaves, soffits as per Appendix H AS3959 (2018) or comply with AS1530.8.2 tested system. Roof mounted evaporative coolers not permitted. Any ventilation openings are to be provided with 2mm SS mesh.
	Downpipes - no requirements. Box gutters to be non combustible and flashed at junction with roof. Box gutters to be screened. Gutter guards to be metal if used. Gutters to be non-combustible.
Verandahs & Decks	No requirement for framing and supports if enclosed with a compliant wall.
	To be non combustible, FC or an AS1530.8.2 tested system.
	Balustrades and handrails within 125mm of the building to be non combustible - no requirement if greater than 125mm.

## SECTION 05 - ACCESS

Intent of measures: To provide safe operational access for emergency services personnel in suppressing a bush fire, while residents are accessing or egressing an area.

### PERFORMANCE CRITERIA (PBP 2019)

- |   |  |
|---|--|
| • | Fire-fighting vehicles are provided with safe, all-weather access to structures and hazard vegetation. |
| • | The capacity of access roads is adequate for fire-fighting vehicles.                                   |
| • | There is appropriate access to water supply.   |
| • | Fire-fighting vehicles can access the dwelling and exit the property safely.                           |

### PUBLIC ROADS

Hilltop Road is a sealed public road. The public road system is deemed to be adequate for emergency services appliances. Figure 5.1 shows the road systems in the area.

### PROPERTY ACCESS

There are no specific access requirements in an urban area where an unobstructed path (no greater than 70m) is provided between the most distant external part of the proposed dwelling and the nearest part of the public access road (where the road speed limit is not greater than 70kph) that supports the operational use of emergency fire fighting vehicles

### ADDITIONAL COMMENTS IN RELATION TO ACCESS

The proposed development can comply with the intent of PBP (2019) with regards to site access requirements.

## SECTION 06 - WATER

Intent of measures: To provide adequate services of water for the protection of buildings during and after the passage of a bush fire, and to locate gas and electricity so as not to contribute to the risk of fire to a building.

### PERFORMANCE CRITERIA (PBP 2019)

- An adequate water supply is to be provided for fire-fighting purposes.
- Water supplies are to be located at regular intervals.
- The water supply is to be accessible and reliable for fire-fighting operations.
- Flows and pressure are to be appropriate
- The integrity of the water supply is to be maintained.
- A static water supply is to be provided for fire-fighting purposes in areas where reticulated water is not available.

### WATER - SPECIFIC REQUIREMENTS

The proposed development can comply with the PBP (2019) with regards to water requirements. Reticulated water is provided however the hydrant sizing, spacing or pressures have not been tested. No additional water for the suppression of bushfire is required for the proposed development.

The following points are to be adhered to for the life of the development.

- All above-ground water service pipes (including taps and connections) external to the building are to be metal.

### ADDITIONAL COMMENTS IN RELATION TO THE PROVISION OF WATER

The proposed development can comply with PBP (2019).

## SECTION 07 - ELECTRICITY & GAS

Intent of measures: To provide adequate services of water for the protection of buildings during and after the passage of a bush fire, and to locate gas and electricity so as not to contribute to the risk of fire to a building.

### PERFORMANCE CRITERIA (PBP 2019)

- Location of electricity services is to limit the possibility of ignition of surrounding bush land or the fabric of buildings.
- Location and design of gas services is not to not lead to the ignition of surrounding bushland or the fabric of buildings.

### ELECTRICITY AND GAS - SPECIFIC REQUIREMENTS

The proposed development can comply with the PBP (2019) with regards to electricity and gas requirements. The following points are to be adhered to (where applicable) for the provision of electricity and gas services where applicable.

#### ELECTRICITY REQUIREMENTS

- Where practicable place electrical transmission lines are underground or,
- If overhead electrical transmission lines are proposed:- lines are installed with short pole spacing (30 metres), unless crossing gullies, gorges or riparian areas; and no part of a tree is closer to a power line than the distance set out in accordance with the specifications in 'Vegetation Safety Clearances' issued by Energy Australia (NS179, April 2002).
- No part of a tree is to be closer to a power line than the distance set out in accordance with the specifications in ISSC3 Guideline for Managing Vegetation Near Power Lines.

#### GAS REQUIREMENTS

- Reticulated or bottled gas is installed and maintained in accordance with AS/NZS 1596:2014 and the requirements of relevant authorities, and metal piping is to be used.
- All fixed gas cylinders are kept clear of all flammable materials to a distance of 10m and shielded on the hazard side.
- Connections to and from gas cylinders are to be metal.
- Polymer-sheathed flexible gas supply lines are not to be used.
- Above-ground gas service pipes are to be metal, including and up to any outlets.

#### ADDITIONAL COMMENTS IN RELATION TO THE PROVISION OF ELECTRICITY AND GAS.

The proposed development can comply with PBP (2019) with regard to the provision of gas and electricity.

## SECTION 08 - RECOMMENDATIONS

The following points are recommended for inclusion in the DA conditions of consent;

1.	Construction	Construct the proposed dwelling to BAL-FZ (Section 2 and 4).
2.	APZs	Manage the site as an Inner APZ (Section 3).
3.	Access	None.
4.	Services	All above ground water, electricity and gas fittings are to be metal (Section 6 & 7).
5.	In the event that Council or the NSW Rural Fire Service modifies our recommendations then this report should no longer be referred to. The bushfire requirements as stated in the DA Consent conditions will take precedence.	
6.	We strongly recommend that the applicant cross references the bushfire requirements within the DA consent conditions and our report and alert us to any discrepancies.	

Space left intentionally blank.

## SECTION 09 - SUMMARY

The development relates to the construction of a sole occupancy dwelling on a vacant allotment.

The development is captured under Section 4.14 of the Environmental Planning and Assessment Act 1979; Consultation and development consent – certain bush fire prone land. For the purpose of bushfire assessment the development is considered infill development as described in the New South Wales Rural Fire Service document Planning for Bushfire Protection (2019).

The subject site is located in Avalon Beach which is within the Northern Beaches Local Government Area (LGA). The site is currently vacant. The allotment is surrounded by managed residential curtilage to the south and east. Remnant vegetation is located to the north, north west and north east of the subject site. Forest vegetation is located to the south east of the subject site.

Due to the infill nature of the development, there is limited space within the site to provide an asset protection zone (APZ). Due to the slope to the north, an APZ greater than 23m is required to avoid potential flame contact and radiant heat loads in excess of 40 kW/m<sup>2</sup> in the event of a bushfire. An approximate 19m APZ is provided between the dwelling and the vegetation to the north. Defendable space is provided in the form of pedestrian access only. The site is to be managed as an inner APZ for perpetuity.

The proposed development is assessed as BAL-FZ as indicated in Figure A and as specified in AS3959 (2018) the Australian Standard for the Construction of Buildings in a Bushfire Prone Area.

The project can comply with the construction requirements of AS3959 (2018) and the performance requirements of the BCA. The objectives and performance requirements of PBP (2019) are also achieved.

Site access, including access via the public road system is suitable for emergency response vehicles. The development complies with PBP (2019) with regards to the provision of water. The requirements for electricity and gas can also be complied with.

Should Council or the NSW Rural Fire Service have any objection to any part of this report, please get in contact to discuss.

Regards,



Matthew Noone

Grad.Dip. Design for Bushfire Prone Areas.

BSc (Geology)

0406077222

T/A Bushfire Planning and Design




## SECTION 10 - REFERENCES

AS3959 (2018)	Australian Standard, Construction of buildings in bushfire-prone areas, AS 3959, Third edition 2018 Standards Australia International Ltd, Sydney.
BCA (2019)	Building Code of Australia 2019, Building Code of Australia, Australian Building Codes Board, Canberra 2019.
EPA Act (1979)	Environmental Planning and Assessment Act 1979, NSW Government, NSW, legislation found at <a href="http://www.legislation.nsw.gov.au">www.legislation.nsw.gov.au</a>
PBP (2019)	Planning for Bushfire Protection, a Guide for Councils,Planners, Fire Authorities, Developers and Home Owners. Rural Fire Service 2019, Australian Government Publishing Service, Canberra.
RFS (2015)	Rural Fire Service, Guide For Bush Fire Prone Land Mapping, Version 5b.

## SECTION 11 - APPENDICES


Appendix A - Architectural Drawings.

# APPENDIX A - ARCHITECTURAL DRAWINGS

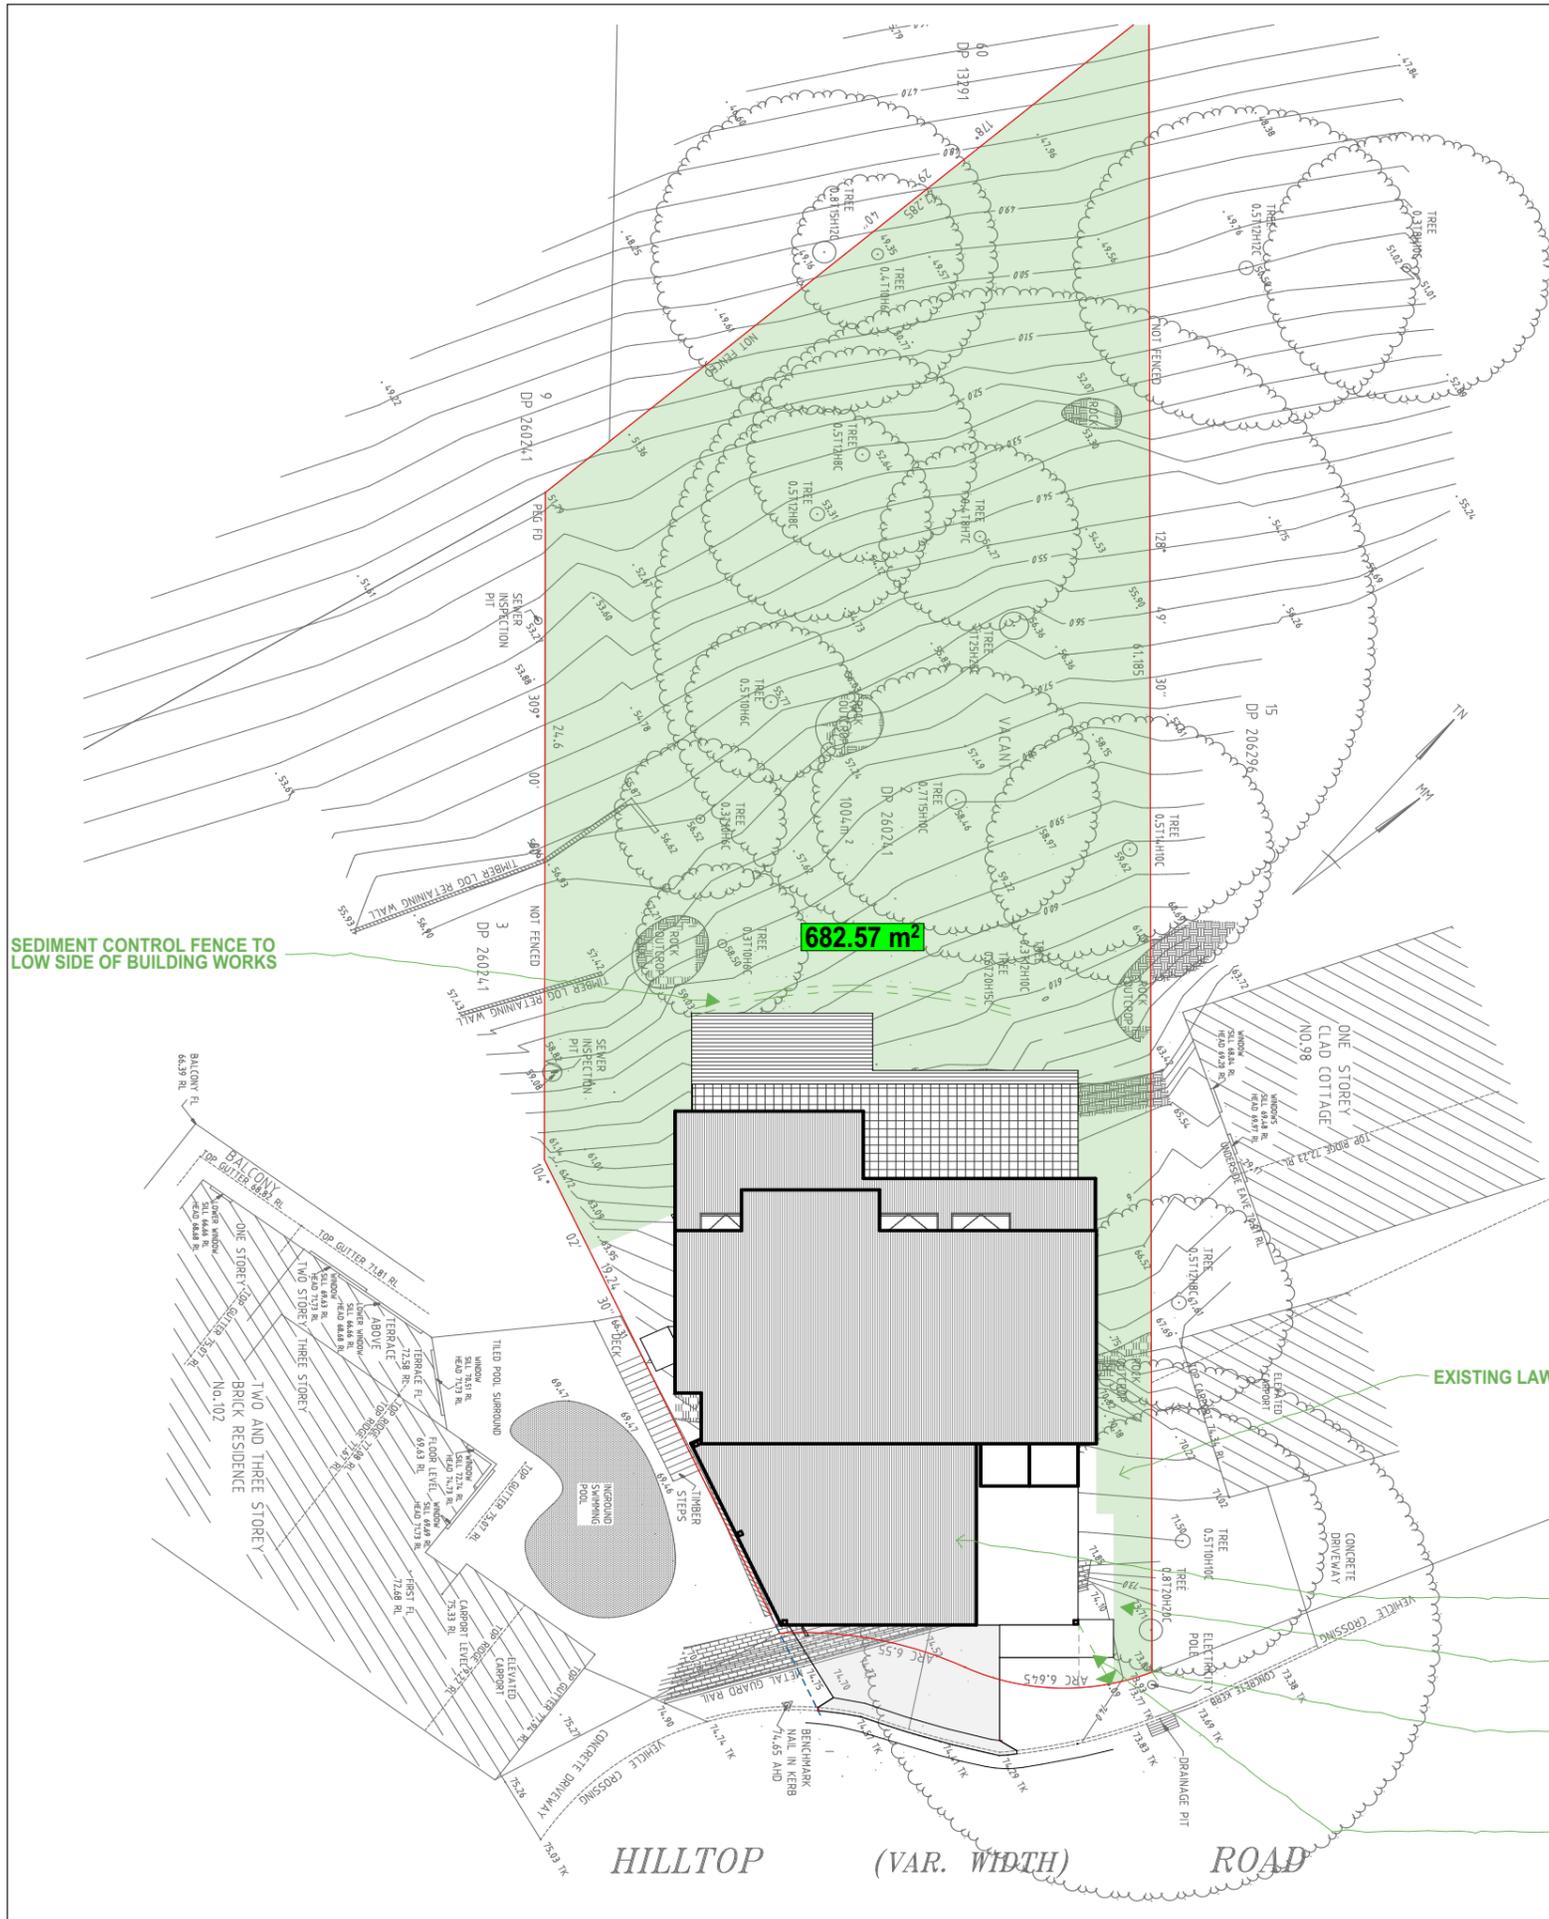


- NOTES:
- RIDGE & GUTTER LEVELS HAVE BEEN DETERMINED BY REMOTE METHODS & ARE APPROXIMATE ONLY.
  - + DENOTES SPOT HEIGHT POSITION
  - TREE DIMENSIONS ARE APPROXIMATE ONLY.
  - NO SERVICES SEARCH HAS BEEN UNDERTAKEN. ONLY THOSE SERVICE STRUCTURES EVIDENT / VISIBLE AT THE TIME OF SURVEY HAVE BEEN LOCATED. DIAL 1100 BEFORE YOU DIG FOR SERVICES CONFIRMATION.
  - BOUNDARIES SHOULD BE MARKED PRIOR TO ANY CONSTRUCTION

-THE PROPERTY IS SUBJECT TO COVENANT C243319  
 -THE PROPERTY IS SUBJECT TO RESTRICTIONS ON THE USE OF LAND DP260241

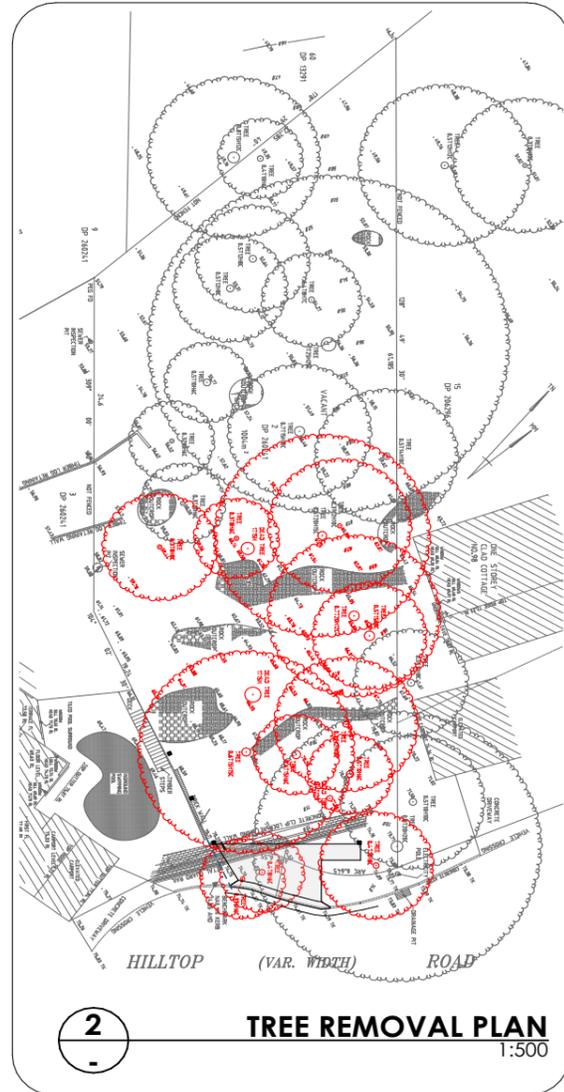

- CONNECT ALL DOWNPIPES TO RAINWATER TANKS VIA 100 DIA. PIPE
- RAINWATER TANK OVERFLOW TO DETENTION BASIN VIA 100 DIA. PIPE
- PROPOSED ON-SITE SORTING & STORAGE AREA TO BE USED FOR WASTE MATERIAL & MATERIAL STORAGE IN CARPORT
- STORMWATER BASIN STORAGE AREA TO BE CONFIRMED AS PART OF CONSTRUCTION CERTIFICATE
- SECURITY FENCING TO SITE FRONT BOUNDARY
- REFER DRAWING A3.6 FOR ADDITIONAL DRIVEWAY DETAILS
- LAY 200x100x6 RHS (GALV) TO KERB AT 1% MIN. GRADE, WHERE CONCENTRATED FLOWS ARE LESS THAN 20l/s. ALTERNATIVELY, ALLOW FLOWS TO OVERFLOW FROM A CONVERTOR AT THE BOUNDARY AS UNCONCENTRATED FLOWS WHERE THEY EXCEED 20l/s

**NOTES**  
 This drawing shall be read in conjunction with all other drawings and specifications for the project.  
 Any discrepancies shall be referred to the architect for clarification before proceeding with work.  
 All dimensions shall be verified on site prior to commencement of construction or fabrication on and off site.  
 Figured dimensions to be used rather than scaling.  
 All building work must be carried out in accordance with the Building Code of Australia and all relevant Australian Standards.  
 CAD Ref: 18546Keaveney-V25.pln DRAWN BY: SH  
**LEGEND**

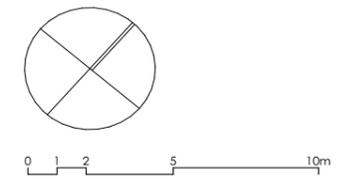

**OLIVER KEAVENEY**  
 UNIT 4/101 DARLEY ST  
 MONA VALE NSW 2103  
 oliver@oak.net.au

PROJECT  
**KEAVENEY HOUSE**  
 100 HILLTOP ROAD  
 CLAREVILLE NSW .  
**LOT:2 DP:260241**  
 NEW DWELLING  
**DEVELOPMENT APPLICATION**  
 CLIENT  
 OLIVER KEAVENEY  
 UNIT 4/101 DARLEY ST  
 MONA VALE NSW 2103

DRAWING TITLE  
**LANDSCAPE /  
 STORMWATER**  
 REVISION  
 DEVELOPMENT APPLICATION

DATE  
 04 AUG 2022

PLOT DATE  
**04/08/22**  
 SCALE@A3  
 1:250  
 PROJECT NO.  
**18456**  
 DRAWING NO.  
**A1.4**