

The title "Development Application ACCESS REPORT" is displayed in a large, bold, black sans-serif font. The word "ACCESS" is significantly larger and bolder than the other words. The background of the page features a large blue diagonal shape on the left and a grey diagonal shape at the bottom, with a photograph of a wheelchair and a person's feet on a textured surface.

Reference Number: 20156

Client: Brookvale Property Trust

Site Address: 638 Pittwater Road, Brookvale, NSW



Vista Access Architects Pty. Ltd.

www.accessarchitects.com.au

admin@accessarchitects.com.au

PO Box 353, Kingswood NSW 2747

ABN: 82124411614

Executive Summary and Design Compliance Statement

This Access Compliance Report is to accompany a Development Application (DA) for the development proposed at **638 Pittwater Road, Brookvale, NSW**. The development is within Northern Beaches Council LGA and proposes a **New Building**. The Council requires 10% of Adaptable units to a **Class C** level. **The scope of works of this report is limited to assessing Level 3 only for access related compliance. All other levels have been previously approved via separate DA application.**

The development proposes the following:

Residential units	60 (incl. Soho units)
Adaptable units	6
Livable Housing Units	12
Commercial/ Retail units	3
Total Accessible parking spaces	14
Accessible parking spaces for residential component	6
Accessible parking spaces for commercial/retail component	8

The development has building classification as detailed below:

- Class 2 (building containing more than 2 SOUs i.e., sole-occupancy units)
- Class 5 (office building for professional or commercial use)
- Class 6 (shops, sale of goods and services by retail)
- Class 7a (car park)

This report is based on the relevant components of:


- Building Code of Australia (BCA) 2022, Volume 1- Performance requirements of D1P1, D1P2, D1P8, D1P9, E3P4, F4P1 and Parts D4, E3 and F4 (where applicable)
- Disability (Access to Premises-Building) Standards 2010 (henceforth referred to as APS)
- AS1428.1-2009 Part 1: General requirements for access, including any amendments
- AS1428.4.1-2009 Part 4.1: TGSIs (Tactile ground surface indicators), including any amendments
- AS2890.6-2009 Part 6: Off-street parking for people with disabilities.
- AS4299-1995 Adaptable Housing
- AS1735-1999 Lift types included in the BCA including Part 12: Facilities for persons with disabilities
- State Environmental Planning Policy 65 (SEPP 65), Objective 4Q1, relating to requirements of the provision of Livable Housing Australia's Silver Level Apartments
- Livable Housing Australia's Livable Housing Design Guidelines- Fourth Edition

The assessment of the proposed development has been undertaken to the extent necessary to issue DA consent under the Environmental Planning and Assessment Act. The proposal achieves the spatial requirements to provide access for people with a disability and it is assumed that assessment of the detailed requirements such as assessment of internal fit-out, details of stairs, ramps and other features will occur at CC (Construction Certificate) stage.

By compliance with the recommendation in this report, the development complies with the requirements of Access Code of Disability (Access to Premises-Building) Standards 2010, and the Disability Access relevant sections of Building Code of Australia and the essential criteria of AS4299-Adaptable Housing and the requirements of SEPP 65 related to Objective 4Q1 - Livable Housing.

The information contained in this statement is true and accurate to the best of our knowledge. Our qualifications and accreditations are listed below.

Assessed by



Jenny Desai

Accredited Access Consultant and LHA Assessor
ACAA Accredited Membership number 572
Qualified- Certificate IV in Access Consulting

Peer reviewed by



Farah Madon

Accredited Access Consultant and LHA Assessor
ACAA Accredited Membership number 281
Qualified- Diploma in Access Consulting

Relevant Dates:

Fee proposal, number FP-20271 dated **10/05/2020**. Fee proposal was accepted by Client on **30/05/2021**

Assessed Drawings:

The following drawings by Berry Rush & Associates Pty Ltd. Architects have been assessed for compliance.

Drawing no	Issue	Date	Details
A02B	B	25-03-2024	Basement B3
A03B	B	25-03-2024	Basement B2
A04B	B	25-03-2024	Basement B1
A05A	B	25-03-2024	Ground floor level
A06A	B	25-03-2024	First floor level
A07A	B	25-03-2024	Second floor level
A08A	B	25-03-2024	Roof level
A19A	A	25-03-2024	Mezzanine level
A20	Prelim	16-04-2024	Third floor level

Document Issue:

Issue	Date	Details
Draft 1	13-04-2024	Issued for Architect's review
Issue A	26-04-2024	Issued for DA- limited to Level 3 only

Limitations and Copyright information:

This report is based on discussions with the project architect and a review of drawings and other relevant documentation provided to us. No site visit was undertaken for the purposes of this report.

This assessment is based on the provided drawings and not based on constructed works; hence the assessment will provide assurance of compliance only if all the recommendations as listed in this report are complied with and constructed in accordance with the requirements of the current BCA, AS1428.1, AS2890.6 and other latest, relevant standards and regulations applicable at the time of construction.

Assessment is based on classification/use of the building. If the class of the building changes to any other building class, this access report will have to be updated accordingly.

Unless stated otherwise, all dimensions mentioned in the report are net (CLEAR) dimensions and are not to be reduced by projecting skirting, kerbs, handrails, lights, fire safety equipment, door handles less than 900mm above FFL (finished floor level) or any other fixtures/fit out elements. When we check drawings, we assume that the dimensions noted are CLEAR dimensions and therefore the Architect / Builder shall allow for construction tolerances.


Only some numerical requirements from relevant AS (Australian Standards) have been noted in the report and for further details and for construction purposes refer to the latest relevant AS.

This report and all its contents including diagrams are a copyright of Vista Access Architects Pty Ltd (VAA) and can only be used for the purposes of this specific project. Copy-pasting diagrams from this report to Architectural plans will constitute copyright infringement.

This report does not assess compliance matters related to WHS, Structural design, Services design, Parts of DDA other than those related to APS or Parts of BCA or Parts of AS other than those directly referenced in this report. VAA gives no warranty or guarantee that this report is correct or complete and will not be liable for any loss arising from the use of this report. We will use our best judgement regarding LHA assessments. However, we are not to be held responsible if another licenced LHA assessor comes to a different conclusion about compliance, certification, or allocation of a particular Quality mark to us as several items in LHA are subject to interpretation.

We have no ability to check for slip resistance of surfaces. All wet areas, parking areas, pavement markings shall have the appropriate slip resistance for the location. We also have no ability to check for wall reinforcements once the walls have already been constructed. The builder shall take full responsibility that the requirements listed in this report are met and the construction and slip resistance shall be as per requirements of AS1428.1/ AS4299 / AS2890.6/ AS3661/ AS4586/ HB197/ HB198 and any other applicable regulation and Australian Standard

Hierarchy of Access-related Legislation and Standards

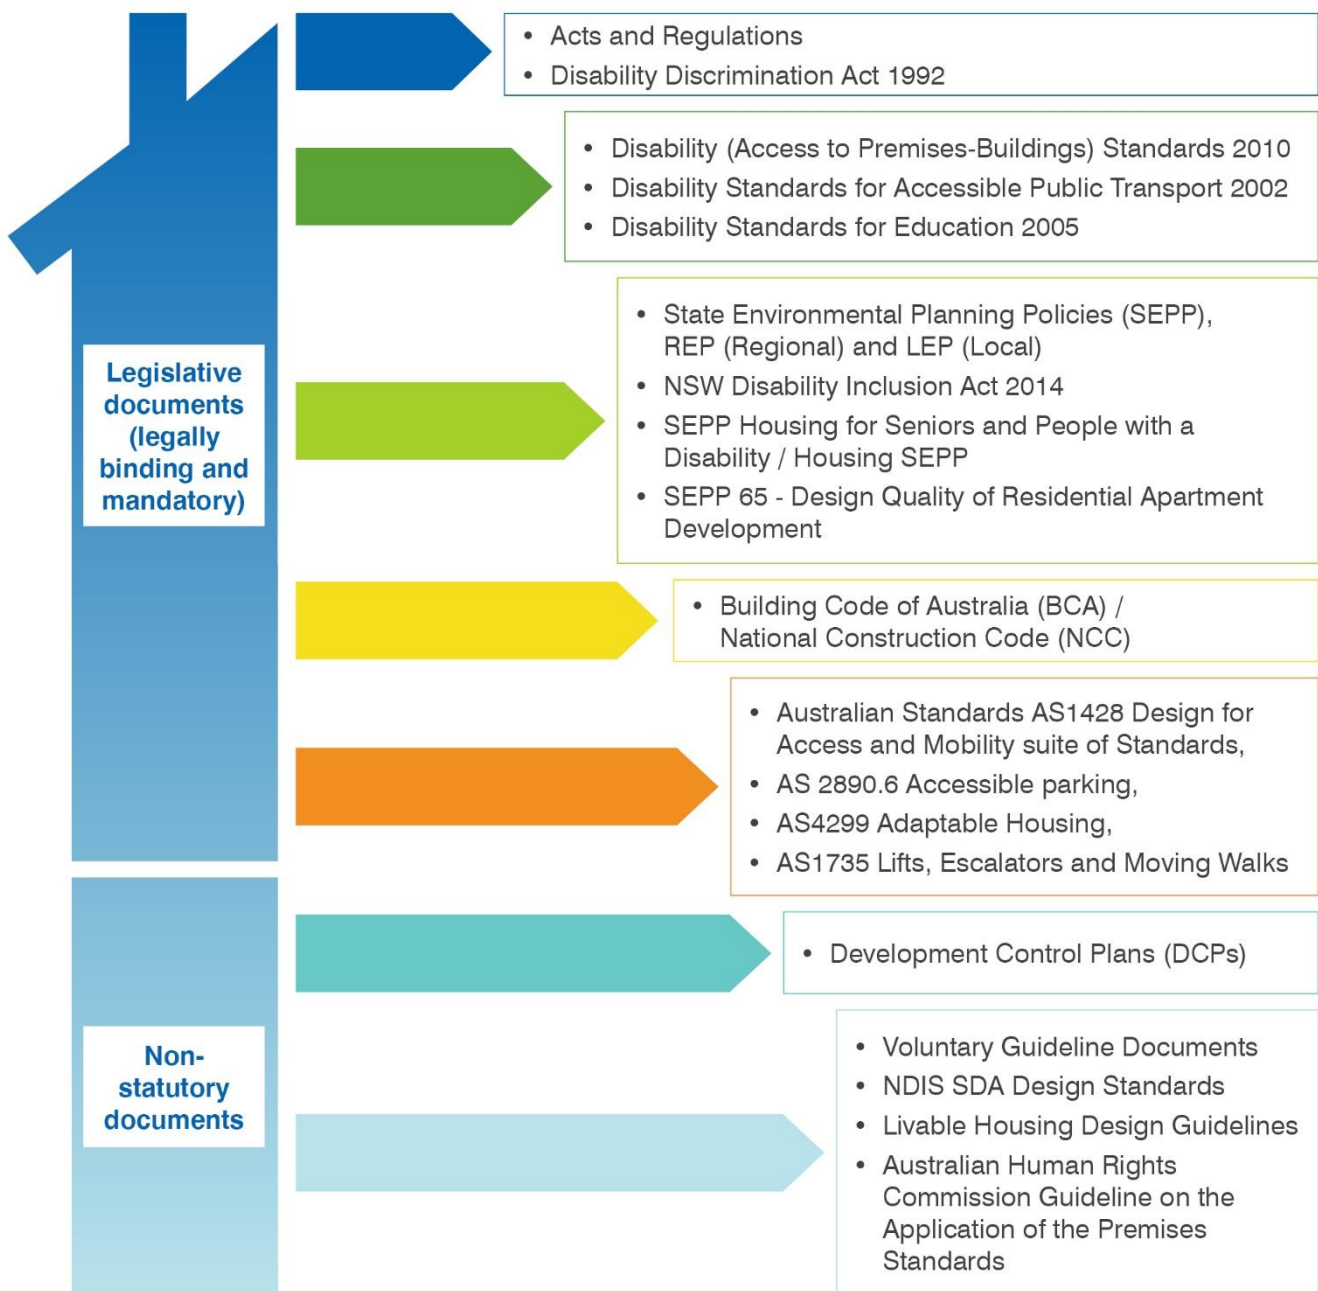

The Federal Disability Discrimination Act 1992 (DDA) provides protection for everyone in Australia against discrimination based on disability. Section 32 of the DDA focuses on the provision of equitable and dignified access to services and facilities for people with mobility, sensory and cognitive disabilities.

Disability discrimination happens when people with a disability and their relatives, friends, carers, co-workers or associates are treated less fairly than people without a disability.

Compliance with Access to Premises Standards give certainty to building certifiers, building developers and building managers that, if access to (new parts) of buildings is provided in accordance with these Standards, the provision of that access, to the extent covered by these Standards, will not be unlawful under the DDA. This however applies only to the new building or new parts of an existing building and its affected part. All areas outside the scope of these areas are still subject to the DDA. We cannot guarantee or certify for DDA compliance because DDA compliance can only be assessed by the Courts.

Scope of DDA extends beyond the building fabric and also includes furniture and fittings.

Compliance assessment with Access related requirements of BCA and Disability (Access to Premises-Building) Standards 2010 (APS)

Development consists of new building/s and therefore compliance is required to full development.

BCA 2022 Part D4 Access for People with a Disability D4D2 General building Access requirements

SOU refers to a Sole Occupancy Unit

Requirement

Class 2 - building containing more than 2 SOUs i.e. sole-occupancy units
For residential use components, access is required:

- From a required accessible pedestrian entrance to at least 1 floor with SOUs and till the entry of door of each SOU on that level.
- To and within 1 of each type of room or space in common use.
- Where floor is accessed by an AS1428.1 ramp or lift, access is required to the entry doorway of each SOU on that level and to and within all common use areas on that level.

Compliance

Capable of compliance

Comments

(Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

- Access has been provided from the main pedestrian entry doorway to the entry doors of all SOUs on at least one floor level by means of accessible pathways and lifts
- Access has been provided to at least 1 of each common use areas.
- Where common use areas are on a floor that is accessible by means of a ramp or lift (Ground floor level and First floor Level in this case), access has been provided to the same.
- Access has been provided to common use garbage storage rooms
- Access is required to common use letterbox area with min 1540x2070mm flat circulation space in front of the letterboxes.
- As a minimum 1550mm clear space is required in front of any common use kitchen / laundry benchtops / BBQ areas, where provided in the development
- All common use accessway widths are to be a minimum of 1M clear measured from skirting to skirting (increases to comply with door circulation spaces where doorways provided) with vertical clearance of at least 2M

Advisory note for any common use kitchen/laundry or BBQ areas (where provided)

- It is suggested that kitchen / BBQ areas could be made partially accessible by providing a workspace of 900mm width next to the sink/cooktop/BBQ as vacant space (without cabinetry under the bench top)
- Provide long lever tap to sink with and handle and water source being within 300mm from the front edge of the benchtop.
- Provide 1 (30x30mm switch size) double GPO fully within 300mm from the front edge of the benchtop.

Details to be verified at CC stage of works.

Requirement

Class 5 / 6 - Commercial/ Retail.

- To and within all areas that are normally used by the occupants.

Compliance

Capable of compliance

Comments

(Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

- Access has been provided to and within all areas required to be accessible.
- Access has been provided to common use garbage storage rooms
- All common use accessway widths are to be a minimum of 1M clear measured from skirting to skirting (increases to comply with door circulation spaces where doorways provided) with vertical clearance of at least 2M

Advisory note for any common use kitchen or BBQ areas (where provided)

- It is recommended that kitchen / BBQ areas could be made partially accessible by providing a workspace of 900mm width next to the sink/cooktop/BBQ as vacant space (without cabinetry under the bench top)
- Provide long lever tap to sink with and handle and water source being within 300mm from the front edge of the benchtop.
- Provide 1 (30x30mm switch size) double GPO fully within 300mm from the front edge of the benchtop.

Advisory note for Reception tables (where provided)

- It is recommended that a lower section for a width of 900mm could be provided to be able to be used by a person in a wheelchair. Height of the FFL (finished floor level) to the top of the table to be 850+/-20mm and height of clearance beneath the unit from the FFL to be 820+/-20mm

Details to be verified at CC stage of works.

Requirement

Class 7a - Covered car park.

- To and within any level containing accessible carparking spaces.

Compliance

Complies with spatial requirements

Comments

(Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

- Access has been provided to all levels containing Accessible carparking spaces.
- All Accessway widths are to be a minimum of 1M clear (measured from skirting to skirting) with vertical clearance of at least 2M

Details to be verified at CC stage of works.

BCA 2022 Part D4D3 Access to buildings

Requirement

Accessway is required from:

- Main pedestrian entry at the site boundary for new buildings.
- Any other accessible building connected by a pedestrian link.
- Accessible car parking spaces.

Compliance

Capable of compliance

Comments

Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application. Details to be verified at CC stage of works.

Requirement

Common use External Walkway / Pedestrian access requirements as per AS1428:


- Accessible path of travel to have a gradient no steeper than 1 in 20 and a cross fall no steeper than 1:40 (1:33 for bitumen).
- For 1:20 grade walkways, 1200mm flat landings are required every 15M.
- The floor surface abutting the sides of the walkway to be provided with a firm and level surface (of a different material) at the same level and grade of the walkway and extend horizontally for a minimum of 600mm unless one of the following is provided: kerb, kerb-rail and handrail or wall of minimum 450mm height.
- At 60 to 90-degree bends in pathways provide a 1500mmx1500mm space with maximum 500mm splay permitted at internal corner.

Compliance

Capable of compliance

Comments

(Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

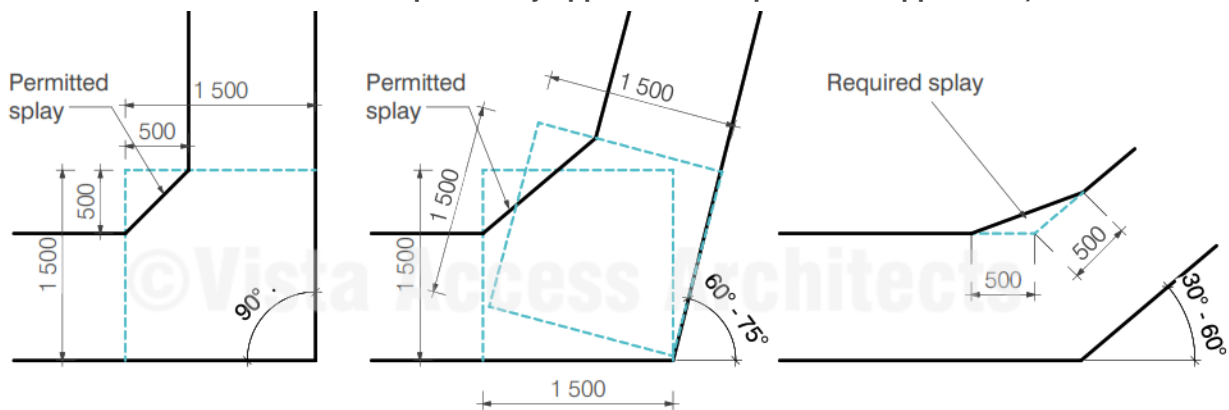

Details to be verified at the CC stage of works.

[Image description: Spatial requirements of walkways with bends as per AS1428.1]

Requirement

Common use floor or ground surfaces

- Use slip-resistant surfaces
- The texture of the surface is to be traversable by people who use a wheelchair and those with an ambulant or sensory disability.
- Abutment of surfaces is to have a smooth transition.
- Construction tolerances to be +/- 3mm vertical or +/-5mm, provided the edges have a bevelled or rounded edge (See diagrams below)
- Where timber decking and boardwalks are provided it is recommended that AS1428.1-2021 requirements be followed.

Grates if used in the accessible path of travel are required to comply with the following:

- Circular openings maximum of 13 mm in diameter
- Slotted openings maximum of 13 mm wide and be oriented so that the long dimension is transverse to the dominant direction of travel
- Where slotted openings are less than 8 mm, the length of the slots may continue across the width of paths of travel

Compliance Capable of compliance

Comments (Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

Details to be verified at the CC stage of works.

Requirement

Accessway is required through:

- Principal pedestrian entry; and
- Not less than 50% of all pedestrian entrances; and
- In building with floor area over 500m², a non-accessible entry must not be located more than 50M from an accessible entry.

Compliance Capable of compliance

Comments (Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

50% of the pedestrian entries, including the main entry have been designed to be accessible with a non-accessible entry not more than 50M from an accessible entry.

Requirement

All common use doorways and doorways to and within Adaptable units (for adaptable units limited to opening size and door circulation requirements to doorways to main entry, main bedroom and main bathroom) to comply with AS1428.1

Where accessible pedestrian entry has Multiple doorways:

- At least 1 to be accessible if 3 provided
- At least 50% to be accessible, if more than 3 provided
- Where doorway has multiple leaves, at least 1 leaf is to have clear opening of 850mm (excluding automatic doors)

Doorway requirements

- All common use doorways in the development within accessible path of travel (other than doorways non-accessible sanitary facilities) to have a clear opening of at least 850mm with appropriate door

circulation spaces in accordance with AS1428.1. In case of multiple leaf doorways, at least 1 operable leaf is required to provide a clear opening of 850mm with the door circulation spaces as per AS1428.1.

- Ambulant toilet cubicle door to have a clear door opening of 700mm.
- Space required for door circulation spaces to have a maximum floor grade of 1:40 (doorway threshold ramps are permitted within the circulation space).
- Door thresholds are to be level, or they can incorporate a doorway threshold ramp with a maximum grade of 1:8, for maximum rise of 35mm and a maximum length of 280mm and located within 20mm of the door leaf, with edges to be tapered or splayed at a minimum of 45° where it does not abut a wall.
- Sliding doorways to be provided with recessed floor tracks to enable flush transition from the inside of the building.
- Distance between successive doorways in airlocks to be 1450mm which is measured when the door is in open position in case of swinging doors.
- Door hardware including door handles, door closers and the in-use indicators / snibs in accessible and ambulant toilets are required to comply with requirements of AS1428.1
- Luminance contrast requirements to doorways and other glazed areas to comply with AS1428.1
- Distance from the door surface to the adjacent wall must not be more than 300mm in depth
- Apart from main entry door and doors to any accessible toilets, the door handle height requirements can be varied if required for Childcare centres, swimming pool barriers or similar situations where the location of the opening and locking controls is prescribed by the relevant statutory authority.


Compliance

Capable of compliance


Comments



Note - Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application.

Details to be verified at the CC stage of works.

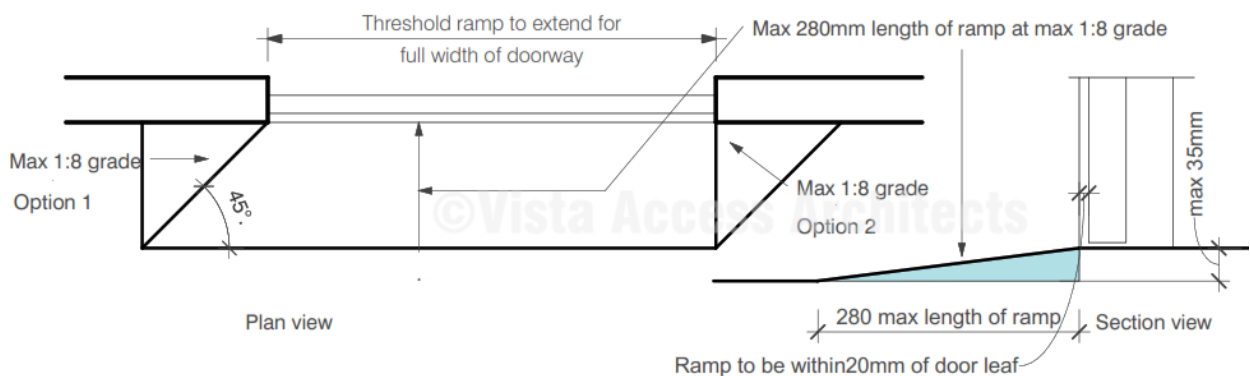

[Image description: Diagram showing requirements for door circulation spaces and door threshold requirements as per AS1428.1]

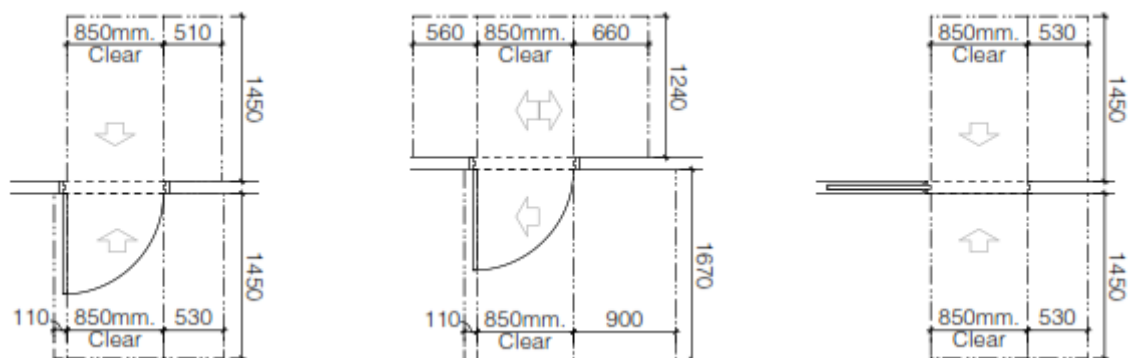

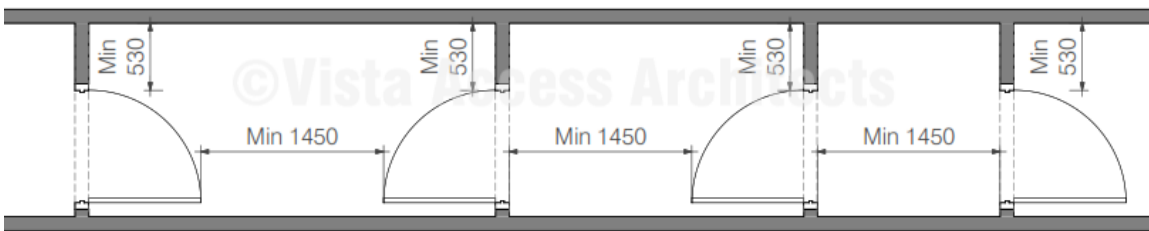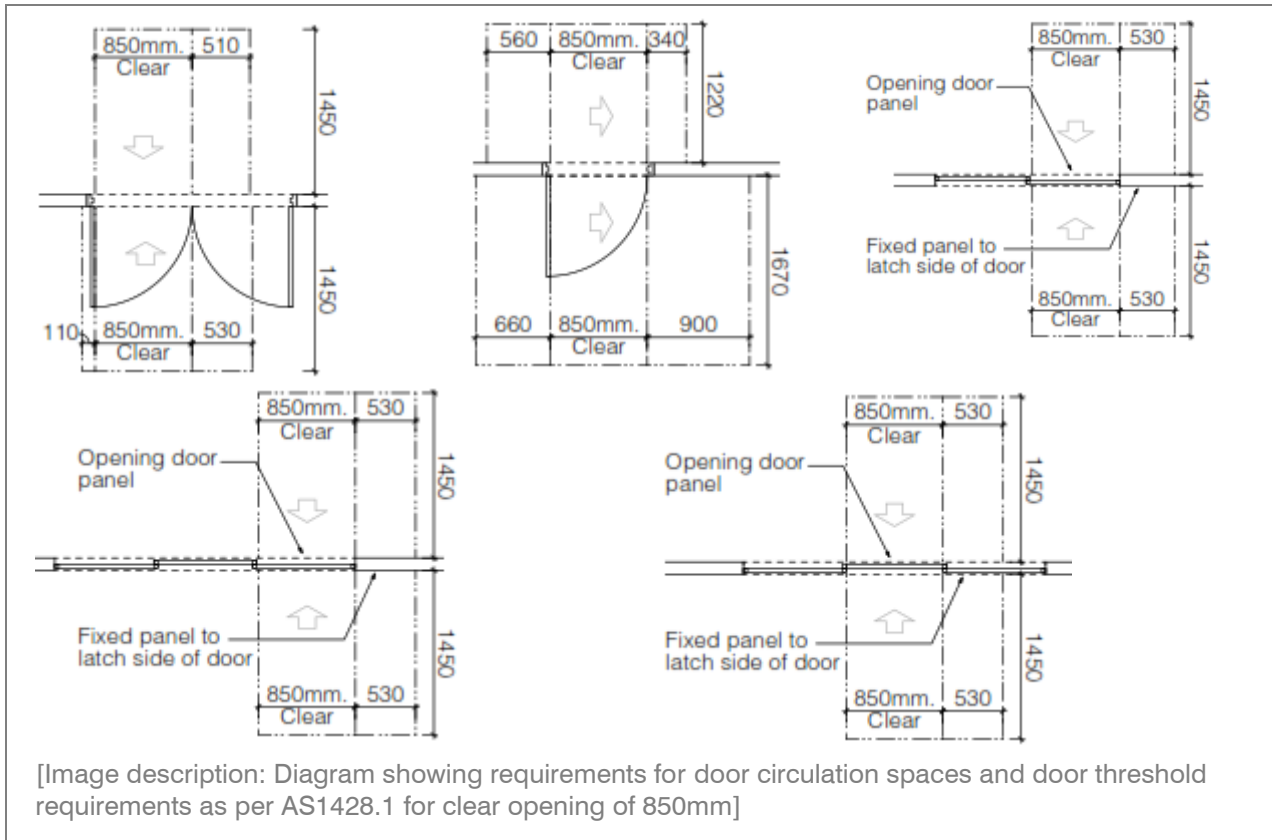

Distances in between airlocks to provide for a minimum 1450mm clear of door swing and minimum latch side space as shown in following diagram.

[Image description: Circulation spaces required in airlocks in a required accessible path of travel]

BCA 2022 Part D4D4 Parts of buildings required to be accessible

Requirement

- Every common use **Ramp** with grades steeper than 1:20 and less than or equal to 1:14 (excluding fire-isolated ramp) is to be compliant with AS1428.1

Compliance

N/A

Comments

This type of ramp has not been identified in the development.

Requirement

- Step ramp** if provided in common use areas is to be compliant with AS1428.1 and NCC/BCA

Compliance N/A

Comments

This type of ramp has not been identified in the development.

Requirement

- **Kerb ramp** if provided in common use areas is to be compliant with AS1428.1

Compliance N/A

Comments

This type of ramp has not been identified in the development.

Requirement

Every **Stairway** in common use areas (excluding fire-isolated stairway) is to be compliant with AS1428.1 including;

- Handrails to be provided on both sides with 1M clearance between them and located at consistent height, between 865mm-1000mm above FFL, with no vertical sections.
- Either provide handrail extensions or offset first riser going up at mid landings
- Opaque risers required with nosing to have a sharp intersection or rounded or chamfered to 5mm.
- Handrails to extend a minimum of 300mm horizontally past the nosing on the top riser. At the bottom of the stairs the handrail is to extend at least one tread depth parallel to the line of the nosing, plus a minimum of 300mm horizontally from the last riser.

Compliance Capable of compliance


Comments (Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

Where this type of stairway is provided, the details of the stairway will be assessed with the relevant requirements of AS1428.1 at the CC stage of works.


Note: In some cases, the stairway from the basement to the ground floor level is considered to be non-fire-isolated, in which case full compliance will be required as per AS1428.1. Verify with the BCA consultant if this is the case.

Note : For stairways with 90° to 180° turns at landings, in order for the handrails to comply with the consistent height requirement, the risers have to be offset at the mid-landings so that no vertical sections are created in the handrails. This applies to both non- fire-isolated and fire-isolated stairways.

Option A- extend handrail by 1 tread at midlanding
Option B- offset first riser going up at midlanding

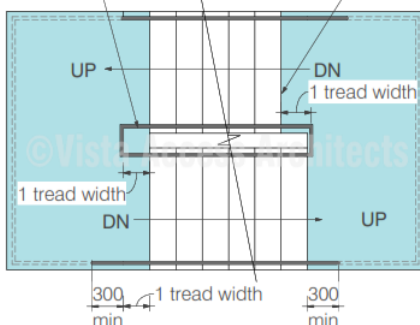

[Image description: Diagram showing the requirements of a non-fire-isolated stairway as per AS1428.1]

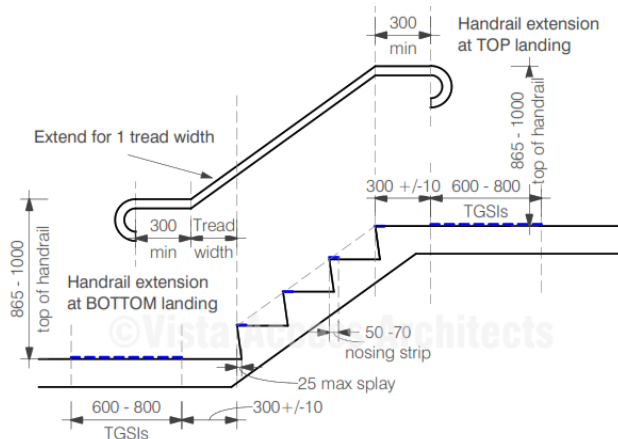

600-800 TGSIs are required where the distance of the landing is 3000mm or more. For landings less than 3000mm, reduce the width of TGSIs to 300-400

Requirement

Every **Fire-isolated Stairway** is to be compliant with AS1428.1 in the following aspects:

- Handrails to be provided only on one side of the staircase with 1M clear width and located between 865-1000mm above FFL. Handrail extensions are not required however since the handrails cannot have any vertical sections and is required to be at a consistent height throughout the stairway, it may be essential to either provide handrail extensions or offset first riser going up at mid landings
- Opaque risers required with nosing to have a sharp intersection or rounded or chamfered to 5mm.
- Handrails to both sides of the stairway are required if the total width of the stairway is 2M or more.

Compliance

Capable of compliance

Comments


(Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

- Ensure either delete first riser going up on all levels OR provide min. 300mm handrail extensions at each mid landing to achieve handrail compliance for fir stairs. This comment also applies to fire stairs on Level 3.


Where this type of stairway is provided, the details of the stairway will be assessed with the relevant requirements of AS1428.1 at the CC stage of works.

Handrails to both sides are not required, however the internal handrail is to be continuous and to comply with all requirements of non-fire-isolated stairways.

Option A- extend handrail by 1 tread at midlanding Option B- offset first riser going up at midlanding

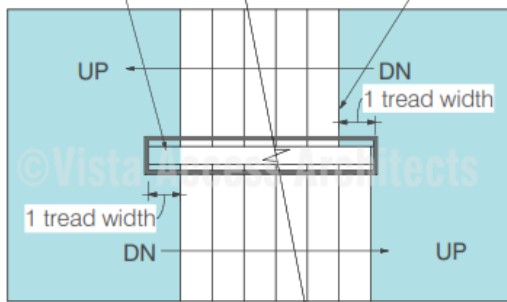

[Image description: Diagram showing the requirements of a fire-isolated stairway as per AS1428.1]

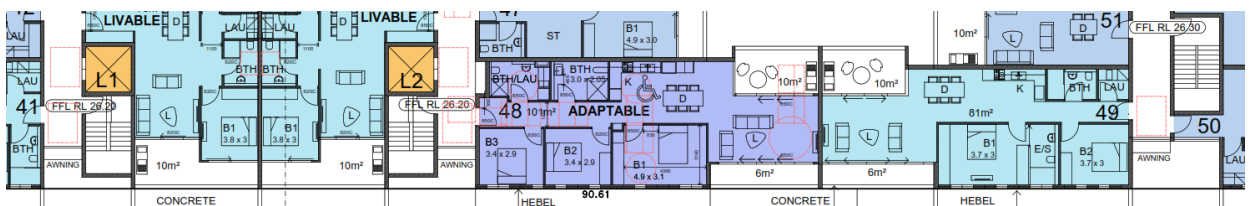

Level 3 fire stairs

Requirement

Nosing for common use fire-isolated and non-fire-isolated stairways require the following:

- Each tread to have a nosing strip between 50mm-75mm depth (of any one colour) for the full width of the stair, which can be setback for a maximum of 15mm from the front of the nosing.
- Multiple strips making up the 50mm-75mm depth is NOT permitted.
- This strip is to have a minimum luminance contrast of 30% to the background and to comply with any change in level requirements if attached on the treads.
- Where the nosing strip is not set back from the front of the nosing then any area of luminance contrast shall not extend down the riser more than 10mm

Compliance

Capable of compliance

Comments (Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)
Detailed features of the nosing strips will be assessed with the requirements of AS1428.1 at the CC stage of works.

Requirement

Slip resistance to comply with **BCA 2022, Table D3D15** and **AS2890.6** when tested in accordance with **AS4586**.

BCA 2022 Table D3D15 Slip –resistance requirements when tested in accordance with AS4586:

Application (common use areas)	Surface conditions	
	Dry	Wet
Ramp (and accessways to accessible parking spaces) steeper than 1:14	P4 or R11	P5 or R12
Ramp steeper than 1:20 but not steeper than 1:14	P3 or R10	P4 or R11
Accessways to accessible parking spaces not steeper than 1:14	P3 or R10	P4 or R11
Tread or landing surface for ramps and stairways	P3 or R10	P4 or R11
Nosing or landing edge strip	P3	P4
Accessible parking spaces and shared areas	P3 or R10	P4 or R11

Slip resistance requirements as per AS4299

AS4299 has slip resistance requirements based on requirements of AS3661 (Slip resistance of pedestrian surfaces) for the following areas:

- Floor surfaces in sanitary facilities including all toilets and bathrooms (essential feature).
- Floor surfaces in the kitchens and Laundries (essential feature).
- Pathways / walkways within the site, within landscaped areas, balconies and other external paved areas (desirable feature for Class A or B developments).
- AS3661.1-1993 is an old Australian standard which has been superseded with AS4586:2013 (Slip resistance classification of new pedestrian surface materials).

HB 197/ HB198 An introductory guide to the slip resistance of pedestrian surface materials provides guidelines for the selection of slip-resistant pedestrian surfaces

Compliance Capable of compliance

Comments

For Slip resistance of surfaces the builder is required to provide a Certificate stating that the Slip resistance of the surfaces comply with the above listed requirements when tested as per AS4586 at CC stage of works.

Requirement

Every **Passenger lift** is to comply with the requirements of **BCA 2022, E3D7**.

Compliance Capable of compliance

Comments

This has been assessed further in the report in the Lifts section. Refer to Lifts section.

Requirement

Passing spaces requirement

It is a requirement to provide passing spaces in common use accessways complying with AS1428.1 at maximum 20 M intervals, where a direct line of sight is not available. Space required is 1800x2800mm (in the direction of travel). Chamfer of 400x400mm is permitted at corners.

Compliance N/A

Comments

There are no accessways over 20M lengths in the development where a direct line of sight is not available

Requirement

Turning spaces requirement

It is a requirement to provide turning spaces in common use accessways complying with AS1428.1 within 2M of the end of accessways where it is not possible to continue travelling and at every 20M intervals. CLEAR Space required is 1540mmx2070mm in the direction of travel (measured from skirting to skirting).

Compliance Complies with spatial requirements

Comments (Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

- Adequate turning spaces have been provided with minimum common use passageway widths being 1540mm clear or alternatively a space of 1540mmx2070mm provided at or within 2M of the end of the passageway.
- A space of 1540mmx2070mm is also required / provided in front of all passenger lift doors.

Details to be verified at CC stage of works.

Advisory note

Where furniture layouts have been decided in developments, ensure that 1M clear space is available around all furniture and that a turning space of 1540mmx2070mm (in the direction of travel) is provided in areas where travel is no longer possible and a person in a wheelchair would be required to make a 180° turn

Requirement

Small building concession

In a Class 5, 6, 7b or 8 building containing not more than 3 storeys, a lift / ramp is not required to provide access to levels other than the entrance level if the floor area of the levels other than the entrance level is not more than 200m².

Compliance For information only

Comments Applies to Mezzanine level in this case

The development (Class 5, 6, 7b or 8 component) has an upper floor which has an area of under 200m² and building is not more than 3 storeys, hence access by means of lift or ramp is not required under the provisions of this Clause in the BCA. However, all other accessible features such as luminance contrast to doorways and stairway features as applicable to a non-fire-isolated stairway will apply to all areas of the non-accessible levels.

Requirement

Carpet specifications

Carpet if used in areas required to be accessible are to be provided with pile height or thickness not more than 11mm and carpet backing not more than 4mm bringing the total height to a maximum of 15mm.

Compliance Capable of compliance

Comments

Applies only if carpets are provided in the common use areas
Details to be verified at CC stage of works.

BCA 2022 Part D4D5 Exemption

Requirement

Access is not required to be provided in the following areas:

- Where access would be inappropriate because of the use of the area
- Where area would pose a health and safety risk
- Any path which exclusively provides access to an exempted area

Compliance For information only

Comments

Areas such as lift machine rooms, fire services room, commercial kitchens, areas in childcare centres such as nappy change room or cot rooms etc or exclusive staff use areas in storage facilities. in the development are exempted from providing access under this clause due to WHS concerns.
Where a caretaker is provided in the development, the toilet provided exclusively for use by the caretaker can be excluded from providing access based on the provisions in this clause.

BCA 2022 Part D4D6 Accessible Carparking

Requirement

Class 2

There are no Accessible carparking requirements for a Class 2 under the BCA.
If adaptable housing has been mandated by the Council, then carparking spaces for Adaptable units will be required under the requirements of AS4299- Adaptable housing.

Compliance Complies

Comments (Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

Northern Beaches Council requires provision of 10% Adaptable units in the development.
Development has total number of 60 units. 10% of 60 = 6 required Adaptable units.
Therefore, 6 accessible / (AS4299 compliant) carparking spaces are required for the residential component of the development.
Development provides a total of 14 accessible parking spaces.
6 Accessible car parking spaces have been provided in development for residential component and 8 other accessible spaces have been provided for commercial/ retail component.
One accessible parking space is required to be allocated to each of the Adaptable units.

Requirement

Class 5

- 1 Accessible car parking space per 100 carparking spaces

Class 6

- 1 Accessible car parking space per 50 carparking spaces (up to 1000 spaces) and additional 1 Accessible car parking space per additional 100 spaces provided

Compliance


Complies

Comments


(Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

Total number of Accessible parking spaces required for the commercial component of the development = 2.


Total number of Accessible parking spaces provided for the commercial component of the development = 8.

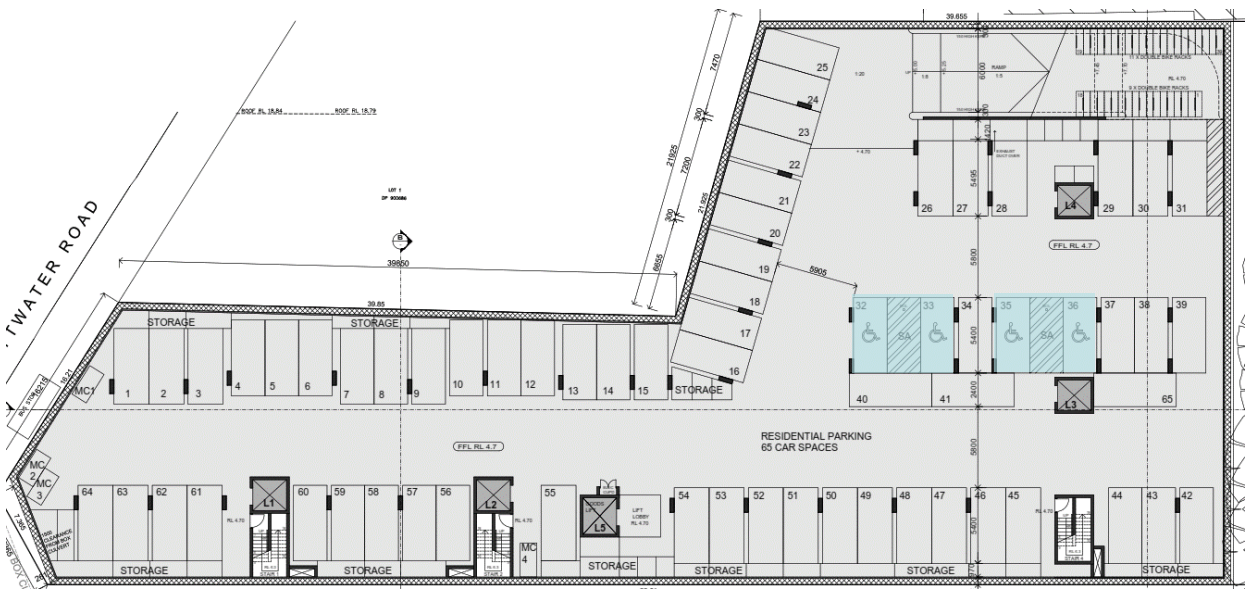

Basement B3

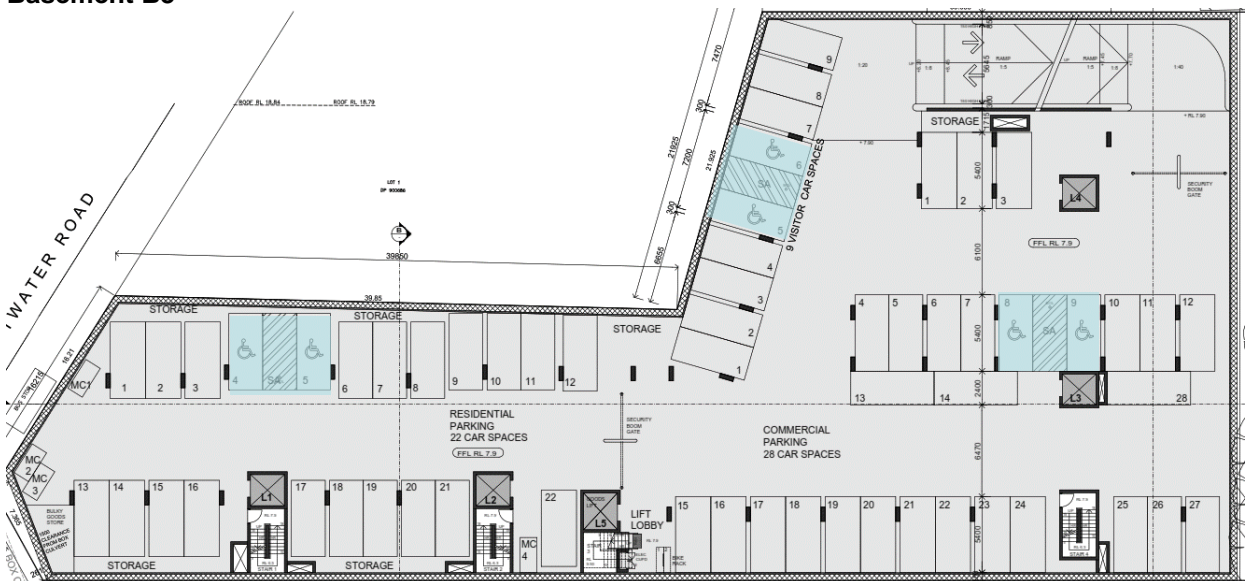

Basement B2

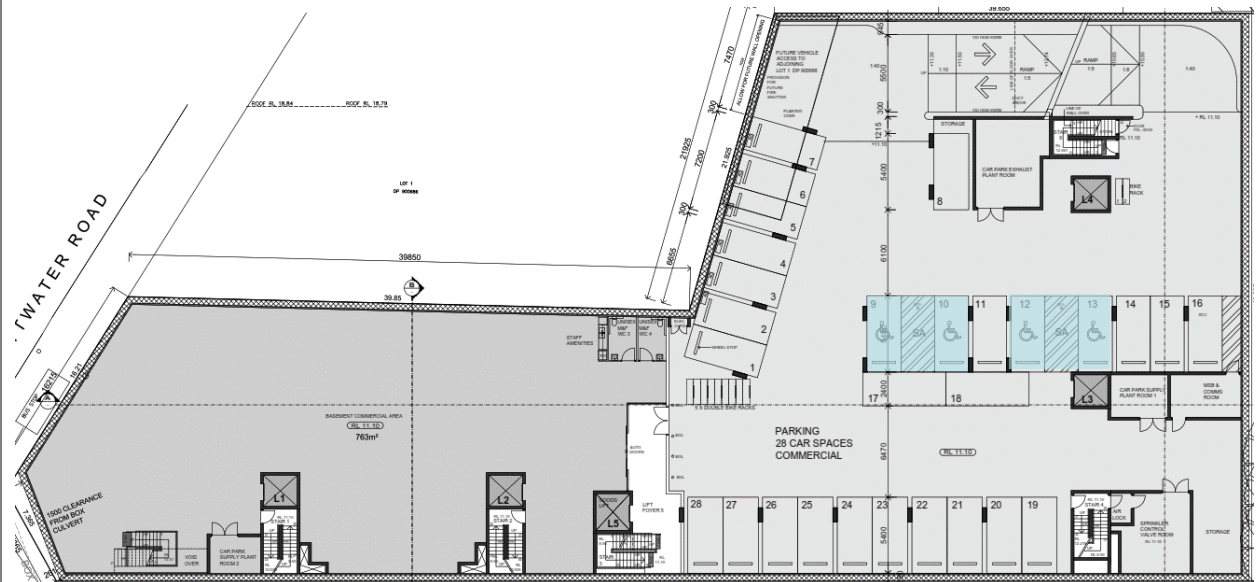

Basement B1

[Image description: Plan of Basement levels above shows the provision of Accessible parking spaces]

AS2890.6-2009 requirements for Accessible car parking space

Requirement

Angle Parking AS 2890.6-2009

- Dedicated space 2.4Mx5.4M, Shared space 2.4Mx5.4M at the same level
- Slip resistant flooring surface with maximum fall 1:40 in any direction or maximum 1:33 if bituminous and outdoors.
- Central Bollard in shared space at 800+/-50mm from entry point.
- Pavement marking in dedicated space by means of access symbol between 800mm-1000mm high placed on a blue rectangle of maximum 1200mm and between 500mm-600mm from its entry point (marking is not to be provided where the space is allocated to an Adaptable unit).
- Minimum headroom of 2.2M at entrances and 2.5M is required over shared space as well as dedicated spaces.
- Non-trafficked area of the shared space to have yellow marking strips at 45°, 150-200mm wide at 200mm-300mm spaces (not required where driveways are used as shared spaces)
- Accessible parking spaces, shared areas and the pavement marking shall have slip resistance of P3/R10 in dry and P4/R11 in wet conditions.



Compliance

Complies with spatial requirements

Comments

(Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

Details to be verified at CC stage of works.

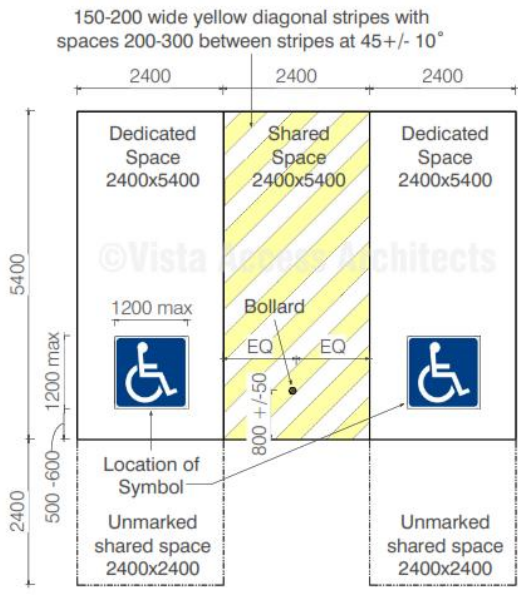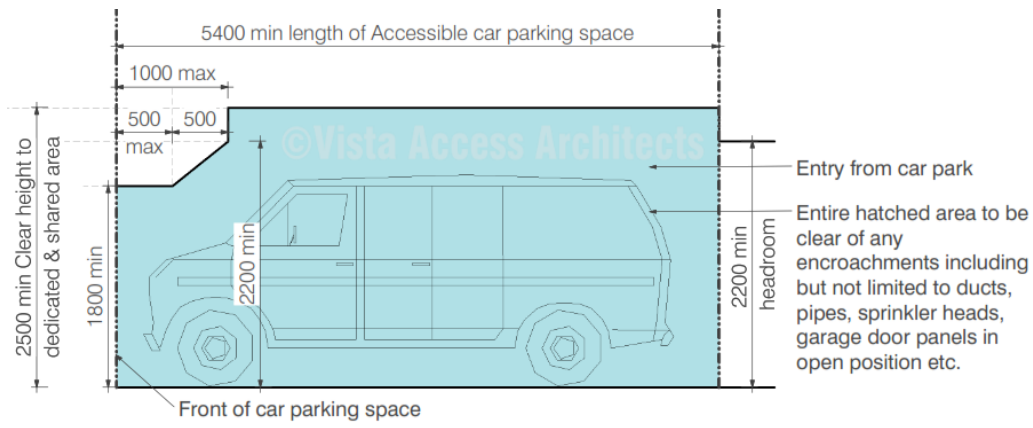

[Image description: Diagram showing spatial requirements of AS2890.6 including line marking, symbol and bollard requirements]

Access symbol is not to be provided when spaces are allocated to a particular residential unit

Additional recommendations as per AS2890.6-2022 (not currently mandatory)

Dedicated Bollard to have a height of minimum 1300mm with a minimum 300mm retro-reflective colour band, located at minimum 900mm in height above car parking floor that provides minimum 30% luminance contrast to the pavement


BCA 2022 Part D4D7 Signage

Requirement

Braille and Tactile signage are required to identify Accessible Sanitary facilities



[Image description: Diagram to help choose the correct signage based on LH/RH transfer]

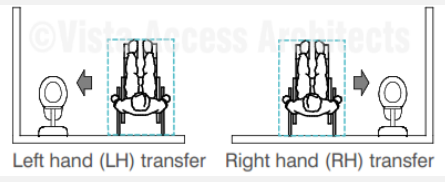

International sign of access is required to signage to all accessible sanitary facilities (excluding SOUs within Class 1b or Class 3) and signage is required to identify if facility is for LH (left hand transfer) or RH (right hand transfer)

Compliance Capable of compliance

Comments
Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance. Details of selected signage to be verified at CC stage of works.

Requirement

Braille and Tactile signage are required to identify Ambulant Sanitary facilities

Compliance N/A

Comments

No ambulant sanitary facilities have been identified in the development.

Requirement

Braille and Tactile signage is required to identify Hearing Augmentation


Compliance Capable of compliance

Comments

Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance. Details of selected signage to be verified at CC stage of works

Requirement

Braille and Tactile signage is required to identify a Fire exit door required by [BCA2022, E4D2](#) by stating the 'Exit' and 'Level', followed by either the floor level number or floor level descriptor or a combination of both of the above and located on the side that faces a person seeking egress



[Image description: Image of Signage The "?" shown in image is to be replaced with the floor level where the door is located]

Compliance Capable of compliance

Comments

Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance. Details of selected signage to be verified at CC stage of works.

Requirement



Signage is required to a non-accessible pedestrian entrance

to direct to the nearest accessible pedestrian entry.

[Image description: Image of directional Signage]

Arrow direction on this signage is indicative only and the direction of the arrow will be based on the location of the accessible entry.

Compliance Capable of compliance

Comments

Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance. Details of selected signage to be verified at CC stage of works.

Requirement


Signage is required where a bank of sanitary facilities is not provided with an accessible unisex sanitary facility.

Compliance N/A

Comments

N/A

Requirement



Signage is required to a single hand pushing action device (example manual control button to an automated doorway) where the latch operation device is not located on the door leaf itself
Braille and tactile signage to identify the latch operation device.

Compliance Capable of compliance (if any automated doors have been provided)

Comments

Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance. Details of selected signage to be verified at CC stage of works.

Requirement

All signage is required to be as per [BCA 2022 Specification 15 Braille and Tactile Signs](#)

This includes location of signage, specifications in regard to braille and tactile characters, luminance contrast and lighting.

Compliance Capable of compliance

Comments

Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance. Details of selected signage to be verified at CC stage of works.

BCA 2022 Part D4D9 Tactile ground surface indicators (TGSIs)

Requirement

TGSIs are required when approaching:

- Stairways other than fire-isolated stairways.
- Escalators / passenger conveyor / moving walk.
- Ramp (other than fire-isolated ramps / kerb or step or swimming pool ramps).
- Under an overhead obstruction of <2M if no barrier is provided.
- When accessway meets a vehicular way adjacent to a pedestrian entry (if no kerb / kerb ramp provided at the location).

Compliance is required with AS1428.4.1 including Luminance contrast and slip resistance requirements for all TGSIs.

Compliance Capable of compliance

Comments

TGSI selections generally take place at CC stage of works. Selection of TGSIs as specified will lead to compliance and these selection details are to be verified at CC stage of works.

BCA 2022 Part D4D12 Limitations on Ramps

Requirement

On an accessway:

- A series of connected ramps must not have a combined vertical rise of more than 3.6M;
- And a landing for a step ramp must not overlap a landing for another step ramp or ramp.

Compliance N/A

Comments

No ramps have been identified in the development

BCA 2022 Part D4D13 Glazing on Accessways

Requirement

Glazing requirements:

- Where there is no chair rail, handrail or transom, all frameless or fully glazed doors, sidelights and any glazing capable of being mistaken for a doorway or opening are required to have a glazing strip
- The marking should be for the full width with a solid and non-transparent 75mm wide, contrasting line located 900-1000mm above FFL and provide a minimum luminance contrast of 30% when viewed against the floor surface within 2M of the glazing on the opposite end. Graphical representation or cut-outs are not permitted.

Compliance Capable of compliance

Comments

Glazing strips are required to be provided to full height glazed areas (doors and windows) used in common use areas such as lift lobbies and common passageways in residential components and in all commercial/retail use components

Glazing strip selections generally take place at CC stage of works. Selection of glazing strips as specified above will lead to compliance and details are to be verified at CC stage of works.

BCA Part F Accessible Sanitary Facilities

BCA 2022 Part F4D5 Accessible Sanitary facilities

Requirement

Accessible unisex toilet is to be provided in accessible part of building such that;

- It can be entered without crossing an area reserved for 1 sex only
- Where male and female sanitary facilities are provided at different locations, Accessible unisex toilet is only required at one of the locations
- Even distribution of LH and RH facilities
- An accessible facility is not required on a level with no lift / ramp access.

Compliance Complies

Comments

2 accessible toilets have been provided in the development within Class 5, 6 component.

BCA 2022 Part F4D6 Accessible unisex sanitary compartments

Requirement

Class 2

At least 1 unisex Accessible toilet when sanitary compartments are provided in common areas.

Compliance N/A

Comments

No common use sanitary facilities have been identified in the development within Class 2 component.

Requirement

Class 5, 6

- 1 unisex Accessible toilet on every storey containing sanitary compartments. Where more than 1 bank of sanitary compartments on a level, at 50% of banks

Compliance Complies

Comments

(Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

2 accessible toilets have been provided in the development. within Class 5, 6 component.

The following common use sanitary facilities have been identified in the development

Location

Unisex Accessible facilities

	LH	LH + Shower	RH	RH + Shower
Unisex accessible toilet on Basement B1 Level within commercial area	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

BCA 2022 Part F4D7 Requirements for Accessible unisex showers

Requirement

Class 2

At least 1 unisex Accessible shower when showers are provided in common areas.

Compliance N/A

Comments

No common use shower facilities have been identified in the development within Class 2 component

Requirement

Class 5, 6

When BCA requires provision of 1 or more showers, then 1 for every 10 showers.

Compliance N/A

Comments

No common use shower facilities have been identified in the development within Class 5, 6, 7, 8, 9 component


Requirement

Accessible unisex toilet is to be designed in accordance with AS1428.1

Compliance Capable of compliance

Comments

(Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application)

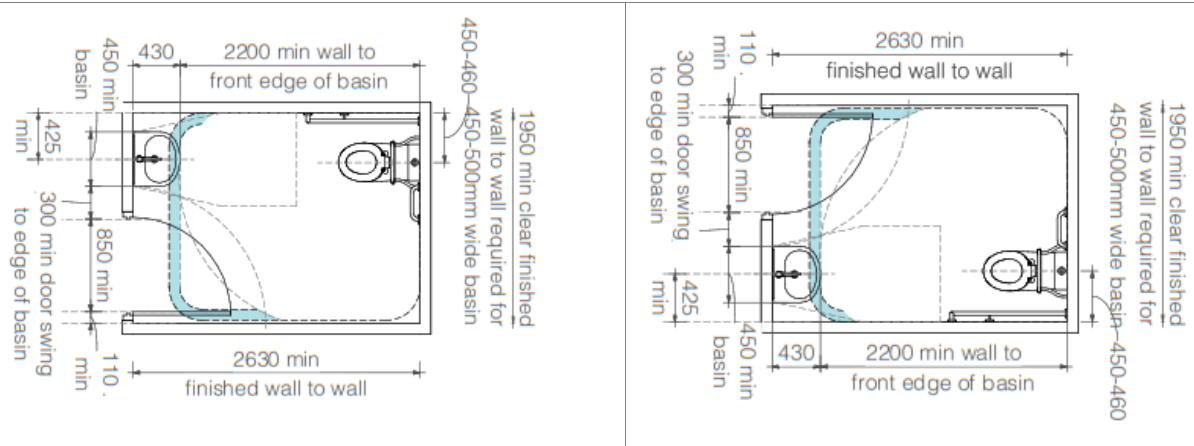

Detailed features of the accessible toilet will be assessed at the CC stage of works

Requirement

Showers for Accessible use are to be designed in accordance with AS1428.1

Compliance N/A

Comments

No accessible showers have been identified on the plans

Requirement

Ambulant use male / female toilets are to be provided if an additional toilet to the Accessible unisex toilet is provided

Compliance N/A

Comments

No ambulant toilet facilities have been identified in the development

Requirement

Ambulant use toilets are to be designed in accordance with AS1428.1

Compliance N/A

Comments

No ambulant toilets have been identified on the plans

BCA Part E Lift Installations

BCA 2022 Part E3D3 Stretcher facility in lifts

Requirement

A **Stretcher lift** is to be provided if a passenger lift is installed to serve any storey with an effective height of 12M. The space requirement is 600mm wide x 2000mm deep x 1400mm high above the floor level. Confirm this requirement with your BCA consultant.

Compliance For information only

Comments

Contact BCA consultant in regard to applicable requirements.

BCA 2022 Part E3D7 Passenger lift and their limitations

Requirement

In an accessible building, **Every Passenger Lift** (excluding electric passenger lift, electrohydraulic passenger lift, inclined lift) must be subject to limitations on use and must comply with **BCA 2022, E3D7, E3D8 and E3D10**

Compliance Capable of compliance

Comments

A certificate of compliance from the lift supplier, stating that the proposed lift complies with the requirements of BCA Part E3- Lift installations will be required at the CC stage of works

BCA 2022 Part E3D8 Accessible features required for passenger lifts

Requirement

Handrail requirements for passenger lifts. Apart from stairway platform lift and low-rise lifts, a handrail is required as per AS1735.12:

- 600mm minimum handrail not more than 500mm from control panel
- Top of handrail between 850-950mm above FFL
- Diameter of handrails to be between 30-50mm and located not less than 50mm from adjacent walls with no obstructions to top 270° arc

Lift floor dimensions (excluding stairway platform lift)

- Lifts traveling **12M** or under, floor size, **1100mm wide x 1400mm deep**
- Lifts travelling **more than 12M**, floor size **1400mm wide x 1600mm deep**

Minimum **Door opening size** complying with AS1735.12, not less than 900mm clear (excluding stairway platform lift).

All lifts with a power operated door are required to have a **Passenger protection system** complying with AS1735.12.

Lift landing doors to be provided at upper landing (excluding stairway platform lift).

Lift car and landing control buttons complying with AS1735.12

Some of the requirements listed below. Refer to AS1735.12 for further details.

For internal control panel:

- If width or depth of car is less than 1400mm, 2 control panels to be provided, one to the left and one to the right of the person entering the car
- Tactile symbol and Braille equivalent to be provided
- Buttons to be located between 900-1100mm above FFL
- All buttons to be 300mm from corner (near entry) and 400mm of all other corners

For external control panel:

To be located between 900-1100mm above FFL and not less than 500mm from internal corners unless otherwise permitted by AS1735.12

Lighting (for all enclosed lift cars) to be provided in accordance with AS1735.12 and AS1680. Minimum illuminance of 100 lx is required at the level of the car floor and average of 50 lx is required on the control panel surface.

To all lifts serving more than 2 levels

- Automatic audible information to identify level when car stops
 - Audible and visual indication at landing to indicate arrival of lift car
- Audible information and indication to be provided between 20-80 dB(A) at a maximum frequency of 1500Hz

Emergency hands free communication (excluding stairway platform lift) – provide a button that alerts a call centre and a light that the call has been received.

Compliance

Capable of compliance

Comments

A certificate of compliance from the lift supplier, stating that the proposed lift complies with the requirements of BCA Part E3- Lift installations will be required at the CC stage of works

AS4299.1995- Adaptable Housing (Applies only to Class 2)

Appendix A of AS4299 schedule is a list of features to be incorporated into a housing unit for it to be termed an 'Adaptable House'.

There are 3 Classification levels for Adaptable Housing

Adaptable Class C in which all essential features are to be incorporated.

Adaptable Class B in which all Class C and 50% of 64 available desirable features are to be incorporated

Adaptable Class A in which all 119 essential and all desirable features are to be incorporated.


6 Adaptable units are required by the Council's DCP to a **Class C** level.

The units designated as adaptable are unit numbers **6, 8, 26, 28, 46, 48**.


Note - Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application.

This assessment is limited to Adaptable units 46 and 48 located on Level 3.

Pre/ post adaptation layout

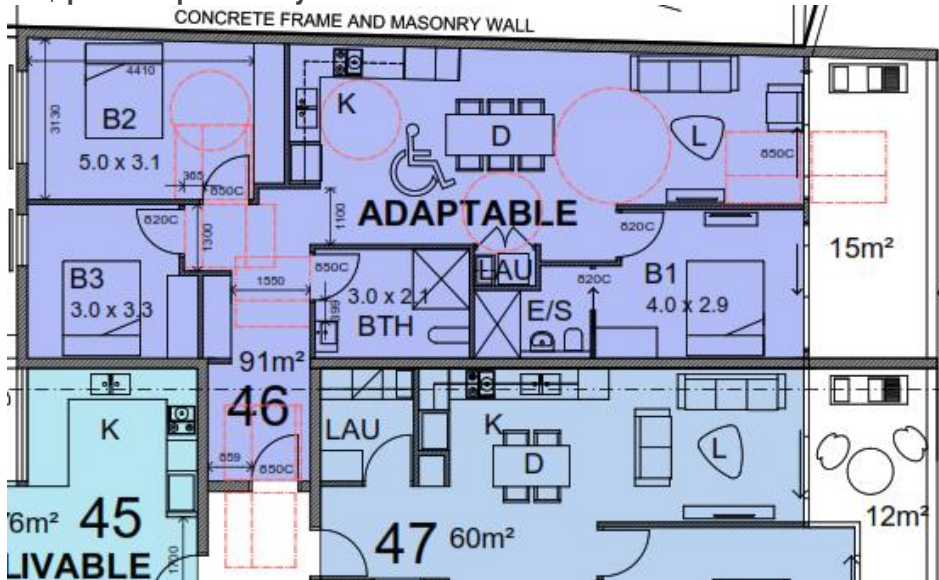

Unit 46

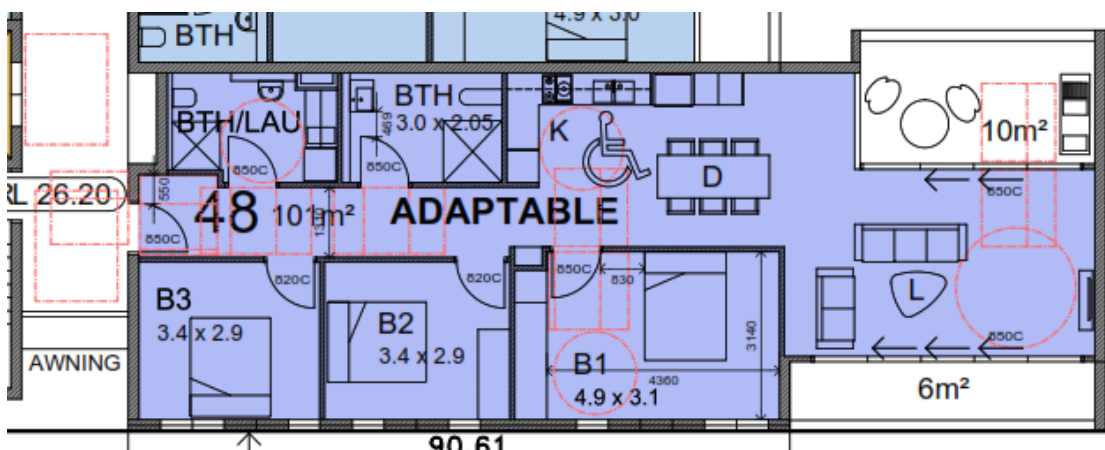

Unit 48

By incorporating the essential requirements listed Checklist below in the Specifications, the nominated Adaptable units can achieve full compliance with Adaptable House Class C

AS4299.1995 - Class C – Essential requirements

R☑ = Required;


C☑ = Capable of compliance at **by adding the requirement to the project specifications** or in some cases capable of compliance at post adaptation stage (where noted in comments).

	Clause No	Requirements as per AS4299	R	C	Comments
	Drawings				
1	2.3	Provision of drawings showing the housing unit in its pre-adaptation and post-adaptation stages	☑	☑	
	Siting				
3	3.3.2	A continuous accessible path of travel from street frontage and vehicle parking to entry complying with AS 1428.1	☑	☑	Access is provided from street by means of an AS1428.1 compliant walkway and from accessible parking space by means of a lift. We have assumed that this has been assessed in the previous DA Details to be verified at the CC stage
	Letter boxes				
11	3.8	Letterboxes to be on hard standing area connected to accessible pathway	☑	☑	Letterboxes for all Adaptable units to be between 900mm to 1100mm above FFL and min 500mm from any internal corner. Details to be verified at the CC stage
	Parking				
14	3.7.2	Car parking space or garage min. area 6.0Mx 3.8M or a hard surfaced level outside of 5.4Mx3.8M is provided as a sheltered car park or can be provided in the future	☑	☑	Can also be provided as per AS2890.6, which is permissible. Details to be verified at the CC stage
	Accessible Entry				
20	4.3.1	Accessible entry	☑	☑	Refer to door circulation requirements noted earlier in the report. Details to be verified at the CC stage
22	4.3.2	Accessible entry to be level (i.e. maximum of 1:40 slope)	☑	☑	
23	4.3.2	Threshold to be low-level	☑	☑	
24	4.3.2	Landing to enable wheelchair manoeuvrability	☑	☑	

	Clause No	Requirements as per AS4299	R	C	Comments
25	4.3.1	Accessible entry door to have 850mm min. clearance	✓	✓	Usually achieved by 920mm door leaf. Door circulation spaces to be as per AS1428.1
27	4.3.4	Door lever handles and hardware to AS1428.1	✓	✓	Details to be verified at the CC stage
Interior: General					
32	4.3.3	Internal doors to have 820mm minimum clearance	✓	✓	Provide an 850mm clear opening door to the adaptable bathroom and 1 main bedroom. Rest to have 820mm clear opening.
33	4.3.7	Internal corridors min. width of 1000mm	✓	✓	
34	4.3.7	Provision for compliance with AS1428.1 for door approaches	✓	✓	Can be compliant post adapt, with easily removable cabinetry.
Living room and dining room					
36	4.7.1	Circulation space of min. 2250mm diameter.	✓	✓	
38	4.7.4	Telephone adjacent to GPO	✓	✓	Details to be verified at the CC stage
41	4.10	Potential illumination level minimum 300 lux	✓	✓	Details to be verified at the CC stage
Kitchen					
42	4.5.2	Minimum width 2.7M, (1550mm clear between benches)	✓	✓	Can be compliant post adaptation.
43	4.5.1	Provision for circulation at doors to comply with AS1428.1	✓	✓	N/A, No door provided to kitchen.
44	4.5.5	Provision for benches to include at least one work surface of 800mm length, adjustable in height from 750mm to 850mm or replaceable.	✓	✓	Can be compliant post adaptation.
45	4.5.5	Refrigerator adjacent to work surface	✓	✓	Can be compliant post adaptation.
46	4.5.6	Kitchen sink adjustable to heights from 750mm to 850 mm or replaceable	✓	✓	Can be compliant post adaptation.
47	4.5.6	Kitchen sink bowl maximum 150mm deep	✓	✓	Can be compliant post adaptation.
48	4.5.6 e	Tap set capstan or lever handles or lever mixer	✓	✓	Can be compliant post adaptation.
49	4.5.6 e	Tap set located within 300mm of front of sink	✓	✓	Can be compliant post adaptation.
51	4.5.7	Cooktops to include either front or side controls with raised cross bars.	✓	✓	Can be compliant post adaptation.

Clause No	Requirements as per AS4299	R	C	Comments	
52	4.5.7	Cooktops to include isolating switch	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Can be compliant post adaptation.
53	4.5.7	Work surface minimum 800 mm length, adjacent to cook top at same height	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Can be compliant post adaptation.
54	4.5.8	Oven located adjacent to an adjustable height or replaceable work surface. It is recommended that a side door opening wall oven is provided with the clear work surface to be on the opposite side of the hinge.	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Can be compliant post adaptation.
59	4.5.11	GPOs to comply with AS1428.1. At least one double GPO fully within 300mm of front of work surface.	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Can be compliant post adaptation.
60	4.5.11	GPO for refrigerator to be easily reachable when the refrigerator is in its operating position.	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Can be compliant post adaptation.
61	4.5.4	Slip-resistant floor surface as per AS3661 and AS 4586	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Details to be verified at the CC stage.

Main bedroom

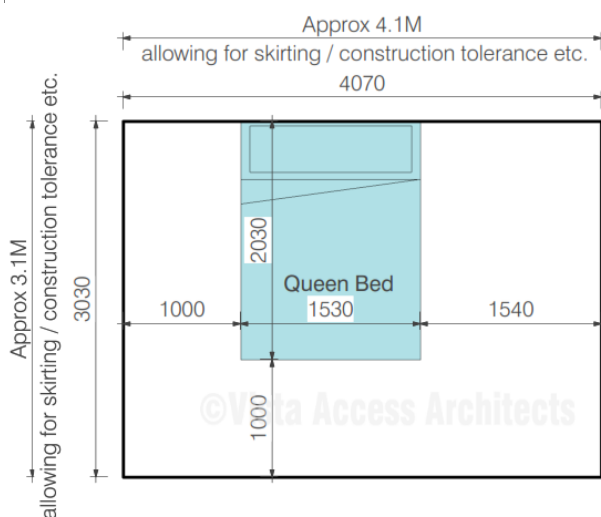

Choose a building block.
 [Image description: Diagram showing circulation spaces around a queen bed as per AS4299]


62	4.6.1	At least one bedroom of area sufficient to accommodate queen size bed and wardrobe and circulation space requirements of AS1428.2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	A space of 1.54Mx2.07M at the base or one side of the bed is considered to be compliant.
----	-------	---	-------------------------------------	-------------------------------------	--

Main Adaptable bathroom


75	4.4.1	Provision for bathroom area to comply with AS1428.1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	A bathroom with minimum space of 2Mx 2.95M or 2.3Mx2.7M or 2.4Mx2.45M is required.
----	-------	---	-------------------------------------	-------------------------------------	--

Clause No **Requirements as per AS4299** **R** **C** **Comments**

[Image description: Diagram shows Post Adaptation bathroom layout and location of wall reinforcements in pre-adaptation locations with reference to post adaptation layout]
 Noted dimensions on the above diagrams are approximate and depend on selected features such as size of the basin.

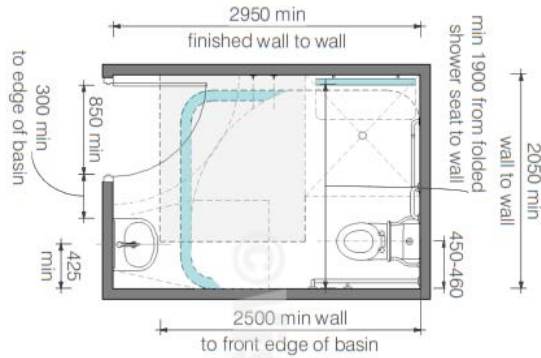

76	4.4.2	Slip-resistant floor surface as per AS3661 and AS 4586	✓	✓	Details to be verified at the CC stage
77	4.4.4 f	Shower recess - no hob. Minimum size 1160x1100mm to comply with AS1428.1	✓	✓	Details to be verified at the CC stage
78	4.4.4 f	Shower area waterproofed to AS3740 with floor to fall to waste	✓	✓	Details to be verified at the CC stage
79	4.4.4 f	Recessed soap holder	✓	✓	If recessed is not provided a heavy duty load bearing soap holder will be required.
80	4.4.4 f	Shower taps positioned for easy reach to access side of shower sliding track.	✓	✓	Details to be verified at the CC stage
82	4.4.4 h	Provision for adjustable, detachable hand held shower rose mounted on a slider grabrail or fixed hook plumbing and wall-strengthening provision (unless brick walls provided)	✓	✓	Reinforcement to wall to take the grabrails has to be provided as per requirements of AS4299
83	4.4.4 h	Provision for grabrail in shower to comply with AS1428.1	✓	✓	Details to be verified at the CC stage

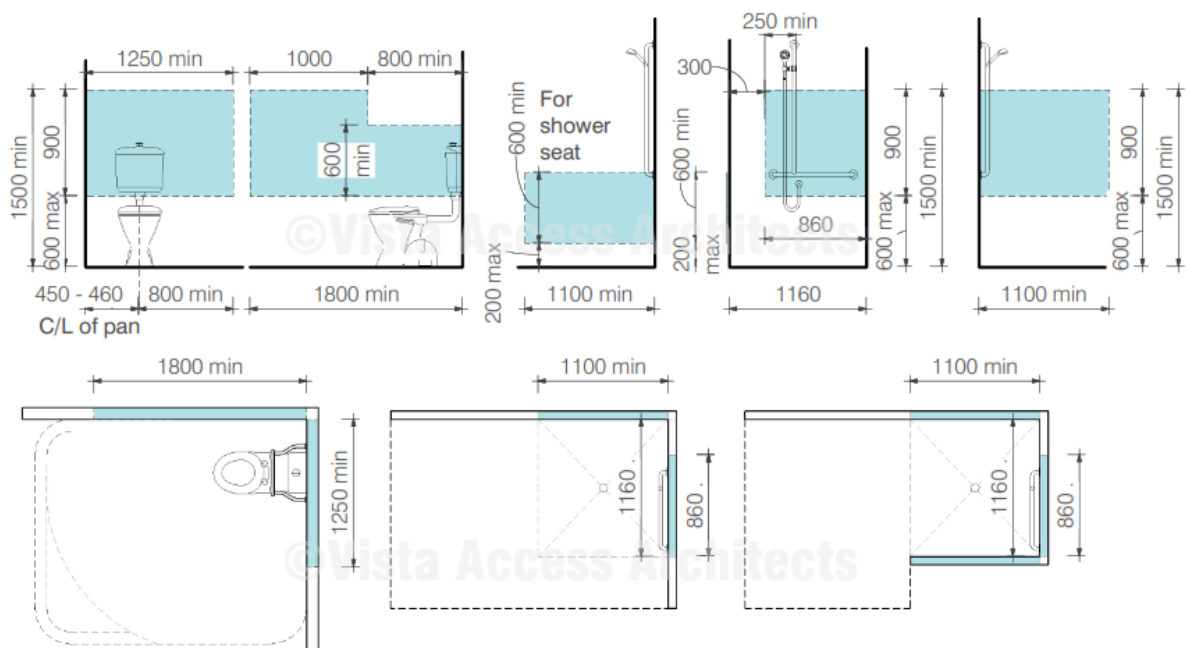

	Clause No	Requirements as per AS4299	R	C	Comments
		[Image description: Diagram showing wall reinforcement requirements for the Adaptable unit for WC and Shower, in post adaptive position]			
86	4.4.4 c	Tap sets to be capstan or lever handles with single outlet	✓	✓	Details to be verified at the CC stage.
88	4.4.4 g	Provision for washbasin with clearances to comply with AS1428.1	✓	✓	Min of 425mm is required from the side wall to the centre line of the basin. Basin is required to be at least 300mm away from door swing.
90	4.4.4 d	Double GPO bedside mirror	✓	✓	Details to be verified at the CC stage.
	Toilet				
92	4.4.3	Provision of either 'visitable toilet' or accessible toilet	✓	✓	Visitable is provided. Accessible can be provided post-adaptation.
93	4.4.1	Provision to comply with AS 1428.1	✓	✓	
94	4.4.3	Location of WC pan at correct distance from fixed walls	✓	✓	450mm – 460mm is required from the side wall to the centre line of the WC pan. Details to be verified at the CC stage.
95	4.4.4 h	Provision for grabrail zone.	✓	✓	Reinforcement to wall to take the grabrails has to be provided as per requirements of AS4299 unless brick walls have been provided. Details to be verified at the CC stage.
96	4.4.2	Slip-resistant floor surface as per AS3661 and AS 4586	✓	✓	Details to be verified at the CC stage.
	Laundry				
98	4.8	Circulation at doors to comply with AS1428.1	✓	✓	N/A cupboard style laundry is proposed.
99	4.8	Provision for adequate circulation space in front of or besides appliances (minimum 1550mm depth)	✓	✓	Details to be verified at the CC stage.
100	4.8 e	Provision for automatic washing machine	✓	✓	Details to be verified at the CC stage.
102	4.8 a	Where clothes line is provided, an accessible path of travel to this	✓	✓	Details to be verified at the CC stage.
105	4.8 g	Double GPO	✓	✓	Details to be verified at the CC stage.
108	4.9.1	Slip-resistant floor surface as per AS3661 and AS 4586	✓	✓	Details to be verified at the CC stage.

	Clause No	Requirements as per AS4299	R	C	Comments
	Door locks				
110	4.3.4	Door hardware operable with one hand, located 900-1100mm above floor	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Details to be verified at the CC stage.

Requirement

- Where the location of fixtures such as WC pans, wash basins, sinks, laundry fixtures and any other fixtures are to be relocated post-adaptation to comply with AS1428.1, then the service pipes (waste and water supply pipes) have to be laid in the correct AS1428.1 specified position at pre-adaptation itself and the services to be capped off for future use.

General recommendations (Advisory only / not mandatory)

- It is recommended that where balconies / outdoor areas have been provided to Adaptable units, provide the sliding doors such that the floor tracks are recessed, so level access can be provided to the balcony / outdoor areas from inside the unit.
- Sliding doors in the living areas leading to outdoor areas are to be such that opening of the door is able to provide a clear opening space of 850mm with a latch side space of 530mm.
- If the balcony is to be brought up to the same level as the unit at post-adaptation by means of decking etc. then ensure that the minimum handrail height requirements required under the BCA are complied with, considering the raised height of the balcony.
- Consideration to be given to recess the slab to the wet areas so that there is no level difference once the floor finishes are applied (i.e. flush transition from carpeted area to tiles area).

SEPP 65 – Part 4Q1 of Apartment Design Guide

Compliance assessment with Objective 4Q-1 Universal Design

Objectives

Design guidance

Objective 4Q-1

Universal design features are included in apartment design to promote flexible housing for all community members

Developments achieve a benchmark of 20% of the total apartments incorporating the Livable Housing Guideline's silver level universal design features


Total number of residential units in the development = 20% of 60 = **12** required Livable units.

Note - Scope of works of this assessment is limited to Level 3 only. All other levels have been previously approved via separate DA application.

This assessment is limited to Livable units 44 and 45 located on Level 3.

Since **6** of the units (**6, 8, 26, 28, 46, 48**) already comply with the Adaptable unit requirements, these units are also capable of satisfying the intent of Silver level of Livable Housing Guidelines as noted in the table below.

In addition to the adaptable units provided the following **6** units **4, 5, 24, 25, 44, 45** are capable of providing compliance with the features of Silver level of Livable Housing Guidelines as noted in the table below.

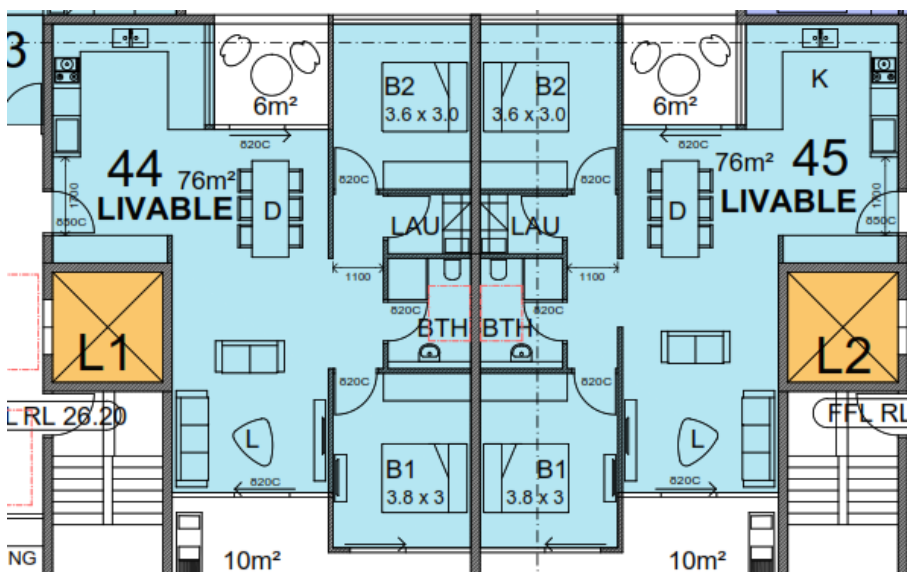

Units- 44 & 45

- Ensure ALL doorways in silver livable units incl. L'dry room doors are provided as 820mm clear opening.
- Ensure a clear space of 900x1200mm (clear of any encroachment including door swing) is provided in front of the pan in all silver livable compliant toilet.
Updated plans required at CC stage of works.


By incorporating the requirements of the below Checklist in the Specifications of the project, the nominated Livable units can achieve full compliance with Livable Housing Guidelines- Silver Level

Note that in this case the adaptable units are also be counted as Livable / LHA Silver level unit in which case the below requirements apply in addition to the AS4299 requirements.

This assessment is limited to Livable units 44 and 45 located on Level 3.
All details to be verified at the CC stage.


Design Element	Requirements (All dimensions noted are required to be clear of finishes as required under AS1428.1)	Compliance / Comments
1 Dwelling Access	<ul style="list-style-type: none"> a. Provide a safe and continuous 1M clear width pathway from front site boundary to an entry door to the dwelling. b. Path including any ramps and walkways to have no steps, even firm, slip-resistant surface, max 1:40 crossfall, max slope of 1:14 with landings of 1.2M every 9M and landings every 15M for 1:20 walkways. 1M clear width of ramps are required. c. Pathway may be provided via an associated car parking in which case the car parking space to be <ul style="list-style-type: none"> ▪ 3200 (width) x5400 (length), ▪ even, firm and slip resistant, level surface of 1:40 max grade and 1:33 max grade for bitumen d. Step ramp may be provided at an entrance doorway. The step ramp to be max 190mm height, max 1:10 grade, max 1900mm length. e. Level landings of 1200mm are required exclusive of the swing of the door or gate and to be provided at the head and foot of the ramp. 	<p>Capable of compliance. Details to be verified at CC stage of works</p> <p>N/A Access is provided from the site boundary.</p> <p>N/A</p> <p>N/A</p>
2 Dwelling entry	<ul style="list-style-type: none"> a. Dwelling Entry should provide an entrance door with <ul style="list-style-type: none"> i. min clear opening width of door to be 820mm ii. Step free threshold of max 5mm with rounded or beveled lip iii. reasonable shelter from the weather b. Level landing of 1200x1200mm at step-free entrance door on the arrival / external side of the entrance door. c. Max permissible threshold is less than 56mm where provided with a 1:8 grade threshold ramp. d. Entrance to be connected to a pathway (specified under Element 1) Note: The entrance to incorporate waterproofing and termite management requirements as specified in the NCC 	<p>Complies. Details to be verified at CC stage of works</p> <p>Complies. Details to be verified at CC stage of works</p> <p>N/A</p> <p>Complies. Details to be verified at CC stage of works Waterproofing compliance by others.</p>
3 Internal doors and corridors	<ul style="list-style-type: none"> a. Doors to rooms on the entry level used for living, dining, bedroom, bathroom, kitchen, laundry and sanitary compartments to be <ul style="list-style-type: none"> i. 820mm clear opening and ii. provided with a level threshold of max 5mm between abutting surfaces with rounded or beveled lip b. Internal corridors and passageways to doorway to be min 1M clear (measured from skirting to skirting) 	<p>Complies. Details to be verified at CC stage of works</p> <p>Complies. Details to be verified at CC</p>

<p>4 Toilet</p>	<p>a. One Toilet to be provided on the ground or entry level that provides,</p> <ul style="list-style-type: none"> i. Min 900mm between walls or amenities ii. Min 1200mm clear space in forward of the WC pan exclusive of door swing. iii. The toilet pan to be positioned in the corner of a room to enable handrails 	<p>Complies. Details to be verified at CC stage of works</p>
<p>5 Shower</p>	<p>a. One bathroom should feature a slip resistant, hobless shower recess. Shower screens are permitted provided they can be easily removed at a later date.</p> <p>b. The shower recess should be located in the corner of the room to enable the installation of grabrails at a future date.</p> <p>For hobless specification please see Australian Standard AS3740-3.6. Reinforcement guidelines for walls in bathrooms and toilets are found in element 6</p>	<p>Complies. Details to be verified at CC stage of works</p>
<p>6 Reinforcement of bathroom & toilet walls</p>	<p>a. Except for walls constructed of solid masonry or concrete, the walls around the shower, bath (if provided) and toilet should be reinforced to provide a fixing surface for the safe installation of grabrails.</p> <p>(b), (c) and (d) the walls around toilet, bath and shower to be via:</p> <ul style="list-style-type: none"> i. Noggins with a thickness of at least 25mm ii. Sheeting with a thickness of at least 12mm <p>Refer to diagrams provided in the Livable Housing Guideline document.</p>	<p>Capable of compliance. Details to be verified at CC stage of works</p> <p>Capable of compliance. Details to be verified at CC stage of works</p>

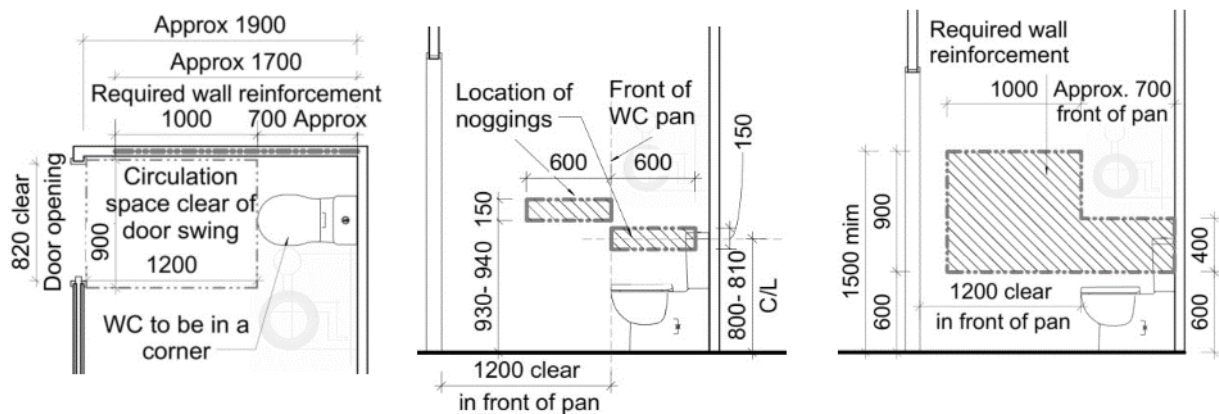


[Image description: Diagram shows wall reinforcements options of noggings or sheeting for a toilet]

Note: In a standalone toilet, the wall reinforcements are required to both sides. Any door openings/ door frames are required to be clear of the required wall reinforcements. If wall with cavity slider is used for wall reinforcements, then allow for additional thickness for the wall.

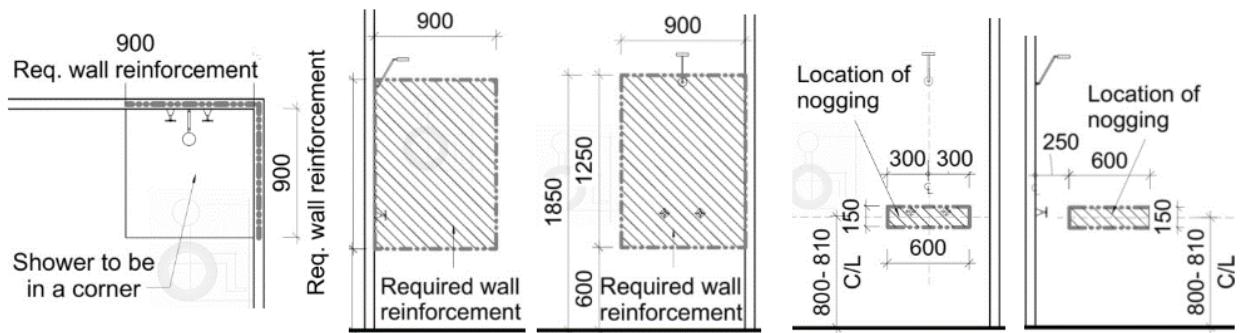

[Image description: Diagram shows wall reinforcements options of noggings or sheeting for a shower]

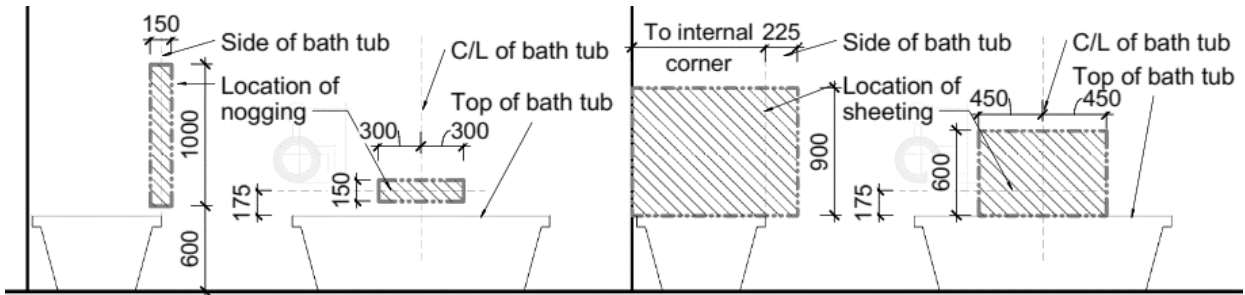

[Image description: Diagram shows wall reinforcements options of noggings or sheeting for a bathtub]

7 Internal Stairways

Stairways in dwellings must feature:

- a continuous handrail on one side of the stairway where there is a rise of more than 1M.

N/A
No internal
stairway in
units.

Statement of Experience

Vista Access Architects specialises in disability access consultancy services including, Disability Access and inclusion requirements, Access Performance Solutions under the NCC, NDIS SDA Certifications, Livable Housing Certifications and Changing Places Certifications.



Farah Madon - Director

- ACA Accredited Access Consultant
- NDIS Accredited SDA Assessor
- Livable Housing Assessor
- Changing Places Assessor

- Accredited and Fellow member of the Access Consultants Association (ACA) - 281
- NDIS Accredited SDA (Specialist Disability Accommodation) Assessor SDA00001
- Architect registered with the NSW Architect's Registration Board - Registration 6940
- Member of Australian Institute of Architects (RAIA), A+ Practice Member 49397
- Registered Assessor of Livable Housing Australia - Registration 10032
- Global Alliance on Accessible Technologies and Environments (GAATES) - BE-02-021-20
- Registered Assessor of Changing Places Australia - Registration CP006

Farah's Educational Profile and Qualifications include:

- Bachelor of Architecture Degree with Honours (B.Arch.)
- International Certification of Accessibility Consultants – Built Environment (ICAC-BE) Program, Level 2 Advanced Accessibility Consultant
- Diploma of Access Consulting

Farah has 20 years of experience of working in the field of Architecture and Access.

Farah is the lead author of the NDIS SDA Design Standard. She has been invited on multiple occasions as an expert witness for Access related matters in the NSW Land and Environment Court.

Farah currently participates on the following key committees concerning access for people with disabilities, on an honorary basis:

- President of Access Consultants Association (previously known as ACAA)
- Member of Standards Australia's ME-064 Committee responsible for the AS4299 and AS1428 suite of standards.
- Community Representative Member of the Penrith City Council's Access Committee
- Member of Australian Institute of Architect's National Enabling Architecture Committee (NEAC)
- Member of Changing Places Australia Technical Advisory Team

Some Recent Awards presented to Farah include:

- 2023 Mulgoa Local Woman of the Year
- 2022 ACAA Fellow Award
- 2021 Australian Access Awards - Winner for the Educational App of the Year - SDA Tools
- 2021 Excellence in Inclusion - Altitude Awards
- 2019 Penrith Citizen of the Year
- 2019 ACAA Access Inclusion Award





Vanessa Griffin

- ACA Accredited Access Consultant
- NDIS Accredited SDA Assessor
- Livable Housing Assessor
- Changing Places Assessor

- Accredited member of ACA (previously ACAA) - 500
- NDIS Accredited SDA Assessor SDA00009
- Registered LHA Assessor - 20035
- Registered Assessor of Changing Places Australia - CP010



Jenny Desai

- ACA Accredited Access Consultant
- NDIS Accredited SDA Assessor
- Livable Housing Assessor

- Accredited member of ACA (previously ACAA) - 572
- NDIS Accredited SDA Assessor SDA00043
- Registered LHA Assessor - 20242
- Master's degree in Design M.Des



Art Phonsawat

- ACA Accredited Access Consultant
- NDIS Accredited SDA Assessor
- Livable Housing Assessor

- Accredited member of ACA (previously ACAA) - 695
- NDIS Accredited SDA Assessor
- Registered LHA Assessor



Trin Woo

- ACA Affiliate Access Consultant

- Affiliate Member of ACA (previously ACAA) - 776
- Bachelor's degree in Architecture B.Arch



Swapna Menon

- ACA Affiliate Access Consultant

- Affiliate Member of the ACA (previously ACAA) - 798
- Bachelor's degree in Architecture B.Arch



Rodney Shepherd

- ACA Affiliate Access Consultant

- Affiliate Member of ACA (previously ACAA) - 751
- Master's Degree in Building Surveying (Distinction)

