STABILISATION & RETAINING WALL REPLACEMENT DETAILS

7 COMEROY CRESCENT, FRENCHS FOREST

INSURED: TIMOTHY AND SAMANTHA DONNAN

INSURER:

ASSESSOR: ENDATA

SHEET LIST							
SHEET NUMBER	SHEET NAME	REV	DATE				
S01	COVER SHEET	Α	03/03/2020				
S02	CONSTRUCTION NOTES	03/03/2020					
S03	TEMPORARY STABILISATION PLAN & DETAILS	А	03/03/2020				
S04	RETAINING WALL DETAILS	Α	03/03/2020				

FOR TENDERING PURPOSES ONLY NOT FOR CONSTRUCTION

					ABN Suit KOO Tel/ Ema	LVER WOLF PROJECT 1 36 108 257 674 e 2/79-87 Princes Highway GARAH NSW 2217 Fax: (02) 9358 2263 ail info@silverwolfprojects.com.au b www.silverwolfprojects.com.au	S PTY LTD	CLAIM: STABII DETAIL
					This drawing and the inform purpose and client. Silver W from the use of this drawing	ation contained thereon have been created soli folf Projects provides no warrant and accepts n and information shown thereon for any other p	o liability arising urpose. This is	7 COM
					permission of Silver Wolf Pr	,		INSURER:
					DRAWN DESIGNED	M.B M.B	03/03/2020 03/03/2020	
					DRG CHECKED	N.H	03/03/2020	ASSESSO
Α	ISSUED FOR TENDERING	03/03/2020	M.B	D.B	DESIGN CHECKED	N.H	03/03/2020	ENDA ⁻
REV	DESCRIPTION	DATE	DRAWN	APPROVED	APPROVED	D.B	03/03/2020	
KEV	DESCRIPTION	DATE	DRAWN	APPROVED	_APPROVED	D.B	03/03/2020	

D	INSURED: TIMOTHY AND SAMANTHA DONNAN	PROJECT PART			
	STABILISATION & RETAINING WALL REPLACEMENT DETAILS				
-	1 COMEROY CRESCENT, FRENCHS FOREST	COVER SHEET			
	INSURER: CGU				
		PROJECT NUMBER	SWP 1903202	SCALE	
)	ASSESSOR: ENDATA	DRG NUMBER	SWP-DWG-1903202-S01	REV	SIZE
)	LINDATA	HEIGHT DATUM: A.H.D		Α Α	A2

GENERAL

- 1 THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH OTHER ARCHITECTURAL DRAWINGS, PLANS AND SPECIFICATIONS AND SUCH OTHER WRITTEN INSTRUCTIONS AS MAY BE ISSUED DURING THE COURSE OF THE CONTRACT. ALL DISCREPANCIES SHALL BE REFERRED TO THE SUPERINTENDENT FOR DECISION BEFORE PROCEEDING WITH THE WORK.
- 2 ALL MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH THE RELEVANT AND CURRENT S.A.A. CODES AND WITH THE BY-LAWS AND ORDINANCES OF THE RELEVANT BUILDING AUTHORITIES.
- 3 SETTING-OUT DIMENSIONS AND SIZES OF STRUCTURAL MEMBERS NOT TO BE OBTAINED BY SCALING THE STRUCTURAL DRAWINGS. ANY SETTING-OUT DIMENSIONS SHOWN IN THE STRUCTURAL DRAWINGS TO BE CHECKED BY THE CONTRACTOR BEFORE CONSTRUCTION COMMENCES. REFER ANY DISCREPANCY TO THE SUPERINTENDENT BEFORE PROCEEDING WITH THE WORK. ALL DIMENSIONS SHOWN ON THE DRAWINGS SHALL BE VERIFIED ON SITE BY THE CONTRACTOR PRIOR TO CONSTRUCTION OR FABRICATION.
- 4 DURING CONSTRUCTION IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT THE STRUCTURE IS MAINTAINED IN A SAFE AND STABLE CONDITION AND NO PART IS OVERSTRESSED. TEMPORARY BRACING TO BE PROVIDED BY THE CONTRACTOR AS REQUIRED TO KEEP THE WORKS AND EXCAVATIONS STABLE AT ALL TIMES.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING ANY EXCAVATION IN A STABLE CONDITION WITHOUT ADVERSELY AFFECTING SURROUNDING PROPERTY INCLUDING SERVICES. THIS INCLUDES OBTAINING ALL NECESSARY APPROVALS FOR SHORING AND ANCHORING SYSTEMS.
- 6 UNLESS NOTED OTHERWISE, ALL LEVELS ARE IN METRES AND ALL DIMENSIONS ARE IN MILLIMETRES.
- 7 THE STRUCTURAL COMPONENTS DETAILED ON THESE DRAWINGS HAVE BEEN DESIGNED IN ACCORDANCE WITH THE RELEVANT S.A.A. CODES AND NCC BUILDING CODE OF AUSTRALIA FOR THE FOLLOWING LOADINGS: -

IMPORTANCE LEVEL 2 STRUCTURE WITH 50 YEARS DESIGN WORKING LIFE HAS BEEN ADOPTED TO AS1170.0

BUILDING SURCHARGE 10kPa

WIND LOAD TO AS1170.2:
-HEIGHT OF STRUCTURE (H) = 2m
-REGION A2
-TERRAIN CATEGORY = 2
ULTIMATE REGIONAL WIND SPEED (Vr) = 45 m/s.
SERVICEABILITY REGIONAL WIND SPEED (Vr.s) = 37 m/s.

FOR SOIL PARAMETERS REFER TO BLOCK RETAINING WALL NOTES

EARTHQUAKE LOADING HAS BEEN DETERMINED IN ACCORDANCE WITH AS1170.4.

8 ALL MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE CURRENT CODES OF PRACTICE EXCEPT WHERE VARIED BY THE SPECIFICATION AND/OR DRAWINGS.

AS1163- STRUCTURAL STEEL HOLLOW SECTIONS
AS1289- METHODS OF TESTING SOILS FOR ENGINEERING PURPOSES

AS1302 - STEEL REINFORCING BARS FOR CONCRETE AS1554.1- WELDING IN BUILDINGS AS1720.1- TIMBER STRUCTURES

AS3600 - CONCRETE STRUCTURES
AS3610 - FORMWORK FOR CONCRETE

AS3700 - MASONRY STRUCTURES

AS3798- GUIDELINES FOR EARTHWORKS FOR COMMERCIAL AND RESIDENTIAL DEVELOPMENTS AS4100- STEEL STRUCTURES

AS4671 - STEEL REINFORCING MATERIALS

STRUCTURAL STEEL

- 1 ALL WORKMANSHIP AND MATERIALS TO BE IN ACCORDANCE WITH AS4100 AND AS1554.
- STEEL COMPONENTS SHALL CONFORM TO THE FOLLOWING TARLE LLN O

OTELE GOIN GIVEN GOINE GOIN OTHER TO THE TOLEGY ING TYBEE C.N.C.						
COMPONENT	AUSTRALIAN STANDARD	GRADE				
PLATE AND FLOOR PLATE	AS3678	250				
HOT ROLLED SECTIONS	AS3679.1	300				
WELDED 'I' SECTIONS	AS3679.2	300				
FLAT, SQUARE AND ROUND BARS	AS3679.1	250				
HOLLOW SECTIONS	AS1163	350				

- 3 ALL COLD FORMED SECTIONS TO CONFORM TO AS1538 AND SHALL BE ROLL-FORMED FROM ZINC COATED HIGH STRENGTH STEEL STRIP, ZINC-HIGH-TEN MINIMUM YIELD STRESS 450MPA, 300G/M2 MINIMUM GALVANISE COATING MASS UNLESS OTHERWISE NOTED ON DRAWINGS. ALL PURLINS, GIRTS AND BRIDGING TO BE LYSAGHT OR APPROVED EQUIVALENT.
- ABBREVIATIONS CFW - CONTINUOUS FILLET WELD FPBW - FULL PENETRATION BUTT WELD
- PPBW PARTIAL PENETRATION BUTT WELD

 5 ALL CONNECTION AND STIFFENER PLATES TO BE 10MM THICK U.N.O.
- ALL WELDS TO BE 6MM CONTINUOUS FILLET STRUCTURAL PURPOSE (SP) WELDS U.N.O. ALL WELDING TO BE SP U.N.O. FROM E41XX (ELECTRODES)/W40X(WIRE).
- 7 ALL BOLTS TO BE M20 AND NO CONNECTION TO HAVE LESS THAN 2 BOLTS U.N.O.
- 8 ALL BOLTS TO BE GALVANISED GRADE 8.8/S U.N.O. PURLIN CONNECTIONS TO BE AS PER MANUFACTURER'S SPECIFICATION U.N.O.
- 9 ALL HOLDING DOWN BOLTS TO BE GALVANISED GRADE 4.6/S U.N.O.
- 10 THE LOCATION OF ALL EXISTING ELEMENTS SHALL BE SITE MEASURED PRIOR TO THE PREPARATION OF SHOP DRAWINGS.
- 11 THE CONTRACTOR SHALL MAKE THE NECESSARY ALLOWANCES FOR COORDINATING ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS IN THE PREPARATION OF STRUCTURAL STEELWORK SHOP DRAWINGS AND SUBSEQUENT FABRICATION AND ERECTION. CONNECTION DETAILS SHOWN ON STRUCTURAL DRAWINGS ARE TYPICAL ONLY. WITH AS4100 & THE AISC PUBLICATION "DESIGN OF STRUCTURAL CONNECTIONS' & 'STANDARDISED STRUCTURAL CONNECTIONS". THESE DETAILS SHALL TAKE DUE ACCOUNT OF ARCHITECTURAL & SERVICES REQUIREMENTS & SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL. THE ENGINEER SHALL SUPPLY LOADS AS REQUIRED. ALL COSTS & THE IMPLICATIONS ASSOCIATED WITH THESE WORKS ARE TO BE ALLOWED FOR BY THE CONTRACTOR.
- 12 ALL REACTIONS SHOWN ARE IN KN U.N.O.
- 13 SHOP DRAWINGS TO BE SUBMITTED IN TRIPLICATE TO THE SUPERINTENDENT /ENGINEER FOR APPROVAL AT LEAST 10 WORKING DAYS PRIOR TO THE COMMENCEMENT OF FABRICATION. FABRICATION IS NOT TO COMMENCE WITHOUT THE ENGINEER'S APPROVAL OF WORKSHOP DRAWINGS. ALL DIMENSIONS AND SETOUTS TO BE OBTAINED FROM ARCHITECTURAL DRAWINGS WHERE NOT INDICATED ON STRUCTURAL DRAWINGS
- 14 ALL FABRICATION OF THE STEEL MEMBERS IS TO BE UNDERTAKEN IN ACCORDANCE WITH AS4100 SECTION 14.
- 15 AFTER FABRICATION ALL STEELWORK NOTED ON THE DRAWINGS AND STEELWORK BUILT IN EXTERNAL WALLS ARE TO BE HOT DIP GALVANISED AFTER PICKLE OR ABRASIVE BLAST CLEANED TO CLASS 2.5 TO AS1627.4, TO COMPLY WITH AS4680. REFER TO ARCHITECTURAL
- 16 ANY SITE WELDING AND DRILLING INTO THE STEEL MEMBERS ARE TO BE TREATED WITH INTERZINC 52 OR APPROVED EQUIVALENT ZINC RICH COATING TO 75μm DFT IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATION.
- 17 STRUCTURAL STEEL ITEMS WHICH ARE PROTECTED FROM WEATHER TO BE ABRASIVE BLAST CLEANED TO CLASS 2.5 TO AS 1627.4, TO BE PRIMED BY INTERZINC 75 OR APPROVED EQUIVALENT TO 75μm DFT.
- 18 ALL CASES OF DAMAGE TO THE PROTECTIVE COATING OF STEELWORK SHALL BE BROUGHT TO THE ATTENTION OF THE SUPERINTENDENT. WITH THE SUPERINTENDENT'S APPROVAL, MINOR DAMAGE MAY BE REPAIRED AS FOLLOWS MECHANICALLY GRIND SURFACE TO ACHIEVE SMOOTH AND BRIGHT METAL COMPARABLE TO CLASS 2. APPLY ZINC RICH PRIMER TO A DRY FILM THICKNESS AS PER SPECIFICATION
- 19 THE ENDS OF ALL HOLLOW SECTIONS SHALL BE SEALED.
- 20 EXAMINATION OF WELDS TO BE (INSPECTION AND TEST RECORDS TO BE SUBMITTED TO THE SUPERINTENDENT).

a.VISUAL SCANNING TO AS1554.1 APPENDIX F ON 100% OF WELDS; b.VISUAL EXAMINATION TO AS1554.1 APPENDIX F ON 10% OF GP WELDS AND 20% OF SP WELDS. c.MAGNETIC PARTICLE EXAMINATION TO BE PERFORMED ON 1% OF GP WELDS AND 5% OF SP WELDS.

d.RADIOGRAPHY OR ULTRASONIC TESTING TO BE PERFORMED ON 2.5% FILLET WELDS AND 10% OF BUTT WELDS.

- 21 THE FABRICATION AND ERECTION OF THE STRUCTURAL STEEL WORK TO BE SUPERVISED BY AN ENGINEER EXPERIENCED IN SUCH SUPERVISION TO ENSURE THAT ALL REQUIREMENTS OF THE DESIGN ARE MET.
- 22 THE CONTRACTOR TO PROVIDE ALL CLEATS AND DRILL ALL HOLES NECESSARY FOR FIXING STEEL ELEMENTS WHETHER OR NOT DETAILED ON THE DRAWINGS.
- 23 SUITABLE EQUIPMENT TO BE USED DURING LOADING, TRANSPORT AND ERECTION OF STEELWORK TO AVOID DAMAGE TO THE STEELWORK FINISHES. STEELWORK STORED ON SITE TO BE PROTECTED AGAINST CORROSION OR DETERIORATION OF PAINTED SURFACES.
- 24 THE CONTRACTOR SHALL PROVIDE TEMPORARY BRACING AND LEAVE IN PLACE UNTIL PERMANENT BRACING ELEMENTS ARE CONSTRUCTED SUCH TEMPORARY BRACING AS IS NECESSARY TO STABILISE THE STRUCTURE DURING ERECTION. ERECTION OF STEEL STRUCTURE AND ITS COMPONENTS TO BE UNDERTAKEN IN ACCORDANCE WITH AS4100 SECTION 15.
- 25 AFTER TIGHTENING, EXPOSED FACES OF BOLTS, NUTS AND WASHERS SHALL BE PREPARED AND COATED AS SPECIFIED OR AS FOR ADJACENT STEELWORK.

CONCRETE BLOCK RETAINING WALL

- 1 RETAINING WALL HAS BEEN DESIGNED FOR THE FOLLOWING LIVE LOADS (SURCHARGE) IN ACCORDANCE WITH AS4678- EARTH-RETAINING STRUCTURES: a.CLASS A 2.5kPa FOR WALLS UP TO 1.5m HIGH AND SLOPING SURFACE UP TO 4:1.
- b.CLASS B 5.0kPa FOR WALLS OVER 1.5m HIGH AND SLOPING SURFACE UP TO 5 DEGREES.
 A 10kPA SURCHARGE HAS BEEN ALLOWED FOR IN THE LOCATION OF THE EXISTING STRUCTURE TO ALLOW FOR DEAD LOAD.
- 3 SLOPING SURFACE STEEPER THAN THE ABOVE MENTIONED SLOPES IS NOT INCLUDED IN THIS DESIGN; THEREFORE, ANY DISCREPANCY FROM THE ABOVE MENTIONED PARAMETERS SHALL BE SPECIFICALLY DESIGNED BY THE ENGINEER.
- 4 MATERIAL SPECIFICATIONS ARE TO BE IN ACCORDANCE WITH RELEVANT CONSTRUCTION NOTES UNDER CONCRETE AND BLOCKWORK SECTIONS.
- 5 RETAINING WALL HAS BEEN DESIGNED FOR THE FOLLOWING SOIL CLASSIFICATION AND GEOTECHNICAL PARAMETERS:
 - a. BACKFILL SOIL HAS BEEN ASSUMED TO BE FULLY DRAINED WITHOUT ANY
 - GROUNDWATER LEVEL BEHIND THE WALL. b. SOIL UNIT WEIGHT (Γ) = 19kN/m3.
- 6 ALL THE ABOVE MENTIONED MINIMUM GEOTECHNICAL PARAMETERS ARE TO BE CERTIFIED BY A QUALIFIED GEOTECHNICAL ENGINEER.
- 7 IT IS ESSENTIAL THAT STEPS BE TAKEN TO PREVENT THE SOIL BEHIND THE WALL FROM BECOMING SATURATED. THESE STEPS SHOULD INCLUDE:

 a.SEALING THE SOIL SURFACE THIS CAN BE DONE BY COVERING IT WITH A COMPACTED LAYER OF MATERIAL WITH LOW PERMEABILITY. THE SURFACE SHOULD BE SLOPED TOWARDS

b.A DRAINAGE SYSTEM WITHIN THE SOIL – THIS CAN BE DONE BY PLACING GRAVEL TO A WIDTH OF APPROXIMATELY 300mm IMMEDIATELY BEHIND THE WALL WITH A CONTINUOUS 100mm DIAMETER SLOTTED PVC AGRICULTURAL PIPE WITH GEO FABRIC SOCK LOCATED AT THE BASE OF THE WALL. THE OUTLETS FROM THE PIPE MUST BE BEYOND THE ENDS OF THE WALL UNLESS THE PIPE IS CONNECTED TO A PROPER STORM WATER DRAINAGE SYSTEM. c.FOR HIGHER WALLS, OR IN CASES WHERE EXCESSIVE GROUND WATER EXISTS IT MAY BE NECESSARY TO PROVIDE ANOTHER AGRICULTURAL PIPE DRAIN AT MID-HEIGHT OF THE WALL.

- 8 CLEANOUT OPENINGS SHOULD BE PROVIDED IN THE BOTTOM COURSE USING EITHER 20.61 BLOCKS PLUS TIMBER FORMWORK AT THE FRONT OR 20.45 BLOCKS PLUS 20.45 A BISCUITS TO PERMIT REMOVAL OF MORTAR FINS AND OTHER DEBRIS, AND TO ALLOW POSITIONING AND TYING OF VERTICAL REINFORCEMENT. THESE OPENINGS MUST BE CLOSED BEFORE GROUTING
- 9 ABOVE THE FIRST COURSE, THE USE OF 15.48, 20.48 AND 30.48 H-BLOCKS IS RECOMMENDED BECAUSE THEY ARE EASIER TO FILL WITH GROUT AND PROVIDE REQUIRED PROTECTION OF THE REINFORCEMENT.
- 10 MORTAR PROJECTING INTO THE CORES SHOULD BE REMOVED, EITHER AS THE BLOCKS ARE LAID, OR BY RODDING AFTER THE MORTAR HAS SET. DEBRIS SHOULD BE REMOVED FROM THE CORES THROUGH THE CLEANOUT OPENINGS.
- 11 WHEN THE WALL IS TO BE TANKED, THE MORTAR JOINTS ON THAT FACE SHOULD BE STRUCK FLUSH AND CLEANED.
- 12 REINFORCEMENT MUST BE POSITIONED ACCURATELY AND TIED SECURELY BEFORE PLACING CONCRETE OR GROUT. VERTICAL REINFORCING BARS INCLUDING STARTER BARS, SHOULD BE AS CLOSE TO THE BACK FACE OF THE WALL AS POSSIBLE, CONSISTENT WITH MIN 50mm COVER REQUIREMENTS
- 13 INFILL SOIL SHOULD NOT PLACED BEHIND THE WALL UNTIL AT LEAST TEN (10) DAYS AFTER GROUTING. INFILL SOIL SHOULD BE PLACED AND COMPACTED IN LAYERS NOT MORE THAN 200mm DEEP.
- 14 THE DRAINAGE SYSTEM SHOULD BE INSTALLED PROGRESSIVELY AS THE INFILL SOIL RISES. THE DRAINAGE SYSTEM BEHIND THE WALL SHOULD BE CONNECTED TO THE MAIN DRAINAGE SYSTEM.

UTILITIES

- 1 THE LOCATION OF UTILITIES SHOWN ON THESE DRAWINGS ARE INDICATIVE ONLY. THE CONTRACTOR SHALL, BEFORE COMMENCING ANY WORKS:
- a DETERMINE THE EXTENT OF EXISTING UTILITY SURVEY AND INFORMATION REFERENCED ON THESE DRAWINGS.
- b OBTAIN CURRENT DIAL BEFORE YOU DIG PLANS AND INFORMATION BY TELEPHONING 1100 OR FAX 1300 682 077 TO ASCERTAIN THE EXACT LOCATION OF UTILITIES.



- c MAKE ANY OTHER ENQUIRIES AS THE CONTRACTOR CONSIDERS NECESSARY TO SATISFY ITSELF AS TO THE EXACT LOCATION OF UTILITY SERVICES; AND
- d ENSURE THAT THE ADOPTED WORK METHOD WILL AVOID DAMAGE TO ALL UTILITIES.
- 2 THE CONTRACTOR SHALL EXERCISE CAUTION WHEN WORKING IN THE VICINITY OF EXISTING
- 3 THIS FIRM WILL NOT BE LIABLE FOR ANY COSTS ARISING FROM DAMAGE TO ANY UTILITY SERVICES CAUSED BY THE CONTRACTOR

TIMBER

- 1 ALL WORKMANSHIP AND MATERIALS ARE TO BE IN ACCORDANCE WITH CURRENT SAA CODES AS1684, AS1720 & AS3959.
- 2 ALL MEMBERS ARE TO BE H2 OR T2 TREATED U.N.O.
- 3 ALL EXTERNAL ABOVE GROUND MEMBERS ARE TO BE H3 TREATED U.N.O.
- 4 ALL HOLES FOR BOLTS ARE TO BE A SNUG FIT. WASHERS ARE TO BE PROVIDED UNDER ALL
- NUTS AND BOLTS AND TO BE A MINIMUM 2.5 TIMES THE DIAMETER OF THE BOLT.
- 5 ALL BOLTED CONNECTIONS ARE TO BE M16 AND NO CONNECTION TO HAVE LESS THAN 2 BOLTS U.N.O.
- 6 ALL BOLTS, NAILS, CLOUTS AND SCREWS ARE TO BE GALVANIZED IN ACCORDANCE WITH RELEVANT AUSTRALIAN STANDARDS.
- 7 ALL CUT ENDS OF MEMBERS ARE TO BE TREATED TO ACHIEVE THE REQUIRED HAZARD PROTECTION LEVEL.
- 8 IT IS THE CONTRACTOR'S RESPONSIBILITY TO ADEQUATELY INSTALL TIE-DOWN CONNECTIONS FROM ROOF TO WALLS VIA TOP PLATE, TOP PLATE TO STUD/MASONRY WALL, STUD WALLS TO FLOOR VIA BOTTOM PLATE AND FROM FLOOR TO FOOTINGS. ALL HOLD DOWN TO ROOF, WALL AND FLOOR FRAMING TO BE IN ACCORDANCE WITH AS1684, AS3700 AND AS4773.
- 9 TERMITE MANAGEMENT SYSTEM TO BE IN ACCORDANCE WITH AS3660.

PILING

- 1 ALL WORKMANSHIP AND MATERIALS TO BE IN ACCORDANCE WITH AS2159.
- 2 REFER TO GEOTECHNICAL REPORT PREPARED BY ALLIANCE GEOTECHNICAL REPORT NUMBER 10441-GR-1-1 REV A DATED 28 FEBRUARY 2020.
- 3 PILES HAVE BEEN DESIGNED FOR THE FOLLOWING GEOTECHNICAL SOIL PARAMETERS INCLUDING ALLOWABLE END BEARING CAPACITY:

ELEMENT	SOIL COHESION Cu (kPa)	PILE SKIN FRICTION (kPa)	SOIL FRICTION ANGLE Ø	SOIL UNIT WEIGTH γ (kN/m3)	END BEARING CAPACITY (kPa)
SCREW PILES	50	50	30	18	200

- 4 THE ABVOE MENTIONED GEOTECHNICAL PARAMETERS ASSUMED FOR DESIGN OF THE PILE FOOTING TO BE APPROVED BY A QUALIFIED GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT OF THE REINFORCEMENT AND /OR CONCRETE.
- 5 DURING INSTALLATION OF FOUNDATIONS AN INDEPENDENT GEOTECHNICAL ENGINEER MUST BE PRESENT TO SATISFY THEMSELF THAT THE CORRECT BEARING HAS BEEN ACHIEVED AND PROVIDE WRITTEN CONFIRMATION.

6 TEMPORARY CASINGS SHALL BE USED, WHERE REQUIRED, AT TH CONTRACTORS EXPENSE.

- 7 BORE HOLES SHALL BE CLEANED OF ANY LOOSE MATERIAL PRIOR TO PLACING CONCRETE OR REINFORCEMENT.
- 8 WHEN CASTING THE PILES, A TREMIE OR CONCRETE PUMP HOSE SHALL BE USED TO LIMIT THE FREE FALL OF CONCRETE TO 1.0 METRE MAX.
- 9 ANY GROUND WATER PRESENT SHOULD BE PUMPED OUT PRIOR TO PLACEMENT OF
- 10 THE CONTRACTOR IS TO COORDINATE THE LOCATION OF ALL UNDERGROUND SERVICES AND TO BE RESPONSIBLE FOR ENSURING THAT THESE ARE EITHER AVOIDED OR RELOCATED AS APPROPRIATE
- 11 BASE OF SOCKET TO BE 2000 BELOW ANY SERVICES LOCATED WITHIN 1000mm OF PILE.

FOR TENDERING PURPOSES ONLY NOT FOR CONSTRUCTION

SILVER WOLF PROJECTS PTY LTD CLIENT: TIMOTHY AND SAMANTHA DONNAN ABN 36 108 257 674 Suite 2/79-87 Princes Highway KOGARAH NSW 2217 Tel/Fax: (02) 9358 2263 Email info@silverwolfprojects.com.au Web www.silverwolfprojects.com.au This drawing and the information contained thereon have been created solely for a particular purpose and client. Silver Wolf Projects provides no warrant and accepts no liability arising from the use of this drawing and information shown thereon for any other purpose. This is protected by copyright and must not be used, reproduced or copied in any form without writter ermission of Silver Wolf Projects. DRAWN DESIGNED M.B 03/03/2020 DRG CHECKED NΗ 03/03/2020 A ISSUED FOR TENDERING 03/03/2020 M.B DΒ DESIGN CHECKED N.H 03/03/2020 DRAWN APPROVED APPROVED DESCRIPTION DATE 03/03/2020


CLIENT:
TIMOTHY AND SAMANTHA DONNAN


PROJECT:
STABILISATION & RETAINING WALL REPLACEMENT
DETAILS
PROJECT ADDRESS:
7 COMEROY CRESCENT, FRENCHS FOREST

DRAWING TITLE
CONSTRUCTION NOTES


PROJECT NUMBER
SWP 1903202
REV
A
HEIGHT DATUM: A.H.D

A A2 SWP-F-08.05 REV A

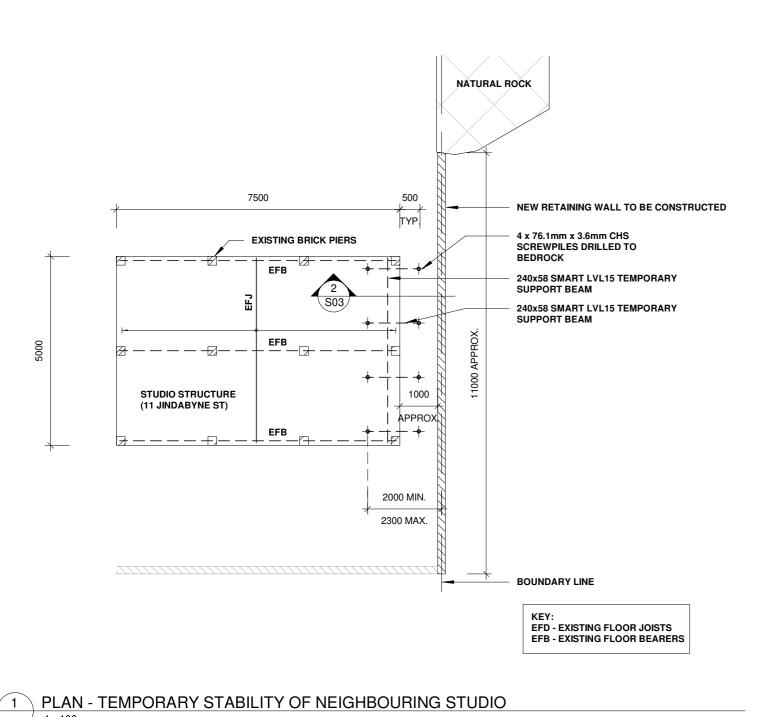


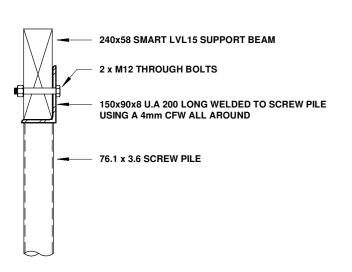

3 DETAIL - SCREW PILE TO SUPPORT BEAM

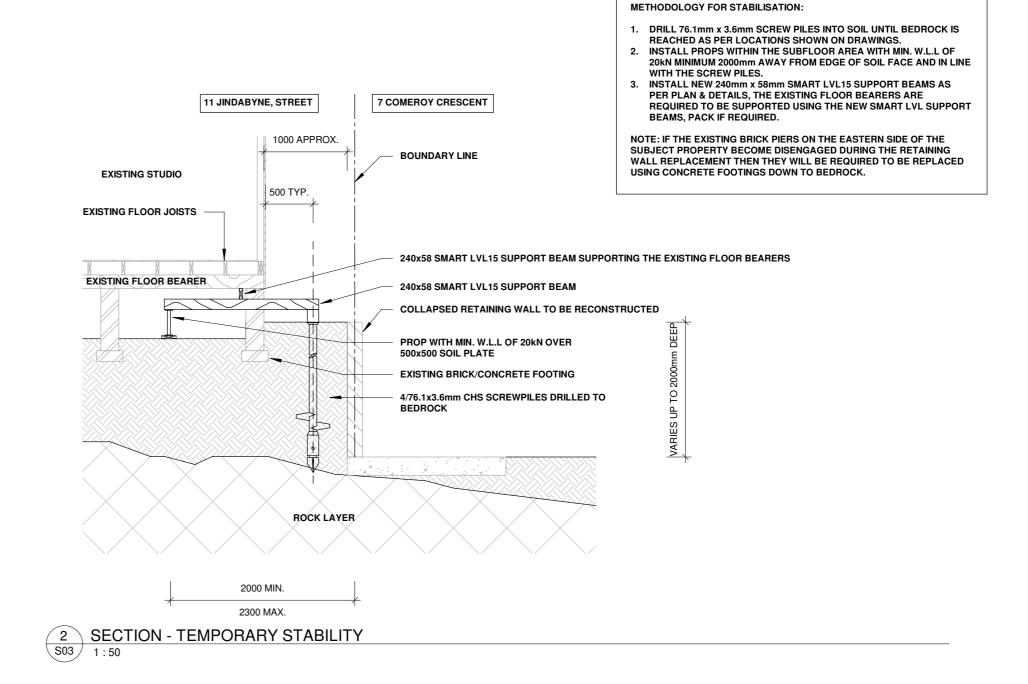

FOR TENDERING PURPOSES ONLY NOT FOR CONSTRUCTION

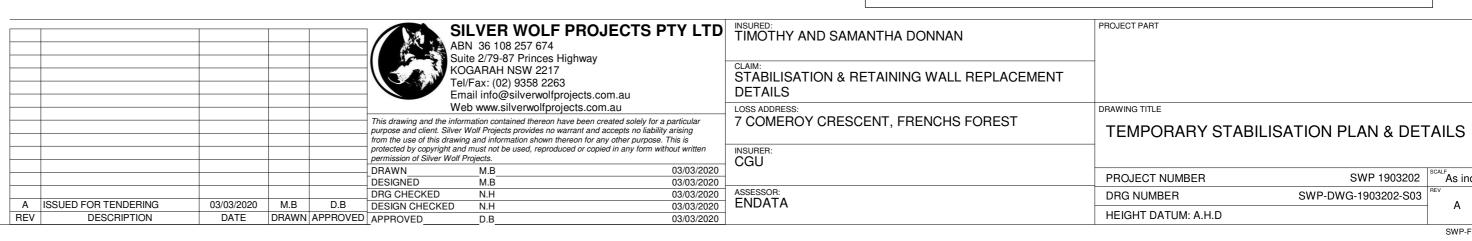


SWP-F-08.05 REV A

As indicated

- ALL BLOCKS ARE TO BE 200 SERIES.
 ALL CORES 20MPa FULLY GROUTED WITH MINIMUM 300 kg/m3 CEMENT CONTENT.
 CLEAN OUT BLOCKS TO BE USED FOR BOTTOM COURSE.
- 4. ALL BARS TO HAVE 50 mm COVER FROM OUTSIDE CONCRETE SURFACE.
- 5. RETAINING WALL HAS BEEN DESIGNED FOR THE FOLLOWING GEOTECHNICAL PARAMAETERS AS PER GEOTECHNICAL REPORT BY ALLIANCE GEOTECHNICAL REPORT NUMBER

GEOTECHNICAL PARAMETERS

GRANULAR COHESSIONLESS (Cu= 0) UNIT WEIGHT (Y)= 17 kN/m3 ANGLE OF FRICTION (Φ) = 26° BEARING CAPACITY = 100 kPa

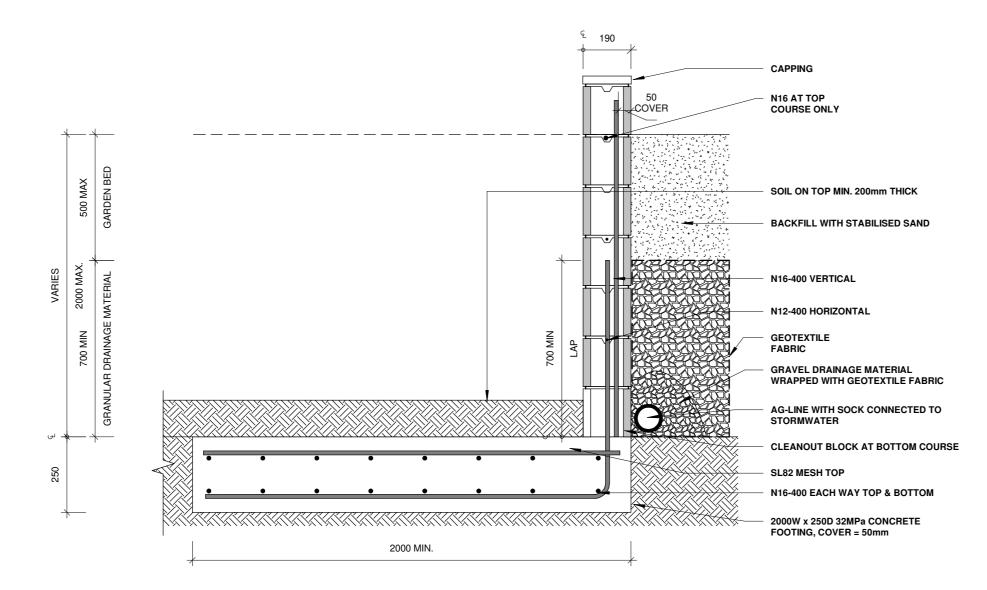

TYPICAL RETAINING WALL DETAIL

FOR TENDERING PURPOSES ONLY NOT FOR CONSTRUCTION

				SI	LVER WOLF PRO	DJECTS PTY LTD	INSURE
							TIIVIC
						ly .	CLAIM:
				Tel	/Fax: (02) 9358 2263		STAE DET/
							LOSS A
				This drawing and the inforr	mation contained thereon have beer	n created solely for a particular	7 CO
						opied in any form without written	INSURE
				DRAWN	M.B	03/03/2020	odo
				DESIGNED	M.B	03/03/2020	
				DRG CHECKED	N.H	03/03/2020	ASSESS
ISSUED FOR TENDERING	03/03/2020	M.B	D.B	DESIGN CHECKED	N.H	03/03/2020	END
/ DESCRIPTION	DATE	DRAWN	APPROVED	APPROVED	D.B	03/03/2020	
					This drawing and the infor purpose and client. Silver from the use of this drawin protected by copyright and permission of Silver Wolf In DRAWN DESIGNED DRAWN DESIGNED DRG CHECKED ISSUED FOR TENDERING 03/03/2020 M.B D.B DESIGN CHECKED	ABN 36 108 257 674 Suite 2/79-87 Princes Highwa KOGARAH NSW 2217 Tel/Fax: (02) 9358 2263 Email info@silverwolfprojects. Web www.silverwolfprojects. Web www.silverwolfprojects. or This drawing and the information contained thereon have been purpose and client. Silver Wolf Projects provides no warrant a from the use of this drawing and information shown thereon for protected by copyright and must not be used, reproduced or or permission of Silver Wolf Projects. DRAWN M.B. DESIGNED M.B. DESIGNED N.H ISSUED FOR TENDERING 03/03/2020 M.B D.B DESIGN CHECKED N.H	Suite 2/79-87 Princes Highway KOGARAH NSW 2217 Tel/Fax: (02) 9358 2263 Email info@silverwolfprojects.com.au Web www.silverwolfprojects.com.au Web www.silverwolfprojects.com.au This drawing and the information contained thereon have been created solely for a particular purpose and client. Silver Wolf Projects provides no warrant and accepts no liability arising from the use of this drawing and information shown thereon for any other purpose. This is protected by copyright and must not be used, reproduced or copied in any form without written permission of Silver Wolf Projects. DRAWN M.B 03/03/2020 DESIGNED M.B 03/03/2020 DESIGNED N.B 03/03/2020 ISSUED FOR TENDERING 03/03/2020 M.B D.B DESIGN CHECKED N.H 03/03/2020

D	INSURED: TIMOTHY AND SAMANTHA DONNAN	PROJECT PART
	STABILISATION & RETAINING WALL REPLACEMENT DETAILS	
	LOSS ADDRESS: 7 COMEROY CRESCENT, FRENCHS FOREST	RETAINING WALL DETAILS
20	INSURER: CGU	PROJECT NUMBER SWP 1903202 SCALE 1 : 15
20	ASSESSOR: ENDATA	DRG NUMBER SWP-DWG-1903202-S04 REV A2 SIZE A2
20		HEIGHT DATUM: A.H.D