

LOT 29  
Sec J  
DP 12297

PIPE SCHEDULE		
REFER TO NOTES FOR PIPE CLASS		
TAG	PIPE DIA.	MIN.GRADE
B1	100	1%
B2	100	2%
B3	100	3%
C1	150	1%
C2	150	3%
C3	150	5%

# GROUND FLOOR LAYOUT

REFER TO SHEET 2 FOR RAINWATER TANK DETAILS. LEAF GUTTER GUARDS OR SIMILAR SCREENING RECOMMENDED TO ALL GUTTERS. BOX GUTTERS AND RW/H/S TO BE DETAILED BY SUPPLIER/INSTALLER IN ACCORDANCE WITH AS3500 U.N.O. WHSA HAZARD IDENTIFICATION: TRENCHING-ALL PERSONS TO FOLLOW THEIR APPROVED SWMS IN RELATION TO BARRICADING DEEP TRENCHES AND WEARING APPROPRIATE CLOTHING. ANY PERSON WORKING INSIDE A TRENCH MUST BE SUPERVISED BY ANOTHER PERSON. DIAL BEFORE YOU DIG 1100 MUST BE CHECKED BEFORE ANY TRENCHING COMMENCES ON SITE. ANY WORKS NEAR IDENTIFIED SERVICES TO BE CARRIED OUT IN ACCORDANCE WITH THE TRADES SWMS. INSTALLATION OF DOWNPIPES AND GUTTERING TO BE CARRIED OUT IN ACCORDANCE WITH INSTALLERS APPROVED SWMS.


MIN. 100,000LITRE- RAINWATER TANK PROVIDE 120000L RAINWATER TANK WITH PUMPS TO SUPPLY GARDEN TAPS AND INTERNAL RE-USE TO BE CONNECTED AS PER ARCHITECTURAL DETAILS, BASIX ASSESSMENT AND WATER AUTHORITY GUIDELINES. Overflow pipe to Pit P1. LOCATION SHOWN DIAGRAMMATIC ONLY. MIN. Overflow RL.145.90m Outlet to be mosquito proofed. All exposed pipework to be painted to withstand external elements. PIPE INLETS AND OUTLETS AS PER DETAILS ON SHEET 2.

120000L TANK - 8400DIA.x2100HIGH

8m x 250x250 GRATED DRAIN

PIPEWORK TO BE CUT INTO ROCK. PIPEWORK MUST HAVE 100mm COVER AT TOE OF EMBANKMENT TO ENTER SIDE OF DRAIN

OWNER/LANDSCAPER RESPONSIBLE TO ENSURE 250mm DEPTH SOILS DOWNSTREAM FOR A MIN. 2m TO BE REPLACED WITH SANDY TOPSOIL TO ENSURE LEVEL SPREADER MAINTAINED

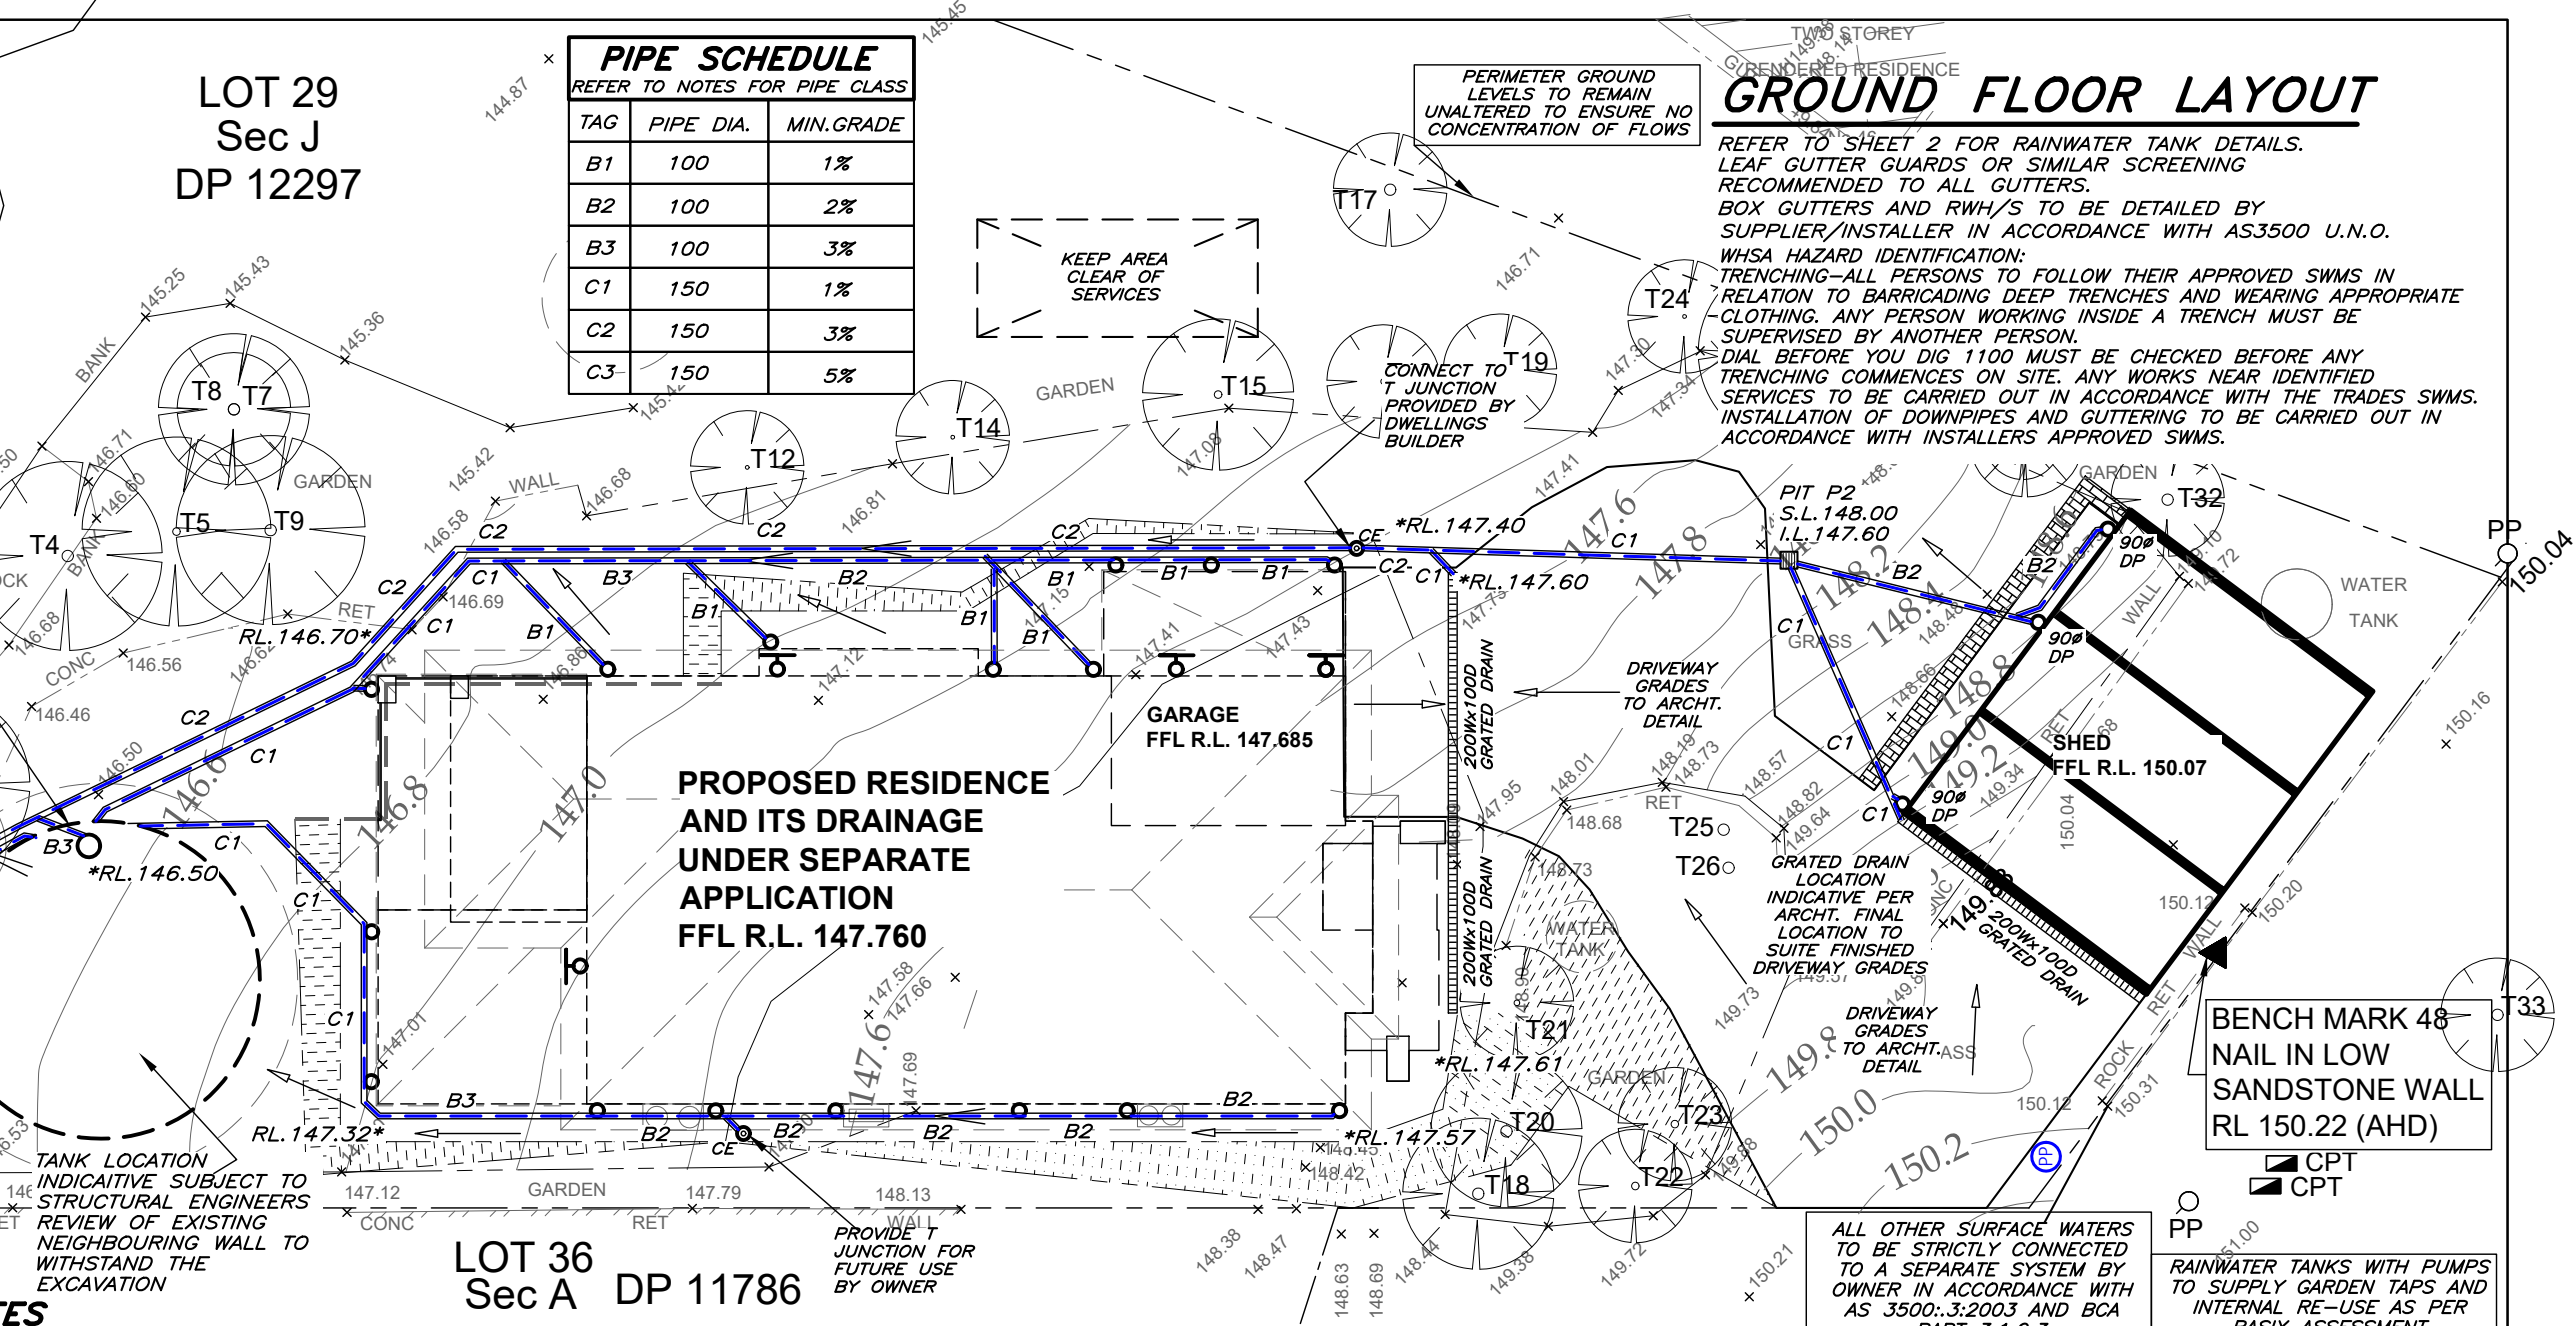

PROPOSED RESIDENCE AND ITS DRAINAGE UNDER SEPARATE APPLICATION FFL R.L. 147.760

GARAGE FFL R.L. 147.685

SHED FFL R.L. 150.07

LOT 36  
Sec A  
DP 11786

BENCH MARK 48 NAIL IN LOW SANDSTONE WALL RL 150.22 (AHD)

## STORMWATER LAYOUT NOTES

- PITS UP TO 450 DEEP TO BE 350SQ U.N.O., PITS UP TO 600 DEEP TO BE 450 SQ U.N.O., PITS UP TO 900 DEEP TO BE 600 SQ U.N.O., PITS UP TO 1200 DEEP TO BE 900 x 600 U.N.O., PITS EXCEEDING 1200 DEEP TO BE 900 SQ. U.N.O. PITS TO BE PRECAST CONCRETE OR RENDERED BRICK WITH CONCRETE HEAVY DUTY GRATES. U.N.O. LIGHT DUTY PITS AND GRATES MAY BE USED ONLY IN LIGHT/FOOT TRAFFICABLE AREAS. U.N.O. ALL PITS TO BE BENCH TO DISCHARGE PIPES U.N.O. GAL. STEP IRONS TO ALL PITS EXCEEDING 900 DEPTH. COVER AND SUMP GRATES SHALL COMPLY WITH AS2733 & AS4198.
- DOWNPIPES TO BE 90 DIA IF CHARGED AND 100 x 50 BOX IF GRAVITY. U.N.O. DP'S SHALL BE INSTALLED IN ACCORDANCE WITH AS3500.3.2.4.11 & AS4198. MAX. ROOF AREA PER DOWNPIPE WITH A NOMINATED GUTTER SIZE TO BE DETERMINED USING MANUFACTURERS SPECIFICATIONS WITH OVERFLOW PROVISIONS BY INSTALLERS.
- PIPES TO HAVE 1% MIN.GRADE U.N.O. BY PIT INVERTS. PIPES TO BE V.C. CLASS 'X' OR U.P.V.C. CLASS STORMWATER PIPE TO AS1254,1260,1273,1477,2179.2 AND WHERE EXPOSED TO DIRECT SUNLIGHT TO HAVE ADEQUATE PROTECTION TO U.V. RADIATION IN ACCORDANCE WITH AS2032. SEWER GRADE/GAL. PIPES AND KERB ADAPTORS TO BE USED WHERE COUNCIL POLICY OR CONSENT REQUIRE SUCH.
- GUTTER OUTLETS SHALL BE FITTED VERTICALLY TO THE SOLE OF THE EAVE GUTTERS. RAINHEADS/BOX GUTTER SUMPS TO HAVE AN OVERFLOW DUCT OR WEIR IN ACCORDANCE WITH AS3500.
- PROVIDE OVERFLOW SPITTERS TO ALL COVERED BALCONIES/ TERRACES. NOT TO BE DIRECTED ON TO ROOF SURFACES
- RISING MAINS (PRESSURE PIPE) TO BE IN ACCORDANCE WITH AS3500.1.2.
- SUBSOIL DRAINS TO BE IN ACCORDANCE WITH AS2439.1 CLASS 100 TO BE USED ONLY IN SINGLE DWELLINGS.
- ALL PIPE JOINTS, VALVES TO BE IN ACCORDANCE WITH AS3500.3.2.2.7 & AS3500.3.2
- EXPANSION JOINTS SHALL COMPLY WITH AS3500.3.2:TABLE 4.1 PVC JOINTS AND ACCESSORIES TO COMPLY WITH AS2179.2 & AS4198.

- ALL TRENCHES TO BE IN ACCORDANCE WITH AS3500.3.2:7.2.8-14. EMBEDMENT MATERIAL AND TRENCH FILL TO ALL PIPES & SUBSOIL DRAINS TO BE IN ACCORDANCE WITH AS3500.3.2:7. ALL WORKS TO BE IN ACCORDANCE WITH AS1254, 1741, 2032, 2733, 2865, 3996, 1260, 1477, 2179.1 & 2,2566, 6367, 8301, ARR97 & BCA.
- IT IS THE BUILDER'S RESPONSIBILITY TO CONFIRM THAT LEVELS AND SURVEYS ARE IN ACCORDANCE WITH LEVELS ON SITE & ARE APPROVED BY COUNCIL & ARCHITECT BEFORE COMMENCING WORK.
- NO SEWER VENTS, GULLY PITS OR SIMILAR TO BE LOCATED BELOW THE MAXIMUM WATER SURFACE LEVEL IN DETENTION BASINS. ALL BASIN WALLS TO BE WATERTIGHT & STRUCTURALLY DESIGNED BY A STRUCTURAL ENGINEER.
- ALL FENCES WHICH MAY DIVERT FLOW FROM PROPOSED DIRECTION TO BE RAISED 100mm.
- BUILDER TO ENSURE ALL DRAINAGE AREAS INCLUDING EXPOSED BALCONIES TO HAVE OVERFLOW MECHANISM IN PLACE IN THE EVENT OF BLOCKAGE WITH ADEQUATE OVERFLOW SECTION THROUGH PLANTERS, PARAPETS ETC.
- ALL EXTERIOR FINISHED GROUND LEVELS TO BE SLOPING AWAY FROM PERIMETER WALLS IN ALL CASES.
- ALL HEADROOM CLEARANCES TO BE COORDINATED BETWEEN BUILDER & ARCHITECT. NOTIFY ENGINEER FOR APPROVAL IF ANY CHANGES OCCUR.
- ALL GULLY POSITIONS ARE DIAGRAMMATIC ONLY- BUILDER SHOULD CONSULT ARCHITECTURALS FOR DIMENSIONS TO LOCATE STORMWATER ELEMENTS U.N.O.
- FIRE RATING TO ARCHITECT'S SPECIFICATION.
- ALL FINISHED FLOOR LEVELS ARE NOMINATED BY ARCHITECT.
- ALL SITE SAFETY MEASURES AND WORK METHOD STATEMENTS PREPARED BY BUILDER/SUB-CONTRACTORS ARE TO BE IMPLEMENTED DURING CONSTRUCTION. NO WORK IS TO COMMENCE UNTIL ALL WORKERS CARRY OUT SITE INDUCTION, PREPARED AND CARRIED OUT BY BUILDER. ANY HAZARD IDENTIFICATION TO BE REPORTED IMMEDIATELY TO SITE SUPERVISOR TO CARRY OUT NECESSARY PROCEDURES TO ELIMINATE HAZARD, PRIOR TO PROCEEDING WITH WORK. STRUCTURAL AND GEOTECHNICAL ADVICE SHOULD BE SOUGHT IN ALL CASES.
- CONFINED SPACES SIGNAGE TO BE INSTALLED IN ACCESSIBLE UNDERGROUND TANKS TO WORK COVER SPECIFICATIONS. ALL PITS EXCEEDING 600mm DEPTH TO HAVE 'J' BOLTS OR SIMILAR INSTALLED TO GRATES.
- MAINTENANCE DEVICES REQ'D BY AUTHORITIES ARE NOT TO BE ASSUMED SHOWN ON DRAWINGS.
- EARTH MOUNDING SHOWN AS TEMPORARY MEASURE UNTIL LANDSCAPING COMPLETED TO DIRECT FLOWS AS SHOWN.


ALL OTHER SURFACE WATERS TO BE STRICTLY CONNECTED TO A SEPARATE SYSTEM BY OWNER IN ACCORDANCE WITH AS 3500.3:2003 AND BCA PART 3.1.2.3.

RAINWATER TANKS WITH PUMPS TO SUPPLY GARDEN TAPS AND INTERNAL RE-USE AS PER BASIX ASSESSMENT

## LEGEND

REFER TO NOTES FOR DP SIZE	
R.L. 0.00 (NEW FINISHED GROUND LEVEL)	○ DP DOWNPIPE-SIZE REFER TO NOTES FOR DP SIZE
+ 00.00 EXISTING LEVEL	⊕ GP GULLY PIT
S.L. 0.00 SURFACE LEVEL	⊕ GP GARDEN GULLY PIT
I.L. 0.00 INVERT LEVEL	≡ O/F OVERFLOW-200x100
T.O.W. TOP OF WALL LEVEL	⊠ RW/H/S RAIN WATER HEAD/SUMP
G.F.L. 0.00 GARAGE FLOOR LEVEL	⊕ SP DP WITH SPREADER
F.F.L. 0.00 FINISHED FLOOR LEVEL	⊕ BG BALCONY GULLY PIT
A,B,C etc. SEE PIPE SCHEDULE	⊕ CE CLEANING EYE
L1 PIPE LABEL	⊕ GF GROUND FALL
PIT P1 SURFACE INLET PIT	⊕ 100 HIGH EARTH MOUNDING
PIT OP1 OVERLAND FLOW PIT	
90mm. AG. LINE	

THIS DRAWING IS DIAGRAMMATIC ONLY & NOT TO BE SCALED. IT IS NOT A PART 4A CERT. REFER TO ARCHITECT'S DRAWINGS FOR DIMENSIONS. COPYRIGHT IN THIS DRAWING IS THE PROPERTY OF IBRAHIM STORMWATER CONSULTANTS AND THE DRAWING SHALL NOT BE REPRODUCED OR COPIED, WHOLE OR IN PART, IN ANY FORM WITHOUT THE PRIOR WRITTEN APPROVAL OF IBRAHIM STORMWATER CONSULTANTS



REVISIONS	

ISSUE	PRINTS	ISSUED TO	DATE
1	EMAIL	BUILDER/CLIENT	25-3-24

SCALE (A3) 1:200, 100 u.n.o.  
SCALE BAR - 1m INTERVALS  
DATE DEC. 2023  
DRAWN M.I.  
DESIGNED M.I.  
APPROVED




**IBRAHIM STORMWATER CONSULTANTS**  
**CONSULTING CIVIL ENGINEERS**  
P.O. BOX 400 CHERRYBROOK NSW 2126  
TELEPHONE: (02) 9980 5515 FAX: (02) 9980 6114  
www.stormwater.net.au email: mail@stormwater.net.au

PROJECT  
**PROPOSED SHED AT 48 LAUREL ROAD INGLESIDE FOR MRS & MR COUROUZOS**

THIS DRAWING JOB NUMBER  
**STORMWATER LAYOUT SH.1 M11647-743660**  
BUILDER SHEET No. REVISION  
METRICON HOMES **1 of 2**

**PANTHER REINFORCED CONCRETE WATER RECYCLING SYSTEM**

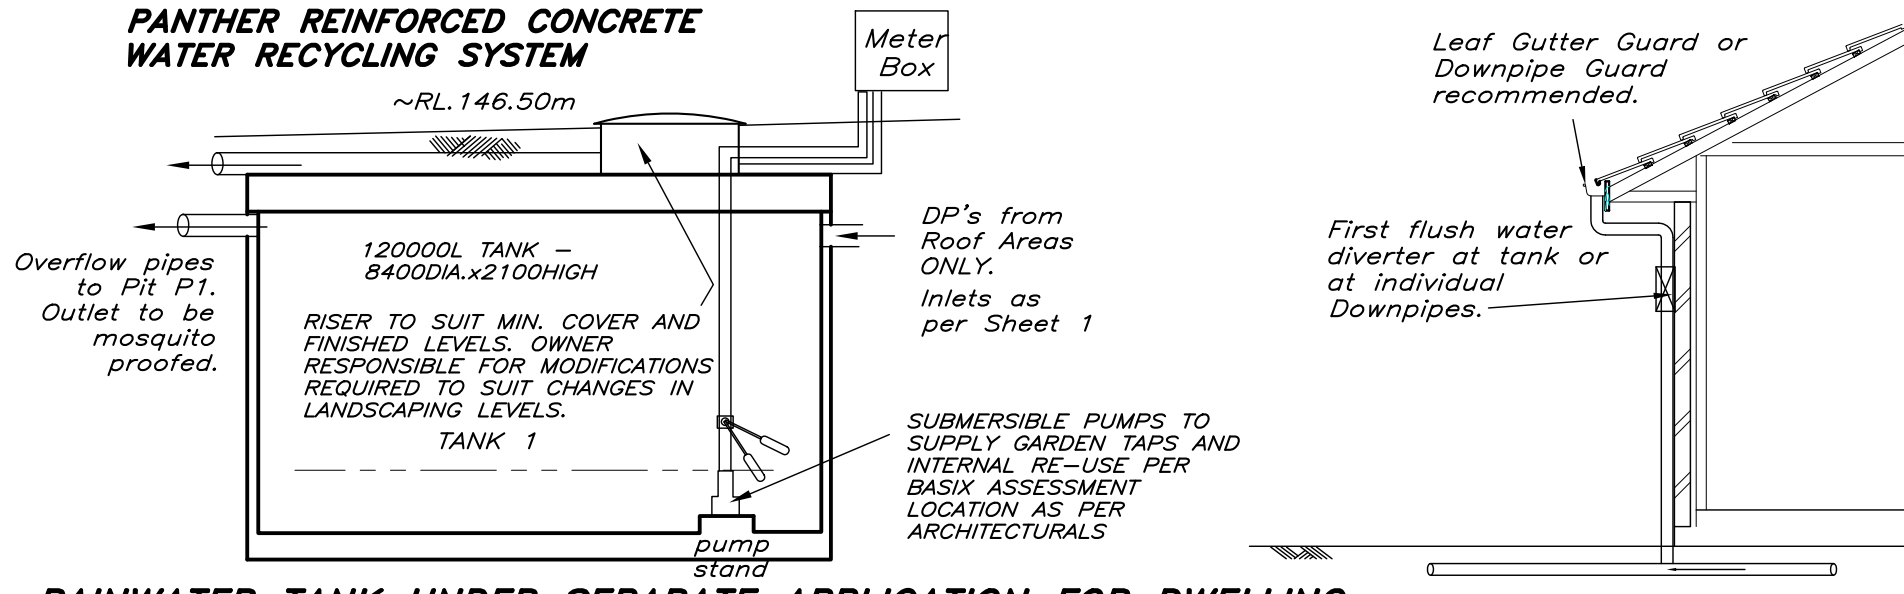


BUILDER/CLIENT TO ENSURE THAT ALL SAFETY MEASURES ARE TAKEN DURING CONSTRUCTION, INCLUDING BUT NOT LIMITED TO, SAFETY FENCING, SIGNAGE, OBTAINING STRUCTURAL AND GEOTECHNICAL ADVICE WHERE EXCAVATIONS ARE NEAR STRUCTURES OR SERVICES, SAFETY MEASURES RECOMMENDED BY PRODUCT SUPPLIERS ETC.

**RAINWATER TANK UNDER SEPARATE APPLICATION FOR DWELLING**

TANK DETAILS SHOWN ARE A SUGGESTED CONFIGURATION ONLY. ANY MODIFICATIONS TO TANK VOLUME OR INLET AND OUTLET LEVELS MUST BE APPROVED BY ENGINEER PRIOR TO COMMENCEMENT OF CONSTRUCTION. TANK SHAPE, & DEVICES SHOWN ARE DIAGRAMMATIC ONLY. MINIMUM OF 450 CLEARANCE (UNLESS L.G.A. REQUIRES LARGER SETBACK) TO SIDE BOUNDARIES MUST BE MAINTAINED. CLIENT IS RESPONSIBLE TO ENSURE COMPLIANCE WITH THIS IN THE INSTALLED STATE.


Charged stormwater lines from Roof Areas ONLY to rainwater tank.  
 All joints to be solvent welded. All exposed pipework to be painted to withstand external elements.  
 First flush water diverter at tank to comply with Water Authority and council DCP's. An approved switch system similar to 'Rainbank' to be used via mains. Pumps to manuf. specs.  
 Rain Tank to be installed and maintained to manufacturers specifications and to comply with all Water Authority Guidelines.  
 Client to be responsible for maintenance system of charged pipelines. Debris accumulation significantly affects systems performance. Maintenance program essential.  
 Structural details for tank base by manufacturer or others.

WHS HAZARD IDENTIFICATION:  
 DEEP TRENCHING—ALL PERSONS TO FOLLOW THEIR SWMS IN RELATION TO BARRICADING DEEP TRENCHES AND WEARING APPROPRIATE CLOTHING. ANY PERSON WORKING INSIDE A TRENCH MUST BE SUPERVISED BY ANOTHER PERSON IN ACCORDANCE WITH COVER AND WORKING IN CONFINED SPACES.  
 DIAL BEFORE YOU DIG 1100 MUST BE CHECKED BEFORE ANY TRENCHING COMMENCES ON SITE. ANY WORKS NEAR IDENTIFIED SERVICES TO BE CARRIED OUT IN ACCORDANCE WITH THE TRADES SWMS.  
 INSTALLATION OF RAIN TANKS: PLUMBER/SITE SUPERVISOR TO ASSESS ACCESS SUITABILITY PRIOR OR POST SLAB CONSTRUCTION. INSTALLATION OF TANKS TO BE CARRIED OUT FOLLOWING SWMS OF TANK SUPPLIER AND PLUMBER. GEOTECHNICAL INVESTIGATIONS FOR BELOW GROUND TANKS TO BE CARRIED OUT BY APPROPRIATELY QUALIFIED PERSONAL IN RELATION TO SUITABLE BATTERS OR SHORING.

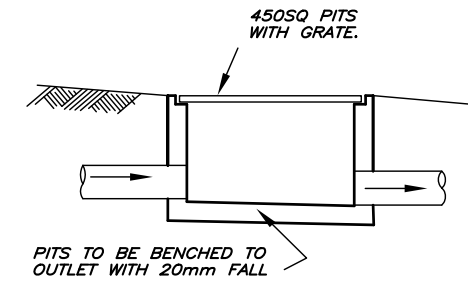


**TYPICAL PIT DETAIL**

NOT TO SCALE

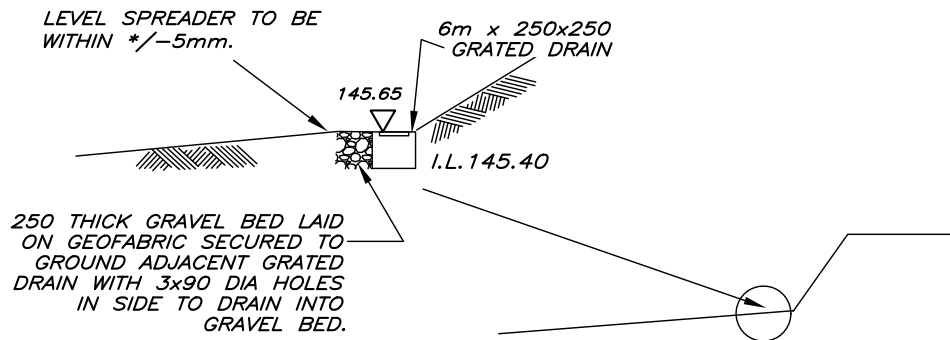


**SECTION 1 - LEVEL SPREADER UNDER SEPARATE APPLICATION FOR DWELLING**

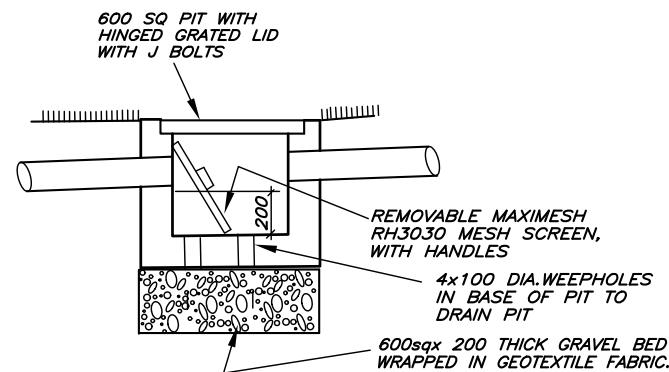

**SILT ARRESTOR PIT - P1**

WHS ALL NEARBY SERVICES TO BE LOCATED PRIOR EXCAVATIONS. ALL PIPES TO BE CUT FLUSH WITH PIT WALLS AND SPARGED. PITS EXCEEDING 600mm IN DEPTH TO HAVE LOCK DOWN MECHANISM. SAFETY GEAR TO BE WORN AT ALL TIMES. INCLUDING FOOTWEAR, CLOTHING AND GLOVES AS PER SWMS.

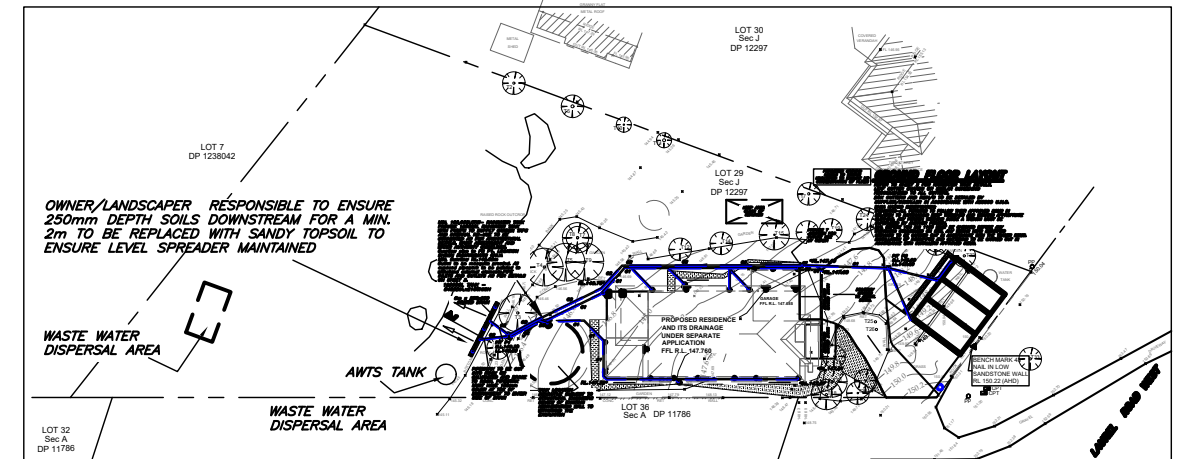

**LOCALITY PLAN**

NOT TO SCALE

THIS DRAWING IS DIAGRAMMATIC ONLY & NOT TO BE SCALED. IT IS NOT A PART 4A CERT. REFER TO ARCHITECTS DRAWINGS FOR DIMENSIONS. COPYRIGHT IN THIS DRAWING IS THE PROPERTY OF IBRAHIM STORMWATER CONSULTANTS AND THE DRAWING SHALL NOT BE REPRODUCED OR COPIED, WHOLE OR IN PART, IN ANY FORM WITHOUT THE PRIOR WRITTEN APPROVAL OF IBRAHIM STORMWATER CONSULTANTS

REVISIONS	

ISSUE	PRINTS	ISSUED TO	DATE
1	EMAIL	BUILDER/CLIENT	25-3-24

SCALE (A3) 1:200, 100 u.n.o.  
 SCALE BAR - 1m INTERVALS  
 DATE DEC . 2023  
 DRAWN M.I.  
 DESIGNED M.I.  
 APPROVED



**IBRAHIM STORMWATER CONSULTANTS CONSULTING CIVIL ENGINEERS**

P.O. BOX 400 CHERRYBROOK NSW 2126  
 TELEPHONE: (02) 9980 5515 FAX: (02) 9980 6114  
 www.stormwater.net.au email: mail@stormwater.net.au

PROJECT  
**PROPOSED SHED AT 48 LAUREL ROAD INGLESIDE FOR MRS & MR COUROUZOS**

THIS DRAWING JOB NUMBER  
**STORMWATER DETAILS SH.1 M11647-743660**  
 BUILDER SHEET No. REVISION  
 METRICON HOMES **2 of 2**