



**DRIVEWAY CONCEPT PLAN**  
SCALE 1:200

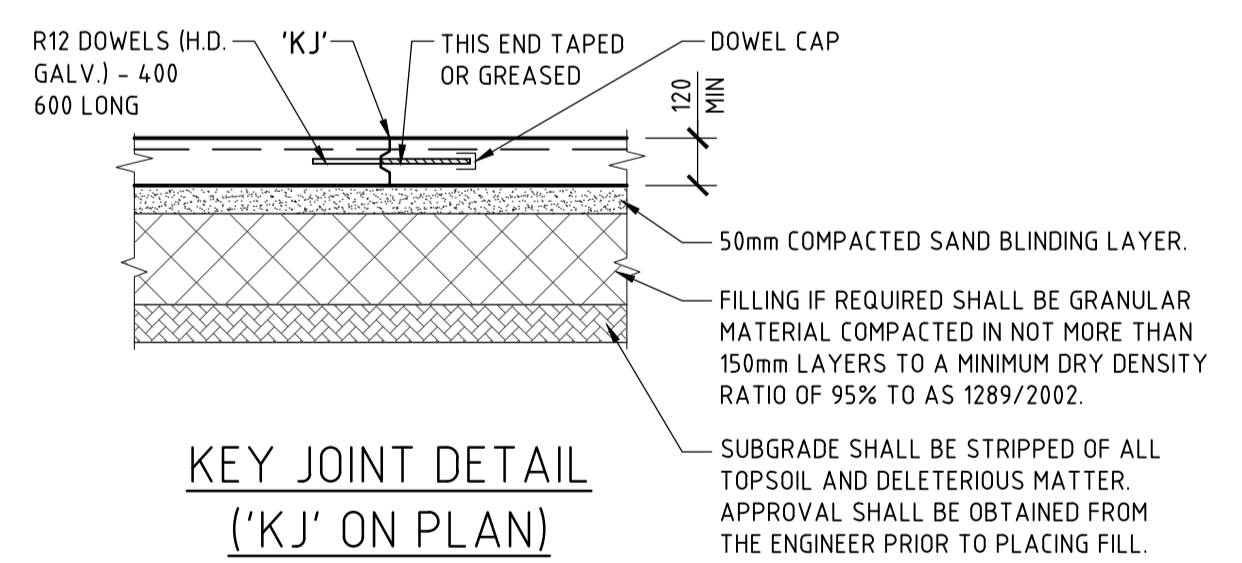


**KEY JOINT DETAIL**  
('KJ' ON PLAN)  
SCALE 1:20

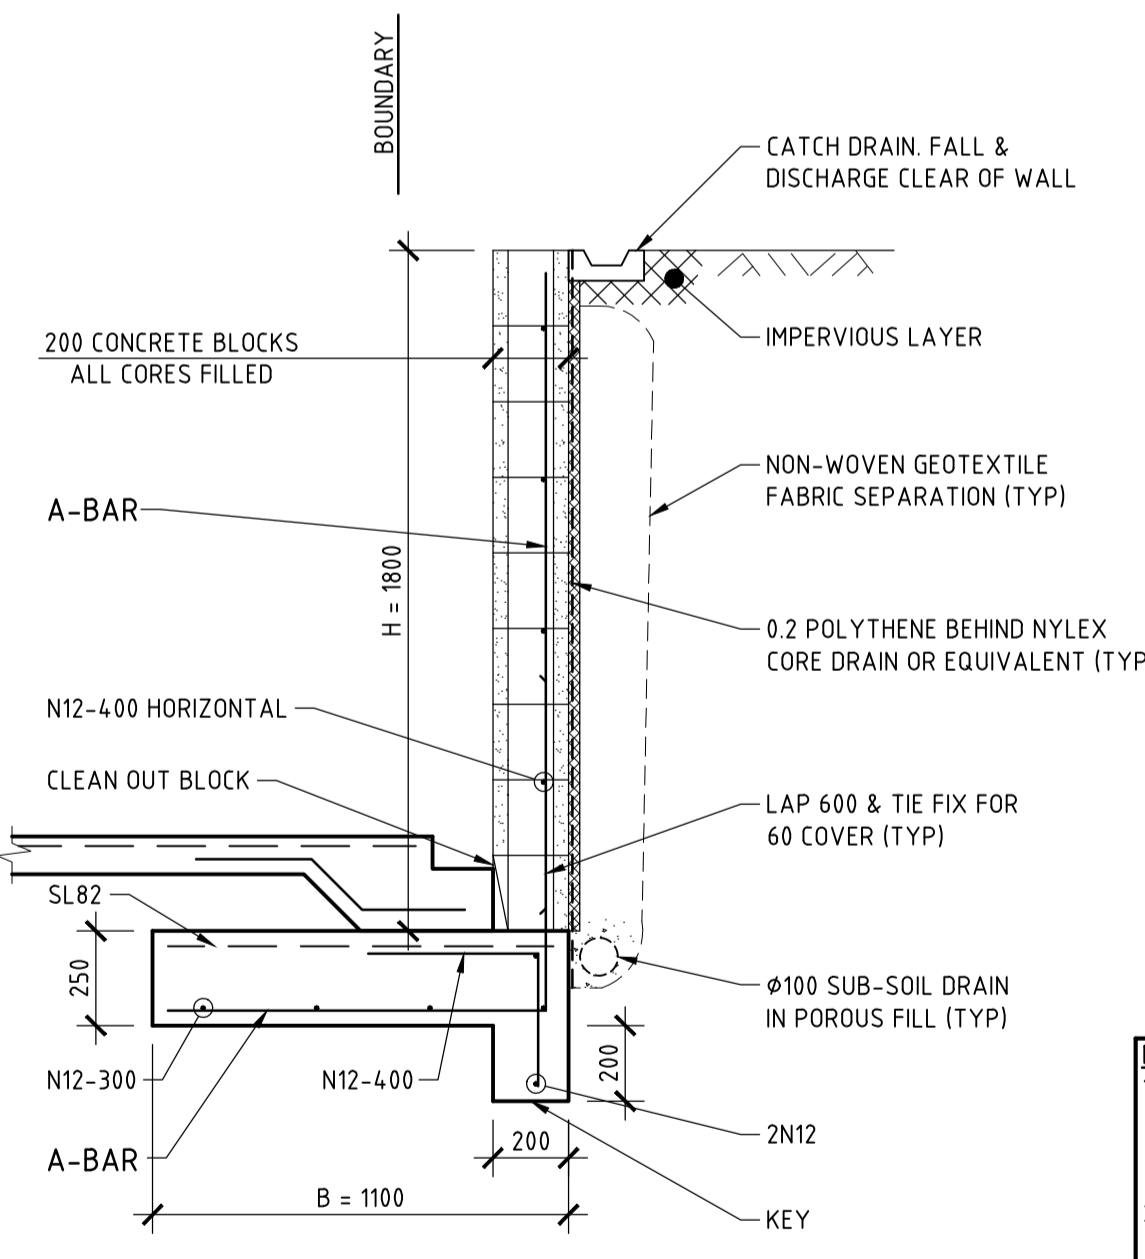

H	B	A-BAR
UP TO 1000	750	N12 - 400
UP TO 1400	900	N16 - 400
UP TO 1800	1100	N16 - 400

**TYPICAL 1.8m BLOCK RETAINING WALL TO FIRM NATURAL GROUND**

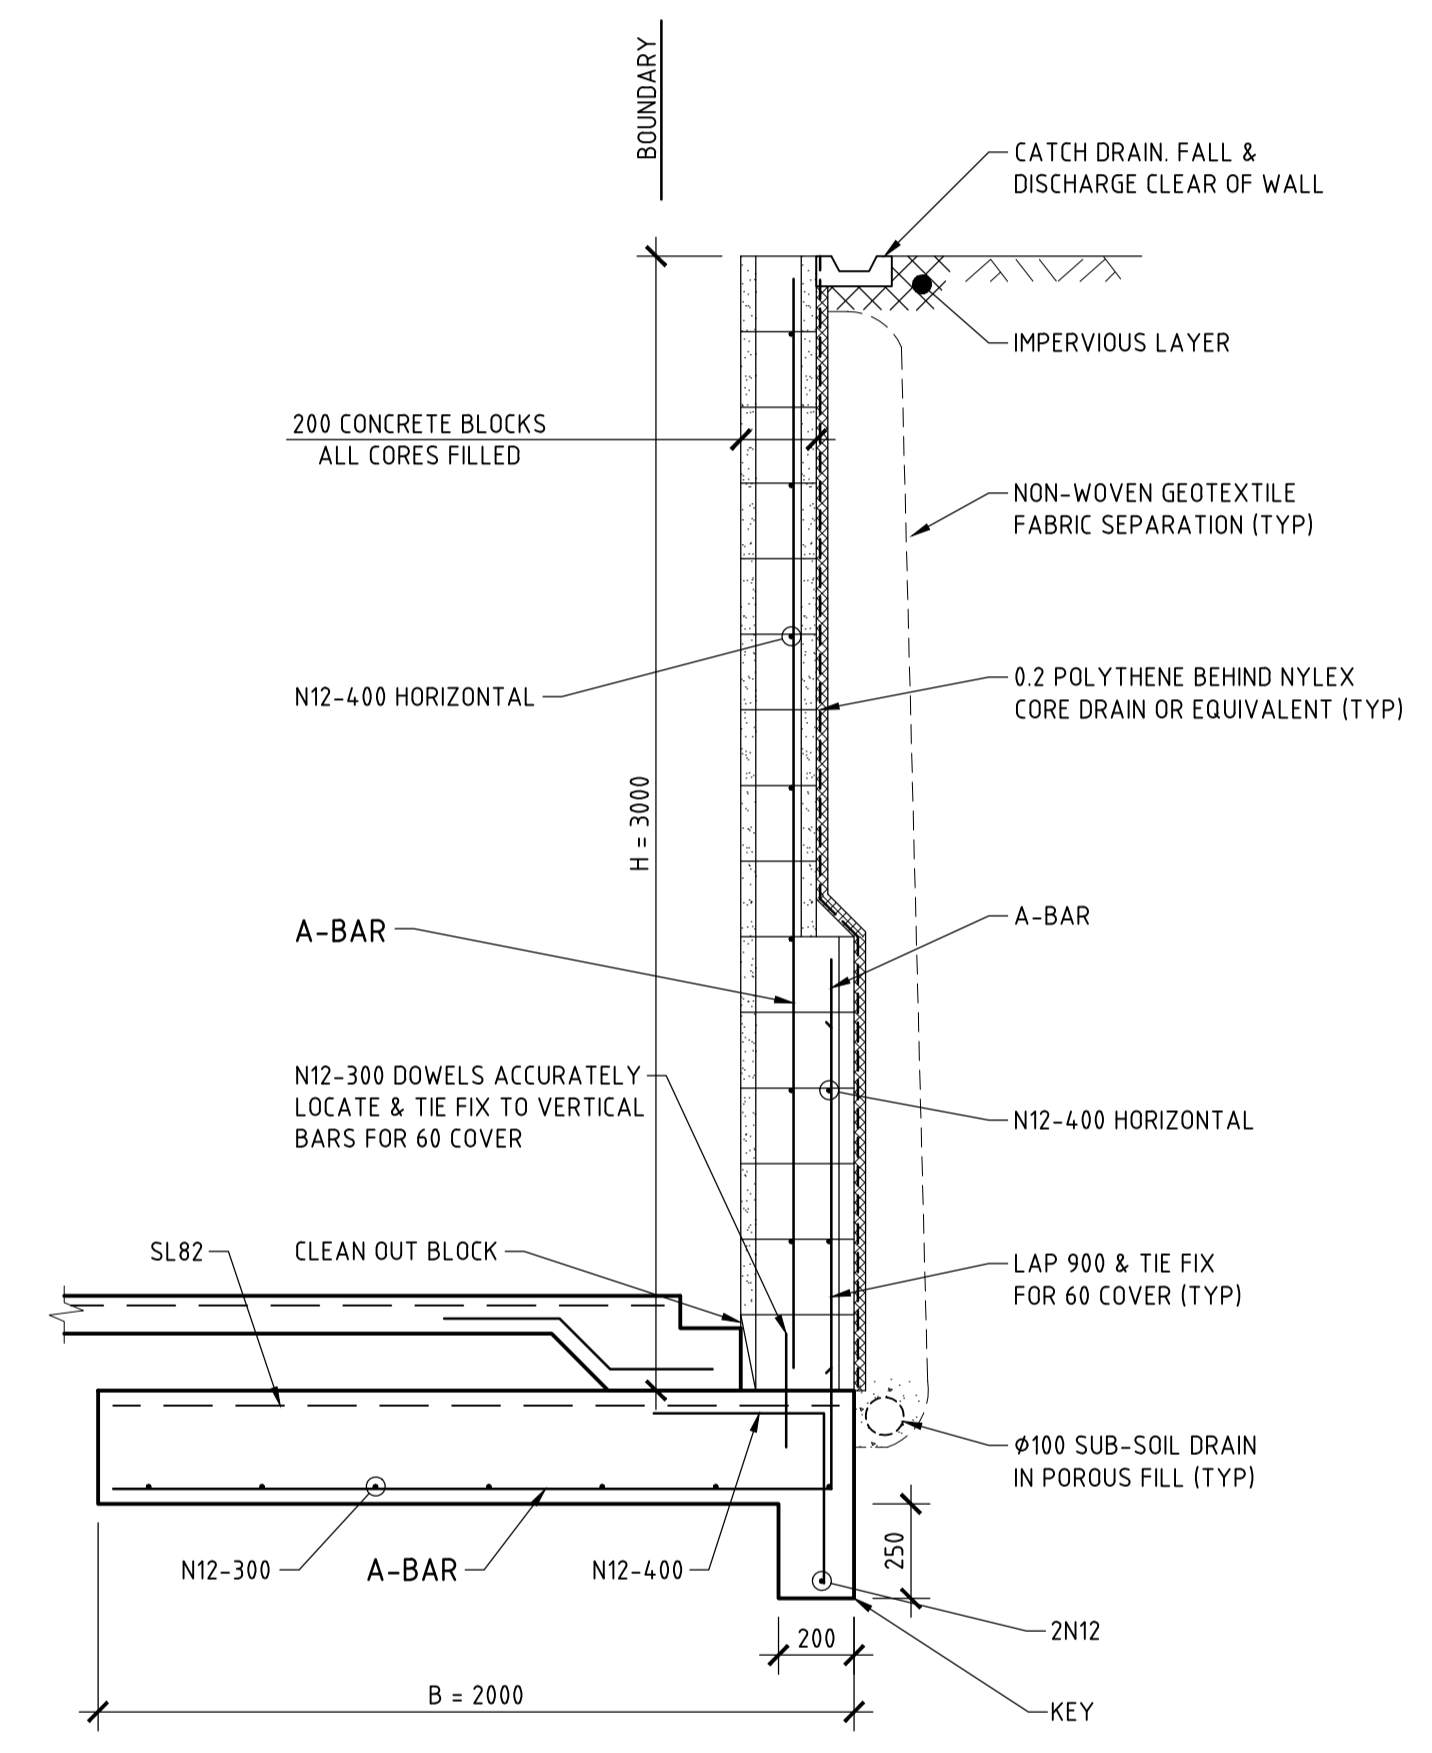

H	B	A-BAR
UP TO 2200	1400	N16 - 400
UP TO 2600	1700	N16 - 200 OR N20 - 400
UP TO 3000	2000	N20 - 200 OR N24 - 400

**TYPICAL 3.0m BLOCK RETAINING WALL TO FIRM NATURAL GROUND**

- NOTES:**
- MORTAR FINS PROTRUDING INTO CORES TO BE REMOVED BEFORE GROUTING AND CLEAN OUT OPENINGS TO BE PROVIDED TO ALLOW REMOVAL OF DEBRIS AND TYING OF REINFORCEMENT.
  - VERTICAL REINFORCEMENT TO BE ACCURATELY POSITIONED CONSISTENT WITH COVER REQUIREMENTS.
  - GROUT TO BE COMPACTED BY RODDING WITH A PLAIN ROUND BAR OR VIBRATOR.
  - HEIGHT OF CORE GROUTING NOT TO EXCEED 3.0m.
  - VERTICAL EXPANSION JOINT TO BE PROVIDED AT 8m MAX CENTRES. HORIZONTAL BARS TO STOP 50mm SHORT OF JOINT AND A R12 (H.D. GALV) BAR 600 LONG WITH ONE END TAPED OR GREASED IS TO BE LAID THROUGH JOINTING AND LAPPED TO HORIZONTAL BARS.

- ABBREVIATIONS**
- U.O.N. UNLESS OTHERWISE NOTED
  - T TOP
  - B BOTTOM
  - H.D. HOT DIPPED
  - GALV. GALVANISED
  - MIN. MINIMUM
  - c/c CENTRE TO CENTRE
  - SQ. SQUARE
  - TYP. TYPICAL

ISSUE DATE	REVISION
12 SEPT 2019	DRIVEWAY AMENDED
16 SEPT 2019	RETAINING WALL EXTENT & REQUIRED DIMENSIONS
22 OCT 2019	BOUNDARY DESIGN AMENDMENTS
28 NOV 2019	OFFSET RETAINING WALL FROM SWEEP PATH
16 DEC 2019	OFFSET RETAINING WALL FROM BOUNDARY

TITLE	DRAWN	DATE	CHECKED	SCALE
STRUCTURAL DETAILS - ALTERATIONS AND ADDITIONS 31 BELLARA AVENUE, NORTH NARRABEEN	MDB	11 SEPTEMBER 2019	[Signature]	SCALE @ A1 1:200 1:20

**TAYLOR CONSULTING**  
CIVIL & STRUCTURAL ENGINEERS

**SHEET - 5/5**

- CONSTRUCTION NOTES**
- GENERAL**
- These drawings shall be read in conjunction with all architectural and other consultants drawings and specifications and with such other written instructions as may be issued during the course of the contract. All discrepancies shall be referred to the Supervising Officer for decision before proceeding with the work.
  - Dimensions shall not be obtained by scaling the structural drawings.
  - All dimensions shall be verified on site by the Contractor who shall be responsible for their correctness.
  - The contractor shall be responsible for maintaining the structure and neighbouring structures in a safe and stable condition during construction. No part shall be overstressed.
  - All workmanship and materials shall be in accordance with the requirements of the current SAA Codes and the By-Laws and Ordinances of the relevant Government Authority.

- FOUNDATIONS**
- Excavation shall be taken into FIRM NATURAL GROUND. The allowable bearing pressure on this material is assumed to be 150 kPa.
  - Foundation material shall be approved immediately before placing concrete.
  - Site Classification to AS 2870 is Class S Site.

- CONCRETE**
- All workmanship and materials shall be in accordance with AS 3600, current edition with amendments.
  - Concrete quality. All cement shall be Type A Normal Portland Cement.

Element	Slump mm	Max. Size Agg mm	f'c MPa	Special Requirements
FOOTINGS	100	20	25	-
SLAB ON GROUND	80	20	25	-

Strength shall be verified by plant control testing.

Clear concrete cover to reinforcement including ties and stirrups shall as follows unless shown otherwise:

Element	Exposure Classification		
	A1 Sheltered locations	B1 External locations over 1m from saltwater shoreline	B2 External locations over 1m from saltwater shoreline
Strip footings	-	50	50
Columns and piers	20	40	50
Beams	20	40	45
Slabs and walls	20	40	45

- Note that slabs placed over a membrane on ground are included as A1.
- Reinforcement symbols:**
- N denotes Grade 500 deformed normal ductility bar to AS 4671.
  - R denotes Grade 250 plain round normal ductility bar to AS 4671.
  - SL denotes Grade 500 low ductility square welded mesh to AS 4671.
  - RL denotes Grade 500 low ductility rectangular welded mesh to AS 4671.
  - denotes direction of main bars of rectangular fabric (main bars down for bottom reinforcement, main bars up for top reinforcement).
  - denotes square fabric.
  - denotes extent of reinforcement.
- All unsupported bars shall be tied in the transverse direction to N12-200 unless otherwise noted.
  - Reinforcement is shown diagrammatically and is not necessarily shown in the true projection.
  - Splices in the reinforcement shall be made only in the positions shown. The written approval of the Supervising Officer shall be obtained for any other splices. Where the lap length is not shown it shall be sufficient to develop the full strength of the reinforcement.
  - Welding of reinforcement will not be permitted unless shown on the structural drawings.
  - Fabric lap detail: Lap 2 wires.

- Slab reinforcement shall extend at least 65 onto masonry support walls unless shown otherwise.
- Concrete sizes shown are minimum and no reductions by ducts, pipes, etc. shall be made without the approval of the Supervising Officer. Sizes do not include thickness of applied finishes.
- Beam depths are written first and do not include slab thickness.
- Pipes or conduits shall not be placed within the concrete cover to reinforcement without the approval of the Supervising Officer.
- No holes or chases other than those shown on the structural drawings shall be made in concrete members without the prior approval of the Supervising Officer.
- Construction joints where not shown shall be located to the approval of the Supervising Officer.
- The contractor shall notify the Engineer 24 hours before pouring concrete.
- The concrete shall be compacted using high frequency vibrators.
- Columns, piers, and pedestals shall be placed 24 hours (min) before concrete in slabs or beams over.
- Curing of all concrete surfaces shall commence immediately after surfaces are finished as specified.

- BRICK AND CONCRETE BLOCK MASONRY**
- All workmanship and materials shall be in accordance with AS 3700.
  - Two layers of approved metal based slip joint material shall be laid under all slabs where they bear on brickwork.
  - Walls shown on structural drawings are load bearing walls. Non load bearing walls under slabs shall be separated from the concrete by a minimum of 10mm thick compressible material.
  - No brickwork which is supported by the slab shall be erected until formwork has been removed.
  - Brick mortar to be 1:1:6 proportions by volume of cement, lime and sand.
  - Brick strength of load bearing brickwork to be a minimum of f'uc = 14 MPa.

- REINFORCED CONCRETE BLOCK MASONRY**
- All concrete masonry units shall conform to the requirements of AS 2733.
  - The design strength of concrete masonry shall be:

Element	Strength Grade of Units (BLOCKS)	Mortar Mix Cement, Lime, Sand
RETAINING WALLS	15 MPa	1:0:1.3

- Workmanship involved in placing concrete units shall comply with AS 3700 and all units shall have fully bedded face shells and cross walls.
  - Clean out holes shall be provided at the base of all reinforced cores.
  - Unless noted otherwise the cores of all concrete masonry units shall be filled with concrete having a characteristic strength at 28 days (f'cd) of 20 MPa and a slump of 180mm to 230mm when being placed. The concrete filling shall be thoroughly compacted.
  - Max size of coarse aggregate in concrete used to fill cores shall be 10mm unless shown otherwise.
- STRUCTURAL STEELWORK**
- All workmanship and materials shall be in accordance with AS 4100 and AS 1554 except where varied by the contract documents.
  - Three (3) copies of all shop details shall be submitted to the engineer for approval of structural sufficiency before fabrication.
  - All welds shall be 6m continuous fillet, all bolts 20mm, all gusset plates 10mm thick, unless noted otherwise on the drawing.
  - Concrete encased steelwork shall be wrapped with 3mm wire at 100mm centres and shall have a minimum 50 cover of concrete.
  - Steel beams and trusses with span greater than 6m shall be fabricated with an upwards pre-camber of 1/500 span in each span unless noted otherwise on the drawings.
  - Structural steelwork is to be wire brushed to remove rust and loose mill scale and coated with one coat of approved primer unless noted otherwise on the drawings.
  - All steelwork cast into brickwork is to be hot dipped galvanised.
- TIMBER**
- Timber construction is to be in accordance with AS 1720 and the Timber Framing Code AS 1684.
  - Timber stress grade shall be F7 unless noted otherwise.