

PO Box 1020  
Penrith NSW 2751  
Tel: 02 4744 5800  
Mob: 0425 833 893  
[info@bfcs.com.au](mailto:info@bfcs.com.au)  
[www.bfcs.com.au](http://www.bfcs.com.au)  
ACN: 161 040 295



**BUSHFIRE**  
**CONSULTING**  
**SERVICES** PTY LTD

Designing Bushfire Protection Measures

Reference: J25/0427

Date of Issue: 21 July 2025

Latest Revision Date: 18 August 2025

# 2025

## Bush Fire Assessment Report

in relation to the proposed  
alterations and additions to the existing dwelling

at: 15 Rhonda Avenue Frenchs Forest  
Lot 11 DP 29893



(subject site)

## Contents

1. Introduction .....	9
2. Purpose of this Report .....	9
3. Location .....	10
4. Property Description.....	11
4.1 Zoning.....	11
4.2 Biodiversity Values .....	12
5. The Proposal.....	12
6. Site Assessment .....	13
7. Bush Fire Attack Assessment.....	13
7.1 Determine Vegetation Formations .....	13
7.2 The effective slope .....	15
7.3 Fire Weather .....	17
7.4 Determination of APZs .....	17
7.5 Identify Construction Requirements .....	18
7.6 Reduction in BAL due to Shielding .....	19
8. Bush Fire Protection Measures .....	21
8.1 Asset Protection Zones .....	21
8.2 Access.....	22
8.3 Water Supplies.....	22
8.4 Gas Services .....	23
8.5 Construction Standards .....	23
8.6 Landscaping .....	24
9. Likely Impact of any BPMs.....	24
10. Recommendations .....	25
11. Summary.....	26
12. References .....	28
13. Legislation.....	28

Appendix 1 – Proposed Ground Floor Plan.....	29
Appendix 2 – Photos of Site and Surrounds .....	30
Appendix 3 – Bushfire Risk Assessment Certificate .....	33
Appendix 4 – Method 2 Calculations .....	35
Appendix 5 - Modifications of section 7.5 of PBP .....	37

## Document Tracking

Item	Detail
Project Name	Bush Fire Assessment Report, proposed alterations and additions to the existing dwelling
Project Address	Lot 11 DP 29893 15 Rhonda Avenue Frenchs Forest
Client Name	Tom Clay
Project Number	J25/0427
Plan Reference	Plans by JJ Drafting Australia P/L, numbered 1311/24 revision E, dated 6/08/2025
Prepared by	Laura Richards
Approved by	Laura Richards and Catherine Gorrie
BAL under AS3959-2018	BAL 40 and BAL 29 and the relevant additional construction requirements of PBP section 7.5

### Bushfire Consulting Services Pty Ltd Contact Details

Catherine Gorrie	Managing Director
Office Number	02 4744 5800
Mobile Number	0425 833 893
Email	info@bfcs.com.au

## Document Control

Version	Primary Author	Description	Date Completed
1	Laura Richards	Final	21/07/2025
2	Catherine Gorrie	Final- Revised Plans	18/08/2025

## Copyright

*The information and intellectual property contained in this document is confidential and is proprietary to the company Bushfire Consulting Services Pty Ltd. It is intended for use only by the person, company or organisation to whom it is provided and only for the stated purpose for which it is provided. It must not be used for any other purpose or by any other individual or organisation without the written approval of the author.*

## Disclaimer

*Any recommendation or advice expressed in this report is made in good faith and in accordance with the relevant legislation for bushfire prone development in New South Wales. Bushfire Consulting Services Pty Ltd has endeavoured to ensure that the information in this document is correct. However, many factors outside our current knowledge or control affect the recipient's needs and project plans. Bushfire Consulting Services Pty Ltd does not warrant or represent that the document is free from error or omissions and does not accept liability for any errors or omissions. Changes to available information, legislation and schedules are made on an ongoing basis and readers should obtain up to date information. To the fullest extent possible Bushfire Consulting Services Pty Ltd excludes any express or implied warranty as to condition, fitness, merchantability or suitability of this document and limits its liability for direct or consequential loss at Bushfire Consulting Services Pty Ltd option to re-supplying the document or the cost of correcting the document. In no event shall Bushfire Consulting Services Pty Ltd responses to questions or any other information in this document be deemed to be incorporated into any legally binding agreement without the express written consent of an officer of Bushfire Consulting Services Pty Ltd.*

*It should be borne in mind that the measures recommended in this report cannot guarantee that a building will survive a bushfire event on every occasion. This is due to the degree of vegetation management, the unpredictable behaviour of bushfires and extreme weather conditions. As such, the author is not liable to any person for any damage or loss whatsoever which has occurred or may occur in relation to the person taking action or not taking action based on the recommendations of this report.*

**NOTE:** *This bush fire assessment shall remain valid for 12 months from the date of issue.*

## Executive Summary



Bushfire Consulting Services was commissioned by Tom Clay to provide a bush fire assessment for alterations and additions to the existing dwelling at Lot 11 DP 29893, 15 Rhonda Avenue Frenchs Forest. The subject site is mapped as designated bush fire prone land by Northern Beaches Council and is located within 100 metres of bush fire prone (hazardous) vegetation. The bush fire attack level (BAL) associated with the development of the subject building has been assessed as BAL 40 and BAL 29

The proposal is a form of infill development and, as such, this report makes recommendations in accordance with the aim, objectives, and performance criteria of Chapter 7 of the NSW RFS document '*Planning for Bush Fire Protection*' (PBP) (NSWRFS 2019). The recommendations address the required bush fire protection measures, including:

- establishment and maintenance of asset protection zones (APZs)
- siting and design of the development
- construction requirements under AS3959-2018 (Standards Australia 2018)
- adequate access for emergency personnel
- adequate water supply, and utility requirements to reduce the risk of ignition by electrical or gas supplies
- landscaping to reduce the risk of ignition by embers, and to minimise flame contact and radiant heat on the proposed development.

Where all recommendations are implemented, the report concludes that the proposal can comply with the aim, objectives and performance criteria of PBP.

## Compliance Summary

<p>This Assessment has been Certified by:</p> <p>Laura Richards</p> <p>BPAD-Level 2 Accredited Practitioner</p> <p>FPAA Cert No: BPAD48551</p>	
<p>This Assessment has been Certified by:</p> <p>Catherine Gorrie</p> <p>BPAD-Level 3 Accredited Practitioner</p> <p>FPAA Cert No: BPAD20751</p>	
<p>What is the recommended level of compliance with AS3959-2018?</p>	<p>BAL 40 and BAL 29</p>
<p>Can this proposal comply with AS 3959-2018?</p>	<p>Yes</p>
<p>Does this development comply with the aim and objectives of PBP?</p>	<p>Yes</p>
<p>Is referral to the NSW Rural Fire Service (RFS) required?</p>	<p>No</p>

## List of Abbreviations

APZ	Asset Protection Zone
AS3959	Australian Standard 3959 – 2018, <i>Construction of Buildings in Bushfire Prone Areas</i>
BAL	Bushfire Attack Level
BPAD	Bushfire Planning and Design (Accreditation Scheme)
BPMs	Bushfire Protection Measures
BPLM	Bushfire Prone Land Map
Council	Northern Beaches Council
DA	Development Application
DEM	Digital Elevation Model
EP&A Act	<i>Environmental Planning and Assessment Act – 1979</i>
FDI	Fire Danger Index
FPAA	Fire Protection Association of Australia
IPA	Inner Protection Area
kW/m <sup>2</sup>	Kilowatts per metre squared
LiDAR	Light Detection and Ranging
LPMA	Land & Property Management Authority
NCC	National Construction Code
OPA	Outer Protection Area
PBP	<i>Planning for Bush Fire Protection 2019</i>
RF Act	<i>Rural Fires Act – 1997</i>
RFS	NSW Rural Fire Service
SEPP	State Environmental Planning Policy
SIX	Spatial Information Exchange



## 1. Introduction

This report has been commissioned by Tom Clay to provide a bush fire assessment for alterations and additions to the existing dwelling at Lot 11 DP 29893, 15 Rhonda Avenue Frenchs Forest.

The subject property is “bushfire prone land” as per the local Council bushfire prone land map as defined by section 10.3 (s10.3) of the *Environmental Planning & Assessment Act (EP&A) 1979* and therefore the requirements stipulated by legislation apply to any new development on the site.

*Planning for Bush Fire Protection 2019* (Chapter 7) describes this type of development as “infill development” and therefore the requirements of section 4.14 (s4.14) of the *EP&A Act* are applicable.

The bush fire assessment and recommendations are derived from the *NSW EP&A Act*, the Rural Fire Service document *Planning for Bush Fire Protection 2019* and Australian Standard 3959-2018 ‘*Construction of Buildings in Bushfire Prone Areas*’.

## 2. Purpose of this Report


The purpose of this report is to provide the owners, the Consent Authority, the Certifier and the Rural Fire Service with a description of the proposed development as well as the vegetation type, slope and any other factors influencing the likely bushfire behaviour, sufficient to show that the development will be protected from the likely bushfire threat as outlined in current legislation.

This assessment includes an analysis of the hazard, threat and subsequent risk to the development and provides recommendations that satisfy the aim and objectives of *Planning for Bush Fire Protection*.

### 3. Location


The site is located and known as Lot 11 DP 29893, 15 Rhonda Avenue Frenchs Forest. The property is part of the Northern Beaches local government area.

**Figure 1. Location Map. Source: NSW SDT Explorer (NSW Government 2025a)**

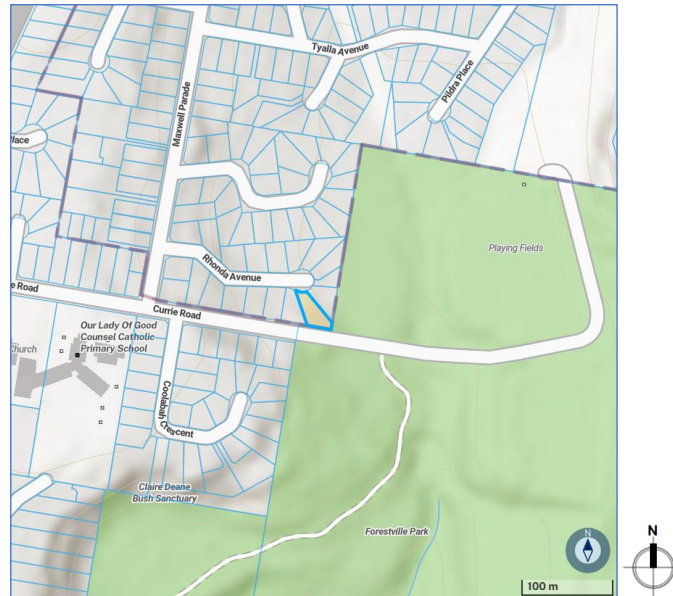


*Site location outlined in blue*

**Figure 2. Aerial Map. Source: NSW SDT Explorer (NSW Government 2025a)**

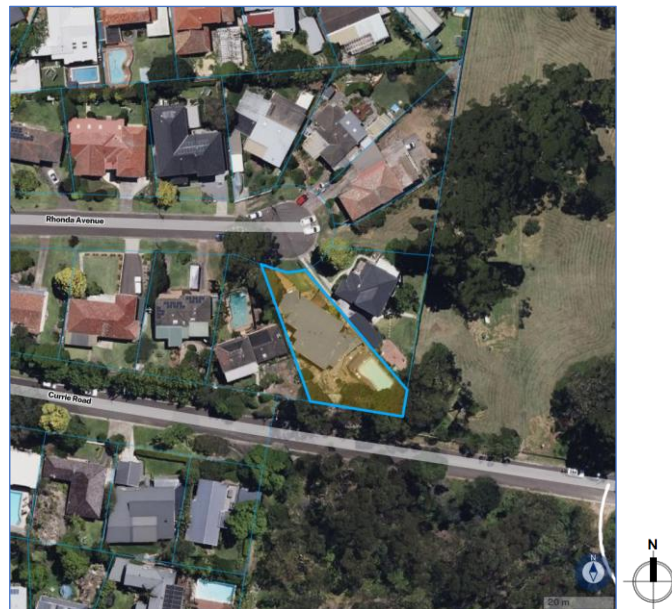

*Site location outlined in blue*

**Figure 3. Bushfire Prone Land Map. Source: NSW Government Planning Portal  
(NSW Government 2025b)**

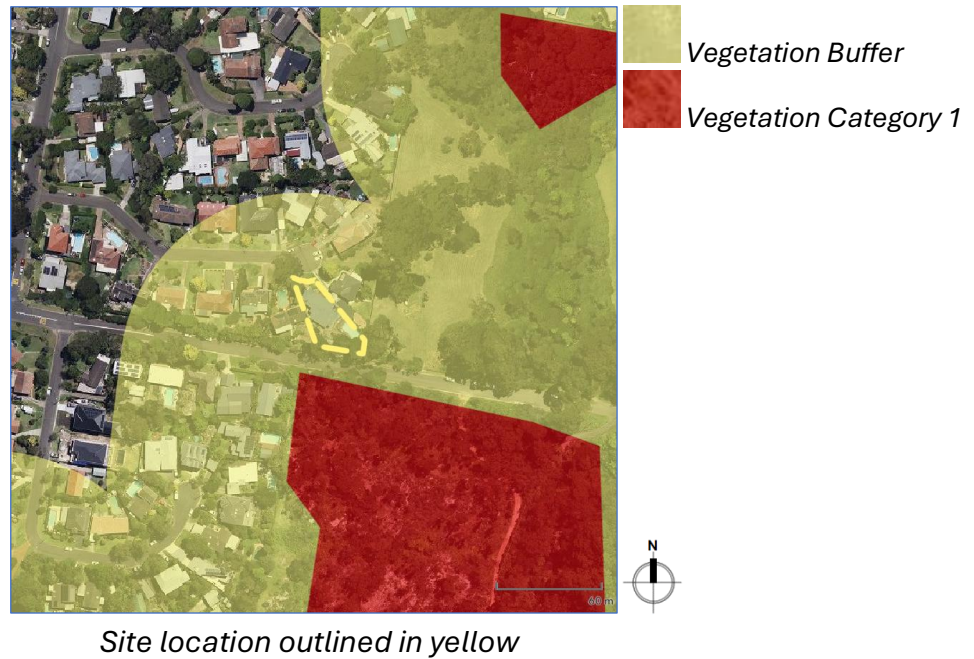

## 4. Property Description

The property is comprised of Lot 11 DP 29893, 15 Rhonda Avenue Frenchs Forest, covering approximately 803m<sup>2</sup> in area (Figure 2). It is bounded by Rhonda Avenue to the approximate north, private allotments to the approximate east and west and Currie Road to the approximate south. It currently contains a single occupancy development and a swimming pool, to be retained.

### 4.1 Zoning

The land is zoned R2 Low Density Residential under Warringah Local Environmental Plan 2011. Adjacent lands to the south are zoned RE1 Public Recreation (Figure 4).

**Figure 4. Zoning Map. Source: NSW Government Planning Viewer  
(NSW Government 2025b)**



*Site location outlined in yellow*

## 4.2 Biodiversity Values

A search of the NSW Office of Heritage and Environment and Heritage's Biodiversity Values Map (NSW Government 2025c) has been carried out and has not revealed any high biodiversity values on the land.

## 5. The Proposal

The proposal is for alterations and additions to the existing dwelling comprising of additions to the ground floor, first floor, addition of a garage in place of a carport, extended balcony, internal alterations, external stairs, a rainwater tank and landscaping. In terms of the NCC, the classification of the building is Class 1a, 10a and 10b.

## 6. Site Assessment

Bushfire Consulting Services Pty Ltd attended the site on 4 July 2025. The assessment relates to the new development shown in the site plans (reference Appendix 1 below). The NSW Spatial Services mapping website has also been used as a reference (NSW Government 2025a), and 'Ocean Shores to Desert Dunes' by David Keith (Keith 2004), in determining the vegetation type.

## 7. Bush Fire Attack Assessment

### 7.1 Determine Vegetation Formations

The hazardous vegetation formations for each aspect of the development within 140m of the asset have been identified according to Keith (2004). The bushfire threat emanates from bushland located to the east and south of the subject building. This vegetation is external to the subject site boundaries.


Apart from the hazard, within 140m of the site, lots contain existing residential developments with curtilages comprising lawns, shrubs and occasional trees, which do not constitute a hazard.

To the east is a dog park containing mown grass and occasional trees, managed by Northern Beaches Council, as shown in Figure 5, and has not been assessed as a hazard.

Based on a site visit and determination of vegetation formation using the Keith (2004) Identification Key, the primary bushland vegetation having the potential to affect the subject building is most representative of Forest in both directions.



**Figure 5. Hazardous vegetation affecting the subject building. Source: NearMap (2025) with overlays by BFCs P/L. Aerial Photography date: 28/05/2025**

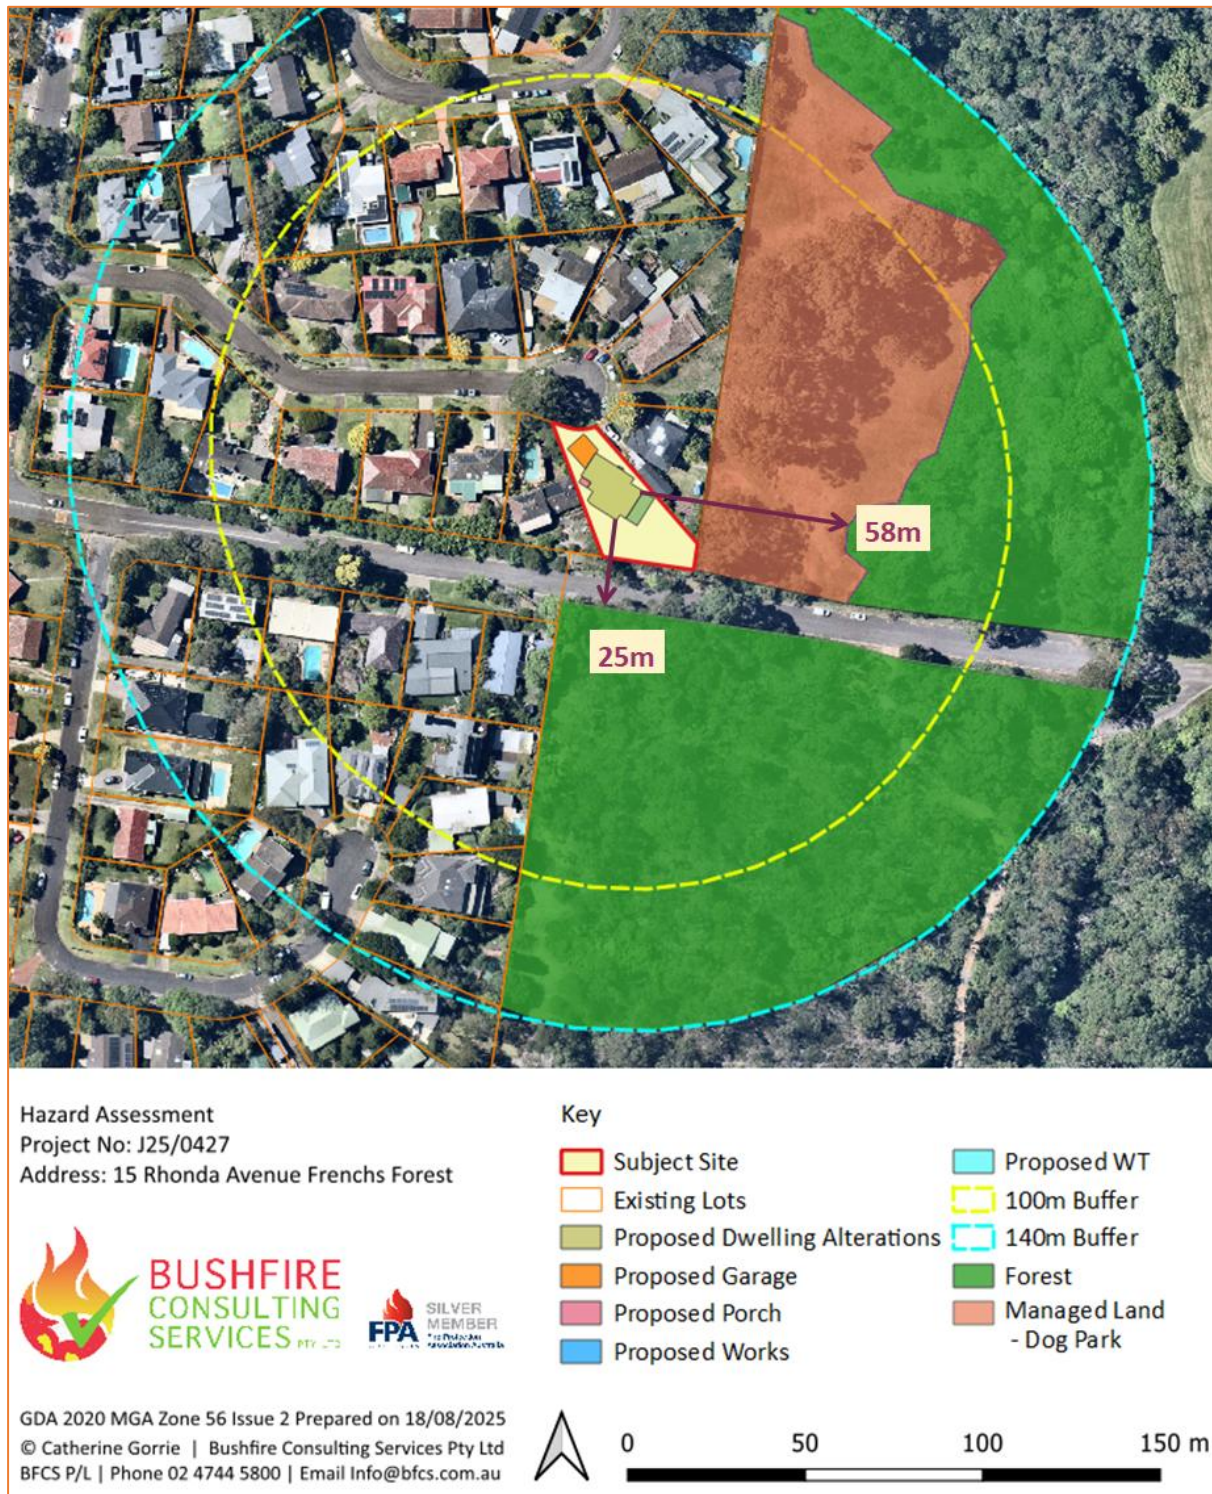

Subject site outlined in red. Vegetation was assessed to a distance of 140m from the subject building

## 7.2 The effective slope

The slope of the land under the classified vegetation has a direct influence on the rate of fire spread, the intensity of the fire and the level of radiant heat flux. The effective slope of the land from the new building for a distance of 100m is derived from a site assessment combined with the most detailed contour data available. The slope is then categorised into one of following classes, relative to the location of the hazard:

- all upslope vegetation (considered 0 degrees)
- >0 to 5 degrees downslope vegetation
- >5 degrees to 10 degrees downslope vegetation
- >10 degrees to 15 degrees downslope vegetation, and
- >15 degrees to 20 degrees downslope vegetation.

1m DEM data is sourced from NSW Spatial Services which is captured using LiDAR and has a horizontal accuracy of 0.3m and vertical accuracy of 0.8m at 95%.

The effective slope has been measured manually on site over a distance of 100m from the proposed development where accessible, under the classified vegetation community constituting the hazard. The slope was found to be consistent with the topographical information from NSW Spatial Services LiDAR data.

Direction from Building Footprint	Slope Under Hazard	Site Slope between development and hazard
North	N/A	N/A
East	Downslope >5 - 10° (9.6°)	Downslope >5-10° (8.7°)
South	Downslope >5 - 10°	Upslope 3.5°
West	N/A	N/A



Figure 6. Slope Diagram. Source: NearMap (2025) and LiDAR (NSW Government 2025a) with overlays by BFCS P/L: Aerial Photography Date: 28/05/2025



Site location outlined in red, 1m contours

East Slope is  $((93-86)/41.1) \times 1/\tan = \text{Downslope } 9.6^\circ$

South slope is  $((102-91)/72.8) \times 1/\tan = \text{Downslope } 8.5^\circ$



### 7.3 Fire Weather

The development is located in the Northern Beaches Council area, a part of the Greater Sydney Region, which has a <sup>1</sup>Fire Danger Index of 100.

### 7.4 Determination of APZs

An Asset Protection Zone (APZ) is a fuel-reduced area surrounding a built asset or structure. An APZ provides a buffer zone between a bush fire hazard and an asset and an area of reduced bush fire fuel that allows suppression of fire. It also provides an area from which backburning or hazard reduction can be conducted, and allows emergency services access as well as providing a relatively safe area for firefighters and home owners to defend their property.

Potential bush fire fuels should be minimised within an APZ. This is so that the vegetation within the planned zone does not provide a path for the transfer of fire to the asset either from the ground level or through the tree canopy. PBP has minimum specifications for APZs to be established around a dwelling to be managed as an Inner Protection Area (IPA).

An IPA should provide a tree canopy cover of less than 15% and have minimal fine fuel at ground level, the grass mowed on a frequent basis, trees and shrubs retained as clumps or islands and do not take up more than 20% of the area, trees and shrubs located far enough from buildings so that they will not ignite the building, garden beds with flammable shrubs not located under trees, and are to be separated from exposed windows and doors by a distance of at least twice the height of the vegetation. Minimise plant species that keep dead material or drop large quantities of ground fuel, tree canopies are not located within 2 metres of the building, trees separated by 2-5 metres and do not provide a continuous canopy from the hazard to the building, and lower limbs of trees removed up to a height of 2 metres above the ground.

---

<sup>1</sup> The Fire Danger Index (FDI) is a numerical rating that indicates the level of fire danger in a specific area. The FDI takes into account factors such as the chance of fire starting, its rate of spread, its intensity, and the difficulty potential for its suppression, according to various combinations of air temperature, relative humidity, wind speed and both the long and short-term drought effects

PBP requires APZs for new subdivisions to meet a radiant heat level of less than 29kW/m<sup>2</sup>. Ideally, all new development within NSW should meet this standard in order to reduce residual bushfire risk across the State. However, this is an existing residential lot and due to lot boundary and environmental constraints it is not possible to meet the 29kW/m<sup>2</sup> standard and therefore the aim is to achieve the greatest possible separation from the hazard, combined with commensurate construction requirements for the new works.

The minimum APZ is established to be 36m to the east and south, which cannot be attained within the site boundaries. Construction commensurate with the available APZ is proposed. The entire lot is to be managed as an IPA. If necessary, selective limb removal is to be carried out to ensure there is no vegetation touching or overhanging the building.

## 7.5 Identify Construction Requirements

The appropriate construction requirements for the development are determined by matching the relevant FFDI, vegetation type, the distance measured from the edge of the unmanaged vegetation to the closest external wall to identify the BAL using the Detailed Method of Determining the BAL of AS3959-2018 Construction of Buildings in Bushfire Prone Areas (Method 2). These construction requirements are located in section 3 of AS3959-2018. These requirements are varied by the applicable additional construction requirements of PBP section 7.5.

### AS3959 (Method 2) Determination of BAL, FFDI 100 – residential developments

Aspect	Distance from hazard	Vegetation Classification	Effective Slope Under Classified Vegetation	Bushfire Attack Level (BAL) required
North	>100m	N/A	N/A	*BAL 29
East	58m	Forest	Downslope 9.6°	BAL 40
South	25m	Forest	Downslope 8.5°	BAL 40
West	>100m	N/A	N/A	BAL 40

\* Due to shielding, see section 7.6 below

The assessment indicates that the subject building will experience radiant heat levels of  $<40\text{kW/m}^2$  as a result of foreseeable local bushfires under conditions of an FDI of 100. The expected radiant heat levels translate to a Bushfire Attack Level (BAL) on the building of BAL 40 and BAL 29. Construction of any new development to BAL 40 specifications is 'primarily concerned with protection from ember attack, radiant heat and direct flame contact up to  $40\text{kW/m}^2$ '.

## 7.6 Reduction in BAL due to Shielding

Where an elevation is shielded from direct radiant heat arising from bush fire attack, then the construction requirements for that elevation can be reduced to the next lower BAL. An elevation is considered to not be exposed to the source of bush fire attack if the line of sight between that elevation and the source of bush fire attack are obstructed by another part of the building.

The shielding of an elevation shall apply to all the elements of the wall but shall not apply to subfloors or roofs.

In this instance, the northern aspect of the dwelling will be fully shielded from exposure to the source of the greatest bushfire attack by the building itself. Therefore the BAL for the north facing elevation can be reduced by one level to BAL 29.

**Figure 8. Shielding Diagram for the Subject Building. Source: NearMap with overlays by BFCs P/L: Aerial Photography Date: 28/05/2025**



## 8. Bush Fire Protection Measures

The BPMs for residential infill development include provisions relating to APZs, access, water supply, electricity and gas services, construction standards, landscaping and emergency evacuation. In order to create appropriate separation between a dwelling and the bush fire hazard, APZs commensurate with those specified for new subdivision must be provided.

### 8.1 Asset Protection Zones

**PBP Table 7.4a Performance criteria and acceptable solutions for residential infill development**

Performance Criteria	Acceptable Solutions/Comment
APZs are provided commensurate with the construction of the building	The entire lot is to be managed as an IPA. If necessary, selective limb removal is to be carried out to ensure there is no vegetation touching or overhanging the building
A defensible space is provided	Achieved as adequate defensible space is available to the front of the subject building and pedestrian firefighter access is available to the rear
APZs are managed and maintained to prevent the spread of a fire to the building	Achieved as the APZs are to be managed in accordance with the requirements of Appendix 4 of PBP
The APZ is provided in perpetuity	Achieved as APZs requirements will be specified in the Development Consent conditions
APZ maintenance is practical, soil stability is not compromised and the potential for crown fires is minimised	Achieved as the APZ is located on lands with a slope less than 18 degrees

## 8.2 Access

Performance Criteria	Acceptable Solutions/Comment
Firefighting vehicles are provided with safe, all-weather access to structures and hazard vegetation	Achieved as property access roads are two-wheel drive, all-weather roads
The capacity of access roads is adequate for firefighting vehicles	Achieved as it is assumed that the capacity of road surfaces is sufficient to carry fully loaded firefighting vehicles (up to 23 tonnes)
There is appropriate access to water supply	Achieved as a hydrant is located approximately 10m from the lot to the north, assumed to be in accordance with the relevant clauses of AS 2419.1:2005
Firefighting vehicles can access the dwelling and exit the property safely	Achieved as the development is located within an urban area where an unobstructed path (no greater than 70m) is provided between the most distant external part of the proposed dwelling and the nearest part of the public access road (where the road speed limit is not greater than 70kph) that supports the operational use of emergency firefighting vehicles

## 8.3 Water Supplies

Performance Criteria	Acceptable Solutions/Comment
An adequate water supply is provided for fire-fighting purposes	Achieved as reticulated water is provided to the development
Water supplies are located at regular intervals	Achieved as a fire hydrant is located approximately 8m to the northeast of the lot assumed to comply with the relevant clauses of AS 2419.1:2021
The integrity of the water supply is maintained	Achieved as any new above-ground water service pipes external to the building are to be metal, including and up to any taps



## 8.4 Gas Services

Performance Criteria	Acceptable Solutions/Comment
Location and design of gas services will not lead to ignition of surrounding bushland or the fabric of buildings	<p>Where applicable, reticulated or bottled gas is installed and maintained in accordance with AS/NZS 1596:2014 and the requirements of relevant authorities, and metal piping is used</p> <p>All fixed gas cylinders are kept clear of all flammable materials to a distance of 10m and shielded on the hazard side, connections to and from gas cylinders are metal</p> <p>Polymer-sheathed flexible gas supply lines are not used, and above-ground gas service pipes are metal, including and up to any outlets</p>

## 8.5 Construction Standards

Performance Criteria	Acceptable Solutions/Comment
The proposed building can withstand bush fire attack in the form of embers, radiant heat and flame contact	<p>BAL 40 and 29 has been determined in accordance with PBP Table A1.12.5</p> <p>The additional construction requirements of section 7.5 of PBP are to be incorporated into the development and are provided as an Appendix</p>
Proposed fences and gates are designed to minimise the spread of bush fire	Any new fences and gates are to be constructed from non-combustible material only
Proposed Class 10a buildings are designed to minimise the spread of bush fire	There are no bush fire protection requirements for Class 10a buildings located more than 6m from a dwelling in bush fire prone areas. Where a Class 10a building is located within 6m of a dwelling it must be constructed in accordance with the NCC

## 8.6 Landscaping

Performance Criteria	Acceptable Solutions/Comment
Landscaping is designed and managed to minimise flame contact and radiant heat to buildings, and the potential for wind-driven embers to cause ignitions	<p>Achieved as any landscaping within the APZ is to comply with the NSW RFS 'Asset protection zone standards' (PBP Appendix 4)</p> <p>A clear area of low-cut lawn or pavement is maintained adjacent to the house, and</p> <p>Trees and shrubs are located so that:</p> <ul style="list-style-type: none"><li>▪ The branches will not overhang the roof;</li><li>▪ The tree canopy is not continuous; and</li><li>▪ Any proposed windbreak is located on the elevation from which fires are likely to approach</li></ul>

## 9. Likely Impact of any BPMs

The proposed bushfire protection measures will not adversely impact on the environment. It should be noted that this report has not focused on environmental issues and as the land is a fully developed residential site, such features are unlikely to exist on the site.



## 10. Recommendations

The following recommendations are made for the bushfire measures for the proposed residential development of alterations and additions to the existing dwelling at Lot 11 DP 29893, 15 Rhonda Avenue Frenchs Forest, and are based upon the relevant provisions of the NSW Rural Fire Service Guideline entitled *Planning for Bush Fire Protection 2019*.

### 1. Asset Protection Zones

At the commencement of the development, and in perpetuity, the entire site shall be managed as an Inner Protection Area (IPA) Asset Protection Zone, as outlined in PBP 2019 Appendix 4.

#### Trees

- canopy cover should be less than 15% (at maturity)
- trees (at maturity) should not touch or overhang the building
- lower limbs should be removed up to a height of 2m above ground
- canopies should be separated by 2 to 5m
- preference should be given to smooth barked and evergreen trees

#### Shrubs

- create large discontinuities or gaps in the vegetation to slow down or break the progress of fire towards buildings
- shrubs should not be located under trees
- shrubs should not form more than 10% ground cover
- clumps of shrubs should be separated from exposed windows and doors by a distance of at least twice the height of the vegetation

#### Grass

- should be kept mown (as a guide grass should be kept to no more than 100mm in height)
- leaves and vegetation debris should be removed.

### 2. Construction Standards

New construction shall comply with Sections 3 and 8 (BAL 40) to the southeast and southwest and Sections 3 and 7 (BAL 29) to the northeast and northwest of AS3959-2018 '*Construction of buildings in bush fire-prone areas*', as varied by the applicable additional

construction requirements of PBP section 7.5 (shown as Appendix 4 below). The concept of Shielding as described in s3.5 of AS3959-2018 cannot be applied.

### 3. Gas Services

Where applicable, reticulated or bottled gas is installed and maintained in accordance with AS/NZS 1596:2014 *The storage and handling of LP Gas* and the requirements of relevant authorities, and metal piping is used.

All fixed gas cylinders are kept clear of all flammable materials to a distance of 10m and shielded on the hazard side, connections to and from gas cylinders are metal.

Polymer-sheathed flexible gas supply lines are not used, and above-ground gas service pipes are metal, including and up to any outlets.

### 4. Fences and gates

All new fences and gates are to be constructed from non-combustible material only.

### 5. Landscaping

Any new landscaping within the APZ is to comply with the NSW RFS '*Asset protection zone standards*' (PBP Appendix 4).

### 6. Emergency and Evacuation Planning

The need to formulate an emergency evacuation plan is suggested. To do so, occupants can complete a Bush Fire Safety Plan on the NSW RFS Website <http://www.rfs.nsw.gov.au/> under publications / bushfire safety.

## 11. Summary

This report consists of a bush fire assessment for the proposed residential development of alterations and additions to the existing dwelling at Lot 11 DP 29893, 15 Rhonda Avenue Frenchs Forest. The report concludes that the proposed development is on designated bushfire prone land and the legislative requirements for development in bushfire prone areas are applicable.

This report has considered all the elements of bushfire attack and finds that the development has a Bushfire Attack Level of BAL 40 and BAL 29. The development

satisfies the Objectives and Performance requirements of 'Planning for Bush Fire Protection' 2019, subject to implementation of the recommendations made by this report.

*Notwithstanding the precautions adopted, it should always be remembered that bushfires burn under a wide range of conditions and an element of risk, no matter how small, always remains and although the standard is designed to improve the performance of such buildings, there can be no guarantee because of the variable nature of bushfires that any one building will withstand bushfire attack on every occasion.*

*This report is a bush fire assessment that provides the required information to assist local Council in determining compliance in accordance with Planning for Bush Fire Protection and AS3959-2018. The local Council is the final consenting authority and the construction of the building must comply with the recommendations included in the Council's conditions of consent.*



**Laura Richards | Accredited Bushfire Planning and Design Practitioner**

Fire Protection Association Australia BPAD-Level 2 (BPAD 48551)

*(a person who is recognised by the NSW Rural Fire Service as a suitably qualified consultant in bush fire risk assessment)*

Corporate Silver Member Fire Protection Association Australia

Grad Cert Bushfire Protection (UWS 2018)

Grad Dip Bushfire Protection (UWS 2023)

**Bushfire Consulting Services Pty Ltd**

Tel: 02 4744 5800 | Mob: 0425 833 893



**Catherine Gorrie | Accredited Bushfire Planning and Design Practitioner**

Fire Protection Association Australia BPAD-Level 3 (BPAD 20751)

*(a person who is recognised by the NSW Rural Fire Service as a suitably qualified consultant in bush fire risk assessment)*

Grad Dip Bushfire Protection (UWS 2010)

Diploma Environmental Health & Building Surveying (TAFE 2005)

Corporate Silver Member Fire Protection Association Australia

**Bushfire Consulting Services Pty Ltd**

**Tel: 02 4744 5800 | Mob: 0425 833 893**

## 12. References

Keith D 2004, *Ocean Shores to Desert Dunes, the Native Vegetation of NSW and the ACT*, Department of Environment and Conservation, Sydney

NearMap 2025, *NearMap Photomap Aerial Imagery*, NearMap Australia, Barrangaroo, NSW

NSW Government 2025a, *NSW Spatial Services*, NSW Department of Finance, Services and Innovation.

NSW Government 2025b, *NSW Planning Portal*, NSW Department of Planning and Environment.

NSW Government 2025c, *Biodiversity Values Map*, NSW Department of Environment and Heritage.

NSW RFS 2019, *Planning for Bush Fire Protection*, NSW Rural Fire Service, Sydney.

Standards Australia 2018, *Australian Standard AS 3959-2018 'Construction of Buildings in Bushfire Prone Areas'*, SAI Global, Australia.

## 13. Legislation

*Environmental Planning & Assessment Act 1979*

*Rural Fires Act 1997*

*Rural Fires Regulation 2022*

*Bushfire Consulting Services Pty Ltd Report No. J25/0427*



## Appendix 2 – Photos of Site and Surrounds

Source: BFCS P/L 4/07/2025



*Subject site*



*Dog park to the east of the subject site*



*Dog park to the east of the subject site*



*Dog park to the east of the subject site*



*Vegetation to the east, approximately 58m from the proposal*



*Vegetation to the east, approximately 58m from the proposal*





*Vegetation to the south, approximately 25m from the proposal*



*Vegetation to the south, approximately 25m from the proposal*



*Vegetation to the south, approximately 25m from the proposal*



## Appendix 3 – Bushfire Risk Assessment Certificate

This form is completed by a recognized consultant in bushfire risk assessment in accordance with section s4.14 of the *Environmental Planning and Assessment Act 1979 No 203*

PROPERTY ADDRESS:	Lot 11 DP 29893 15 Rhonda Avenue Frenchs Forest
DESCRIPTION OF PROPOSAL:	Alterations and additions to the existing dwelling
PLAN REFERENCE: (relied upon in report preparation)	Plans by JJ Drafting Australia P/L, numbered 1311/24 revision E, dated 6/08/2025
BAL RATING	BAL 40 and BAL 29 (If the BAL rating is FZ the application is to be referred to NSW RFS for assessment)
DOES THE PROPOSAL RELY ON ALTERNATE SOLUTIONS:	YES <b>NO</b> (Circle the relevant response) (If YES the application is to be referred to NSW RFS for assessment)

I, Laura Richards, of Bushfire Consulting Services Pty Ltd, have carried out a bushfire risk assessment on the above mentioned proposal and property. A detailed Bushfire Assessment Report is attached which includes the submission requirements set out in Appendix 2 of *Planning for Bushfire Protection 2019* together with recommendations as to how the relevant specifications and requirements are to be achieved.

REPORT REFERENCE:	J25/0427
REPORT DATE:	21/07/2025
CERTIFICATION NO/ACCREDITED SCHEME:	BPAD-Level 2 Accredited Practitioner FPAA Cert No: BPAD48551

Note: this certificate must be completed and signed by a person recognised by the NSW Rural Fire Service as a qualified consultant in bush fire risk assessment in accordance with s4.14 of the *EP&A Act 1979 No 203*.

\*\*\*\*\*

I hereby certify, in accordance with Section 4.14 of the Environmental Planning and Assessment Act 1979 No 203:

That I am a person recognised by the NSW Rural Fire Service as a qualified consultant in bushfire risk assessment; and

That subject to the recommendations contained in the attached Bushfire Risk Assessment Report the proposed development conforms to the relevant specifications and requirements\*.

\* The relevant specifications and requirements being; specifications and requirements of the document entitled Planning for Bush Fire Protection prepared by the NSW Rural Fire Service in co-operation with the Department of Planning and any other document as prescribed by Section s4.14 of the *Environmental Planning and Assessment Act 1979 No 203*.

I am aware that the bush fire assessment report, prepared for the above mentioned site is to be submitted in support of a development application for this site and will be relied upon by Council as the basis for ensuring that the bushfire risk management aspects of the proposed development have been addressed in accordance with *Planning for Bush Fire Protection 2019*.

Attachments:

- ☒ Bush Fire Risk Assessment Certificate
- ☒ Recommendations
- ☒ Statement of vegetation impact in relation to APZ



SIGNATURE:

DATE: 21/07/2025

## Appendix 4 – Method 2 Calculations



### NBC Bushfire Attack Assessment Report V4.1

AS3959 (2018) Appendix B - Detailed Method 2

Print Date: 11/07/2025

Assessment Date: 11/07/2025

Site Street Address: 15 Rhonda Avenue, Frenchs Forest

Assessor: Catherine Gorrie; Bushfire Consulting Services Pty Ltd

Local Government Area: Northern Beaches

Alpine Area: No

#### Equations Used

Transmissivity: Fuss and Hammins, 2002

Flame Length: RFS PBP, 2001/Vesta/Catchpole

Rate of Fire Spread: Noble et al., 1980

Radiant Heat: Drysdale, 1985; Sullivan et al., 2003; Tan et al., 2005

Peak Elevation of Receiver: Tan et al., 2005

Peak Flame Angle: Tan et al., 2005

Run Description: East

#### Vegetation Information

Vegetation Type: Sydney Coastal DSF

Vegetation Group: Dry Sclerophyll Forests (Shrubby)

Vegetation Slope: 9.6 Degrees

Vegetation Slope Type: Downslope

Surface Fuel Load(t/ha): 21.3

Overall Fuel Load(t/ha): 27.3

Vegetation Height(m): 1.4

Only Applicable to Shrub/Scrub and Vesta

#### Site Information

Site Slope: 8.7 Degrees

Site Slope Type: Downslope

Elevation of Receiver(m): Default

APZ/Separation(m): 54.5

#### Fire Inputs

Veg./Flame Width(m): 100

Flame Temp(K): 1090

#### Calculation Parameters

Flame Emissivity: 95

Relative Humidity(%): 25

Heat of Combustion(kJ/kg): 18600

Ambient Temp(K): 308

Moisture Factor: 5

FDI: 100

#### Program Outputs

Level of Construction: BAL 19

Peak Elevation of Receiver(m): 8.61

Radiant Heat(kW/m2): 14.9

Flame Angle (degrees): 73

Flame Length(m): 35.5

Maximum View Factor: 0.255

Rate Of Spread (km/h): 4.96

Inner Protection Area(m): 34

Transmissivity: 0.769

Outer Protection Area(m): 21

Fire Intensity(kW/m): 69921

#### BAL Thresholds

BAL-40: BAL-29: BAL-19: BAL-12.5: 10 kw/m2: Elevation of Receiver:

Asset Protection Zone(m): 26 34 45 61 88 6

<b>Run Description:</b>	South				
<b><u>Vegetation Information</u></b>					
<b>Vegetation Type:</b>	Sydney Coastal DSF				
<b>Vegetation Group:</b>	Dry Sclerophyll Forests (Shrubby)				
<b>Vegetation Slope:</b>	8.5 Degrees	<b>Vegetation Slope Type:</b>		Downslope	
<b>Surface Fuel Load(t/ha):</b>	21.3	<b>Overall Fuel Load(t/ha):</b>		27.3	
<b>Vegetation Height(m):</b>	1.4	Only Applicable to Shrub/Scrub and Vesta			
<b><u>Site Information</u></b>					
<b>Site Slope</b>	3.5 Degrees	<b>Site Slope Type:</b>		Upslope	
<b>Elevation of Receiver(m)</b>	Default	<b>APZ/Separation(m):</b>		22	
<b><u>Fire Inputs</u></b>					
<b>Veg./Flame Width(m):</b>	100	<b>Flame Temp(K):</b>		1090	
<b><u>Calculation Parameters</u></b>					
<b>Flame Emissivity:</b>	95	<b>Relative Humidity(%):</b>		25	
<b>Heat of Combustion(kJ/kg)</b>	18600	<b>Ambient Temp(K):</b>		308	
<b>Moisture Factor:</b>	5	<b>FDI:</b>		100	
<b><u>Program Outputs</u></b>					
<b>Level of Construction:</b>	BAL FZ	<b>Peak Elevation of Receiver(m):</b>		11.43	
<b>Radiant Heat(kW/m2):</b>	51.05	<b>Flame Angle (degrees):</b>		38	
<b>Flame Length(m):</b>	33.14	<b>Maximum View Factor:</b>		0.773	
<b>Rate Of Spread (km/h):</b>	4.59	<b>Inner Protection Area(m):</b>		22	
<b>Transmissivity:</b>	0.868	<b>Outer Protection Area(m):</b>		0	
<b>Fire Intensity(kW/m):</b>	64811				
<b><u>BAL Thresholds</u></b>					
<b>BAL-40: BAL-29: BAL-19: BAL-12.5: 10 kw/m2: Elevation of Receiver:</b>					
<b>Asset Protection Zone(m):</b>	25	32	44	59	84
					6

## Appendix 5 - Modifications of section 7.5 of PBP

### 7.5 Additional construction requirements

To ensure the performance criteria for construction standards given in section 7.4 can be met, PBP adopts additional measures over and above AS 3959 and NASH Standard as follows:

- construction measures for ember protection at BAL-12.5 and BAL-19 provided by AS 3959
- construction measures for development in BAL-FZ; and
- requirements over and above the performance criteria contained within AS 1530.8.1 and AS 1530.8.2 apply in regards to flaming.

#### 7.5.1 Ember protection

Based on the findings from the 2009 Victorian Bush Fires Royal Commission, PBP aims to maintain the safety levels previously provided by AS 3959:1999 in relation to ember protection at lower Bush Fire Attack Levels.

In particular, the areas addressed are in relation to:

- sarking;
- subfloor screening;
- floors;
- verandas, decks, steps, ramps and landings;
- timber support posts and beams; and
- fascias and bargeboards.

#### 7.5.2 NSW State Variations under G5.2(a) (i) and 3.10.5.0(c)(i) of the NCC

Certain provisions of AS 3959 are varied in NSW based on the findings of the Victorian Bush Fires Royal Commission and bush fire industry research.

The following variations to AS 3959 apply in NSW for the purposes of NSW G5.2(a)(i) of Volume One and NSW 3.10.5.0(c)(i) of Volume Two of the NCC;

- clause 3.10 of AS 3959 is deleted and any sarking used for BAL-12.5, BAL-19, BAL-29 or BAL-40 shall:
  - be non-combustible; or

- comply with AS/NZS 4200.1, be installed on the outside of the frame and have a flammability index of not more than 5 as determined by AS 1530.2; and
- clause 5.2 and 6.2 of AS 3959 is replaced by clause 7.2 of AS 3959, except that any wall enclosing the subfloor space need only comply with the wall requirements for the respective BAL; and
- clause 5.7 and 6.7 of AS 3959 is replaced by clause 7.7 of AS 3959, except that any wall enclosing the subfloor space need only comply with the wall requirements for the respective BAL; and
  - fascias and bargeboards, in BAL-40, shall comply with:
  - clause 8.4.1(b) of AS 3959; or
  - clause 8.6.6 of AS 3959.