


NOTE:
AS PER GEOTECHNICAL ADVICE,
ALL CLAYEY SOIL MUST BE
REMOVED FROM BELOW BEARING
SURFACE. WHERE CLAYEY SOIL IS
REMOVED, REPLACE WITH MASS
FILL CONCRETE, OR COMPACTED
CRUSHED SANDSTONE GRADED TO
DGB20 OVER CLASS V FOUNDING
LAYER.


## N12-200 CLOSED TIES 4N16 EACH FACE

PIPE SUPPORT COLUMN TYPICAL ELEVATION SHORT SIDE



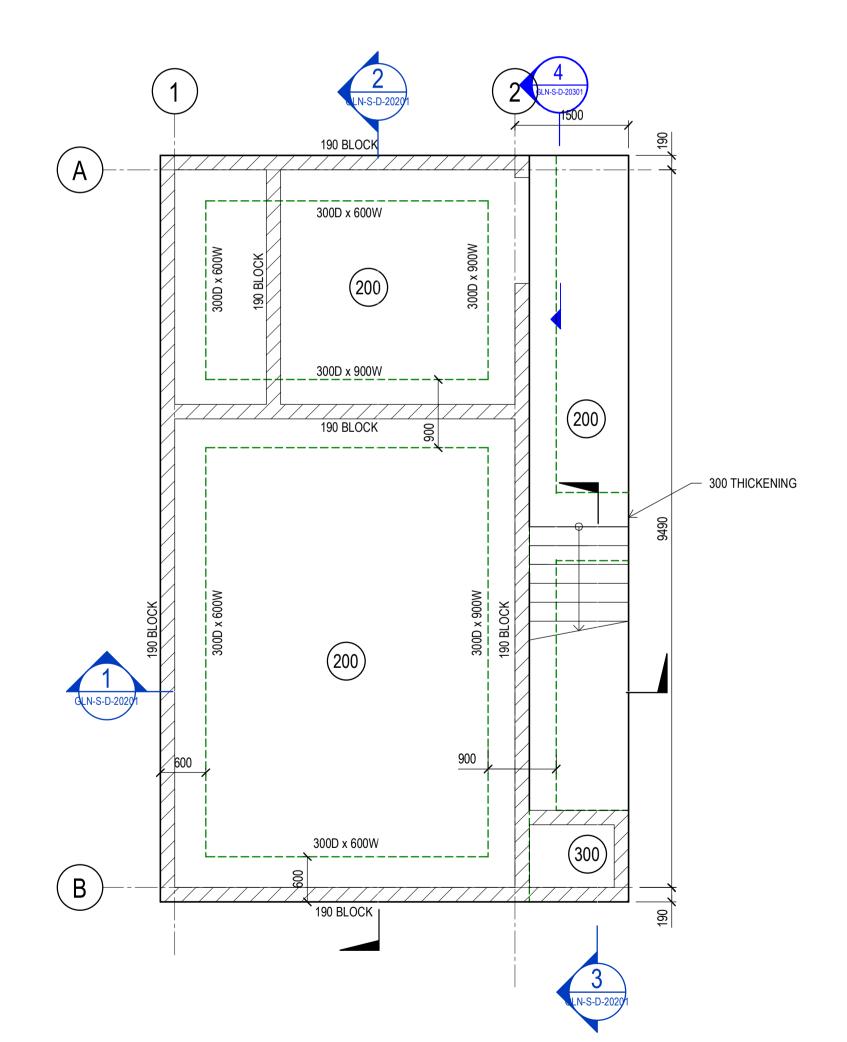


TANK SLAB GENERAL ARRANGEMENT
SCALE 1:50

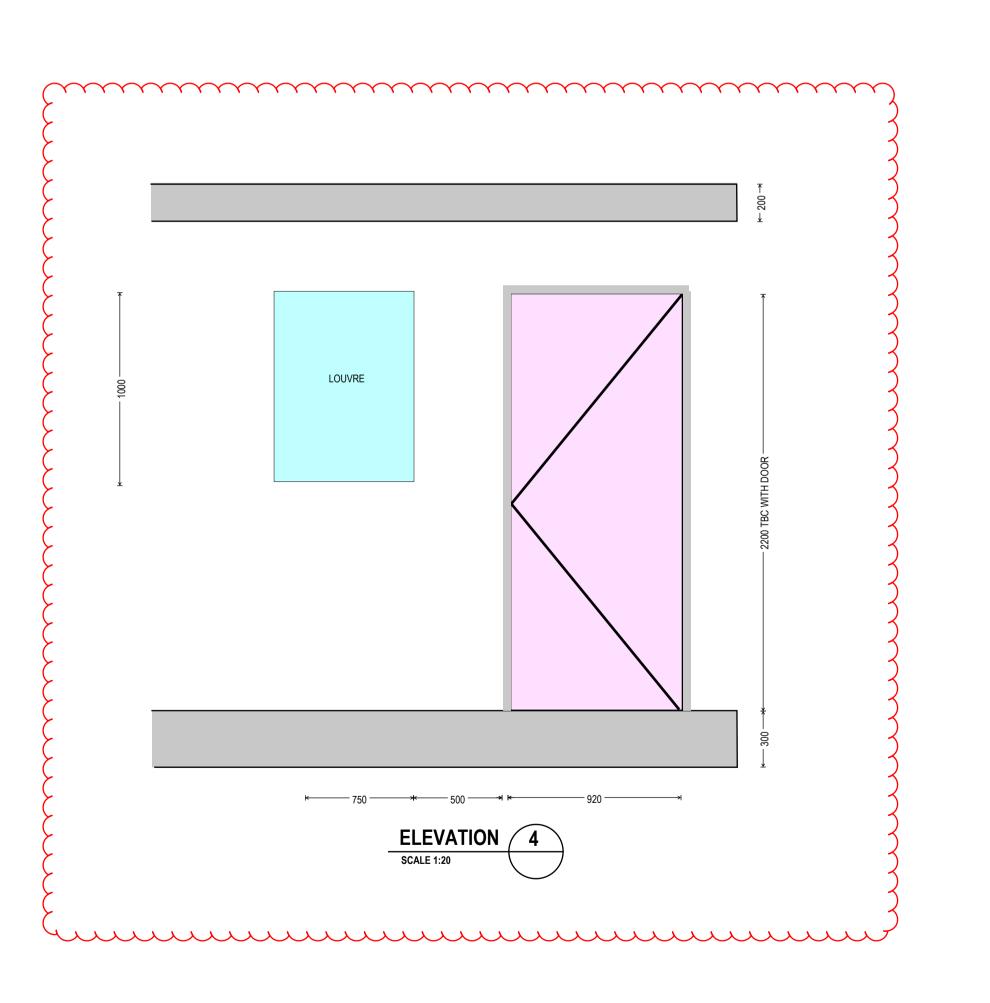

THESE DESIGNS, DRAWINGS AND SPECIFICATIONS ARE COPYRIGHT AND THE PROPERTY OF SCP CONSULTING AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY OR IN PART WITHOUT THE WRITTEN PERMISSION OF SCP CONSULTING ALL SETOUT TO BE OBTAINED FROM THE ARCHITECTURAL DRAWINGS UNLESS OTHERWISE SHOWN ON THESE DRAWINGS. DO NOT USE CAD/ELECTRONIC FILES FOR SETOUT UNDER ANY CIRCUMSTANCES.



Key Plan



С	TENDER ADDENDUM	12.05.22
В	TENDER ADDENDUM	13.04.22
Α	TENDER ISSUE	14.03.22
Rev	Revision Description	Date

© SCP ENG (727 364) www.scpconsult.com.au ABN 80 003 076 024

LENDLEASE

GLENAEON RETIREMENT LIVING - SPS UPGRADE PROJECT

DETAILS SHEET 1

